



2150 Smithtown Ave., Suite 3, Ronkonkoma, NY 11779  
T: 631.580.3191 • F: 631.580.3195 • W: [envirohealth.org](http://envirohealth.org)

## **Notice to Parents, Guardians, and Staff William Floyd School District Lead in School Drinking Water Program 2023 – 2025**

The William Floyd School District would like to inform all parents, staff, and community members that we have a complete and updated Lead in Water Program for the 2023 to 2025 testing period for lead in water. Our goal is to provide safe drinking water sources throughout all its facilities. If lead is found at any water outlet at levels above 5 parts per billion (ppb), which is equal to 5 micrograms per liter ( $\mu\text{g/L}$ ), the NYSDOH requires that the school take action to reduce the exposure to lead.

### **What is first draw testing of school drinking water for lead?**

Lead is a heavy metal that usually enters water through distribution systems, including pipes, solder, fixtures, and valves. When ingested, it can interfere with brain development and lead to other health problems, especially in young children. Lead levels may increase when water sits undisturbed in the system. The “on-again, off-again” nature of water use at most schools can raise lead levels in school drinking water. Water that remains in pipes overnight, over a weekend, or over vacation periods stays in contact with lead pipes or lead solder and, as a result, could contain higher levels of lead. This is why schools are required to collect a sample after the water has been sitting in the plumbing system for a certain period of time. This “first draw” sample is likely to show higher levels of lead for that outlet than what you would see if you sampled after using the water continuously. However, even if the first draw sample does not reflect what you would see with continuous usage, it is still important because it can identify outlets that have elevated lead levels.

The William Floyd School District has developed their 2023-2025 Lead in Drinking Water Sampling and Remediation Plan, as required by the New York State Department of Health (Public Health Law Sections 1370-a and 1110, Subpart 67-4 Lead Testing in School Drinking Water).

Outlets that tested with lead levels above the action level (5 ppb) were removed from service, unless an outlet is a sink faucet needed for handwashing. In that case, a sign was posted at the outlet indicating that the sink is not to be used for drinking. Outlets that tested below the action level remain in service with no restrictions.

## **What are the health effects of lead?**

Lead is a metal that can harm children and adults when it gets into their bodies. Lead is a known neurotoxin, particularly harmful to the developing brain and nervous system of children under 6 years old. Lead can harm a young child's growth, behavior, and ability to learn. Lead exposure during pregnancy may contribute to low birth weight and developmental delays in infants. There are many sources of lead exposure in the environment, and it is important to reduce all lead exposures as much as possible. Water testing helps identify and correct possible sources of lead that contribute to exposure from drinking water.

## **What are the other sources of lead exposure?**

Lead is a metal that has been used for centuries for many purposes, resulting in widespread distribution in the environment. Major sources of lead exposure include lead-based paint in older housing, and lead that built up over decades in soil and dust due to historical use of lead in gasoline, paint, and manufacturing. Lead can also be found in a number of consumer products, including certain types of pottery, pewter, brass fixtures, foods, plumbing materials, and cosmetics. Lead seldom occurs naturally in water supplies but drinking water could become a possible source of lead exposure if the building's plumbing contains lead. The primary source of lead exposure for most children with elevated blood-lead levels is lead-based paint.

## **Should your child be tested for lead?**

The risk to an individual child from past exposure to elevated lead in drinking water depends on many factors; for example, a child's age, weight, amount of water consumed, and the amount of lead in the water. Children may also be exposed to other significant sources of lead including paint, soil and dust. Since blood lead testing is the only way to determine a child's blood lead level, parents should discuss their child's health history with their child's physician to determine if blood lead testing is appropriate. Pregnant women or women of childbearing age should also consider discussing this matter with their physician.

**For information about lead in school drinking water, go to:**

- [http://www.health.ny.gov/environmental/water/drinking/lead/lead\\_testing\\_of\\_school\\_drinking\\_water.htm](http://www.health.ny.gov/environmental/water/drinking/lead/lead_testing_of_school_drinking_water.htm)
- <https://regs.health.ny.gov/volume-1a-title-10/1942050456/subpart-67-4-lead-testing-school-drinking-water>

**For information about NYS Department of Health Lead Poisoning Prevention, go to:**

- <http://www.health.ny.gov/environmental/lead/>

**For more information on blood lead testing and ways to reduce your child's risk of exposure to lead, see "What Your Child's Blood Lead Test Means":**

- <http://www.health.ny.gov/publications/2526/>  
(available in ten languages).

Sample Location	Fixture Type	App or N/A	Prior 1 <sup>st</sup> Draw Results (ppb)	Prior 1 <sup>st</sup> Draw Sampling Date	Re-Test 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
<b>Hobart Elementary School</b>									
Kitchen Serving Line	SK	App	68.0	10/4/2024					Signed - Hand Wash Only
Kitchen Pot Filler	PF	App	45.0	10/4/2024	33.0	3.0	1.0	2/26/2025	Removed from service; Pending remediation
Kitchen 3-Bay @A	SK	App	6.0	10/4/2024	1.0			2/26/2025	
Teacher's Lounge	SPY	App	6.0	10/4/2024					Permanently Removed
Room 188	WF	App	16.0	10/4/2024					Permanently Removed
Room 186	WF	App	11.0	10/4/2024					Permanently Removed
<b>Moriches Elementary School</b>									
Kitchen Pot Filler	SP	App	9.0	10/4/2024	4.0			2/26/2025	
Kitchen Island by Meat Slicer	SK	App	6.0	10/4/2024	4.0			2/26/2025	
Kitchen West Serving Line Counter Left - Prep	SK	App	7.0	10/4/2024	<1.0			2/26/2025	
Main Office	WF	App	105.0	10/4/2024					Permanently Removed
Pod 1 Hallway by Room 1	WF	App	16.0	10/4/2024					Permanently Removed
Room 54	WF	App	11.0	10/4/2024					Permanently Removed
Room 53	WF	App	8.0	10/4/2024					Permanently Removed
<b>Nathaniel Woodhull Elementary School</b>									
Room 125 PTO Room	WF	App	12.0	10/4/2024	9.0			2/26/2025	Removed from service; Pending remediation
<b>Tangier Smith Elementary School</b>									
Kitchen Pot Filler	PF	App	7.0	10/4/2024	8.0	<1.0	<1.0	2/26/2025	Removed from service; Pending remediation
Kitchen Food Prep	SK	App	7.0	10/4/2024	4.0			2/26/2025	
Serving Area North Prep Sink	SK	App	7.0	10/4/2024	2.0			2/26/2025	
Room B	WF	App	71.0	10/4/2024					Permanently Removed
Room C	WF	App	17.0	10/4/2024					Permanently Removed
<b>William Floyd Elementary School</b>									
Room 186	WF	App	15.0	10/4/2024					Permanently Removed
<b>William Floyd Middle School</b>									
Kitchen Potfiller - Left	PF	App	9.0	10/4/2024	7.0	<1.0	<1.0	2/26/2025	Removed from service; Pending remediation
Room 417 Station 1	SK	App	187.0	10/4/2024	2.0			2/26/2025	
<b>William Paca Middle School</b>									
Kitchen 2-Bay	SK	App	11.0	10/4/2024	7.0	<1.0	<.0	2/26/2025	Removed from service; Pending remediation
Kitchen Pot Filler	PF	App	6.0	10/4/2024	7.0	3.0	3.0	2/26/2025	Removed from service; Pending remediation
Serving Area - Main Office Side - Prep	SK	App	13.0	10/4/2024	10.0	5.0	1.0	2/26/2025	Removed from service; Pending remediation
Serving Area - Electric Room Side - Prep	SK	App	7.0	10/4/2024	9.0	<1.0	<1.0	2/26/2025	Removed from service; Pending remediation
Room 112 Home Economics - Counter @B	SK	App	6.0	10/4/2024	2.0			2/26/2025	
Girls Locker Room by Back Exit	WF	App	20.0	10/4/2024					Permanently Removed
Girls Locker Room by Entry	WF	App	9.0	10/4/2024					Permanently Removed
<b>William Flyod High School</b>									
9/10 Grade Kitchen Island	SK	App	9.0	10/5/24	5.0			2/26/2025	
Culinary Kitchen by Pot	PF	App	31.0	10/5/24	8.0	4.0	<1.0	2/26/2025	Removed from service; Pending remediation
Teachers Lounge Kitchenette	SK	App	6.0	10/5/24	2.0			2/26/2025	

# Districtwide Lead in Drinking Water Sampling and Remediation Plan

2023-2025

William Floyd UFSD

October 2024

Enviroscience Project #23199



2150 Smithtown Ave., Suite 3, Ronkonkoma, NY 11779

T: 631.580.3191 • F: 631.580.3195 • W: [envirohealth.org](http://envirohealth.org)

DISTRICTWIDE LEAD IN DRINKING WATER SAMPLING AND REMEDIATION PLAN

2023-2025

MONTH YEAR

ENVIROSCIENCE PROJECT #JOB

Prepared for: WILLIAM FLOYD UFSD  
240 Mastic Beach Blvd  
Mastic Beach, New York 11951

Prepared by: ENVIROSCIENCE CONSULTANTS, LLC  
2150 Smithtown Avenue  
Ronkonkoma, New York 11779  
(631) 580-3191

Project Manager: *Pam Chadderton*

## TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>
1.0	Executive Summary
2.0	Sampling Methodology
3.0	Initial Results

### Appendices

Appendix A	John S. Hobart Elementary School
Appendix B	Moriches Elementary School
Appendix C	Nathanial Woodhull Elementary School
Appendix D	Tangier Smith Elementary School
Appendix E	William Floyd Elementary School
Appendix F	William Floyd Middle School
Appendix G	William Paca Middle School
Appendix H	William Floyd High School

## 1.0 EXECUTIVE SUMMARY

The William Floyd UFSD has developed their 2023-2025 Lead in Drinking Water Sampling and Remediation Plan, as required by the New York State Department of Health (Public Health Law Sections 1370-a and 1110, Subpart 67-4 Lead Testing in School Drinking Water).

In accordance with the regulation, this Lead Remediation Plan is prepared to identify locations deemed as Applicable Drinking Water Sources and report first draw sample results, to mitigate locations where sample results exceed 5 parts per billion, to identify locations deemed as Non-Applicable Water Sources, communicate this designation to building occupants, and to develop strategies for monitoring locations deemed Non-Applicable Water Sources to insure building occupants do not consume water from these locations.

The following locations within the William Floyd UFSD buildings have been deemed Applicable Drinking Water Sources by the administration:

- 1) Water fountains and bottle filling stations;
- 2) Kitchen water faucets and pot fillers used in food preparation;
- 3) Ice machines
- 4) Home Economics classroom sinks
- 5) Nurse's Office and Faculty Room sinks

First draw samples were collected from each of these locations within the District, and analyzed by a New York State Department of Health ELAP certified laboratory. The chains of custody are available upon request. For results at or below 5 ppb, no further action is required until 2025. For locations above 5 ppb, options include: second and third draw sample collection to determine source of lead, designation of the location as Non-applicable Water Source, or permanent removal of the fixture from the location. In either case, the result was communicated by Enviroscience Consultants, and the fixture was shut off by the District immediately upon receipt of results.

The following locations within the William Floyd UFSD buildings were deemed Non-Applicable Water Sources by the administration:

- 1) Science Laboratory sinks
- 2) Art Room sinks
- 3) Technical Classroom sinks
- 4) Other Classroom sinks
- 5) Bathroom sinks
- 6) Outside spigots
- 7) Custodial Closet sinks
- 8) Mixed Valve sinks (or hot only)

In these cases, the William Floyd UFSD staff have placed signs adjacent to the fixture to notify occupants that the water is not intended for consumption. To further support this protocol, the following management of the locations is required:

- 1) Science Laboratory sinks - communicate in writing with students that these locations are for science experiments and hand washing only, not for consumption. This is most easily accomplished by including this language in the laboratory safety paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective science teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 2) Art Room sinks - communicate in writing to students that these locations are for cleaning of art supplies and hand washing only, not for consumption. This is most easily accomplished by including this language in the course paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective art teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 3) Technical Classroom sinks - classrooms in this category often include wood shop or auto mechanics classrooms, where students are to hand wash after bathroom usage or activities as part of a regular hygiene program. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 4) Other classroom sinks - classrooms in this category often include elementary classrooms, where students are to hand wash after bathroom usage or activities as part of a regular hygiene program. This program should be monitored by teachers and staff

to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.

- 5) Bathroom sinks - in intermediate buildings, signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like in bathrooms, so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 6) Outside spigots - all-weather signage will be installed at each location. Further, spigots will have a special key maintained by the custodial staff to ensure that non-authorized persons do not fill sports coolers or use hoses for consumption. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 7) Custodial Closet sinks - these locations should be accessed by custodial personnel only and locked when not in use. Access to others should be restricted. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 8) Mixed Valve sinks (or hot only) – per Public Health Law Sections 1370-a and 1110, Subpart 67-4 Lead Testing in School Drinking Water mixed valve or hot water only sources are not required to be sampled. Signage is required for these sources. Signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.

All locations deemed non-applicable, but do not have signs, should be taken offline until signs have been posted. Signs are suggested to have pictures that instruct for handwashing only, do not drink.





## 2.0 SAMPLING METHODOLOGY

In accordance with the regulation, Enviroscience Consultants, LLC performed initial water sampling at the William Floyd UFSD buildings on October 4 & 5, 2024. Samples were collected in wide-mouth 250 milliliter containers and were collected in the morning hours before the facilities opened. The water sources were not used for at least 8 hours and not more than 18

hours prior to sampling. Unique source numbers and designations were assigned to each source location. Unique sample identification numbers were assigned to each sample taken. The key to fixture type codes, source designations, and the sampling location schematics are shown below.

Code Key for Lead in Water			
Fixture Type Codes			
BF	Bottle Filler	SK	Sink
HB	Hose Bib	SL	Supply Line
IM	Ice Machine	SP	Spigot
OS	Other Source	SPY	Spray
PF	Pot Filler	SS	Slop Sink
		V	Valve
		WC	Water Cooler
		WF	Water Fountain
Source Designations			
App	Applicable	N/A	Non-applicable

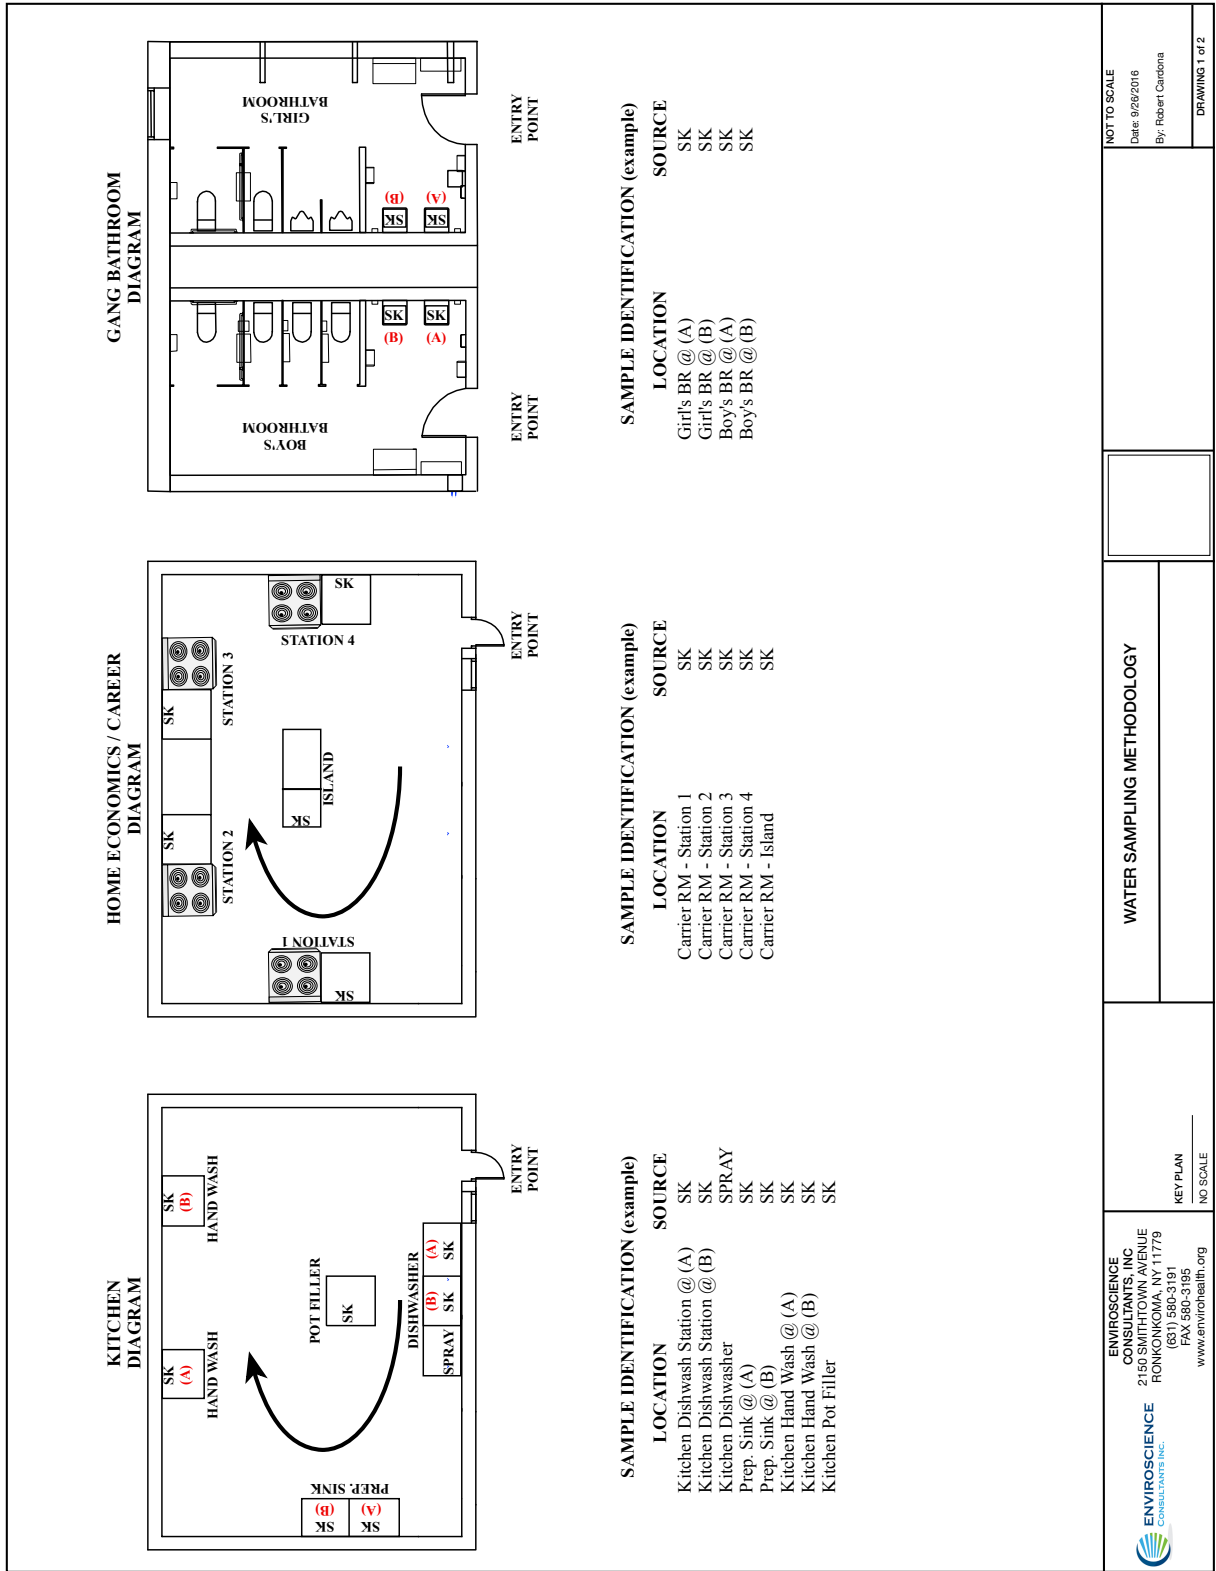

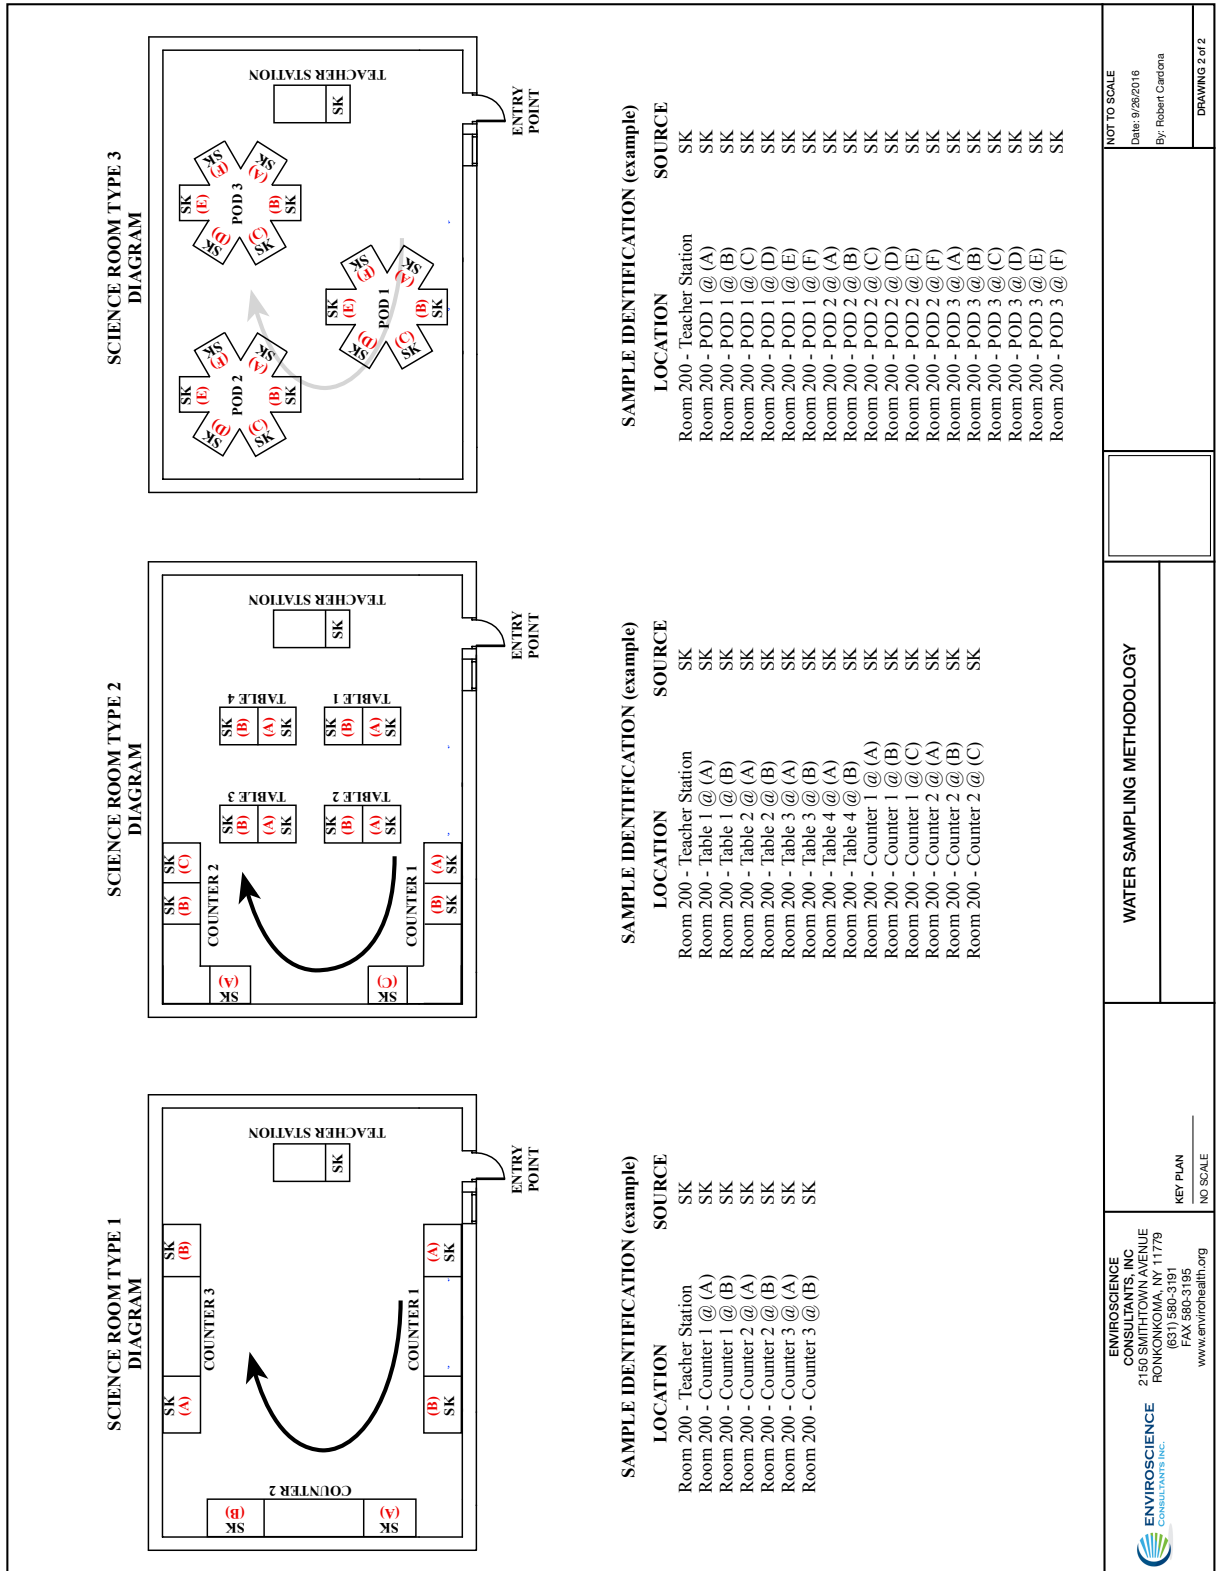

<b>WATER SAMPLING METHODOLOGY</b>		NOT TO SCALE Date: 9/26/2016 By: Robert Castano
 <b>ENVIROSCIENCE</b> CONSULTANTS, INC 2150 SMITHTOWN AVENUE RONKONKOMA, NY 11779 (631) 580-3191 FAX 580-3195 www.envirohealth.org	KEY PLAN NO SCALE	DRAWING 2 of 2

### 3.0 Initial Results

All water source locations in each of the school buildings were assessed. Water source locations identified as drinking water sources were considered Applicable, and first draw samples were collected. Water source locations identified as non-drinking water sources were considered non-applicable and these locations were documented.

The results of the initial sampling and the use of signs warning against water use at non-applicable sources is documented in the School Water Outlet Inventory for each building.

All elevated locations should be taken off line until the remediation is completed. Any other drinking water sources in these buildings that were not functional at the time of initial sampling and have not been tested should be tested before returning to service. All locations deemed non-applicable, but do not have signs, should be taken offline until signs have been posted. Signs are suggested to have pictures that instruct for handwashing only, do not drink.

The following is a summary of results in parts per billion (ppb) of locations in the William Floyd UFSD where sample results were found above 5 ppb:

John S. Hobart Elementary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen Serving Line-sink	68.0	10/4/2024	Removed from service; Pending remediation
Kitchen Pot Filler	45.0	10/4/2024	Removed from service; Pending remediation
Kitchen 3-Bay @A-sink	6.0	10/4/2024	Removed from service; Pending remediation
Teacher's Lounge-sink	6.0	10/4/2024	Removed from service; Pending remediation

John S. Hobart Elementary School

SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 188-water fountain	16.0	10/4/2024	Removed from service; Pending remediation
Room 186-water fountain	11.0	10/4/2024	Removed from service; Pending remediation

Moriches Elementary School

SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen Pot Filler	9.0	10/4/2024	Removed from service; Pending remediation
Kitchen Island by Meat Slicer-sink	6.0	10/4/2024	Removed from service; Pending remediation
Kitchen West Serving Line Counter Left – Prep sink	7.0	10/4/2024	Removed from service; Pending remediation
Main Office-water fountain	105.0	10/4/2024	Removed from service; Pending remediation
Pod 1 Hallway by Room 1-water fountain	16.0	10/4/2024	Removed from service; Pending remediation
Room 54-water fountain	11.0	10/4/2024	Removed from service; Pending remediation
Room 53-water fountain	8.0	10/4/2024	Removed from service; Pending remediation

Nathanial Woodhull Elementary School

SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 125 PTO Room	12	10/4/2024	Removed from service; Pending remediation

Tangier Smith Elementary School

SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen Pot Filler	7.0	10/4/2024	Removed from service; Pending remediation
Kitchen Food Prep Sink	7.0	10/4/2024	Removed from service; Pending remediation
Serving Area North Prep Sink	7.0	10/4/2024	Removed from service; Pending remediation
Room B-water fountain	71.0	10/4/2024	Removed from service; Pending remediation
Room C-water fountain	17.0	10/4/2024	Removed from service; Pending remediation

William Floyd Elementary School

SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 186-water fountain	15	10/4/2024	Removed from service; Pending remediation

William Floyd Middle School

SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen Potfiller - Left	9.0	10/4/2024	Removed from service; Pending remediation
Room 417 Station 1-sink	187.0	10/4/2024	Removed from service; Pending remediation

Paca Middle School

SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen 2-Bay-sink	11.0	10/4/2024	Removed from service; Pending remediation
Kitchen Pot Filler	6.0	10/4/2024	Removed from service; Pending remediation

Paca Middle School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Serving Area - Main Office Side – Prep-sink	13.0	10/4/2024	Removed from service; Pending remediation
Serving Area - Electric Room Side – Prep-sink	7.0	10/4/2024	Removed from service; Pending remediation
Room 112 Home Economics - Counter @B-sink	6.0	10/4/2024	Removed from service; Pending remediation
Girls Locker Room by Back Exit-water fountain	20.0	10/4/2024	Removed from service; Pending remediation
Girls Locker Room by Entry-water fountain	9.0	10/4/2024	Removed from service; Pending remediation

William Floyd High School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
9/10 Grade Kitchen Island-Sink	9.0	10/5/24	Removed from service; Pending remediation
Culinary Kitchen by Pot-Potfiller	31.0	10/5/24	Removed from service; Pending remediation
Teachers Lounge Kitchenette-sink	6.0	10/5/24	Removed from service; Pending remediation

## Appendix A

John S. Hobart Elementary School

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1001-1	Main Office Kitchenette	SK	App	<1.0	10/4/2024					-
1001-2	Main Office Bathroom	SK	N/A		10/4/2024					Sign
1002-1	Nurse's Office	SK	App	2	10/4/2024					-
1002-2	Nurse's Office Bathroom	SK	N/A		10/4/2024					Sign
1003-1	Women's Bathroom by Nurse's Office @ A	SK	N/A		10/4/2024					Sign
1003-2	Women's Bathroom by Nurse's Office @ B	SK	N/A		10/4/2024					Sign
1004-1	Hall by Nurse's Office	WF	App	<1.0	10/4/2024					
1004-2	Hall by Nurse's Office	BF	App	<1.0	10/4/2024					
1005-1	Men's Bathroom by Nurse's Office	SK	N/A		10/4/2024					Sign
1006-1	Room 130 Counter 1	SK	N/A		10/4/2024					Sign
1006-1	Room 130 Counter 2	SK	N/A		10/4/2024					Sign
1007-1	Room 136	SK	N/A		10/4/2024					Sign
1009-1	Room 142	SK	N/A		10/4/2024					Sign
1010-1	Room 144	SK	N/A		10/4/2024					Sign
1011-1	Room 146	SK	N/A		10/4/2024					Sign
1012-1	Room 148	SK	N/A		10/4/2024					Sign
1013-1	Girl's Bathroom by Room 148 Unit @ A	SK	N/A		10/4/2024					Sign
1013-2	Girl's Bathroom by Room 148 Unit @ B	SK	N/A		10/4/2024					Sign
1013-3	Girl's Bathroom by Room 148 Unit @ C	SK	N/A		10/4/2024					Sign
1014-1	Custodial Closet by Room 148	SS	N/A		10/4/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1015-1	Faculty Bathroom by Room 148	SK	N/A		10/4/2024					Sign
1016-1	Faculty Bathroom by Room 149C	SK	N/A		10/4/2024					Sign
1017-1	Hall by Room 149C - left	WF	App	<1.0	10/4/2024					
1017-2	Hall by Room 149C - right	WF	App	<1.0	10/4/2024					
1018-1	Boy's Bathroom by Room 149C Unit @ A	SK	N/A		10/4/2024					Sign
1018-2	Boy's Bathroom by Room 149C Unit @ B	SK	N/A		10/4/2024					Sign
1018-3	Boy's Bathroom by Room 149C Unit @ C	SK	N/A		10/4/2024					Sign
1019-1	Room 150	SK	N/A		10/4/2024					Sign
1020-1	Room 152	SK	N/A		10/4/2024					Sign
1021-1	Room 154	SK	N/A		10/4/2024					Sign
1022-1	Room 156	SK	N/A		10/4/2024					Sign
1023-1	Room 158	SK	N/A		10/4/2024					Sign
1024-1	Room 157	SK	N/A		10/4/2024					Sign
1025-1	Room 155	SK	N/A		10/4/2024					Sign
1026-1	Room 153	SK	N/A		10/4/2024					Sign
1027-1	Room 151	SK	N/A		10/4/2024					Sign
1028-1	Room 145	SK	N/A		10/4/2024					Sign
1029-1	Room 143	SK	N/A		10/4/2024					Sign
1030-1	Hall by Room 141	WF	App	<1.0	10/4/2024					
2001-1	Room 236	SK	N/A		10/4/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
2002-1	Room 238	SK	N/A		10/4/2024					Sign
2003-1	Room 240	SK	N/A		10/4/2024					Sign
2004-1	Room 242	SK	N/A		10/4/2024					Sign
2005-1	Room 244	SK	N/A		10/4/2024					Sign
2006-1	Room 246	SK	N/A		10/4/2024					Sign
2007-1	Room 248	SK	N/A		10/4/2024					Sign
2008-1	Girl's Bathroom by Room 248 Unit @ A	SK	N/A		10/4/2024					Sign
2008-2	Girl's Bathroom by Room 248 Unit @ A	SK	N/A		10/4/2024					Sign
2008-3	Girl's Bathroom by Room 248 Unit @ C	SK	N/A		10/4/2024					Sign
2009-1	Custodial Closet by Room 148	SS	N/A		10/4/2024					Sign
2010-1	Faculty Bathroom by Room 248	SK	N/A		10/4/2024					Sign
2011-1	Faculty Bathroom by Room 249C	SK	N/A		10/4/2024					Sign
2012-1	Hall by Room 249C - left	WF	App	<1.0	10/4/2024					
2012-2	Hall by Room 249C - right	WF	App	<1.0	10/4/2024					
2013-1	Boy's Bathroom by Room 249C Unit @ A	SK	N/A		10/4/2024					Sign
2013-3	Boy's Bathroom by Room 249C Unit @ C	SK	N/A		10/4/2024					Sign
2014-1	Room 250	SK	N/A		10/4/2024					Sign
2015-1	Room 252	SK	N/A		10/4/2024					Sign
2016-1	Room 254	SK	N/A		10/4/2024					Sign
2017-1	Room 256	SK	N/A		10/4/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
2018-1	Room 258	SK	N/A		10/4/2024					Sign
2019-1	Room 257	SK	N/A		10/4/2024					Sign
2020-1	Room 255	SK	N/A		10/4/2024					Sign
2021-1	Room 253	SK	N/A		10/4/2024					Sign
2022-1	Room 251	SK	N/A		10/4/2024					Sign
2023-1	Room 245	SK	N/A		10/4/2024					Sign
2024-1	Room 243	SK	N/A		10/4/2024					Sign
2025-1	Hall by Room 242	WF	App	<1.0	10/4/2024					
2025-2	Hall by Room 242	BF	App	<1.0	10/4/2024					
1030-1	Gym South Bathroom	SK	N/A		10/4/2024					Sign
1031-1	Gym North Bathroom	SK	N/A		10/4/2024					Sign
1032-1	Boy's Bathroom by Gym Custodial Closet	SK	N/A		10/4/2024					Sign
1032-2	Boy's Bathroom by Gym Unit @ A	SK	N/A		10/4/2024					Sign
1032-3	Boy's Bathroom by Gym Unit @ B	SK	N/A		10/4/2024					Sign
1032-4	Boy's Bathroom by Gym Unit @ C	SK	N/A		10/4/2024					Sign
1033-1	Girl's Bathroom by Gym Unit @ A	SK	N/A		10/4/2024					Sign
1033-2	Girl's Bathroom by Gym Unit @ B	SK	N/A		10/4/2024					Sign
1033-3	Girl's Bathroom by Gym Unit @ C	SK	N/A		10/4/2024					Sign
1034-1	Hall by Gym	WF	App	<1.0	10/4/2024					
1034-2	Hall by Gym	BF	App	<1.0	10/4/2024					

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1035-1	Room 127	SS	N/A		10/4/2024					Sign
1036-1	Kitchen Bathroom	SK	N/A		10/4/2024					Sign
1036-2	Kitchen Snackbar	SK	App	2	10/4/2024					
1036-3	Kitchen Serving Line	SK	App	68	10/4/2024					Removed from Service Pending Remediation
1036-4	Kitchen Serving Line Handwash	SK	N/A		10/4/2024					Sign
1036-5	Kitchen Handwash @ A	SK	N/A		10/4/2024					Sign
1036-6	Kitchen Island	SK	App	5	10/4/2024					
1036-7	Kitchen	PF	App	45	10/4/2024					Removed from Service Pending Remediation
1036-8	Kitchen Handwash @ B	SK	N/A		10/4/2024					Sign
1036-9	Kitchen 3-Bay @ A	SK	App	6	10/4/2024					Removed from Service Pending Remediation
1036-10	Kitchen 3-Bay @ B	SK	App	3	10/4/2024					
1037-1	Teacher's Lounge	SK	App	1	10/4/2024					
1037-2	Teacher's Lounge	SPY	App	6	10/4/2024					Removed from Service Pending Remediation
1038-1	Multipurpose Room	WF	App		10/4/2024					Non-functional
1038-2	Hall by Cafeteria	WF	App	<1.0	10/4/2024					
1038-3	Hall by Cafeteria	WB	App	<1.0	10/4/2024					
1039-1	Boy's Bathroom in Multipurpose Room	SK	App		10/4/2024					
1040-1	Girl's Bathroom by Multipurpose Room	SK	App		10/4/2024					
1041-1	Hall by Mechanical Room 116A	WF	App	<1.0	10/4/2024					
1042-1	Room 163	SK	N/A		10/4/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1043-1	Room 167 Counter 1	SK	App		10/4/2024					
1043-2	Room 167 Counter 2	SK	App		10/4/2024					
1044-1	Room 169	SK	App		10/4/2024					
1045-1	Room 171	SK	App		10/4/2024					
1046-1	Room 173	SK	App		10/4/2024					
1047-1	Room 175	SK	App		10/4/2024					
1048-1	Room 177	SK	App		10/4/2024					
1049-1	Room 179	SK	App		10/4/2024					
1050-1	Room 186	SK	App		10/4/2024					
1050-2	Room 186	WF	App	11	10/4/2024					Removed from Service Pending Remediation
1051-1	Room 188	SK	App		10/4/2024					
1051-2	Room 188	WF	App	16	2/9/2023					Removed from Service Pending Remediation
1052-1	Room 187	SK	N/A		10/4/2024					Sign
1052-2	Room 187	WF	App	<1.0	10/4/2024					
1053-1	Room 185	SK	N/A		10/4/2024					Sign
1053-2	Room 185	WF	App	<1.0	10/4/2024					
1054-1	Room 183	SK	N/A		10/4/2024					Sign
1054-2	Room 183	WF	App	2	10/4/2024					
1055-1	Room 181	SK	N/A		10/4/2024					Sign
1055-2	Room 181	WF	App	<1.0	10/4/2024					

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1056-1	Room 182	SK	N/A		10/4/2024					Sign
1056-2	Room 182	WF	App	2	10/4/2024					
1057-1	Room 184	SK	N/A		10/4/2024					Sign
1057-2	Room 184	WF	App	2	10/4/2024					
1058-1	Room 180	SK	N/A		10/4/2024					Sign
1059-1	Room 178	SK	N/A		10/4/2024					Sign
1060-1	Room 176	SK	N/A		10/4/2024					Sign
1061-1	Room 174	SK	N/A		10/4/2024					Sign
1062-1	Room 172	SK	N/A		10/4/2024					Sign
1063-1	Room 170	SK	N/A		10/4/2024					Sign
1064-1	Custocial Closet in Boy's Bathroom by Room 167	SS	N/A		10/4/2024					Sign
1064-2	Boy's Bathroom by Room 167 @ A	SK	N/A		10/4/2024					Sign
1064-3	Boy's Bathroom by Room 167 @ B	SK	N/A		10/4/2024					Sign
1064-4	Boy's Bathroom by Room 167 @ C	SK	N/A		10/4/2024					Sign
1065-1	Gender Neutral Bathroom by Room 167	SK	N/A		10/4/2024					Sign
1066-1	Hall by Room 167	WF	App	<1.0	10/4/2024					
1066-2	Hall by Room 167	BF	App	<1.0	10/4/2024					
1067-1	Gender Neutral Bathroom by Room 166	SK	N/A		10/4/2024					Sign
1068-1	Girl's Bathroom by Room 166 @ A	SK	N/A		10/4/2024					Sign
1068-2	Girl's Bathroom by Room 166 @ B	SK	N/A		10/4/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1068-3	Girl's Bathroom by Room 166 @ C	SK	N/A		10/4/2024					Sign
1069-1	Hall by Library	WF	App		2/9/2023					Non-functional
1070-1	Library	SK	N/A		10/4/2024					Sign

## Laboratory Report

NYE Report #: 230432-24084

February 10, 2023

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; John S Hobart Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 09, 2023. New York Environmental analyzed the samples on February 10, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	09 Feb 2023
Date Received:	09 Feb 2023
Date Analyzed:	10 Feb 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
230209P014	1	Hall by Nurse's Office-WF, Initial	0.001	0.007	mg/L	H
230209P015	2	Hall by Gym -WF, Initial	0.001	<0.001	mg/L	
230209P016	3	Hall by Room 167-WF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

## Laboratory Report

NYE Report #: 2406214-31382

October 8, 2024

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; Hobart Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 04, 2024. New York Environmental analyzed the samples on October 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241004Q096	1	Main Office Kitchenette-SK Initial	0.001	<0.001	mg/L	
241004Q097	2	Nurse's Office-SK Initial	0.001	0.002	mg/L	
241004Q098	3	Hall by Nurse's Office-BF Initial	0.001	<0.001	mg/L	
241004Q099	4	Hall by Nurse's Office-WF Initial	0.001	<0.001	mg/L	
241004Q100	5	Multipurpose Room-WF Initial	0.001	0.002	mg/L	
241004Q101	6	Hall by Room 141-WF Initial	0.001	<0.001	mg/L	
241004Q102	7	Hall by Room 149C -BF Initial	0.001	<0.001	mg/L	
241004Q103	8	Hall by Room 149C-WF Initial	0.001	<0.001	mg/L	
241004Q104	9	Hall by Room 249C-BF Initial	0.001	<0.001	mg/L	
241004Q105	10	Hall by Room 249C -WF Initial	0.001	<0.001	mg/L	
241004Q106	11	Hall by Room 242-BF Initial	0.001	<0.001	mg/L	
241004Q107	12	Hall by Room 242-WF Initial	0.001	<0.001	mg/L	
241004Q108	13	Hall by Gym -BF Initial	0.001	<0.001	mg/L	
241004Q109	14	Hall by Gym -WF Initial	0.001	<0.001	mg/L	
241004Q110	15	Kitchen SnackBar-SK Initial	0.001	0.002	mg/L	
241004Q111	16	Kitchen Serving Line-SK Initial	0.001	0.068	mg/L	E,H
241004Q112	17	Kitchen Island-SK Initial	0.001	0.005	mg/L	
241004Q113	18	Kitchen-PF Initial	0.001	0.045	mg/L	H
241004Q114	19	Kitchen 3-Bay @ A-SK Initial	0.001	0.006	mg/L	H
241004Q115	20	Kitchen 3-Bay @ B-SK Initial	0.001	0.003	mg/L	
241004Q116	21	Teacher's Lounge-SK Initial	0.001	0.001	mg/L	
241004Q117	22	Teacher's Lounge-SPY Initial	0.001	0.006	mg/L	H
241004Q118	23	Hall by Cafeteria-BF Initial	0.001	<0.001	mg/L	
241004Q119	24	Hall by Cafeteria-WF Initial	0.001	<0.001	mg/L	
241004Q120	25	Hall by Mechanical Room 116A-WF Initial	0.001	<0.001	mg/L	
241004Q121	26	Hall by Room 167-BF Initial	0.001	<0.001	mg/L	



Date Collected:	21 Jun 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
241004Q122	27	Hall by Room 167-WF Initial	0.001	<0.001	mg/L	
241004Q123	28	Room 181-WF Initial	0.001	<0.001	mg/L	
241004Q124	29	Room 182-WF Initial	0.001	0.002	mg/L	
241004Q125	30	Room 184-WF Initial	0.001	0.002	mg/L	
241004Q126	31	Room 183-WF Initial	0.001	0.002	mg/L	
241004Q127	32	Room 185-WF Initial	0.001	<0.001	mg/L	
241004Q128	33	Room 187-WF Initial	0.001	<0.001	mg/L	
241004Q129	34	Room 188-WF Initial	0.001	0.016	mg/L	H
241004Q130	35	Room 186-WF Initial	0.001	0.011	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.

## Appendix B

Moriches Elementary School

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1001-1	Kitchen Office Handwash	SK	N/A		10/3/2024					Sign
1001-2	Kitchen Sanitizer Station @ A	SK	N/A		10/3/2024					Sign
1001-3	Kitchen Sanitizer Station @ B	SK	N/A		10/3/2024					Sign
1001-4	Kitchen Potfiller	SP	App	9.0	10/3/2024					Removed from Service Pending Remediation
1001-5	Kitchen Custodian Closet	SS	N/A		10/3/2024					Sign
1001-6	Kitchen Pass Thru Room	SP	N/A		10/3/2024					Sign
1001-7	Kitchen Island Food Prep by Ovens	SK	App	4.0	10/3/2024					
1001-8	Kitchen Island by Meat Slicer	SK	App	6.0	10/3/2024					Removed from Service Pending Remediation
1002-1	Kitchen West Serving Line Counter	SK	App	7.0	10/3/2024					Removed from Service Pending Remediation
1002-2	Kitchen West Serving Line Handwash	SK	N/A		10/3/2024					Sign
1003-1	Kitchen East Serving Line Counter	SK	App	3.0	10/3/2024					
1003-2	Kitchen East Serving Line Handwash	SK	N/A		10/3/2024					Sign
1004-1	Kitchen Bathroom	SK	N/A		10/3/2024					Sign
1005-1	POD 2 Girls Bathroom Unit @ A	SK	N/A		10/3/2024					Sign
1005-2	POD 2 Girls Bathroom Unit @ B	SK	N/A		10/3/2024					Sign
1006-1	POD 2 Hallway by Girls Bathroom	WF	App	<1.0	10/3/2024					
1006-2	POD 2 Hallway by Girls Bathroom	BF	App	<1.0	10/3/2024					
1007-1	POD 2 Boys Bathroom Custodian Closet	SS	N/A		10/3/2024					Sign
1007-2	POD 2 Boys Bathroom	SK	N/A		10/3/2024					Sign
1008-1	POD 2 Women Faculty Bathroom	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1009-1	POD 2 Student Only Bathroom	SK	N/A		10/3/2024					Sign
1010-1	POD 2 Hallway by Room 9	WF	App		2/9/2023					Non-functional
1011-1	POD 2 Room 9	SK	N/A		10/3/2024					Sign
1012-1	POD 2 Room 10	SK	N/A		10/3/2024					Sign
1013-1	POD 2 Room 11	SK	N/A		10/3/2024					Sign
1014-1	POD 2 Room 12	SK	N/A		10/3/2024					Sign
1015-1	POD 2 Room 13	SK	N/A		10/3/2024					Sign
1016-1	POD2 Room 14	SK	N/A		10/3/2024					Sign
1017-1	POD 2 Room 15	SK	N/A		10/3/2024					Sign
1018-1	POD 2 Room 16 (Faculty Room)	SK	App	3	10/3/2024					
1019-1	Women Bathroom by Psychologist Office	SK	N/A		10/3/2024					Sign
1020-1	Men Bathroom by Psychologist Office	SK	N/A		10/3/2024					Sign
1021-1	Nurses Office	SK	App	1.0	10/3/2024					
1021-2	Nurses Office Bathroom	SK	N/A		10/3/2024					Sign
1022-1	Main Office	WF	App	105.0	10/3/2024					Removed from Service Pending Remediation
1022-2	Main Office Bathroom	SK	N/A		10/3/2024					Sign
1022-3	Principals Office Bathroom	SK	N/A		10/3/2024					Sign
1023-1	POD 1 Girls Bathroom @ A	SK	N/A		10/3/2024					Sign
1023-2	POD 1 Girls Bathroom @ B	SK	N/A		10/3/2024					Sign
1024-1	POD 1 Hallway by Girls Bathroom	WF	App	1.0	10/3/2024					

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1024-2	POD 1 Hallway by Girls Bathroom	BF	App	<1.0	10/3/2024					
1025-1	POD 1 Boys Bathroom @ A	SK	N/A		10/3/2024					Sign
1025-2	POD 1 Boys Bathroom @ B	SK	N/A		10/3/2024					Sign
1026-1	POD 1 Womens Faculty Bathroom	SK	N/A		10/3/2024					Sign
1027-1	POD 1 Mens Faculty Bathroom	SK	N/A		10/3/2024					Sign
1028-1	POD 1 Hallway by Room 1	WF	App		10/3/2024					Non-functional
1029-1	POD 1 Room 1	SK	N/A		10/3/2024					Sign
1030-1	POD 1 Room 2	SK	App	2.0	10/3/2024					
1031-1	POD 1 Room 3	SK	App	2.0	10/3/2024					
1032-1	POD 1 Room 4	SK	N/A		10/3/2024					Sign
1033-1	POD 1 Room 5	SK	N/A		10/3/2024					Sign
1034-1	POD 1 Room 6	SK	N/A		10/3/2024					Sign
1035-1	POD 1 Room 7	SK	N/A		10/3/2024					Sign
1036-1	POD 1 Room 8	SK	N/A		10/3/2024					Sign
1037-1	Room 54	SK	N/A		2/9/2023					Sign
1037-2	Room 54	WF	App	11.0	10/3/2024					Removed from Service Pending Remediation
1038-1	Room 53	SK	N/A		2/9/2023					Sign
1038-2	Room 53	WF	App	8.0	2/9/2023					Removed from Service Pending Remediation
1039-1	Gym Office 2 Bathroom	SK	N/A		10/3/2024					Sign
1040-1	Gym Boys Bathroom	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1040-2	Gym Boys Bathroom	WF	App	4.0	10/3/2024					
1041-1	Gym Office 1 Bathroom	SK	N/A		10/3/2024					Sign
1042-1	Gym Girls Bathroom	SK	N/A		10/3/2024					Sign
1042-2	Gym Girls Bathroom	WF	App		2/9/2023					Non-functional
1043-1	Room 52	SK	App	69.0	2/9/2023					Sign
1043-2	Room 52	WF	App	5.0	10/3/2024					
1044-1	POD 4 Girls Bathroom Unit @ A	SK	N/A		10/3/2024					Sign
1044-2	POD 4 Girls Bathroom Unit @ B	SK	N/A		10/3/2024					Sign
1045-1	POD 4 Hallway by Girls Bathroom	WF	App	<1.0	10/3/2024					
1045-2	POD 4 Hallway by Girls Bathroom	BF	App	<1.0	10/3/2024					
1046-1	POD 4 Boys Bathroom Custodian Closet	SS	N/A		10/3/2024					Sign
1046-2	POD 4 Boys Bathroom	SS	N/A		10/3/2024					Sign
1047-1	POD 4 Womens Faculty Bathroom	SK	N/A		10/3/2024					Sign
1048-1	POD 4 Mens Faculty Bathroom	SK	N/A		10/3/2024					Sign
1049-1	POD 4 Hallway by Room 25	WF	App	1.0	2/9/2023					
1050-1	POD 4 Room 25	SK	N/A		10/3/2024					Sign
1051-1	POD 4 Room 26	SK	N/A		10/3/2024					Sign
1052-1	POD 4 Room 27	SK	N/A		10/3/2024					Sign
1053-1	POD 4 Room 28	SK	N/A		10/3/2024					Sign
1054-1	POD 4 Room 29	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1055-1	POD 4 Room 30	SK	N/A		10/3/2024					Sign
1056-1	POD 4 Room 31	SK	N/A		10/3/2024					Sign
1057-1	POD 4 Room 32	SK	N/A		10/3/2024					Sign
1058-1	Room 51	SK	N/A		2/9/2023					Sign
1059-1	Room 34	SK	N/A		10/3/2024					Sign
1060-1	Women Bathroom Across Room 47	SK	N/A		10/3/2024					Sign
1061-1	Men Bathroom Across Room 46	SK	N/A		10/3/2024					Sign
1062-1	Custodian Closet by Room 46	SK	N/A		10/3/2024					Sign
1063-1	Room 44	SS	N/A		10/3/2024					Sign
1064-1	Hallway by Room 43	WF	App	<1.0	10/3/2024					
1064-2	Hallway by Room 43	BF	App	<1.0	10/3/2024					
1065-1	Girls Bathroom by Room 43 Unit @ A	SK	N/A		10/3/2024					Sign
1065-2	Girls Bathroom by Room 43 Unit @ B	SK	N/A		10/3/2024					Sign
1065-3	Girls Bathroom by Room 43 Unit @ C	SK	N/A		10/3/2024					Sign
1066-1	Boys Bathroom by Room 43 @ A	SK	N/A		10/3/2024					Sign
1066-2	Boys Bathroom by Room 43 @ B	SK	N/A		10/3/2024					Sign
1066-3	Boys Bathroom by Room 43 @ C	SK	N/A		10/3/2024					Sign
1067-1	Room 43	SK	N/A		10/3/2024					Sign
1068-1	Room 35	SK	N/A		10/3/2024					Sign
1069-1	Room 50 Counter @ A	SK	N/A	25.0	2/9/2023					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1069-2	Room 50 Counter @ B	SK	N/A		10/3/2024					Sign
1070-1	POD 3 Girls Bathroom @ A	SK	N/A		10/3/2024					Sign
1070-2	POD 3 Girls Bathroom @ B	SK	N/A		10/3/2024					Sign
1071-1	POD 3 Hallway by Girls Bathroom	WF	App		2/9/2023					Non-functional
1072-1	POD 3 Boys Bathroom Custodian Closet	SS	N/A		10/3/2024					Sign
1072-2	POD 3 Boys Bathroom @ A	SK	App		10/3/2024					Sign
1072-3	POD 3 Boys Bathroom @ B	SK	App		10/3/2024					
1073-1	POD 3 Womens Faculty Bathroom	SK	App		10/3/2024					
1074-1	POD 3 Mens Faculty Bathroom	SK	App		10/3/2024					
1075-1	POD 3 Hallway by Room 17	WF	App		2/9/2023					Non-functional
1076-1	POD 3 Room 17	SK	App		10/3/2024					
1077-1	POD 3 Room 18	SK	App		10/3/2024					
1078-1	POD 3 Room 19	SK	App		10/3/2024					
1079-1	POD 3 Room 20	SK	App		10/3/2024					
1080-1	POD 3 Room 21	SK	App		10/3/2024					
1081-1	POD 3 Room 22	SK	App		10/3/2024					
1082-1	POD 3 Room 23	SK	App		10/3/2024					
1083-1	POD 3 Room 24	SK	App		10/3/2024					
1084-1	Custodian Office Bathroom	SK	App		10/3/2024					

## Laboratory Report

NYE Report #: 230431-24083

February 10, 2023

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; Moriches Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 09, 2023. New York Environmental analyzed the samples on February 10, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	09 Feb 2023
Date Received:	09 Feb 2023
Date Analyzed:	10 Feb 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
230209P006	1	Kitchen East Serving Line Handwash-SK, Initial	0.001	0.052	mg/L	E,H
230209P007	2	Main Office -WF, Initial	0.001	0.027	mg/L	H
230209P008	3	Room 54-SK, Initial	0.001	0.002	mg/L	
230209P009	4	Room 53-SK, Initial	0.001	0.005	mg/L	
230209P010	5	Room 53-WF, Initial	0.001	0.002	mg/L	
230209P011	6	Room 52-SK, Initial	0.001	0.069	mg/L	E,H
230209P012	7	POD 4 Hallway by Room 25-WF, Initial	0.001	0.001	mg/L	
230209P013	8	Room 50 Counter @ A-SK, Initial	0.001	0.025	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.

## Laboratory Report

NYE Report #: 2406208-31376

October 8, 2024

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; Moriches Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 04, 2024. New York Environmental analyzed the samples on October 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241004M002	1	Kitchen Potfiller-SP, Initial	0.001	0.009	mg/L	H
241004M003	2	Kitchen Island Food Prep by Ovens-SK, Initial	0.001	0.004	mg/L	
241004M004	3	Kitchen Island by Meat Slicer-SK, Initial	0.001	0.006	mg/L	H
241004M005	4	Kitchen West Serving Line Counter Left-Prep-SK, Initial	0.001	0.007	mg/L	H
241004M006	5	Kitchen East Serving Line Counter Right-Prep-SK, Initial	0.001	0.003	mg/L	
241004M007	6	POD 2 Hallway by Girls Bathroom-BF, Initial	0.001	<0.001	mg/L	
241004M008	7	POD 2 Hallway by Girls Bathroom-WF, Initial	0.001	<0.001	mg/L	
241004M009	8	POD 2 Room 16 (Faculty Room)-SK, Initial	0.001	0.003	mg/L	
241004M010	9	Nurses Office-SK, Initial	0.001	0.001	mg/L	
241004M011	10	Main Office -WF, Initial	0.001	0.105	mg/L	E,H
241004M012	11	POD 1 Hallway by Girls Bathroom-BF, Initial	0.001	0.001	mg/L	
241004M013	12	POD 1 Hallway by Girls Bathroom-WF, Initial	0.001	<0.001	mg/L	
241004M014	13	POD 1 Hallway by Room 1-WF, Initial	0.001	0.016	mg/L	H
241004M015	14	POD 1 Room 2-SK, Initial	0.001	0.002	mg/L	
241004M016	15	POD 1 Room 3-SK, Initial	0.001	0.002	mg/L	
241004M017	16	Room 54-WF, Initial	0.001	0.011	mg/L	H
241004M018	17	Room 53-WF, Initial	0.001	0.008	mg/L	H
241004M019	18	Gym Boys Bathroom-WF, Initial	0.001	0.004	mg/L	
241004M020	19	Room 52-WF, Initial	0.001	0.005	mg/L	
241004M021	20	POD 4 Hallway by Girls Bathroom-BF, Initial	0.001	<0.001	mg/L	
241004M022	21	POD 4 Hallway by Girls Bathroom-WF, Initial	0.001	<0.001	mg/L	
241004M023	22	Hallway by Room 43-BF, Initial	0.001	<0.001	mg/L	
241004M024	23	Hallway by Room 43-WF, Initial	0.001	<0.001	mg/L	
241004M025	24	POD 3 Hallway by Girls Bathroom-BF, Initial	0.001	<0.001	mg/L	
241004M026	25	POD 3 Hallway by Girls Bathroom-WF, Initial	0.001	<0.001	mg/L	



Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

**Lab ID**    **CID**    **Sample Location/Description**    **LOQ**    **Result**    **Units**    **Flag**

Comment:

CID: Client ID    LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.



## Appendix C

Nathanial Woodhull Elementary School

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1001-1	Kitchen	PF	App	3.0	10/3/2024		-	-	-	-
1001-2	Kitchen 3-Bay - Left	SK	N/A		10/3/2024		-	-	-	Sign
1001-3	Kitchen 3-Bay - Middle	SK	N/A		10/3/2024		-	-	-	Sign
1001-4	Kitchen 3-Bay - Right	SK	N/A		10/3/2024		-	-	-	Sign
1001-5	Kitchen 3-Bay	SPY	N/A		10/3/2024		-	-	-	Sign
1001-6	Kitchen Handwash	SK	N/A		10/3/2024		-	-	-	Sign
1001-7	Kitchen Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1001-8	Kitchen Island Food Prep	SK	App	3.0	10/3/2024		-	-	-	-
1002-1	Serving Area in Cafeteria Handwash - Right	SK	N/A		10/3/2024		-	-	-	Sign
1002-2	Serving Area in Cafeteria Food Prep	SK	App	2.0	10/3/2024		-	-	-	-
1002-3	Serving Area in Cafeteria Handwash - Left	SK	N/A		10/3/2024		-	-	-	Sign
1003-1	Boy's Bathroom by Room 133 - Trough 1 @A	SK	N/A		10/3/2024		-	-	-	Sign
1003-2	Boy's Bathroom by Room 133 - Trough 1 @B	SK	N/A		10/3/2024		-	-	-	Sign
1003-3	Boy's Bathroom by Room 133 - Trough 2 @A	SK	N/A		10/3/2024		-	-	-	Sign
1003-4	Boy's Bathroom by Room 133 - Trough 2 @B	SK	N/A		10/3/2024		-	-	-	Sign
1004-1	Hallway by Room 133	WF	App		2/9/2023		-	-	-	Non-functional
1005-1	Girl's Bathroom by Room 133 - Trough 1 @A	SK	N/A		10/3/2024		-	-	-	Sign
1005-2	Girl's Bathroom by Room 133 - Trough 1 @B	SK	N/A		10/3/2024		-	-	-	Sign
1005-3	Girl's Bathroom by Room 133 - Trough 2 @A	SK	N/A		10/3/2024		-	-	-	Sign
1005-4	Girl's Bathroom by Room 133 - Trough 2 @B	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1006-1	Room 132	SK	N/A		10/3/2024		-	-	-	Sign
1006-2	Room 132	WF	App	<1.0	10/3/2024		-	-	-	-
1007-1	Room 131	SK	N/A		10/3/2024		-	-	-	Sign
1007-2	Room 131	WF	App	<1.0	10/3/2024		-	-	-	-
1008-1	Room 130	SK	N/A		10/3/2024		-	-	-	Sign
1008-2	Room 130	WF	App	<1.0	10/3/2024		-	-	-	-
1009-1	Room 129	SK	N/A		10/3/2024		-	-	-	Sign
1009-2	Room 129	WF	App	<1.0	10/3/2024		-	-	-	-
1010-1	Room 128	SK	N/A		10/3/2024		-	-	-	Sign
1010-2	Room 128	WF	App	<1.0	10/3/2024		-	-	-	-
1011-1	Room 127	SK	N/A		10/3/2024		-	-	-	Sign
1011-2	Room 127	WF	App	<1.0	10/3/2024		-	-	-	-
1012-1	Room 126	SK	N/A		10/3/2024		-	-	-	Sign
1012-2	Room 126	WF	App	<1.0	10/3/2024		-	-	-	-
1013-1	Room 125 - PTO Room	SK	App	12.0	10/3/2024					Removed from Service Pending Remediation
1013-2	Room 125 - PTO Room	WF	App		10/3/2024		-	-	-	Non-functional
1014-1	Room 124	SK	N/A		10/3/2024		-	-	-	Sign
1014-2	Room 124	WF	App	<1.0	10/3/2024		-	-	-	-
1015-1	Room 123 - Science - Pod 1 @A	SK	N/A		10/3/2024		-	-	-	Sign
1015-2	Room 123 - Science - Pod 1 @B	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1015-3	Room 123 - Science - Pod 1 @C	SK	N/A		10/3/2024		-	-	-	Sign
1015-4	Room 123 - Science - Pod 2 @A	SK	N/A		10/3/2024		-	-	-	Sign
1015-5	Room 123 - Science - Pod 2 @B	SK	N/A		10/3/2024		-	-	-	Sign
1015-6	Room 123 - Science - Pod 2 @C	SK	N/A		10/3/2024		-	-	-	Sign
1015-7	Room 123 - Science - Pod 3 @A	SK	N/A		10/3/2024		-	-	-	Sign
1015-8	Room 123 - Science - Pod 3 @B	SK	N/A		10/3/2024		-	-	-	Sign
1015-9	Room 123 - Science - Pod 3 @C	SK	N/A		10/3/2024		-	-	-	Sign
1015-10	Room 123 - Science - Counter	SK	N/A		10/3/2024		-	-	-	Sign
1016-1	Room 115 - Art	SK	N/A		10/3/2024		-	-	-	Sign
1017-1	Room 114	SK	N/A		10/3/2024		-	-	-	Sign
1018-1	Room 106	SK	App	24.0	2/9/2023					Sign
1019-1	Room 104 - Science - Pod 1 @A	SK	N/A		10/3/2024		-	-	-	Sign
1019-2	Room 104 - Science - Pod 1 @B	SK	N/A		10/3/2024		-	-	-	Sign
1019-3	Room 104 - Science - Pod 1 @C	SK	N/A		10/3/2024		-	-	-	Sign
1019-4	Room 104 - Science - Pod 2 @A	SK	N/A		10/3/2024		-	-	-	Sign
1019-5	Room 104 - Science - Pod 2 @B	SK	N/A		10/3/2024		-	-	-	Sign
1019-6	Room 104 - Science - Pod 2 @C	SK	N/A		10/3/2024		-	-	-	Sign
1019-7	Room 104 - Science - Pod 3 @A	SK	N/A		10/3/2024		-	-	-	Sign
1019-8	Room 104 - Science - Pod 3 @B	SK	N/A		10/3/2024		-	-	-	Sign
1019-9	Room 104 - Science - Pod 3 @C	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1019-10	Room 104 - Science - Counter	SK	N/A		10/3/2024		-	-	-	Sign
1020-1	Girl's Bathroom by Library-Left	SK	N/A		10/3/2024		-	-	-	Sign
1020-2	Girl's Bathroom by Library-Right	SK	N/A		10/3/2024		-	-	-	Sign
1021-1	Faculty Bathroom by Library	SK	N/A		10/3/2024		-	-	-	Sign
1022-1	Hallway by Library	WF	App	<1.0	10/3/2024		-	-	-	-
1022-2	Hallway by Library	BF	App	<1.0	10/3/2024		-	-	-	-
1023-1	Boy's Bathroom by Library	SS	N/A		10/3/2024		-	-	-	Sign
1023-2	Boy's Bathroom by Library-Left	SK	N/A		10/3/2024		-	-	-	Sign
1023-3	Boy's Bathroom by Library-Right	SK	N/A		10/3/2024		-	-	-	Sign
1024-1	Library Office Kitchenette	SK	N/A		10/3/2024		-	-	-	Sign
1025-1	Custodial Closet Room 137	SS	N/A		10/3/2024		-	-	-	Sign
1026-1	Room 138	SK	N/A		10/3/2024		-	-	-	Sign
1026-2	Room 138	WF	App	<1.0	10/3/2024		-	-	-	-
1027-1	Room 140	SK	N/A		10/3/2024		-	-	-	Sign
1027-2	Room 140	WF	App	<1.0	10/3/2024		-	-	-	-
1028-1	Conference Room D	SK	N/A		10/3/2024		-	-	-	Sign
1029-1	Room next to Assistant Principal's Office	SK	N/A	2.0	10/3/2024		-	-	-	Sign
1030-1	Principal's Office Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1031-1	Hallway by Main Office	WF	App	<1.0	10/3/2024		-	-	-	-
1032-2	Hallway by Main Office	BF	App	<1.0	10/3/2024					

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1032-1	Nurse's Office	SK	App	<1.0	10/3/2024		-	-	-	-
1032-2	Nurse's Office Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1033-1	Staff Only Bathroom @A	SK	N/A		10/3/2024		-	-	-	Sign
1033-2	Staff Only Bathroom @B	SK	N/A		10/3/2024		-	-	-	Sign
1034-1	Multipurpose Room	SK	N/A		10/3/2024		-	-	-	Sign
1035-1	Social Worker Room B	SK	N/A		10/3/2024		-	-	-	Sign
1036-1	Room 145	SK	N/A		10/3/2024		-	-	-	Sign
1036-2	Room 145	WF	App	1.0	10/3/2024		-	-	-	-
1036-3	Room 145 Bathroom	SK	N/A		2/9/2023		-	-	-	Sign
1037-1	Room 142	SK	N/A		10/3/2024		-	-	-	Sign
1037-2	Room 142	WF	App	3.0	10/3/2024		-	-	-	-
1037-3	Room 142 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1038-1	Room 143	SK	N/A		10/3/2024		-	-	-	Sign
1038-2	Room 143	WF	App	<1.0	10/3/2024		-	-	-	-
1038-3	Room 143 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1039-1	Room 147	SK	N/A		10/3/2024		-	-	-	Sign
1039-2	Room 147	WF	App	<1.0	10/3/2024		-	-	-	-
1039-3	Room 147 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1040-1	Room 149	SK	N/A		10/3/2024		-	-	-	Sign
1040-2	Room 149	WF	App	<1.0	10/3/2024		-	-	-	-

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1040-3	Room 149 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1041-1	Custodial Closet by Room 150A	SS	N/A		10/3/2024		-	-	-	Sign
1042-1	Room 146A	SK	N/A		10/3/2024		-	-	-	Sign
1042-2	Room 146A	WF	App	3.0	10/3/2024		-	-	-	-
1042-3	Room 146A Bathroom	SK	App	14.0	2/9/2023					Sign
1043-1	Room 150B	SK	N/A		10/3/2024		-	-	-	Sign
1043-2	Room 150B	WF	App	1.0	10/3/2024		-	-	-	-
1043-3	Room 150B Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1044-1	Room 148	SK	N/A		10/3/2024		-	-	-	Sign
1044-2	Room 148	WF	App	1.0	10/3/2024		-	-	-	-
1044-3	Room 148 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1045-1	Boy's Bathroom by Room 148 - Trough 1 @A	SK	N/A		10/3/2024		-	-	-	Sign
1045-2	Boy's Bathroom by Room 148 - Trough 1 @B	SK	N/A		10/3/2024		-	-	-	Sign
1046-1	Girl's Bathroom by Room 148 - Trough 1 @A	SK	N/A		10/3/2024		-	-	-	Sign
1046-2	Girl's Bathroom by Room 148 - Trough 1 @B	SK	N/A		10/3/2024		-	-	-	Sign
1047-1	Faculty Bathroom by Room 148	SK	N/A		10/3/2024		-	-	-	Sign
1048-1	Custodial Closet by Kindergarten	SS	N/A		10/3/2024		-	-	-	Sign
1049-1	Room 151	SK	N/A		10/3/2024		-	-	-	Sign
1049-2	Room 151	WF	App	<1.0	10/3/2024		-	-	-	-
1050-1	Room 152	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1050-2	Room 152	WF	App	<1.0	10/3/2024		-	-	-	-
1051-1	Room 153	SK	N/A		10/3/2024		-	-	-	Sign
1051-2	Room 153	WF	App	<1.0	10/3/2024		-	-	-	-
1052-1	Hallway in Kindergarten	WF	App	5.0	10/3/2024		-	-	-	-
1053-1	Room 154	SK	N/A		10/3/2024		-	-	-	Sign
1053-2	Room 154	WF	App	<1.0	10/3/2024		-	-	-	-
1054-1	Room 155	SK	N/A		10/3/2024		-	-	-	Sign
1054-2	Room 155	WF	App	2.0	10/3/2024		-	-	-	-
1055-1	Room 156	SK	N/A		10/3/2024		-	-	-	Sign
1055-2	Room 156	WF	App	<1.0	10/3/2024		-	-	-	-
1056-1	Room 157	SK	N/A		10/3/2024		-	-	-	Sign
1056-2	Room 157	WF	App	<1.0	10/3/2024		-	-	-	-
1057-1	Hallway by Gym-Right	WF	App	<1.0	10/3/2024		-	-	-	-
1057-2	Hallway by Gym-Right	BF	App	<1.0	10/3/2024					
1058-1	Hallway by Gym-Left	WF	App	<1.0	10/3/2024		-	-	-	-
1059-1	Teacher's Faculty Bathroom in Gym	SK	N/A		10/3/2024		-	-	-	Sign
1060-1	Student Bathroom in Gym	SK	N/A		10/3/2024		-	-	-	Sign
1061-1	Room 163	SK	N/A		10/3/2024		-	-	-	Sign
1062-1	Room 162	SK	N/A		10/3/2024		-	-	-	Sign
1063-1	Room 160	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1064-1	Room 158	SK	N/A		10/3/2024		-	-	-	Sign
1065-1	Room 161	SK	N/A		10/3/2024		-	-	-	Sign
1066-1	Room 159	SK	N/A		10/3/2024		-	-	-	Sign
1067-1	Custodial Closet by Cafeteria	SS	N/A		10/3/2024		-	-	-	Sign
1068-1	Hallway by Cafeteria	WF	App	<1.0	10/3/2024		-	-	-	-
1068-2	Hallway by Cafeteria	BF	App	<1.0	10/3/2024		-	-	-	-
1069-1	Girl's Bathroom by Cafeteria - Trough @A	SK	N/A		10/3/2024		-	-	-	Sign
1069-2	Girl's Bathroom by Cafeteria - Trough @B	SK	N/A		10/3/2024		-	-	-	Sign
1070-1	Faculty Bathroom by Cafeteria	SK	N/A		10/3/2024		-	-	-	Sign
1071-1	Boy's Bathroom by Cafeteria - Trough @A	SK	N/A		10/3/2024		-	-	-	Sign
1071-2	Boy's Bathroom by Cafeteria - Trough @B	SK	N/A		10/3/2024		-	-	-	Sign
2001-1	Room 263	SK	N/A		10/3/2024		-	-	-	Sign
2002-1	Room 262	SK	N/A		10/3/2024		-	-	-	Sign
2003-1	Room 260	SK	N/A		10/3/2024		-	-	-	Sign
2004-1	Room 258	SK	N/A		10/3/2024		-	-	-	Sign
2005-1	Room 261	SK	N/A		10/3/2024		-	-	-	Sign
2006-1	Room 259	SK	N/A		10/3/2024		-	-	-	Sign
2007-1	Second Floor Custodial Closet	SS	N/A		10/3/2024		-	-	-	Sign
2008-1	Second Floor Hallway	WF	App	<1.0	10/3/2024		-	-	-	-
2008-2	Second Floor Hallway	BF	App	<1.0	10/3/2024		-	-	-	-

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
2009-1	Second Floor Girl's Bathroom - Trough @A	SK	N/A		10/3/2024		-	-	-	Sign
2009-2	Second Floor Girl's Bathroom - Trough @B	SK	N/A		10/3/2024		-	-	-	Sign
2010-1	Second Floor Faculty Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
2011-1	Second Floor Boy's Bathroom - Trough @A	SK	N/A		10/3/2024		-	-	-	Sign
2011-2	Second Floor Boy's Bathroom - Trough @B	SK	N/A		10/3/2024		-	-	-	Sign

## Laboratory Report

NYE Report #: 230433-24085

February 10, 2023

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; Nathaniel Woodhull Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 09, 2023. New York Environmental analyzed the samples on February 10, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	09 Feb 2023
Date Received:	09 Feb 2023
Date Analyzed:	10 Feb 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
230209P017	1	Room 106-SK, Initial	0.001	0.024	mg/L	H
230209P018	2	Room 146A Bathroom-SK, Initial	0.001	0.014	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

## Laboratory Report

NYE Report #: 2406212-31380

October 8, 2024

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Flyod UFSD; Nathaniel Woodhull Elementary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 04, 2024. New York Environmental analyzed the samples on October 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241004Q027	1	Kitchen-PF, Initial	0.001	0.003	mg/L	
241004Q028	2	Kitchen Island Food Prep-SK, Initial	0.001	0.003	mg/L	
241004Q029	3	Serving Area in Cafeteria Food Prep-SK, Initial	0.001	0.002	mg/L	
241004Q030	4	Room 132-WF, Initial	0.001	<0.001	mg/L	
241004Q031	5	Room 131-WF, Initial	0.001	<0.001	mg/L	
241004Q032	6	Room 130-WF, Initial	0.001	<0.001	mg/L	
241004Q033	7	Room 129-WF, Initial	0.001	<0.001	mg/L	
241004Q034	8	Room 128-WF, Initial	0.001	<0.001	mg/L	
241004Q035	9	Room 127-WF, Initial	0.001	<0.001	mg/L	
241004Q036	10	Room 126-WF, Initial	0.001	<0.001	mg/L	
241004Q037	11	Room 125 - PTO Room-WF, Initial	0.001	0.012	mg/L	H
241004Q038	12	Room 124-WF, Initial	0.001	<0.001	mg/L	
241004Q039	13	Hallway by Library-WF, Initial	0.001	<0.001	mg/L	
241004Q040	14	Hallway by Library-BF, Initial	0.001	<0.001	mg/L	
241004Q041	15	Room 138-WF, Initial	0.001	<0.001	mg/L	
241004Q042	16	Room 140-WF, Initial	0.001	<0.001	mg/L	
241004Q043	17	Hallway by Main Office-WF, Initial	0.001	<0.001	mg/L	
241004Q044	18	Hallway by Main Office-BF, Initial	0.001	<0.001	mg/L	
241004Q045	19	Nurse's Office-SK, Initial	0.001	<0.001	mg/L	
241004Q046	20	Room 145-WF, Initial	0.001	0.001	mg/L	
241004Q047	21	Room 142-WF, Initial	0.001	0.003	mg/L	
241004Q048	22	Room 143-WF, Initial	0.001	<0.001	mg/L	
241004Q049	23	Room 147-WF, Initial	0.001	<0.001	mg/L	
241004Q050	24	Room 149-WF, Initial	0.001	<0.001	mg/L	
241004Q051	25	Room 146A-WF, Initial	0.001	0.003	mg/L	
241004Q052	26	Room 150B-WF, Initial	0.001	0.001	mg/L	



Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241004Q053	27	Room 148-WF, Initial	0.001	0.001	mg/L	
241004Q054	28	Room 151-WF, Initial	0.001	<0.001	mg/L	
241004Q055	29	Room 152-WF, Initial	0.001	<0.001	mg/L	
241004Q056	30	Room 153-WF, Initial	0.001	<0.001	mg/L	
241004Q057	31	Hallway in Kindergarten-WF, Initial	0.001	0.005	mg/L	
241004Q058	32	Room 154-WF, Initial	0.001	<0.001	mg/L	
241004Q059	33	Room 155-WF, Initial	0.001	0.002	mg/L	
241004Q060	34	Room 156-WF, Initial	0.001	<0.001	mg/L	
241004Q061	35	Room 157-WF, Initial	0.001	<0.001	mg/L	
241004Q062	36	Hallway by Gym-Right-BF, Initial	0.001	<0.001	mg/L	
241004Q063	37	Hallway by Gym-Right-WF, Initial	0.001	<0.001	mg/L	
241004Q064	38	Hallway by Gym-Left-WF, Initial	0.001	<0.001	mg/L	
241004Q065	39	Hallway by Cafeteria-WF, Initial	0.001	<0.001	mg/L	
241004Q066	40	Hallway by Cafeteria-BF, Initial	0.001	<0.001	mg/L	
241004Q067	41	Second Floor Hallway-WF, Initial	0.001	<0.001	mg/L	
241004Q068	42	Second Floor Hallway-BF, Initial	0.001	<0.001	mg/L	
241004Q069	43	Room next to Assistant Principal's Office-SK, Initial	0.001	0.002	mg/L	

**Comment:**

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

## Appendix D

Tangier Smith Elementary School

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1001-01	Kitchen Handwash	SK	N/A		10/3/2024					Sign
1001-02	Kitchen Hose Hook	OS	N/A		10/3/2024					Sign
1001-03	Kitchen Dishwash 3-Bay - Left	SK	N/A		10/3/2024					Sign
1001-04	Kitchen Dishwash 3-Bay - Right	SK	N/A		10/3/2024					Sign
1001-05	Kitchen Dishwash 3-Bay	SPY	N/A		10/3/2024					Sign
1001-06	Kitchen	PF	App	7.0	10/3/2024					Removed from Service Pending Remediation
1001-07	Kitchen Food Prep	SK	App	7.0	10/3/2024					Removed from Service Pending Remediation
1001-08	Kitchen 2-Bay	SK	App	5.0	10/3/2024		-	-	-	-
1001-09	Kitchen Bathroom	SK	N/A		10/3/2024					Sign
1001-10	Kitchen Custodial Closet	SS	N/A		10/3/2024					Sign
1002-01	Serving Area - North Prep Sink	SK	App	7.0	10/3/2024					Removed from Service Pending Remediation
1002-02	Serving Area - North Handwash	SK	N/A		10/3/2024					Sign
1003-01	Serving Area - South Handwash	SK	N/A		10/3/2024					Sign
1003-02	Serving Area - South Prep Sink	SK	App	3.0	10/3/2024		-	-	-	-
1004-01	Girl's Bathroom - Pod 4 - Trough @A	SK	N/A		10/3/2024					Sign
1004-02	Girl's Bathroom - Pod 4 - Trough @B	SK	N/A		10/3/2024					Sign
1005-01	Hallway in Pod 4	WF	App	<1.0	2/8/2023		-	-	-	
1005-2	Hallway in Pod 4	BF	App	<1.0	10/3/2024					
1006-01	Boy's Bathroom - Pod 4	SK	N/A		10/3/2024					Sign
1006-02	Boy's Bathroom - Pod 4 - Custodial Closet	SS	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1007-01	Women's Bathroom - Pod 4	SK	N/A		10/3/2024					Sign
1008-01	Men's Bathroom - Pod 4	SK	N/A		10/3/2024					Sign
1009-01	Room 32	SK	N/A		10/3/2024					Sign
1010-01	Room 31	SK	N/A	9.0	2/8/2023					Sign
1011-01	Room 30	SK	N/A		10/3/2024					Sign
1012-01	Room 29	SK	N/A	6.0	2/8/2023					Sign
1013-01	Room 28	SK	N/A		10/3/2024					Sign
1014-01	Room 27	SK	N/A		10/3/2024					Sign
1015-01	Room 26	SK	N/A	11.0	2/8/2023					Sign
1016-01	Room 25	SK	N/A	9.0	2/8/2023					Sign
1017-01	Teacher's Lounge Kitchenette	SK	App	5.0	10/3/2024		-	-	-	-
1017-02	Teacher's Lounge Kitchenette	SPY	App	3.0	10/3/2024		-	-	-	-
1018-01	Men's Bathroom by Faculty Room	SK	N/A		10/3/2024					Sign
1019-01	Women's Bathroom by Faculty Room	SK	N/A		10/3/2024					Sign
1020-01	Nurse's Office	SK	App	5.0	10/3/2024		-	-	-	-
1020-02	Nurse's Office Bathroom	SK	N/A		10/3/2024					Sign
1021-01	Main Office	WF	App		2/8/2023		-	-	-	Non-functional
1021-02	Main Office Bathroom	SK	N/A		10/3/2024					Sign
1021-3	Principal's Office Bathroom	SK	N/A		10/3/2024					Sign
1022-01	Girl's Bathroom - Pod 1 - Left	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1022-02	Girl's Bathroom - Pod 1 - Right	SK	N/A		10/3/2024					Sign
1023-01	Hallway of Pod 1	WF	App	<1.0	10/3/2024		-	-	-	-
1023-02	Hallway of Pod 1	BF	App	<1.0	10/3/2024		-	-	-	-
1024-01	Boy's Bathroom - Pod 1 - Left	SK	N/A		10/3/2024					Sign
1024-02	Boy's Bathroom - Pod 1 - Right	SK	N/A		10/3/2024					Sign
1024-3	Boy's Bathroom - Pod 1 - Custodial Closet	SS	N/A		10/3/2024					Sign
1025-01	Women's Bathroom - Pod 1	SK	N/A		10/3/2024					Sign
1026-01	Men's Bathroom - Pod 1	SK	N/A		10/3/2024					Sign
1027-01	Pod 1 by Electric Room	WF	App		2/8/2023		-	-	-	Non-functional
1028-01	Room 8	SK	N/A	15.0	2/8/2023					Sign
1029-01	Room 7	SK	N/A		10/3/2024					Sign
1030-01	Room 6	SK	N/A		10/3/2024					Sign
1031-01	Room 5	SK	N/A		10/3/2024					Sign
1032-01	Room 4	SK	N/A	219.0	2/8/2023					Sign
1033-01	Room 3	SK	N/A		10/3/2024					Sign
1034-01	Room 2	SK	N/A		10/3/2024					Sign
1035-01	Room 1	SK	N/A		10/3/2024					Sign
1082-1	Room A	SK	N/A		10/3/2024					Sign
1082-2	Room A	WF	App	3.0	10/3/2024					Removed from Service Pending Remediation
1083-1	Room B	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1083-2	Room B	WF	App	71.0	10/3/2024					Removed from Service Pending Remediation
1084-1	Room C	SK	N/A		10/3/2024					Sign
1084-2	Room C	WF	App	17.0	10/3/2024					Removed from Service Pending Remediation
1036-01	Room 36	SK	N/A		10/3/2024					Sign
1036-02	Room 36	WF	App		2/8/2023		-	-	-	Non-functional
1037-01	Room 35	SK	N/A		10/3/2024					Sign
1037-02	Room 35	WF	App		2/8/2023		-	-	-	Non-functional
1038-01	Room 34	SK	N/A		10/3/2024					Sign
1038-02	Room 34	WF	App		2/8/2023		-	-	-	Non-functional
1039-01	Girl's Bathroom - Pod 2 - Trough @A	SK	N/A		10/3/2024					Sign
1039-02	Girl's Bathroom - Pod 2 - Trough @B	SK	N/A		10/3/2024					Sign
1040-01	Hallway of Pod 2	WF	App	<1.0	10/3/2024		-	-	-	-
1040-01	Hallway of Pod 2	BF	App	<1.0	10/3/2024					
1041-01	Boy's Bathroom - Pod 2	SK	N/A		10/3/2024					Sign
1041-02	Boy's Bathroom - Pod 2 - Custodial Closet	SS	N/A		10/3/2024					Sign
1042-01	Women's Bathroom - Pod 2	SK	N/A		10/3/2024					Sign
1043-01	Men's Bathroom - Pod 2	SK	N/A		10/3/2024					Sign
1044-01	Room 16	SK	N/A	187.0	2/8/2023					Sign
1045-01	Room 15	SK	N/A	102.0	2/8/2023					Sign
1046-01	Room 14	SK	N/A	40.0	2/8/2023					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1047-01	Room 13	SK	N/A	22.0	2/8/2023					Sign
1048-01	Room 12	SK	N/A	40.0	2/8/2023					Sign
1049-01	Room 11	SK	N/A	40.0	2/8/2023					Sign
1050-01	Room 10	SK	N/A	117.0	2/8/2023					Sign
1051-01	Room 9	SK	N/A	38.0	2/8/2023					Sign
1052-01	Room 33	SK	N/A		10/3/2024					Sign
1053-01	Gym Locker Room	WF	App	20.0	2/8/2023					Removed from Service
1053-02	Gym Locker Room Bathroom	SK	N/A		2/8/2023		-	-	-	Sign
1054-01	Coach's Office Bathroom by Room 35	SK	N/A		10/3/2024					Sign
1055-01	Coach's Office Bathroom by Library	SK	N/A		10/3/2024					Sign
1056-01	Room 102	SK	N/A		10/3/2024					Sign
1057-01	Room 115	SK	N/A		10/3/2024					Sign
1058-01	Room 116	SK	N/A		10/3/2024					Sign
1059-01	Room 117	SK	N/A		10/3/2024					Sign
1060-01	Boy's Bathroom - New Wing - Trough @A	SK	N/A		10/3/2024					Sign
1060-02	Boy's Bathroom - New Wing - Trough @B	SK	N/A		10/3/2024					Sign
1060-3	Boy's Bathroom - New Wing - Trough @C	SK	N/A		10/3/2024					Sign
1061-01	Hallway of New Wing	WF	App	<1.0	10/3/2024		-	-	-	
1061-02	Hallway of New Wing	BF	App	<1.0	10/3/2024		-	-	-	-
1062-01	Girl's Bathroom - New Wing - Trough @A	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1062-02	Girl's Bathroom - New Wing - Trough @B	SK	N/A		10/3/2024					Sign
1062-3	Girl's Bathroom - New Wing - Trough @C	SK	N/A		10/3/2024					Sign
1063-01	Custodial Closet - New Wing	SS	N/A		10/3/2024					Sign
1064-01	Men's Bathroom - New Wing	SK	N/A		10/3/2024					Sign
1065-01	Women's Bathroom - New Wing	SK	N/A		10/3/2024					Sign
1066-01	Room 37 Art @A	SK	N/A		10/3/2024					Sign
1066-02	Room 37 Art @B	SK	N/A	109.0	2/8/2023					Sign
1066-3	Room 37 Art @C	SK	N/A		10/3/2024					Sign
1066-4	Room 37 Art @D	SK	N/A		10/3/2024					Sign
1067-01	Girl's Bathroom - Pod 3 - Left	SK	N/A		10/3/2024					Sign
1067-02	Girl's Bathroom - Pod 3 - Right	SK	N/A		10/3/2024					Sign
1068-01	Hallway of Pod 3	WF	App	<1.0	10/3/2024		-	-	-	-
1068-2	Hallway of Pod 3	BF	App	<1.0	10/3/2024					
1069-01	Boy's Bathroom - Pod 3 - Left	SK	App		10/3/2024		-	-	-	-
1069-02	Boy's Bathroom - Pod 3 - Right	SK	App		10/3/2024		-	-	-	-
1069-3	Boy's Bathroom - Pod 3 - Custodial Closet	SS	N/A		10/3/2024					Sign
1070-01	Women's Bathroom - Pod 3	SK	N/A		10/3/2024					Sign
1071-01	Men's Bathroom - Pod 3	SK	N/A		10/3/2024					Sign
1072-01	Hallway of Pod 3 by Electric Room	WF	App		2/8/2023		-	-	-	Removed from Service
1073-01	Room 24	SK	N/A	59.0	2/8/2023					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1074-01	Room 23	SK	N/A		10/3/2024					Sign
1075-01	Room 22	SK	N/A	40.0	2/8/2023					Sign
1076-01	Room 21	SK	N/A		10/3/2024					Sign
1077-01	Room 20	SK	N/A	21.0	2/8/2023					Sign
1078-01	Room 19	SK	N/A		10/3/2024					Sign
1079-01	Room 18	SK	N/A	23.0	2/8/2023					Sign
1080-01	Room 17	SK	N/A		10/3/2024					Sign
1081-01	Custodial Office Bathroom	SK	N/A		10/3/2024					Sign

## Laboratory Report

NYE Report #: 230437-24089

February 13, 2023

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; Tangier Smith Elementary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 09, 2023. New York Environmental analyzed the samples on February 10, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	08 Feb 2023
Date Received:	09 Feb 2023
Date Analyzed:	10 Feb 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
230209P034	1	Kitchen-PF, Initial	0.001	0.026	mg/L	H
230209P035	2	Room 31-SK, Initial	0.001	0.009	mg/L	H
230209P036	3	Room 29-SK, Initial	0.001	0.006	mg/L	H
230209P037	4	Room 26-SK, Initial	0.001	0.011	mg/L	H
230209P038	5	Room 25-SK, Initial	0.001	0.009	mg/L	H
230209P039	6	Room 18-SK, Initial	0.001	0.023	mg/L	H
230209P040	7	Room 20-SK, Initial	0.001	0.021	mg/L	H
230209P041	8	Room 22-SK, Initial	0.001	0.040	mg/L	H
230209P042	9	Room 24-SK, Initial	0.001	0.059	mg/L	E,H
230209P043	10	Room 37 Art @B-SK, Initial	0.001	0.109	mg/L	E,H
230209P044	11	Gym Locker Room-WF, Initial	0.001	0.020	mg/L	H
230209P045	12	Room 9-SK, Initial	0.001	0.038	mg/L	H
230209P046	13	Room 10-SK, Initial	0.001	0.117	mg/L	E,H
230209P047	14	Room 11-SK, Initial	0.001	0.040	mg/L	H
230209P048	15	Room 12-SK, Initial	0.001	0.040	mg/L	H
230209P049	16	Room 13-SK, Initial	0.001	0.022	mg/L	H
230209P050	17	Room 14-SK, Initial	0.001	0.040	mg/L	H
230209P051	18	Room 15-SK, Initial	0.001	0.102	mg/L	E,H
230209P052	19	Room 16-SK, Initial	0.001	0.187	mg/L	E,H
230209P053	20	Room 4-SK, Initial	0.001	0.219	mg/L	E,H
230209P054	21	Room 8-SK, Initial	0.001	0.015	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.



## Laboratory Report

NYE Report #: 2406210-31378

October 8, 2024

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; Tangier Smith Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 04, 2024. New York Environmental analyzed the samples on October 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241004M056	1	Kitchen-PF, Initial	0.001	0.007	mg/L	H
241004M057	2	Kitchen Food Prep-SK, Initial	0.001	0.007	mg/L	H
241004M058	3	Kitchen 2-Bay-SK, Initial	0.001	0.005	mg/L	
241004M059	4	Serving Area - North Prep Sink-SK, Initial	0.001	0.007	mg/L	H
241004M060	5	Serving Area - South Prep Sink-SK, Initial	0.001	0.003	mg/L	
241004M061	6	Hallway in Pod 4-BF, Initial	0.001	<0.001	mg/L	
241004M062	7	Hallway in Pod 4-WF, Initial	0.001	<0.001	mg/L	
241004M063	8	Teacher's Lounge Kitchenette-SK, Initial	0.001	0.005	mg/L	
241004M064	9	Teacher's Lounge Kitchenette-SPY, Initial	0.001	0.003	mg/L	
241004M065	10	Nurse's Office-SK, Initial	0.001	0.005	mg/L	
241004M066	11	Hallway of Pod 1-BF, Initial	0.001	<0.001	mg/L	
241004M067	12	Hallway of Pod 1-WF, Initial	0.001	<0.001	mg/L	
241004M068	13	Room A-WF, Initial	0.001	0.003	mg/L	
241004M069	14	Room B-WF, Initial	0.001	0.071	mg/L	E,H
241004M070	15	Room C-WF, Initial	0.001	0.017	mg/L	H
241004M071	16	Hallway of Pod 2-BF, Initial	0.001	<0.001	mg/L	
241004M072	17	Hallway of Pod 2-WF, Initial	0.001	<0.001	mg/L	
241004M073	18	Hallway of New Wing-BF, Initial	0.001	<0.001	mg/L	
241004M074	19	Hallway of Pod 3-BF, Initial	0.001	0.001	mg/L	
241004M075	20	Hallway of Pod 3-WF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.



## Appendix E

William Floyd Elementary School

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1001-1	Kitchen Office Handwash	SK	N/A		10/3/2024		-	-	-	Sign
1001-2	Kitchen 3 Bay @ A	SK	N/A		10/3/2024		-	-	-	Sign
1001-3	Kitchen 3 Bay @ B	SK	N/A		10/3/2024		-	-	-	Sign
1001-4	Kitchen Potfiller	SP	App	3.0	10/3/2024		-	-	-	-
1001-5	Kitchen Potfiller	SPY	App	3.0	10/3/2024		-	-	-	-
1001-6	Kitchen Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1002-1	Cafeteria Staff Room	SK	App	<1.0	10/3/2024		-	-	-	-
1003-1	Girls Bathroom by Room 105 @ A	SK	N/A		10/3/2024		-	-	-	Sign
1003-2	Girls Bathroom by Room 105 @ B	SK	N/A		10/3/2024		-	-	-	Sign
1003-3	Girls Bathroom by Room 105 @ C	SK	N/A		10/3/2024		-	-	-	Sign
1003-4	Girls Bathroom by Room 105 @ D	SK	N/A		10/3/2024		-	-	-	Sign
1004-1	Hall by Room 105	BF	App	<1.0	10/3/2024		-	-	-	-
1004-2	Hall by Room 105	WF	App	<1.0	10/3/2024		-	-	-	-
1005-1	Boys Bathroom by Room 105 @ A	SK	N/A		10/3/2024		-	-	-	Sign
1005-2	Boys Bathroom by Room 105 @ B	SK	N/A		10/3/2024		-	-	-	Sign
1005-3	Boys Bathroom by Room 105 @ C	SK	N/A		10/3/2024		-	-	-	Sign
1006-1	Custodian Closet by Room 105	SS	N/A		10/3/2024		-	-	-	Sign
1007-1	Room 100	SK	N/A		10/3/2024		-	-	-	Sign
1008-1	Staff Bathroom by Room 115	SK	N/A		10/3/2024		-	-	-	Sign
1009-1	Nurses Office 116	SK	App	<1.0	10/3/2024		-	-	-	-

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1009-2	Nurses Office 116 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1010-1	Library Media Center Office	SK	N/A		10/3/2024		-	-	-	Sign
1011-1	Room 125 Custodian Office Bathroom @ A	SK	N/A	22.0	2/9/2023					Sign
1011-2	Room 125 Custodian Office Bathroom @ B	SK	N/A	16.0	2/9/2023					Sign
1012-1	Room 126 Student Bathroom @ A	SK	N/A		10/3/2024		-	-	-	Sign
1012-2	Room 126 Student Bathroom @ B	SK	N/A		10/3/2024		-	-	-	Sign
1012-3	Room 126 Girls Gym Office Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1013-1	Boys Gym Office Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1014-1	Art Room 300	SK	N/A		10/3/2024		-	-	-	Sign
1014-2	Art Rom 300 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1015-1	Hall by Art Room 300	WF	App	<1.0	10/3/2024		-	-	-	-
1016-1	Room 301A Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1017-1	Staff Bathroom by Nurses Office 323	SK	N/A		10/3/2024		-	-	-	Sign
1018-1	Custodian Closet by Nurses Office 323	SS	N/A		10/3/2024		-	-	-	Sign
1019-1	Nurses Office 323	SK	App	<1.0	10/3/2024		-	-	-	-
1019-2	Nurses Office 323 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1020-1	Room 303	SK	N/A		10/3/2024		-	-	-	Sign
1021-1	Room 304	SK	N/A		10/3/2024		-	-	-	Sign
1021-2	Room 304	SPY	N/A		10/3/2024		-	-	-	Removed from Service
1022-1	Hall by Room 304	WF	App	<1.0	10/3/2024		-	-	-	-

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1023-1	Room 305	SK	N/A		10/3/2024		-	-	-	Sign
1023-2	Room 305	SPY	N/A		10/3/2024		-	-	-	Removed from Service
1024-1	Room 306	SK	N/A		10/3/2024		-	-	-	Sign
1024-2	Room 306	SPY	N/A		10/3/2024		-	-	-	Removed from Service
1025-1	Faculty Bathroom by Room 315	SK	N/A		10/3/2024		-	-	-	Sign
1026-1	Room 307	SK	N/A		10/3/2024		-	-	-	Sign
1026-2	Room 307	SPY	N/A		10/3/2024		-	-	-	Removed from Service
1027-1	Room 308	SK	N/A		10/3/2024		-	-	-	Sign
1027-2	Room 308	SPY	N/A		10/3/2024		-	-	-	Removed from Service
1028-1	Faculty Bathroom by Room 313	SK	N/A		10/3/2024		-	-	-	Sign
1029-1	Custodian Closet by Room 313	SS	N/A		10/3/2024		-	-	-	Sign
1030-1	Room 309	SK	N/A		10/3/2024		-	-	-	Sign
1031-1	Room 310	SK	N/A		10/3/2024		-	-	-	Sign
1032-1	Room 311	SK	N/A		10/3/2024		-	-	-	Sign
1032-2	Room 311	SPY	N/A		10/3/2024		-	-	-	Removed from Service
1033-1	Room 312	SK	N/A		10/3/2024		-	-	-	Sign
1034-1	Hallway by Room 310	WF	App	<1.0	10/3/2024		-	-	-	-
1035-1	Room 145 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1036-1	Hallway by Room 142	WF	App	<1.0	10/3/2024		-	-	-	-
1037-1	Boys Bathroom by Room 142 @ A	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1037-2	Boys Bathroom by Room 142 @ B	SK	N/A		10/3/2024		-	-	-	Sign
1038-1	Room 143 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1039-1	Main Office Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1040-1	Girls Bathroom by Room 163 @ A	SK	N/A		10/3/2024		-	-	-	Sign
1040-2	Girls Bathroom by Room 163 @ B	SK	N/A		10/3/2024		-	-	-	Sign
1040-3	Girls Bathroom by Room 163 @ C	SK	N/A		10/3/2024		-	-	-	Sign
1041-1	Hallway by Room 163	BF	App	<1.0	10/3/2024		-	-	-	-
1041-2	Hallway by Room 163	WF	App	<1.0	10/3/2024		-	-	-	-
1042-1	Room 163	SK	N/A		10/3/2024		-	-	-	Sign
1042-2	Room 163 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1043-1	Room 171	SK	N/A		10/3/2024		-	-	-	Sign
1044-1	Room 172	SK	N/A		10/3/2024		-	-	-	Sign
1045-1	Girls Bathroom by Room 172 @ A	SK	N/A		10/3/2024		-	-	-	Sign
1045-2	Girls Bathroom by Room 172 @ B	SK	N/A		10/3/2024		-	-	-	Sign
1046-1	Faculty Bathroom by Room 172	SK	N/A		10/3/2024		-	-	-	Sign
1047-1	Hallway by Room 172	WF	App	<1.0	10/3/2024		-	-	-	
1047-2	Hallway by Room 172	BF	App	<1.0	10/3/2024					
1048-1	Boys Bathroom by Room 172 Custodian Closet	SS	N/A		10/3/2024		-	-	-	Sign
1048-2	Boys Bathroom by Room 172 @ A	SK	N/A		10/3/2024		-	-	-	Sign
1048-3	Boys Bathroom by Room 172 @ B	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1049-1	Room 173	SK	N/A		10/3/2024		-	-	-	Sign
1050-1	Room 174	SK	N/A		10/3/2024		-	-	-	Sign
1051-1	Room 175	SK	N/A		10/3/2024		-	-	-	Sign
1052-1	Room 176	SK	N/A		10/3/2024		-	-	-	Sign
1053-1	Room 177	SK	N/A		10/3/2024		-	-	-	Sign
1054-1	Room 178	WF	N/A		10/3/2024		-	-	-	Sign
1054-2	Room 178	SK	N/A		10/3/2024		-	-	-	Sign
1054-3	Room 178 Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1055-1	Room 181	SK	N/A		10/3/2024		-	-	-	Sign
1056-1	Room 186	WF	App	15.0	10/3/2024					Removed from Service Pending Remediation
1056-2	Room 186	SK	N/A		10/3/2024		-	-	-	Sign
1057-1	Room 187	WF	App	3.0	10/3/2024		-	-	-	-
1057-2	Room 187	SK	N/A		10/3/2024		-	-	-	Sign
1058-1	Room 188	WF	App	3.0	10/3/2024		-	-	-	-
1058-2	Room 188	SK	N/A		10/3/2024		-	-	-	Sign
1059-1	Room 189	WF	App	1.0	10/3/2024		-	-	-	-
1059-2	Room 189	SK	N/A		10/3/2024		-	-	-	Sign
2001-1	Art Room 202	SK	N/A		10/3/2024		-	-	-	Sign
2002-1	Custodian Closet by Room 202	SS	N/A		10/3/2024		-	-	-	Sign
2003-1	Boys Bathroom by Room 205 @ A	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
2003-2	Boys Bathroom by Room 205 @ B	SK	N/A		10/3/2024		-	-	-	Sign
2003-3	Boys Bathroom by Room 205 @ C	SK	N/A		10/3/2024		-	-	-	Sign
2004-1	Hallway by Room 205	WF	App	<1.0	10/3/2024		-	-	-	
2004-2	Hallway by Room 205	BF	App	<1.0	10/3/2024					
2005-1	Girls Bathroom by Room 205 Unit 1 @ A	SK	N/A		10/3/2024		-	-	-	Sign
2005-2	Girls Bathroom by Room 205 Unit 1 @ B	SK	N/A		10/3/2024		-	-	-	Sign
2005-3	Girls Bathroom by Room 205 Unit 2 @ A	SK	N/A		10/3/2024		-	-	-	Sign
2005-4	Girls Bathroom by Room 205 Unit 2 @ B	SK	N/A		10/3/2024		-	-	-	Sign
2006-1	Boys Bathroom by Room 228 @ A	SK	N/A		10/3/2024		-	-	-	Sign
2006-2	Boys Bathroom by Room 228 @ B	SK	N/A		10/3/2024		-	-	-	Sign
2007-1	Girls Bathroom by Room 228 @ A	SK	N/A		10/3/2024		-	-	-	Sign
2007-2	Girls Bathroom by Room 228 @ B	SK	N/A		10/3/2024		-	-	-	Sign
2007-3	Girls Bathroom by Room 228 @ C	SK	N/A		10/3/2024		-	-	-	Sign
2008-1	Hallway by Room 231	WF	App	<1.0	10/3/2024		-	-	-	-
2008-2	Hallway by Room 231	BF	App	<1.0	10/3/2024					
2009-1	Room 233	SK	N/A		10/3/2024		-	-	-	Sign
2010-1	Girls Bathroom by Room 242 @ A	SK	N/A		10/3/2024		-	-	-	Sign
2010-2	Girls Bathroom by Room 242 @ B	SK	N/A		10/3/2024		-	-	-	Sign
2011-1	Faculty Bathroom Room 242	SK	N/A		10/3/2024		-	-	-	Sign
2012-1	Hallway by Room 242	WF	App	<1.0	10/3/2024		-	-	-	-

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
2012-2	Hallway by Room 242	BF	App	<1.0	10/3/2024					
2013-1	Boys Bathroom by Room 242 Custodian Closet	SS	N/A		10/3/2024		-	-	-	Sign
2013-2	Boys Bathroom by Room 242 @ A	SK	N/A		10/3/2024		-	-	-	Sign
2013-3	Boys Bathroom by Room 242 @ B	SK	N/A		10/3/2024		-	-	-	Sign

## Laboratory Report

NYE Report #: 230434-24086

February 13, 2023

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; William Floyd Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 09, 2023. New York Environmental analyzed the samples on February 10, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	09 Feb 2023
Date Received:	09 Feb 2023
Date Analyzed:	10 Feb 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
230209P019	1	Room 125 Custodian Office Bathroom @ A-SK, Initial	0.001	0.022	mg/L	H
230209P020	2	Room 125 Custodian Office Bathroom @ B-SK, Initial	0.001	0.016	mg/L	H
230209P021	3	Hall by Art Room 300-WF, Initial	0.001	0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

## Laboratory Report

NYE Report #: 2406213-31381

October 8, 2024

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Flyod UFSD; William Flyod Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 04, 2024. New York Environmental analyzed the samples on October 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241004Q070	1	Hallway by Room 205-BF, Initial	0.001	<0.001	mg/L	
241004Q071	2	Hallway by Room 205-WF, Initial	0.001	<0.001	mg/L	
241004Q072	3	Hallway by Room 231-BF, Initial	0.001	0.003	mg/L	
241004Q073	4	Hallway by Room 231-WF, Initial	0.001	<0.001	mg/L	
241004Q074	5	Hallway by Room 242-BF, Initial	0.001	<0.001	mg/L	
241004Q075	6	Hallway by Room 242-WF, Initial	0.001	<0.001	mg/L	
241004Q076	7	Kitchen Potfiller-SP, Initial	0.001	0.003	mg/L	
241004Q077	8	Kitchen Potfiller -SPY, Initial	0.001	0.003	mg/L	
241004Q078	9	Cafeteria Staff Room-SK, Initial	0.001	<0.001	mg/L	
241004Q079	10	Hall by Room 105-BF, Initial	0.001	<0.001	mg/L	
241004Q080	11	Hall by Room 105-WF, Initial	0.001	<0.001	mg/L	
241004Q081	12	Nurses Office 116-SK, Initial	0.001	<0.001	mg/L	
241004Q082	13	Hall by Art Room 300-WF, Initial	0.001	<0.001	mg/L	
241004Q083	14	Nurses Office 323-SK, Initial	0.001	<0.001	mg/L	
241004Q084	15	Hall by Room 304-WF, Initial	0.001	<0.001	mg/L	
241004Q085	16	Hallway by Room 310-WF, Initial	0.001	<0.001	mg/L	
241004Q086	17	Hallway by Room 142-BF, Initial	0.001	<0.001	mg/L	
241004Q087	18	Hallway by Room 142-WF, Initial	0.001	<0.001	mg/L	
241004Q088	19	Hallway by Room 163-BF, Initial	0.001	<0.001	mg/L	
241004Q089	20	Hallway by Room 163-WF, Initial	0.001	<0.001	mg/L	
241004Q090	21	Hallway by Room 172-BF, Initial	0.001	<0.001	mg/L	
241004Q091	22	Hallway by Room 172-WF, Initial	0.001	<0.001	mg/L	
241004Q092	23	Room 186-WF, Initial	0.001	0.015	mg/L	H
241004Q093	24	Room 187-WF, Initial	0.001	0.003	mg/L	
241004Q094	25	Room 188-WF, Initial	0.001	0.003	mg/L	
241004Q095	26	Room 189-WF, Initial	0.001	0.001	mg/L	



Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

**Lab ID**    **CID**    **Sample Location/Description**    **LOQ**    **Result**    **Units**    **Flag**

Comment:

CID: Client ID    LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.



## Appendix F

William Floyd Middle School

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1001-1	Kitchen Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1001-2	Kitchen Handwash @ A	SK	N/A		10/3/2024		-	-	-	Sign
1001-3	Kitchen 2-Bay	SK	App	<1.0	10/3/2024		-	-	-	-
1001-4	Kitchen Handwash @ B	SK	N/A		10/3/2024		-	-	-	Sign
1001-5	Kitchen - left	PF	App	9.0	10/3/2024					Removed from Service Pending Remediation
1001-6	Kitchen - right	PF	App	2.0	10/3/2024		-	-	-	-
1001-7	Kitchen Island	SK	App	<1.0	10/3/2024		-	-	-	-
1001-8	Kitchen 3-Bay @ A	SK	N/A		10/3/2024		-	-	-	Sign
1001-9	Kitchen 3-Bay @ B	SK	N/A		10/3/2024		-	-	-	Sign
1001-10	Kitchen Closet	SS	N/A		10/3/2024		-	-	-	Sign
1001-11	Kitchen Closet	SPY	N/A		10/3/2024		-	-	-	Sign
1001-12	Kitchen Serving Line Handwash	SK	N/A		10/3/2024		-	-	-	Sign
1001-13	Kitchen Serving Line @ A	SK	App	1.0	10/3/2024		-	-	-	-
1001-14	Kitchen Serving Line @ B	SK	App	3.0	10/3/2024		-	-	-	-
1002-1	Hall by Cafeteria	IM	App	<1.0	10/3/2024		-	-	-	-
1003-1	Girl's Locker Room	WF	App	2.0	10/3/2024		-	-	-	-
1003-2	Girl's Locker Room Coach's Office Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1003-3	Girl's Locker Room Bathroom @ A	SK	N/A		10/3/2024		-	-	-	Sign
1003-4	Girl's Locker Room Bathroom @ B	SK	N/A		10/3/2024		-	-	-	Sign
1003-5	Girl's Locker Room Bathroom @ C	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1004-1	Boy's Locker Room	WF	App	<1.0	10/3/2024		-	-	-	-
1004-2	Boy's Locker Room Coach's Office Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1004-3	Boy's Locker Room Bathroom @ A	SK	N/A		10/3/2024		-	-	-	Sign
1004-4	Boy's Locker Room Bathroom @ B	SK	N/A		10/3/2024		-	-	-	Sign
1004-5	Boy's Locker Room Bathroom @ C	SK	N/A		10/3/2024		-	-	-	Sign
1005-1	Custodial Break Room	SK	N/A		10/3/2024		-	-	-	Sign
1006-1	Hall by Cafeteria - left	WF	App	<1.0	10/3/2024		-	-	-	
1006-2	Hall by Cafeteria - left	BF	App	<1.0	10/3/2024		-	-	-	-
1007-1	Girl's Bathroom by Cafeteria @ A	SK	N/A		10/3/2024		-	-	-	Sign
1007-2	Girl's Bathroom by Cafeteria @ B	SK	N/A		10/3/2024		-	-	-	Sign
1007-3	Girl's Bathroom by Cafeteria @ C	SK	N/A		10/3/2024		-	-	-	Sign
1007-4	Girl's Bathroom by Cafeteria @ D	SK	N/A		10/3/2024		-	-	-	Sign
1008-1	Custodial Closet by Cafeteria	SS	N/A		10/3/2024		-	-	-	Sign
1009-1	Boy's Bathroom by Cafeteria @ A	SK	N/A		10/3/2024		-	-	-	Sign
1009-2	Boy's Bathroom by Cafeteria @ B	SK	N/A		10/3/2024		-	-	-	Sign
1009-3	Boy's Bathroom by Cafeteria @ C	SK	N/A		10/3/2024		-	-	-	Sign
1009-4	Boy's Bathroom by Cafeteria @ D	SK	N/A		10/3/2024		-	-	-	Sign
1010-1	Boy's Bathroom by Stage @ A	SK	N/A		10/3/2024		-	-	-	Sign
1010-2	Boy's Bathroom by Stage @ B	SK	N/A		10/3/2024		-	-	-	Sign
1010-3	Boy's Bathroom by Stage @ C	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1010-4	Boy's Bathroom by Stage @ D	SK	N/A		10/3/2024		-	-	-	Sign
1011-1	Custodial Closet by Stage	SS	N/A		10/3/2024		-	-	-	Sign
1012-1	Girl's Bathroom by Stage @ A	SK	N/A		10/3/2024		-	-	-	Sign
1012-2	Girl's Bathroom by Stage @ B	SK	N/A		10/3/2024		-	-	-	Sign
1012-3	Girl's Bathroom by Stage @ C	SK	N/A		10/3/2024		-	-	-	Sign
1012-4	Girl's Bathroom by Stage @ D	SK	N/A		10/3/2024		-	-	-	Sign
1013-1	Hall by Stage - left	WF	App	<1.0	10/3/2024		-	-	-	-
1013-2	Hall by Stage - right	WF	App	<1.0	10/3/2024		-	-	-	-
1014-1	Faculty Room	SK	App	2.0	10/3/2024		-	-	-	-
1015-1	Room 501	SK	N/A		10/3/2024		-	-	-	Sign
1016-1	Hall by Auditorium - left	WF	App	<1.0	10/3/2024		-	-	-	-
1016-2	Hall by Auditorium - right	WF	App	<1.0	10/3/2024		-	-	-	-
1017-1	Nurse's Office	SK	App	1.0	10/3/2024		-	-	-	-
1017-2	Nurse's Office Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1018-1	Main Office - left	WF	App		10/3/2024		-	-	-	Removed from Service
1018-2	Main Office - right	WF	App		10/3/2024		-	-	-	Removed from Service
1018-3	Main Office Kitchenette	SK	App	<1.0	10/3/2024		-	-	-	-
1018-4	Main Office Men's Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1018-5	Main Office Women's Bathroom	SK	N/A		10/3/2024		-	-	-	Sign
1018-6	Main Office Principal's Bathroom	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1019-1	Library	SK	App	<1.0	10/3/2024		-	-	-	-
1020-1	Custodial Closet by Main Office	SS	N/A		10/3/2024		-	-	-	Sign
1021-1	Men's Faculty Bathroom A Wing	SK	N/A		10/3/2024		-	-	-	Sign
1022-1	Women's Faculty Bathroom A Wing	SK	N/A		10/3/2024		-	-	-	Sign
1023-1	Room 201 Unit @ A	SK	N/A		10/3/2024		-	-	-	Sign
1023-2	Room 201 Unit @ B	SK	N/A		10/3/2024		-	-	-	Sign
1023-3	Room 201	SK	N/A		10/3/2024		-	-	-	Sign
1024-1	Hall by Room 213	WF	App	<1.0	10/3/2024		-	-	-	-
1025-1	Custodial Closet by Room 213	SS	N/A		10/3/2024		-	-	-	Sign
1026-1	Men's Faculty Bathroom by Room 213	SK	N/A		10/3/2024		-	-	-	Sign
1027-1	Hall by Room 212	WF	App	<1.0	10/3/2024		-	-	-	-
1028-1	Room 203 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
1028-2	Room 203 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
1028-3	Room 203 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign
1028-4	Room 203 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
1028-5	Room 203 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
1028-6	Room 203 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign
1028-7	Room 203 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
1028-8	Room 203 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
1028-9	Room 203 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1029-1	Room 203 / Room 205 Prep Room	SK	N/A		10/3/2024		-	-	-	Sign
1030-1	Room 205 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
1030-2	Room 205 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
1030-3	Room 205 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign
1030-4	Room 205 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
1030-5	Room 205 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
1030-6	Room 205 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign
1030-7	Room 205 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
1030-8	Room 205 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
1030-9	Room 205 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign
1031-1	Room 208P	SK	N/A		10/3/2024		-	-	-	Sign
1032-1	Room 208 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
1032-2	Room 208 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
1032-3	Room 208 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign
1032-4	Room 208 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
1032-5	Room 208 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
1032-6	Room 208 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign
1032-7	Room 208 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
1032-8	Room 208 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
1032-9	Room 208 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1033-1	Hall by Room 202	WF	App	<1.0	10/3/2024		-	-	-	-
1033-2	Hall by Room 202	BF	App	<1.0	10/3/2024		-	-	-	-
1034-1	Women's Faculty Bathroom by Room 202	SK	N/A		10/3/2024		-	-	-	Sign
1035-1	Boy's Bathroom in A Wing @ A	SK	N/A		10/3/2024		-	-	-	Sign
1035-2	Boy's Bathroom in A Wing @ B	SK	N/A		10/3/2024		-	-	-	Sign
1035-3	Boy's Bathroom in A Wing @ C	SK	N/A		10/3/2024		-	-	-	Sign
1035-4	Boy's Bathroom in A Wing @ D	SK	N/A		10/3/2024		-	-	-	Sign
1036-1	Girl's Bathroom in A Wing @ A	SK	N/A		10/3/2024		-	-	-	Sign
1036-2	Girl's Bathroom in A Wing @ B	SK	N/A		10/3/2024		-	-	-	Sign
1036-3	Girl's Bathroom in A Wing @ C	SK	N/A		10/3/2024		-	-	-	Sign
1036-4	Girl's Bathroom in A Wing @ D	SK	N/A		10/3/2024		-	-	-	Sign
1037-1	Room 301	SK	N/A		10/3/2024		-	-	-	Sign
1037-2	Room 301 Unit @ A	SK	N/A		10/3/2024		-	-	-	Sign
1037-3	Room 301 Unit @ B	SK	N/A		10/3/2024		-	-	-	Sign
1038-1	Hall by Room 314	WF	App	<1.0	10/3/2024		-	-	-	-
1039-1	Men's Faculty Bathroom by Room 313	SK	N/A		10/3/2024		-	-	-	Sign
1040-1	Hall by Room 313	WF	App	<1.0	10/3/2024		-	-	-	-
1041-1	Room 303 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
1041-2	Room 303 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
1041-3	Room 303 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1041-4	Room 303 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
1041-5	Room 303 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
1041-6	Room 303 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign
1041-7	Room 303 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
1041-8	Room 303 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
1041-9	Room 303 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign
1042-1	Room 303 / Room 305 Prep Room	SK	N/A		10/3/2024		-	-	-	Sign
1043-1	Room 305 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
1043-2	Room 305 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
1043-3	Room 305 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign
1043-4	Room 305 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
1043-5	Room 305 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
1043-6	Room 305 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign
1043-7	Room 305 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
1043-8	Room 305 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
1043-9	Room 305 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign
1044-1	Room 309P	SK	N/A		10/3/2024		-	-	-	Sign
1045-1	Room 309 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
1045-2	Room 309 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
1045-3	Room 309 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
1045-4	Room 309 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
1045-5	Room 309 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
1045-6	Room 309 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign
1045-7	Room 309 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
1045-8	Room 309 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
1045-9	Room 309 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign
1046-1	Hall by Room 304	WF	App	<1.0	10/3/2024		-	-	-	-
1046-2	Hall by Room 302	WF	App	<1.0	10/3/2024		-	-	-	-
1047-1	Women's Faculty Bathroom by Room 304	SK	N/A		10/3/2024		-	-	-	Sign
1048-1	Custodial Closet by Room 304	SS	N/A		10/3/2024		-	-	-	Sign
1049-1	Boy's Bathroom in B Wing @ A	SK	N/A		10/3/2024		-	-	-	Sign
1049-2	Boy's Bathroom in B Wing @ B	SK	N/A		10/3/2024		-	-	-	Sign
1049-3	Boy's Bathroom in B Wing @ C	SK	N/A		10/3/2024		-	-	-	Sign
1049-4	Boy's Bathroom in B Wing @ D	SK	N/A		10/3/2024		-	-	-	Sign
1050-1	Girl's Bathroom in B Wing @ A	SK	N/A		10/3/2024		-	-	-	Sign
1050-2	Girl's Bathroom in B Wing @ B	SK	N/A		10/3/2024		-	-	-	Sign
1050-3	Girl's Bathroom in B Wing @ C	SK	N/A		10/3/2024		-	-	-	Sign
1050-4	Girl's Bathroom in B Wing @ D	SK	N/A		10/3/2024		-	-	-	Sign
2001-1	Room 422	SK	N/A		10/3/2024		-	-	-	Sign
2001-2	Room 422 2-Bay	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
2002-1	Room 421	SK	N/A		10/3/2024		-	-	-	Sign
2002-2	Room 421 2-Bay	SK	N/A		10/3/2024		-	-	-	Sign
2003-1	Room 417 Teacher's Station	SK	App	2.0	10/3/2024		-	-	-	-
2003-2	Room 417 Station 1	SK	App	187.0	10/3/2024					Removed from Service Pending Remediation
2003-3	Room 417 Station 2	SK	App	1.0	10/3/2024		-	-	-	-
2003-4	Room 417 Station 3	SK	App	3.0	10/3/2024		-	-	-	-
2003-5	Room 417 Station 4	SK	App	<1.0	10/3/2024		-	-	-	-
2003-6	Room 417 Station 5	SK	App	<1.0	10/3/2024		-	-	-	-
2003-7	Room 417 Station 6	SK	App	<1.0	10/3/2024		-	-	-	-
2004-1	Room 401	SK	N/A		10/3/2024		-	-	-	Sign
2004-2	Room 401 Unit @ A	SK	N/A		10/3/2024		-	-	-	Sign
2004-3	Room 401 Unit @ B	SK	N/A		10/3/2024		-	-	-	Sign
2005-1	Men's Faculty Bathroom by Room 400	SK	N/A		10/3/2024		-	-	-	Sign
2006-1	Hall by Room 402	WF	App		10/3/2024		-	-	-	Non-functional
2007-1	Room 403 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
2007-2	Room 403 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
2007-3	Room 403 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign
2007-4	Room 403 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
2007-5	Room 403 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
2007-6	Room 403 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
2007-7	Room 403 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
2007-8	Room 403 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
2007-9	Room 403 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign
2008-1	Room 403 / Room 405 Prep Room	SK	N/A		10/3/2024		-	-	-	Sign
2009-1	Room 405 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
2009-2	Room 405 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
2009-3	Room 405 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign
2009-4	Room 405 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
2009-5	Room 405 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
2009-6	Room 405 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign
2009-7	Room 405 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
2009-8	Room 405 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
2009-9	Room 405 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign
2010-1	Room 408P	SK	N/A		10/3/2024		-	-	-	Sign
2011-1	Room 408 Teacher's Station	SK	N/A		10/3/2024		-	-	-	Sign
2011-2	Room 408 Counter @ A	SK	N/A		10/3/2024		-	-	-	Sign
2011-3	Room 408 Counter @ B	SK	N/A		10/3/2024		-	-	-	Sign
2011-4	Room 408 Counter @ C	SK	N/A		10/3/2024		-	-	-	Sign
2011-5	Room 408 Counter @ D	SK	N/A		10/3/2024		-	-	-	Sign
2011-6	Room 408 Counter @ E	SK	N/A		10/3/2024		-	-	-	Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Sampling Date	Remarks
2011-7	Room 408 Counter @ F	SK	N/A		10/3/2024		-	-	-	Sign
2011-8	Room 408 Counter @ G	SK	N/A		10/3/2024		-	-	-	Sign
2011-9	Room 408 Counter @ H	SK	N/A		10/3/2024		-	-	-	Sign
2012-1	Hall by Room 412	WF	App	<1.0	10/3/2024		-	-	-	-
2013-1	Women's Faculty Bathroom by Room 412	SK	N/A		10/3/2024		-	-	-	Sign
2014-1	Custodial Closet by Room 412	SS	N/A		10/3/2024		-	-	-	Sign
2015-1	Hall by Room 413	WF	App	<1.0	10/3/2024		-	-	-	-
2015-2	Hall by Room 413	BF	App	<1.0	10/3/2024		-	-	-	-
2016-1	Boy's Bathroom in Upper B Wing @ A	SK	N/A		10/3/2024		-	-	-	Sign
2016-2	Boy's Bathroom in Upper B Wing @ B	SK	N/A		10/3/2024		-	-	-	Sign
2016-3	Boy's Bathroom in Upper B Wing @ C	SK	N/A		10/3/2024		-	-	-	Sign
2016-4	Boy's Bathroom in Upper B Wing @ D	SK	N/A		10/3/2024		-	-	-	Sign
2017-1	Girl's Bathroom in Upper B Wing @ A	SK	N/A		10/3/2024		-	-	-	Sign
2017-2	Girl's Bathroom in Upper B Wing @ B	SK	N/A		10/3/2024		-	-	-	Sign
2017-3	Girl's Bathroom in Upper B Wing @ C	SK	N/A		10/3/2024		-	-	-	Sign
2017-4	Girl's Bathroom in Upper B Wing @ D	SK	N/A		10/3/2024		-	-	-	Sign

## Laboratory Report

NYE Report #: 230436-24088

February 13, 2023

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; William Floyd Middle School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 09, 2023. New York Environmental analyzed the samples on February 10, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	09 Feb 2023
Date Received:	09 Feb 2023
Date Analyzed:	10 Feb 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
230209P029	1	Girl's Locker Room-WF, Initial	0.001	0.001	mg/L	
230209P030	2	Boy's Locker Room-WF, Initial	0.001	0.005	mg/L	
230209P031	3	Hall by Room 202-WF, Initial	0.001	<0.001	mg/L	
230209P032	4	Hall by Room 314-WF, Initial	0.001	<0.001	mg/L	
230209P033	5	Hall by Room 413-WF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

## Laboratory Report

NYE Report #: 2406230-31385

October 9, 2024

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; William Floyd Middle School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 08, 2024. New York Environmental analyzed the samples on October 09, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	03 Oct 2024
Date Received:	08 Oct 2024
Date Analyzed:	09 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241008J001	1	Kitchen 2-Bay-SK, Initial	0.001	<0.001	mg/L	
241008J002	2	Kitchen - left-PF, Initial	0.001	0.009	mg/L	H
241008J003	3	Kitchen - right-PF, Initial	0.001	0.002	mg/L	
241008J004	4	Kitchen Island-SK, Initial	0.001	<0.001	mg/L	
241008J005	5	Kitchen Serving Line @ A-Left-SK, Initial	0.001	0.001	mg/L	
241008J006	6	Kitchen Serving Line @ B-Right-SK, Initial	0.001	0.003	mg/L	
241008J007	7	Hall by Cafeteria-IM, Initial	0.001	<0.001	mg/L	
241008J008	8	Girl's Locker Room-WF, Initial	0.001	0.002	mg/L	
241008J009	9	Boy's Locker Room-WF, Initial	0.001	<0.001	mg/L	
241008J010	10	Hall by Cafeteria-left-BF, Initial	0.001	<0.001	mg/L	
241008J011	11	Hall by Cafeteria-right-WF, Initial	0.001	<0.001	mg/L	
241008J012	12	Hall by Stage-left-WF, Initial	0.001	<0.001	mg/L	
241008J013	13	Hall by Stage-right-WF, Initial	0.001	<0.001	mg/L	
241008J014	14	Faculty Room-SK, Initial	0.001	0.002	mg/L	
241008J015	15	Hall by Auditorium-left-WF, Initial	0.001	<0.001	mg/L	
241008J016	16	Hall by Auditorium-right-WF, Initial	0.001	<0.001	mg/L	
241008J017	17	Nurse's Office-SK, Initial	0.001	0.001	mg/L	
241008J018	18	main Office Kitchenette-SK, Initial	0.001	<0.001	mg/L	
241008J019	19	Library-SK, Initial	0.001	<0.001	mg/L	
241008J020	20	Hall by Room 213-WF, Initial	0.001	<0.001	mg/L	
241008J021	21	Hall by Room 202-BF, Initial	0.001	<0.001	mg/L	
241008J022	22	Hall by Room 202-WF, Initial	0.001	<0.001	mg/L	
241008J023	23	Hall by Room 314-WF, Initial	0.001	<0.001	mg/L	
241008J024	24	Hall by Room 304-WF, Initial	0.001	<0.001	mg/L	
241008J025	25	Hall by Room 302-WF, Initial	0.001	<0.001	mg/L	
241008J026	26	Room 417 Teacher's Station-SK, Initial	0.001	0.002	mg/L	



Date Collected:	03 Oct 2024
Date Received:	08 Oct 2024
Date Analyzed:	09 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
241008J027	27	Room 417 Station 1-SK, Initial	0.001	0.187	mg/L	E,H
241008J028	28	Room 417 Station 2-SK, Initial	0.001	0.001	mg/L	
241008J029	29	Room 417 Station 3-SK, Initial	0.001	0.003	mg/L	
241008J030	30	Room 417 Station 4-SK, Initial	0.001	<0.001	mg/L	
241008J031	31	Room 417 Station 5-SK, Initial	0.001	<0.001	mg/L	
241008J032	32	Room 417 Station 6-SK, Initial	0.001	<0.001	mg/L	
241008J033	33	Hall by Room 412-WF, Initial	0.001	<0.001	mg/L	
241008J034	34	Hall by Room 413-BF, Initial	0.001	<0.001	mg/L	
241008J035	35	Hall by Room 413-WF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.

## Appendix G

Paca Middle School

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1001-1	Kitchen Handwash	SK	N/A		10/3/2024					Sign Required
1001-2	Kitchen Dishwash 3-Bay - Left	SK	N/A		10/3/2024					-
1001-3	Kitchen Dishwash 3-Bay - Right	SK	N/A		10/3/2024					-
1001-4	Kitchen Handwash	SK	N/A		10/3/2024					Sign Required
1001-5	Kitchen 2-Bay	SK	App	11.0	10/3/2024					Removed from Service Pending Remediation
1001-6	Kitchen	WF	App		10/3/2024					Non-functional
1001-7	Kitchen Prep Island	SK	App	5.0	10/3/2024					
1001-8	Kitchen Pot Filler	PF	App	6.0	10/3/2024					Removed from Service Pending Remediation
1001-9	Kitchen Bathroom @ A	SK	N/A		10/3/2024					Sign
1001-10	Kitchen Bathroom @ B	SK	N/A		10/3/2024					Sign
1002-1	Serving Area - Main Office Side - Handwash	SK	N/A		10/3/2024					Sign
1002-2	Serving Area - Main Office Side - Prep	SK	App	13.0	10/3/2024					Removed from Service Pending Remediation
1002-3	Serving Area - Electric Room Side - Prep	SK	App	7.0	10/3/2024					Removed from Service Pending Remediation
1002-4	Serving Area - Electric Room Side - Handwash	SK	N/A		10/3/2024					Sign
1003-1	Room 218 - Electric Power Room	SS	N/A		10/3/2024					Sign
1004-1	Girl's Bathroom in Cafeteria	SK	N/A		10/3/2024					Sign
1005-1	Custodial Closet in Cafeteria	SK	N/A		10/3/2024					Sign
1006-1	Boy's Bathroom in Cafeteria	SK	N/A		10/3/2024					Sign
1007-1	Nurse's Office Bathroom - Left	SK	N/A		10/3/2024					Sign
1007-2	Nurse's Office	SK	App	4.0	10/3/2024					

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1007-3	Nurse's Office Bathroom - Right	SK	N/A		2/8/2023					Sign
1008-1	Main Office - Principal's Office Bathroom	SK	N/A		10/3/2024					Sign
1008-2	Main Office - Men's Bathroom	SK	N/A		10/3/2024					Sign
1008-3	Main Office - Women's Bathroom	SK	N/A		10/3/2024					Sign
1009-1	Girl's Bathroom by Room 212	SK	N/A		10/3/2024					Sign
1010-1	Boy's Bathroom by Room 212	SK	N/A		10/3/2024					Sign
1011-1	Hallway by Room 212	WF	App		10/3/2024					Non-functional
1057-1	Teacher's Lounge	SK	App	2.0	10/3/2024					
1012-1	Room 207A	OS	N/A		10/3/2024					Sign
1013-1	Girl's Bathroom by Room 134 @ A	SK	N/A		10/3/2024					Sign
1013-2	Girl's Bathroom by Room 134 @ B	SK	N/A		10/3/2024					Sign
1013-3	Girl's Bathroom by Room 134 @ C	SK	N/A		10/3/2024					Sign
1014-1	Custodial Closet by Room 134	SS	N/A		10/3/2024					Sign
1015-1	Boy's Bathroom by Room 134 @ A	SK	N/A		10/3/2024					Sign
1015-2	Boy's Bathroom by Room 134 @ B	SK	N/A		10/3/2024					Sign
1015-3	Boy's Bathroom by Room 134 @ C	SK	N/A		10/3/2024					Sign
1016-1	Faculty Bathroom by Library	SK	N/A		10/3/2024					Sign
1017-1	Library Room 112B	SK	App	5.0	10/3/2024					
1018-1	Hallway by Library	WF	App	<1.0	10/3/2024					
1018-2	Hallway by Library	BF	App	<1.0	10/3/2024					

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1019-1	Hallway by Room 134	WF	App		2/8/2023					Non-functional
1020-1	Room 135	SK	N/A		10/3/2024					Sign
1021-1	Custodial Closet in West Lobby	SS	N/A		10/3/2024					Sign
1022-1	Faculty Bathroom in West Lobby	SK	N/A		10/3/2024					Sign
1023-1	Boy's Bathroom in West Lobby @ A	SK	N/A		10/3/2024					Sign
1023-2	Boy's Bathroom in West Lobby @ B	SK	N/A		10/3/2024					Sign
1023-3	Boy's Bathroom in West Lobby @ C	SK	N/A		10/3/2024					Sign
1024-1	Hallway of West Lobby - Left	WF	App	<1.0	10/3/2024					
1024-2	Hallway of West Lobby - Right	WF	App	<1.0	10/3/2024					
1025-1	Girl's Bathroom in West Lobby @ A	SK	N/A		10/3/2024					Sign
1025-2	Girl's Bathroom in West Lobby @ B	SK	N/A		10/3/2024					Sign
1025-3	Girl's Bathroom in West Lobby @ C	SK	N/A		10/3/2024					Sign
1026-1	Room 161 Teacher's Station	SK	N/A		10/3/2024					Sign
1026-2	Room 161 Counter @ A	SK	N/A		10/3/2024					Sign
1026-3	Room 161 Counter @ B	SK	N/A		10/3/2024					Sign
1026-4	Room 161 Counter @ C	SK	N/A		10/3/2024					Sign
1026-5	Room 161 Counter @ D	SK	N/A		10/3/2024					Sign
1026-6	Room 161 Counter @ E	SK	N/A		10/3/2024					Sign
1026-7	Room 161 Counter @ F	SK	N/A		10/3/2024					Sign
1026-8	Room 161 Counter @ G	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1026-9	Room 161 Counter @ H	SK	N/A		10/3/2024					Sign
1027-1	Room 161/162 Prep Room Counter @ A	SK	N/A		10/3/2024					Sign
1027-2	Room 161/162 Prep Room Counter @ B	SK	N/A		10/3/2024					Sign
1028-1	Room 162 Teacher's Station	SK	N/A		10/3/2024					Sign
1028-2	Room 162 Counter @ A	SK	N/A		10/3/2024					Sign
1028-3	Room 162 Counter @ B	SK	N/A		10/3/2024					Sign
1028-4	Room 162 Counter @ C	SK	N/A		10/3/2024					Sign
1028-5	Room 162 Counter @ D	SK	N/A		10/3/2024					Sign
1028-6	Room 162 Counter @ E	SK	N/A		10/3/2024					Sign
1028-7	Room 162 Counter @ F	SK	N/A		10/3/2024					Sign
1028-8	Room 162 Counter @ G	SK	N/A		10/3/2024					Sign
1028-9	Room 162 Counter @ H	SK	N/A		10/3/2024					Sign
1029-1	Room 164 Teacher's Station	SK	N/A		10/3/2024					Sign
1029-2	Room 164 Counter @ A	SK	N/A		10/3/2024					Sign
1029-3	Room 164 Counter @ B	SK	N/A		10/3/2024					Sign
1029-4	Room 164 Counter @ C	SK	N/A		10/3/2024					Sign
1029-5	Room 164 Counter @ D	SK	N/A		10/3/2024					Sign
1029-6	Room 164 Counter @ E	SK	N/A		10/3/2024					Sign
1029-7	Room 164 Counter @ F	SK	N/A		10/3/2024					Sign
1029-8	Room 164 Counter @ G	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1029-9	Room 164 Counter @ H	SK	N/A		10/3/2024					Sign
1030-1	Room 164 Prep Room	SK	N/A		10/3/2024					Sign
1031-1	Room 165 Teacher's Station	SK	N/A		10/3/2024					Sign
1031-2	Room 165 Counter @ A	SK	N/A		10/3/2024					Sign
1031-3	Room 165 Counter @ B	SK	N/A		10/3/2024					Sign
1031-4	Room 165 Counter @ C	SK	N/A		10/3/2024					Sign
1031-5	Room 165 Counter @ D	SK	N/A		10/3/2024					Sign
1031-6	Room 165 Counter @ E	SK	N/A		10/3/2024					Sign
1031-7	Room 165 Counter @ F	SK	N/A		10/3/2024					Sign
1031-8	Room 165 Counter @ G	SK	N/A		10/3/2024					Sign
1031-9	Room 165 Counter @ H	SK	N/A		10/3/2024					Sign
1032-1	Room 156 Teacher's Station	SK	N/A		10/3/2024					Sign
1032-2	Room 156 Counter @ A	SK	N/A		10/3/2024					Sign
1032-3	Room 156 Counter @ B	SK	N/A		10/3/2024					Sign
1032-4	Room 156 Counter @ C	SK	N/A		10/3/2024					Sign
1032-5	Room 156 Counter @ D	SK	N/A		10/3/2024					Sign
1032-6	Room 156 Counter @ E	SK	N/A		10/3/2024					Sign
1032-7	Room 156 Counter @ F	SK	N/A		10/3/2024					Sign
1032-8	Room 156 Counter @ G	SK	N/A		10/3/2024					Sign
1032-9	Room 156 Counter @ H	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1033-1	Room 156 Prep Room	SK	N/A		10/3/2024					Sign
1034-1	Room 157 Teacher's Station	SK	N/A		10/3/2024					Sign
1034-2	Room 157 Counter @ A	SK	N/A		10/3/2024					Sign
1034-3	Room 157 Counter @ B	SK	N/A		10/3/2024					Sign
1034-4	Room 157 Counter @ C	SK	N/A		10/3/2024					Sign
1034-5	Room 157 Counter @ D	SK	N/A		10/3/2024					Sign
1034-6	Room 157 Counter @ E	SK	N/A		10/3/2024					Sign
1034-7	Room 157 Counter @ F	SK	N/A		10/3/2024					Sign
1034-8	Room 157 Counter @ G	SK	N/A		10/3/2024					Sign
1034-9	Room 157 Counter @ H	SK	N/A		10/3/2024					Sign
1035-1	Room 157 Prep Room	SK	N/A		10/3/2024					Sign
1036-1	Room 158 Teacher's Station	SK	N/A		10/3/2024					Sign
1036-2	Room 158 Counter @ A	SK	N/A		10/3/2024					Sign
1036-3	Room 158 Counter @ B	SK	N/A		10/3/2024					Sign
1036-4	Room 158 Counter @ C	SK	N/A		10/3/2024					Sign
1036-5	Room 158 Counter @ D	SK	N/A		10/3/2024					Sign
1036-6	Room 158 Counter @ E	SK	N/A		10/3/2024					Sign
1036-7	Room 158 Counter @ F	SK	N/A		10/3/2024					Sign
1036-8	Room 158 Counter @ G	SK	N/A		10/3/2024					Sign
1036-9	Room 158 Counter @ H	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1037-1	Room 158 Prep Room	SK	N/A		10/3/2024					Sign
1038-1	Room 151 Teacher's Station	SK	N/A		10/3/2024					Sign
1038-2	Room 151 Counter @ A	SK	N/A		10/3/2024					Sign
1038-3	Room 151 Counter @ B	SK	N/A		10/3/2024					Sign
1038-4	Room 151 Counter @ C	SK	N/A		10/3/2024					Sign
1038-5	Room 151 Counter @ D	SK	N/A		10/3/2024					Sign
1038-6	Room 151 Counter @ E	SK	N/A		10/3/2024					Sign
1038-7	Room 151 Counter @ F	SK	N/A		10/3/2024					Sign
1038-8	Room 151 Counter @ G	SK	N/A		10/3/2024					Sign
1038-9	Room 151 Counter @ H	SK	N/A		10/3/2024					Sign
1039-1	Room 151 Prep Room	SK	N/A		10/3/2024					Sign
1040-1	Room 154 Teacher's Station	SK	N/A		10/3/2024					Sign
1040-2	Room 154 Counter @ A	SK	N/A		10/3/2024					Sign
1040-3	Room 154 Counter @ B	SK	N/A		10/3/2024					Sign
1040-4	Room 154 Counter @ C	SK	N/A		10/3/2024					Sign
1040-5	Room 154 Counter @ D	SK	N/A		10/3/2024					Sign
1040-6	Room 154 Counter @ E	SK	N/A		10/3/2024					Sign
1040-7	Room 154 Counter @ F	SK	N/A		10/3/2024					Sign
1040-8	Room 154 Counter @ G	SK	N/A		10/3/2024					Sign
1040-9	Room 154 Counter @ H	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1041-1	Room 154 Prep Room Counter @ A	SK	N/A		10/3/2024					Sign
1041-2	Room 154 Prep Room Counter @ B	SK	N/A		10/3/2024					Sign
1042-1	Room 153 Teacher's Station	SK	N/A		10/3/2024					Sign
1042-2	Room 153 Counter @ A	SK	N/A		10/3/2024					Sign
1042-3	Room 153 Counter @ B	SK	N/A		10/3/2024					Sign
1042-4	Room 153 Counter @ C	SK	N/A		10/3/2024					Sign
1042-5	Room 153 Counter @ D	SK	N/A		10/3/2024					Sign
1042-6	Room 153 Counter @ E	SK	N/A		10/3/2024					Sign
1042-7	Room 153 Counter @ F	SK	N/A		10/3/2024					Sign
1042-8	Room 153 Counter @ G	SK	N/A		10/3/2024					Sign
1042-9	Room 153 Counter @ H	SK	N/A		10/3/2024					Sign
1043-1	Girl's Bathroom in H Lobby @ A	SK	N/A		10/3/2024					Sign
1043-2	Girl's Bathroom in H Lobby @ B	SK	N/A		10/3/2024					Sign
1043-3	Girl's Bathroom in H Lobby @ C	SK	N/A		10/3/2024					Sign
1044-1	Hallway of H Lobby - Left	WF	App	<1.0	10/3/2024					
1044-2	Hallway of H Lobby - Right	WF	App	<1.0	10/3/2024					
1045-1	Boy's Bathroom in H Lobby @ A	SK	N/A		10/3/2024					Sign
1045-2	Boy's Bathroom in H Lobby @ B	SK	N/A		10/3/2024					Sign
1045-3	Boy's Bathroom in H Lobby @ C	SK	N/A		10/3/2024					Sign
1046-1	Faculty Bathroom in H Lobby	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1047-1	Custodial Closet in H Lobby	SS	N/A		10/3/2024					Sign
1048-1	Room 110 - Tech	SK	N/A		10/3/2024					Sign
1049-1	Room 112 - Home Economics - Counter @ A	SK	App	1.0	10/3/2024					
1049-2	Room 112 - Home Economics - Counter @ B	SK	App	6.0	10/3/2024					Removed from Service Pending Remediation
1049-3	Room 112 - Home Economics - Counter @ C	SK	App	1.0	10/3/2024					
1049-4	Room 112 - Home Economics - Counter @ D	SK	App	2.0	10/3/2024					
1049-5	Room 112 - Home Economics - Counter @ E	SK	App	3.0	10/3/2024					
1049-6	Room 112 - Home Economics - Counter @ F	SK	App	4.0	10/3/2024					
1050-1	Hallway by Room 112	WF	App	2.0	10/3/2024					
1051-1	Boy's Bathroom by Room 112 - Left	SK	N/A		10/3/2024					Sign
1051-2	Boy's Bathroom by Room 112 - Middle	SK	N/A		10/3/2024					Sign
1051-3	Boy's Bathroom by Room 112 - Right	SK	N/A		10/3/2024					Sign
1052-1	Custodial Closet by Room 112	SS	N/A		10/3/2024					Sign
1053-1	Girl's Bathroom by Room 112 - Left	SK	N/A		10/3/2024					Sign
1053-2	Girl's Bathroom by Room 112 - Middle	SK	N/A		10/3/2024					Sign
1053-3	Girl's Bathroom by Room 112 - Right	SK	N/A		10/3/2024					Sign
1054-1	Faculty Staff Bathroom by Room 138	SK	N/A		10/3/2024					Sign
1055-1	Hallway by Room 138	WF	App		10/3/2024					Non-functional
1056-1	Room 156 - Tech Room	SK	N/A		10/3/2024					Sign
1057-1	Girl's Locker Room Coach's Office Bathroom	SK	N/A		10/3/2024					Sign

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1057-2	Girl's Locker Room Bathroom - Left	SK	N/A		10/3/2024					Sign
1057-3	Girl's Locker Room Bathroom - Right	SK	N/A		10/3/2024					Sign
1057-4	Girl's Locker Room by Back Exit	WF	App	20.0	10/3/2024					Removed from Service Pending Remediation
1057-5	Girl's Locker Room by Entry	WF	App		2/8/2024					Non-functional
1058-1	Girl's Team Locker Room Bathroom @ A	SK	N/A		10/3/2024					Sign
1058-2	Girl's Team Locker Room Bathroom @ B	SK	N/A		10/3/2024					Sign
1058-3	Girl's Team Locker Room Bathroom @ C	SK	N/A		10/3/2024					Sign
1058-4	Girl's Team Locker Room	WF	App	2.0	10/3/2024					
1059-1	Boy's Locker Room by Entry	WF	App	9.0	10/3/2024					Removed from Service Pending Remediation
1059-2	Boy's Locker Room by Back Exit	WF	App		2/8/2023					Non-functional
1059-3	Boy's Locker Room - Custodial Closet	SS	N/A		10/3/2024					Sign
1059-4	Boy's Locker Room Bathroom - Left	SK	N/A		10/3/2024					Sign
1059-5	Boy's Locker Room Bathroom - Right	SK	N/A		10/3/2024					Sign
1059-6	Boy's Locker Room Coach's Office Bathroom	SK	N/A		10/3/2024					Sign
	Boy'd Team Locker Room	WF	App	<1.0	10/3/2024					
1060-1	Boy's Team Locker Room Bathroom @ A	SK	N/A		10/3/2024					Sign
1060-2	Boy's Team Locker Room Bathroom @ B	SK	N/A		10/3/2024					Sign
1060-3	Boy's Team Locker Room Bathroom @ C	SK	N/A		10/3/2024					Sign
1061-1	Hallway by Gym - Next to Room 206	WF	App	<1.0	10/3/2024					
1061-2	Hallway by Gym - Next to Room 206	BF	App	<1.0	10/3/2024					

Space #	Sample Location	Fixture Type	App or N/A	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)				Remarks
1062-1	Women's Bathroom in Security Area	SK	N/A		10/3/2024					Sign
1063-1	Men's Bathroom in Security Area	SK	N/A		10/3/2024					Sign
1064-1	Security Office - Kitchenette	SK	App	<1.0	10/3/2024					
1064-2	Security Office - Bathroom	SK	N/A		10/3/2024					Sign
1065-1	Family Service League Kitchenette	SK	App	4.0	10/3/2024					
1066-1	Food Pantry	SK	N/A		10/3/2024					Sign
1067-1	Women's Bathroom by Room 207 @ A	SK	N/A		10/3/2024					Sign
1067-2	Women's Bathroom by Room 207 @ B	SK	N/A		10/3/2024					Sign
1068-1	Men's Bathroom by Room 207	SK	N/A		10/3/2024					Sign
1056	Boy's Team Locker Room	WF	App		10/3/2024					

**Laboratory Report (Revised)**

NYE Report #: 230430-24082R

February 14, 2023

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; William Paca Middle School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 09, 2023. New York Environmental analyzed the samples on February 10, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	08 Feb 2023
Date Received:	09 Feb 2023
Date Analyzed:	10 Feb 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
230209P001	1	Hallway by Gym - Next to Room 206-WF, Initial	0.001	<0.001	mg/L	
230209P002	2	Girl's Locker Room by Back Exit-WF, Initial	0.001	0.027	mg/L	H
230209P003	3	Girl's Team Locker Room -WF, Initial	0.001	0.091	mg/L	E,H
230209P004	4	Hallway by Library-WF, Initial	0.001	0.001	mg/L	
230209P005	5	Hallway by Room 112-WF, Initial	0.001	0.003	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.

Revision History:

Report revised on 2/14/2023, replaces report generated on 2/13/2023.

- Sample Location/Description for Lab ID 220209P002 revised as per client request.

## Laboratory Report

NYE Report #: 2406209-31377

October 8, 2024

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Flyod UFSD; William Paca Middle School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 04, 2024. New York Environmental analyzed the samples on October 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241004M027	1	Kitchen 2-Bay-SK, Initial	0.001	0.011	mg/L	H
241004M028	2	Kitchen Prep Island-SK, Initial	0.001	0.005	mg/L	
241004M029	3	Kitchen Pot Filler-PF, Initial	0.001	0.006	mg/L	H
241004M030	4	Serving Area - Main Office Side - Prep-SK, Initial	0.001	0.013	mg/L	H
241004M031	5	Serving Area - Electric Room Side - Prep-SK, Initial	0.001	0.007	mg/L	H
241004M032	6	Nurse's Office-SK, Initial	0.001	0.004	mg/L	
241004M033	7	Library Room 112B-SK, Initial	0.001	0.005	mg/L	
241004M034	8	Hallway by Library-BF, Initial	0.001	<0.001	mg/L	
241004M035	9	Hallway by Library-WF, Initial	0.001	<0.001	mg/L	
241004M036	10	Hallway of West Lobby - Left-WF, Initial	0.001	<0.001	mg/L	
241004M037	11	Hallway of West Lobby - Right-WF, Initial	0.001	<0.001	mg/L	
241004M038	12	Hallway of H Lobby - Left-WF, Initial	0.001	<0.001	mg/L	
241004M039	13	Hallway of H Lobby - Right-WF, Initial	0.001	<0.001	mg/L	
241004M040	14	Room 112 - Home Economics - Counter @ A-SK, Initial	0.001	0.001	mg/L	
241004M041	15	Room 112 - Home Economics - Counter @ B-SK, Initial	0.001	0.006	mg/L	H
241004M042	16	Room 112 - Home Economics - Counter @ C-SK, Initial	0.001	0.001	mg/L	
241004M043	17	Room 112 - Home Economics - Counter @ D-SK, Initial	0.001	0.002	mg/L	
241004M044	18	Room 112 - Home Economics - Counter @ E-SK, Initial	0.001	0.003	mg/L	
241004M045	19	Room 112 - Home Economics - Counter @ F-SK, Initial	0.001	0.004	mg/L	
241004M046	20	Hallway by Room 112-WF, Initial	0.001	0.002	mg/L	
241004M047	21	Room 141 Teachers Lounge-SK, Initial	0.001	0.002	mg/L	
241004M048	22	Girl's Locker Room by Back Exit-WF, Initial	0.001	0.020	mg/L	H
241004M049	23	Girl's Team Locker Room -WF, Initial	0.001	0.002	mg/L	
241004M050	24	Boy's Team Locker Room-WF, Initial	0.001	<0.001	mg/L	
241004M051	25	Boy's Locker Room by Entry-WF, Initial	0.001	0.009	mg/L	H
241004M052	26	Hallway by Gym - Next to Room 206-BF, Initial	0.001	<0.001	mg/L	



Date Collected:	03 Oct 2024
Date Received:	04 Oct 2024
Date Analyzed:	07 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
241004M053	27	Hallway by Gym - Next to Room 206-WF, Initial	0.001	<0.001	mg/L	
241004M054	28	Security Office - Kitchenette-SK, Initial	0.001	<0.001	mg/L	
241004M055	29	Family Service League Kitchenette-Adult GED-SK, Initial	0.001	0.004	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

## Appendix H

William Floyd High School

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1001-1	11 / 12 Grade Serving Line Women's Bathroom @ A	SK	NA		10/5/2024					Mixed Valve; Sign
1001-2	11 / 12 Grade Serving Line Women's Bathroom @ B	SK	NA		10/5/2024					Mixed Valve; Sign
1001-3	11 / 12 Grade Serving Line Men's Bathroom @ A	SK	NA		10/5/2024					Mixed Valve; Sign
1001-4	11 / 12 Grade Serving Line Men's Bathroom @ B	SK	NA		10/5/2024					Mixed Valve; Sign
1001-5	11 / 12 Grade Serving Line - left	WF	App	<1.0	2/8/2023					
1001-6	11 / 12 Grade Serving Line - right	WF	App	<1.0	10/5/2024					
1001-7	11 / 12 Grade Serving Line Handwash @ A	SK	NA		10/5/2024					Sign
1001-8	11 / 12 Grade Serving Line Handwash @ B	SK	NA		10/5/2024					Sign
1002-1	11 / 12 Grade Kitchen	IM	App	<1.0	10/5/2024					
1002-2	11 / 12 Grade Kitchen Handwash @ A	SK	NA		10/5/2024					Sign
1002-3	11 / 12 Grade Kitchen 3-Bay	SK	NA		10/5/2024					Sign
1003-1	11 / 12 Grade Express Serving Line Handwash @ A	SK	NA		10/5/2024					Sign
1003-2	11 / 12 Grade Express Serving Line Handwash @ B	Sk	NA		10/5/2024					Sign
1004-1	11 / 12 Grade Cafeteria - left	WF	App	<1.0	10/5/2024					
1004-2	11 / 12 Grade Cafeteria - right	WF	App	<1.0	10/5/2024					
1004-4	11 / 12 Grade Cafeteria Men's Bathroom @ A	SK	NA		10/5/2024					Sign
1004-5	11 / 12 Grade Cafeteria Men's Bathroom @ B	SK	NA		10/5/2024					Sign
1004-6	11 / 12 Grade Cafeteria Women's Bathroom	SK	NA		10/5/2024					Sign
1005-1	Java City Dishwash	SK	NA		10/5/2024					Sign
1005-2	Java City Handwash	Sk	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1006-1	Custodial Office Bathroom	SK	NA		10/5/2024					Sign
1007-1	ROTC unit @ A	SK	NA		10/5/2024					Sign
1007-2	ROTC unit @ B	SK	NA		10/5/2024					Sign
1007-3	ROTC unit @ C	SK	NA		10/5/2024					Sign
1008-1	Hall by ROTC	WF	App	<1.0	10/5/2024					
1008-2	Hall by ROTC	BF	App	<1.0	10/5/2024					
1008-3	Nurse's Office halway	WF	App	<1.0	10/5/2024					
1008-4	Nurse's Office halway	BF	App	<1.0	10/5/2024					
1009-1	East Gym Girl's Locker Room	WF	App		10/5/2024					Non-functional
1009-2	East Gym Girl's Locker Room	SK	NA		10/5/2024					Non-functional
1009-3	East Gym Girl's Locker Room	SS	NA		10/5/2024					Sign
1010-1	East Gym Boy's Locker Room Coach's Office	SK	NA		10/5/2024					Sign
1010-2	East Gym Boy's Locker Room	WF	App		10/5/2024					Non-functional
1010-3	East Gym Boy's Locker Room	SK	NA		10/5/2024					Sign
1010-4	East Gym Boy's Locker Room	SS	NA		10/5/2024					Sign
1011-1	Boy's Bathroom by Auditorium	SK	NA		10/5/2024					Sign
1012-1	Girl's Bathroom by Auditorium	SK	NA		10/5/2024					Sign
1013-1	Office of Special Education Women's Bathroom	SK	NA		10/5/2024					Sign
1013-2	Office of Special Education Men's Bathroom	SK	NA		10/5/2024					Sign
1014-1	Men's Bathroom by Room 105A	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1014-2	Boy's Bathroom by Room 105A @ A	SK	NA		10/5/2024					Sign
1015-1	Women's Bathroom by Room 105A	SK	NA		10/5/2024					Sign
1015-2	Girl's Bathroom by Room 105A @ A	SK	NA		10/5/2024					Sign
1016-1	Rita Rech Museum @ A	SK	NA		10/5/2024					Sign
1016-2	Rita Rech Museum @ B	SK	NA		10/5/2024					Sign
1016-3	Rita Rech Museum @ C	SK	NA		10/5/2024					Sign
1016-4	Rita Rech Museum @ D	SK	NA		10/5/2024					Sign
1017-1	East Nurse's Office	SK	App	2.0	10/5/2024					
1017-2	East Nurse's Office	SPY	App	<1.0	10/5/2024					
1017-3	East Nurse's Office BR	SK	App		10/5/2024					Sign
1017-4	East Nurse's Office Exam Room	SK	App	19.0	2/8/2023					Sign
1018-1	Room 116 Teacher's Station	SK	NA		10/5/2024					
1018-2	Room 116 Counter @ A	SK	NA		10/5/2024					Sign
1018-3	Room 116 Counter @ B	SK	NA		10/5/2024					Sign
1018-4	Room 116 Counter @ C	SK	NA		10/5/2024					Sign
1018-5	Room 116 Counter @ D	SK	NA		10/5/2024					Sign
1018-6	Room 116 Counter @ E	SK	NA		10/5/2024					Sign
1018-7	Room 116 Counter @ F	SK	NA		10/5/2024					Sign
1019-1	Room 115 Teacher's Station @ A	SK	NA		10/5/2024					Sign
1019-2	Room 115 Teacher's Station @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1019-3	Room 115 Counter @ A	SK	NA		10/5/2024					Sign
1019-4	Room 115 Counter @ B	SK	NA		10/5/2024					Sign
1019-5	Room 115 Counter @ C	SK	NA		10/5/2024					Sign
1020-1	Women's Bathroom by Room 115	SK	NA		10/5/2024					Sign
1020-2	Girl's Bathroom by Room 115	SK	NA		10/5/2024					Mixed Valve; Sign
1021-1	Men's Bathroom by Room 115	SK	NA		10/5/2024					Sign
1021-2	Boy's Bathroom by Room 115	SK	NA		10/5/2024					Mixed Valve; Sign
1022-2	District Office Bathroom by Conference Room	SK	NA		10/5/2024					Sign
1022-3	District Office Bathroom by Kitchenette	SK	NA		10/5/2024					Sign
1022-4	District Office Kitchenette	SK	App	<1.0	10/5/2024					
1023-1	Room 170 Counter @ A	SK	NA		10/5/2024					Sign
1023-2	Room 170 Counter @ B	SK	NA		10/5/2024					Sign
1024-1	Room 170 / Room 166	SK	NA		10/5/2024					Sign
1025-1	Room 166 Counter @ A	SK	NA		10/5/2024					Sign
1025-2	Room 166 Counter @ B	SK	NA		10/5/2024					Sign
1026-1	Room 169 Teacher's Station	SK	NA		10/5/2024					Sign
1026-2	Room 169 Counter	SK	NA		10/5/2024					Sign
1026-3	Room 169 Pod 1 @ A	SK	NA		10/5/2024					Sign
1026-4	Room 169 Pod 1 @ B	SK	NA		10/5/2024					Sign
1026-5	Room 169 Pod 2 @ A	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1026-6	Room 169 Pod 2 @ B	SK	NA		10/5/2024					Sign
1026-7	Room 169 Pod 3 @ A	SK	NA		10/5/2024					Sign
1026-8	Room 169 Pod 3 @ B	SK	NA		10/5/2024					Sign
1026-9	Room 169 Pod 4 @ A	SK	NA		10/5/2024					Sign
1026-10	Room 169 Pod 4 @ B	SK	NA		10/5/2024					Sign
1026-11	Room 169 Pod 5 @ A	SK	NA		10/5/2024					Sign
1026-12	Room 169 Pod 5 @ B	SK	NA		10/5/2024					Sign
1026-13	Room 169 Pod 6 @ A	SK	NA		10/5/2024					Sign
1026-14	Room 169 Pod 6 @ B	SK	NA		10/5/2024					Sign
1026-15	Room 169 Pod 7 @ A	SK	NA		10/5/2024					Sign
1026-16	Room 169 Pod 7 @ B	SK	NA		10/5/2024					Sign
1026-17	Room 169 Office	SK	NA		10/5/2024					Sign
1027-1	Room 167 Counter @ A	SK	NA		10/5/2024					Sign
1027-2	Room 167 Counter @ B	SK	NA		10/5/2024					Sign
1027-3	Room 167 Office	SK	NA		10/5/2024					Sign
1028-1	Women's Bathroom by Room 159	SK	NA		10/5/2024					Sign
1029-1	Men's Bathroom by Room 159	SK	NA		10/5/2024					Sign
1030-1	Girl's Bathroom by Library @ A	SK	NA		10/5/2024					Sign
1030-2	Girl's Bathroom by Library @ B	SK	NA		10/5/2024					Sign
1030-3	Girl's Bathroom by Library @ C	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1031-1	Custodial Closet by Library	SS	NA		10/5/2024					Sign
1032-1	Hall by Library	WF	App	<1.0	10/5/2024					
1032-1	Hall by Library	BF	App	<1.0	10/5/2024					
1033-1	Boy's Bathroom by Library @ A	SK	NA		10/5/2024					Sign
1033-2	Boy's Bathroom by Library @ B	SK	NA		10/5/2024					Sign
1033-3	Boy's Bathroom by Library @ C	SK	NA		10/5/2024					Sign
1034-1	Library Office	SK	App	4.0	10/5/2024					
1035-1	Main Office Kitchenette	SK	App	3.0	10/5/2024					
1035-2	Main Office Bathroom	SK	NA		10/5/2024					Sign
1036-1	Girl's Bathroom by Room 151 @ A	SK	NA		10/5/2024					Sign
1036-2	Girl's Bathroom by Room 151 @ B	SK	NA		10/5/2024					Sign
1036-3	Girl's Bathroom by Room 151 @ C	SK	NA		10/5/2024					Sign
1037-1	Custodial Closet by Room 151	SS	NA		10/5/2024					Sign
1038-1	Hall by Room 151	WF	App	<1.0	10/5/2024					
1039-1	Men's Bathroom by Room 151	SK	NA		10/5/2024					Sign
1040-1	Boy's Bathroom by Room 151 @ A	SK	NA		10/5/2024					Sign
1040-2	Boy's Bathroom by Room 151 @ B	SK	NA		10/5/2024					Sign
1040-3	Boy's Bathroom by Room 151 @ C	SK	NA		10/5/2024					Sign
1041-1	Girl's Bathroom by Room 141 @ A	SK	NA		10/5/2024					Removed from Service
1041-2	Girl's Bathroom by Room 141 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1041-3	Girl's Bathroom by Room 141 @ C	SK	NA		10/5/2024					Removed from Service
1042-1	Custodial Closet by Room 141	SS	NA		10/5/2024					Sign
1043-1	Hall by Room 141	WF	App	<1.0	10/5/2024					
1044-1	Women's Bathroom by Room 141	SK	NA		10/5/2024					Sign
1045-1	Boy's Bathroom by Room 141 @ A	SK	NA		10/5/2024					Sign
1045-2	Boy's Bathroom by Room 141 @ B	SK	NA		10/5/2024					Sign
1045-3	Boy's Bathroom by Room 141 @ C	SK	NA		10/5/2024					Removed from Service
1046-1	West Nurse's Office	SK	App	<1.0	10/5/2024					
1046-2	West Nurse's Office Bathroom	SK	NA		10/5/2024					Sign
1047-1	Room 321 Counter @ A	SK	NA		10/5/2024					Sign
1047-2	Room 321 Counter @ B	SK	NA		10/5/2024					Sign
1047-3	Room 321 Counter @ C	SK	NA		10/5/2024					Sign
1048-1	Room 318 Bathroom	SK	NA		10/5/2024					Sign
1049-1	Boy's Bathroom by Room 318 Unit 1	SK	NA		10/5/2024					Mixed Valve; Sign
1049-2	Boy's Bathroom by Room 318 Unit 2	SK	NA		10/5/2024					Mixed Valve; Sign
1050-1	Faculty Bathroom by Room 318	SK	NA		10/5/2024					Sign
1051-1	Hall by Room 318 - left	WF	App	<1.0	10/5/2024					
1051-2	Hall by Room 318 - right	WF	App	<1.0	10/5/2024					
1052-1	Custodial Closet by Room 318	SS	NA		10/5/2024					Sign
1053-1	Boy's Bathroom by Room 318 Unit 1	SK	NA		10/5/2024					Mixed Valve; Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1053-2	Boy's Bathroom by Room 318 Unit 2	SK	NA		10/5/2024					Mixed Valve; Sign
1054-1	Faculty Bathroom by Room 316	SK	NA		10/5/2024					Sign
1055-1	Room 319 Counter 1 @ A	SK	App	<1.0	10/5/2024					Sign
1055-2	Room 319 Counter 1 @ B	SK	App	<1.0	10/5/2024					Sign
1055-3	Room 319 Counter 2	SK	App	<1.0	10/5/2024					Sign
1056-1	Hall by West Wing Elevator - left	WF	App	<1.0	10/5/2024					
1056-2	Hall by West Wing Elevator - right	WF	App	<1.0	10/5/2024					
1057-1	Room 315 Counter	SK	App	<1.0	10/5/2024					Sign
1057-2	Room 315 by Bathroom	SK	NA		10/5/2024					Sign
1058-1	Room 302	SS	NA		10/5/2024					Sign
1059-1	Custodial Closet by Room 300	SS	NA		10/5/2024					Sign
1060-1	Hall by Room 300 - left	WF	App		10/5/2024					Non-functional
1060-2	Hall by Room 300 - right	WF	App		10/5/2024					Non-functional
1061-1	Girl's Bathroom by West Wing Tech	SK	NA		10/5/2024					Mixed Valve; Sign
1062-1	Hall by West Wing Tech Bathroom - left	WF	App		10/5/2024					Non-functional
1062-2	Hall by West Wing Tech Bathroom - right	WF	App		10/5/2024					Non-functional
1063-1	Boy's Bathroom by West Wing Tech	SK	NA		10/5/2024					Mixed Valve; Sign
1064-1	Room 323	SK	NA		10/5/2024					Sign
1065-1	Room 324	SK	NA		10/5/2024					Sign
1066-1	West Gym Men's Coach's Locker Room Bathroom	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1067-1	West Gym Women's Coach's Locker Room Bathroom	SK	NA		10/5/2024					Sign
1069-1	West Gym Boy's Team Locker Room @ A	SK	NA		10/5/2024					Sign
1069-2	West Gym Boy's Team Locker Room @ B	SK	NA		10/5/2024					Sign
1069-3	West Gym Boy's Team Locker Room @ C	SK	NA		10/5/2024					Sign
1068-1	West Gym Girl's Team Locker Room @ A	SK	NA		10/5/2024					Sign
1068-2	West Gym Girl's Team Locker Room @ B	SK	NA		10/5/2024					Sign
1068-3	West Gym Girl's Team Locker Room @ C	SK	NA		10/5/2024					Sign
1069-1	West Gym	IM	App	<1.0	10/5/2024					
1070-1	West Gym Trainer's Office	SK	App	4.0	10/5/2024					
1070-1	West Gym Trainer's Office Bathroom	SK	NA		10/5/2024					Sign
1071-1	West Gym Girl's Locker Room	WF	App		2/8/2023					Non-functional
1071-2	West Gym Girl's Locker Room Bathroom @ A	SK	NA		10/5/2024					Sign
1071-3	West Gym Girl's Locker Room Bathroom @ B	SK	NA		10/5/2024					Sign
1071-4	West Gym Girl's Locker Room Bathroom @ C	SK	NA		10/5/2024					Sign
1072-1	West Gym Boy's Locker Room Bathroom @ A	SK	NA		10/5/2024					Sign
1072-2	West Gym Boy's Locker Room Bathroom @ B	SK	NA		10/5/2024					Sign
1072-3	West Gym Boy's Locker Room Bathroom @ C	SK	NA		10/5/2024					Removed from Service
1073-1	Room 175 Counter 1	SK	NA		10/5/2024					Sign
1073-2	Room 175 Counter 2	SK	NA		10/5/2024					Sign
1074-1	Room 174 Counter 1	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1074-2	Room 174 Counter 2	SK	NA		10/5/2024					Sign
1075-1	Hall by Room 173	WF	App	<1.0	10/5/2024					
1075-2	Hall by Room 173	BF	App	<1.0	10/5/2024					
1076-1	West Gym Girl's Bathroom @ A	SK	NA		10/5/2024					Sign
1076-2	West Gym Girl's Bathroom @ B	SK	NA		10/5/2024					Sign
1076-3	West Gym Girl's Bathroom @ C	SK	NA		10/5/2024					Sign
1076-4	West Gym Girl's Bathroom @ D	SK	NA		10/5/2024					Sign
1076-5	West Gym Girl's Bathroom @ E	SK	NA		10/5/2024					Sign
1077-1	West Gym	WF	App	<1.0	10/5/2024					
1077-2	West Gym	BF	App	<1.0	10/5/2024					
1078-1	West Gym Boy's Bathroom @ A	SK	NA		10/5/2024					Sign
1078-2	West Gym Boy's Bathroom @ B	SK	NA		10/5/2024					Sign
1078-3	West Gym Boy's Bathroom @ C	SK	NA		10/5/2024					Sign
1078-4	West Gym Boy's Bathroom @ D	SK	NA		10/5/2024					Removed from Service
1078-5	West Gym Boy's Bathroom @ E	SK	NA		10/5/2024					Sign
1079-1	Room 135 Counter 1	SK	NA		10/5/2024					Sign
1079-2	Room 135 Counter 2	SK	NA		10/5/2024					Sign
1079-3	Room 135 Station 1	SK	NA		10/5/2024					Sign
1079-4	Room 135 Station 2	SK	NA		10/5/2024					Sign
1079-5	Room 135 Station 3	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1079-6	Room 135 Station 4	SK	NA		10/5/2024					Sign
1079-7	Room 135 Station 5	SK	NA		10/5/2024					Sign
1079-8	Room 135 Station 6	SK	NA		10/5/2024					Sign
1079-9	Room 135 Station 7	SK	NA		10/5/2024					Sign
1079-10	Room 135 Station 8	SK	NA		10/5/2024					Sign
1080-1	Room 134 Dispenser 1	SK	NA		10/5/2024					Sign
1080-2	Room 134 Dispenser 2	SK	NA		10/5/2024					Sign
1080-3	Room 134 Dispenser 3	SK	NA		10/5/2024					Sign
1081-1	Room 133 Counter	SK	NA		10/5/2024					Sign
1081-2	Room 133 Station 1	SK	NA		10/5/2024					Sign
1081-3	Room 133 Station 2	SK	NA		10/5/2024					Sign
1081-4	Room 133 Station 3	SK	NA		10/5/2024					Sign
1082-1	Men's Bathroom by 9 / 10 Kitchen	SK	NA		10/5/2024					Sign
1083-1	Women's Bathroom by 9 / 10 Kitchen	SK	NA		10/5/2024					Sign
1084-1	9/10 Grade Kitchen	IM	NA		10/5/2024					Removed from Service
1084-2	9/10 Grade Kitchen 2-Bay	SK	App	4.0	10/5/2024					
1084-3	9/10 Grade Kitchen Handwash @ A	SK	NA		10/5/2024					Sign
1084-4	9/10 Grade Kitchen 3-Bay @ A	SK	NA		10/5/2024					Hot Only; Sign
1084-5	9/10 Grade Kitchen 3-Bay @ A	SPY	NA		10/5/2024					Hot Only; Sign
1084-6	9/10 Grade Kitchen 3-Bay @ B	SK	NA		10/5/2024					Hot Only; Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
1084-7	9/10 Grade Kitchen Handwash @ B	SK	NA		10/5/2024					Sign
1084-8	9/10 Grade Kitchen - left	PF	App	3.0	10/5/2024					
1084-9	9/10 Grade Kitchen - right	PF	App	2.0	10/5/2024					
1084-11	9/10 Grade Kitchen Island	SK	App	9.0	10/5/2024					
1085-1	9/10 Grade Serving Line Handwash	SK	NA		10/5/2024					Sign
1086-1	Room 163 Kitchen Prep 2-Bay	SK	App	<1.0	10/5/2024					
1086-2	Room 163 Kitchen Prep Handwash	SK	NA		10/5/2024					Sign
1086-3	Room 163 Kitchen Prep 3-Bay	SK	NA		10/5/2024					Sign
1086-4	Room 163 Kitchen Prep 3-Bay	SPY	NA		10/5/2024					Sign
0001-1	Supply Room Unit @ A	SK	NA		10/5/2024					Sign
0001-2	Supply Room Unit @ B	SK	NA		10/5/2024					Sign
0001-3	Supply Room Unit @ C	SK	NA		10/5/2024					Sign
0002-1	Faculty Bathroom by Culinary	SK	NA		10/5/2024					Sign
0003-1	Boy's Bathroom by Culinary	SK	NA		10/5/2024					Sign
0004-1	Girl's Bathroom by Culinary	SK	NA		10/5/2024					Sign
0005-1	Custodial Closet by Culinary	SS	NA		10/5/2024					Sign
0006-1	Culinary Kitchen Bathroom @ A	SK	NA		10/5/2024					Sign
0006-2	Culinary Kitchen Bathroom @ B	SK	NA		10/5/2024					Sign
0006-3	Culinary Kitchen Laundry Room	SS	NA		10/5/2024					Sign
0006-4	Culinary Kitchen Handwash @ A	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
0006-5	Culinary Kitchen Handwash @ B	SK	NA		10/5/2024					Sign
0006-6	Culinary Kitchen Handwash @ C	SK	NA		10/5/2024					Sign
0006-7	Culinary Kitchen 3-Bay Sanitizer @ A	SK	NA		10/5/2024					Sign
0006-8	Culinary Kitchen 3-Bay Sanitizer @ B	SPY	NA		10/5/2024					Sign
0006-9	Culinary Kitchen Handwash @ D	SK	NA		10/5/2024					Sign
0006-10	Culinary Kitchen	SS	NA		10/5/2024					Sign
0006-11	Culinary Kitchen 3-Bay @ A	SK	NA		10/5/2024					Sign
0006-12	Culinary Kitchen 3-Bay @ B	SK	NA		10/5/2024					Sign
0006-14	Culinary Kitchen Island by Storage	SK	App	1.0	10/5/2024					
0006-15	Culinary Kitchen Island by Baking Goods	SK	App	4.0	10/5/2024					
0006-17	Culinary Kitchen by Stove	PF	App	3.0	10/5/2024					
0006-18	Culinary Kitchen by Pot	PF	App	31.0	10/5/2024					Removed from Service Pending Remediation
2001-1	Hall by Room 226	WF	App	3.0	10/5/2024					
2002-1	Men's Bathroom by Room 226 @ A	SK	NA		10/5/2024					Sign
2002-2	Men's Bathroom by Room 226 @ B	SK	NA		10/5/2024					Sign
2003-1	Unisex Bathroom in Office Storage @ A	SK	NA		10/5/2024					Sign
2003-2	Unisex Bathroom in Office Storage @ B	SK	NA		10/5/2024					Sign
2004-1	Room 228 Teacher's Station	SK	NA		10/5/2024					Sign
2004-2	Room 228 Pod 1 @ A	SK	NA		10/5/2024					Sign
2004-3	Room 228 Pod 1 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2004-4	Room 228 Pod 2 @ A	SK	NA		10/5/2024					Sign
2004-5	Room 228 Pod 2 @ B	SK	NA		10/5/2024					Sign
2004-6	Room 228 Pod 3 @ A	SK	NA		10/5/2024					Sign
2004-7	Room 228 Pod 3 @ B	SK	NA		10/5/2024					Sign
2004-8	Room 228 Pod 4 @ A	SK	NA		10/5/2024					Sign
2004-9	Room 228 Pod 4 @ B	SK	NA		10/5/2024					Sign
2004-10	Room 228 Pod 5 @ A	SK	NA		10/5/2024					Sign
2004-11	Room 228 Pod 5 @ B	SK	NA		10/5/2024					Sign
2004-12	Room 228 Pod 6 @ A	SK	NA		10/5/2024					Sign
2004-13	Room 228 Pod 6 @ B	SK	NA		10/5/2024					Sign
2004-14	Room 228 Pod 7-Middle @ A	SK	NA		10/5/2024					Sign
2004-15	Room 228 Pod 7-Middle @ B	SK	NA		10/5/2024					Sign
2005-1	Room 228 Prep Room	SK	NA		10/5/2024					Sign
2006-1	Custodial Closet by Room 204	SS	NA		10/5/2024					Sign
2007-1	Room 209 Teacher's Station @ A	SK	NA		10/5/2024					Sign
2007-2	Room 209 Teacher's Station @ B	SK	NA		10/5/2024					Sign
2007-3	Room 209 Counter @ A	SK	NA		10/5/2024					Sign
2007-4	Room 209 Counter @ B	SK	NA		10/5/2024					Sign
2007-5	Room 209 Counter @ C	SK	NA		10/5/2024					Sign
2007-6	Room 209 Counter @ D	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2007-7	Room 209 Counter @ E	SK	NA		10/5/2024					Sign
2007-8	Room 209 Counter @ F	SK	NA		10/5/2024					Sign
2007-9	Room 209 Counter @ G	SK	NA		10/5/2024					Sign
2007-10	Room 209 Counter @ H	SK	NA		10/5/2024					Sign
2007-11	Room 209 Counter @ I	SK	NA		10/5/2024					Sign
2007-12	Room 209 Counter @ J	SK	NA		10/5/2024					Sign
2007-13	Room 209 Counter @ K	SK	NA		10/5/2024					Sign
2007-14	Room 209 Counter @ L	SK	NA		10/5/2024					Sign
2007-15	Room 209 Counter @ M	SK	NA		10/5/2024					Sign
2007-16	Room 209 Counter @ N	SK	NA		10/5/2024					Sign
2008-1	Staff Bathroom by Room 207	SK	NA		10/5/2024					Sign
2009-1	Boy's Bathroom by Room 207 Trough @ A	SK	NA		10/5/2024					Mixed Valve; Sign
2009-2	Boy's Bathroom by Room 207 Trough @ B	SK	NA		10/5/2024					Mixed Valve; Sign
2009-3	Boy's Bathroom by Room 207 Trough @ C	SK	NA		10/5/2024					Mixed Valve; Sign
2010-1	Staff Bathroom by Room 209	SK	NA		10/5/2024					Sign
2011-1	Girl's Bathroom by Room 209 Trough @ A	SK	NA		10/5/2024					Mixed Valve; Sign
2011-2	Girl's Bathroom by Room 209 Trough @ B	SK	NA		10/5/2024					Mixed Valve; Sign
2011-3	Girl's Bathroom by Room 209 Trough @ C	SK	NA		10/5/2024					Mixed Valve; Sign
2012-1	Staff Bathroom by Room 211	SK	NA		10/5/2024					Sign
2013-1	Staff Bathroom by Room 214	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2014-1	Hall by Room 214	WF	App	<1.0	10/5/2024					
2014-2	Hall by Room 214	BF	App	<1.0	10/5/2024					
2015-1	Room 217 Teacher's Station @ A	SK	NA		10/5/2024					Sign
2015-2	Room 217 Teacher's Station @ B	SK	NA		10/5/2024					Sign
2015-3	Room 217 Counter @ A	SK	NA		10/5/2024					Sign
2015-4	Room 217 Counter @ B	SK	NA		10/5/2024					Sign
2015-5	Room 217 Counter @ C	SK	NA		10/5/2024					Sign
2015-6	Room 217 Counter @ D	SK	NA		10/5/2024					Sign
2015-7	Room 217 Counter @ E	SK	NA		10/5/2024					Sign
2015-8	Room 217 Counter @ F	SK	NA		10/5/2024					Sign
2015-9	Room 217 Counter @ G	SK	NA		10/5/2024					Sign
2015-10	Room 217 Counter @ H	SK	NA		10/5/2024					Sign
2015-11	Room 217 Counter @ I	SK	NA		10/5/2024					Sign
2015-12	Room 217 Counter @ J	SK	NA		10/5/2024					Sign
2015-13	Room 217 Counter @ K	SK	NA		10/5/2024					Sign
2016-1	Room 218 Teacher's Station @ A	SK	NA		10/5/2024					Sign
2016-2	Room 218 Teacher's Station @ B	SK	NA		10/5/2024					Sign
2016-3	Room 218 Counter @ A	SK	NA		10/5/2024					Sign
2016-4	Room 218 Counter @ B	SK	NA		10/5/2024					Sign
2016-5	Room 218 Counter @ C	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2016-6	Room 218 Counter @ D	SK	NA		10/5/2024					Sign
2016-7	Room 218 Counter @ E	SK	NA		10/5/2024					Sign
2016-8	Room 218 Counter @ F	SK	NA		10/5/2024					Sign
2017-1	Room 218A Prep Room	SK	NA		10/5/2024					Sign
2018-1	Hall by Room 219	WF	App		10/5/2024					Non-functional
2019-1	Room 219 Teacher's Station @ A	SK	NA		10/5/2024					Sign
2019-2	Room 219 Teacher's Station @ B	SK	NA		10/5/2024					Sign
2019-3	Room 219 Counter @ A	SK	NA		10/5/2024					Sign
2019-4	Room 219 Counter @ B	SK	NA		10/5/2024					Sign
2019-5	Room 219 Counter @ C	SK	NA		10/5/2024					Sign
2019-6	Room 219 Counter @ D	SK	NA		10/5/2024					Sign
2019-7	Room 219 Counter @ E	SK	NA		10/5/2024					Sign
2019-8	Room 219 Counter @ F	SK	NA		10/5/2024					Sign
2020-1	Custodial Closet by Room 219	SS	NA		10/5/2024					Sign
2021-1	Staff Bathroom by Room 221	SK	NA		10/5/2024					Sign
2022-1	Boy's Bathroom by Room 221 Trough @ A	SK	NA		10/5/2024					Mixed Valve; Sign
2022-2	Boy's Bathroom by Room 221 Trough @ B	SK	NA		10/5/2024					Mixed Valve; Sign
2022-3	Boy's Bathroom by Room 221 Trough @ C	SK	NA		10/5/2024					Mixed Valve; Sign
2023-1	Staff Bathroom by Room 223	SK	NA		10/5/2024					Sign
2024-1	Girl's Bathroom by Room 223 Trough @ A	SK	NA		10/5/2024					Mixed Valve; Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2024-2	Girl's Bathroom by Room 223 Trough @ B	SK	NA		10/5/2024					Mixed Valve; Sign
2024-3	Girl's Bathroom by Room 223 Trough @ C	SK	NA		10/5/2024					Mixed Valve; Sign
2025-1	Room 221 Teacher's Station @ A	SK	NA		10/5/2024					Removed from Service
2025-2	Room 221 Teacher's Station @ B	SK	NA		10/5/2024					Removed from Service
2025-3	Room 221 Counter @ A	SK	NA		10/5/2024					Sign
2025-4	Room 221 Table 1 @ A	SK	NA		10/5/2024					Removed from Service
2025-5	Room 221 Table 1 @ B	SK	NA		10/5/2024					Removed from Service
2025-6	Room 221 Table 2 @ A	SK	NA		10/5/2024					Removed from Service
2025-7	Room 221 Table 2 @ B	SK	NA		10/5/2024					Removed from Service
2025-8	Room 221 Table 3 @ A	SK	NA		10/5/2024					Removed from Service
2025-9	Room 221 Table 3 @ B	SK	NA		10/5/2024					Removed from Service
2025-10	Room 221 Table 4 @ A	SK	NA		10/5/2024					Removed from Service
2025-11	Room 221 Table 4 @ B	SK	NA		10/5/2024					Removed from Service
2025-12	Room 221 Table 5 @ A	SK	NA		10/5/2024					Removed from Service
2025-13	Room 221 Table 5 @ B	SK	NA		10/5/2024					Removed from Service
2025-14	Room 221 Table 6 @ A	SK	NA		10/5/2024					Removed from Service
2025-15	Room 221 Table 6 @ B	SK	NA		10/5/2024					Removed from Service
2026-1	Room 222 Art Table @ A	SK	NA		10/5/2024					Sign
2026-2	Room 222 Art Table @ B	SK	NA		10/5/2024					Sign
2026-3	Room 222 Art Table @ C	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2026-4	Room 222 Art Table @ D	SK	NA		10/5/2024					Sign
2026-5	Room 222 Art Table @ E	SK	NA		10/5/2024					Sign
2026-6	Room 222 Art Table @ F	SK	NA		10/5/2024					Sign
2026-7	Room 222 Art Counter	SK	NA		10/5/2024					Sign
2026-8	Room 222 Dark Room	SS	NA		10/5/2024					Sign
2027-1	Room 260 Teacher's Station	SK	NA		10/5/2024					Sign
2027-2	Room 260 Pod 1 @ A	SK	NA		10/5/2024					Sign
2027-3	Room 260 Pod 1 @ B	SK	NA		10/5/2024					Sign
2027-4	Room 260 Pod 2 @ A	SK	NA		10/5/2024					Sign
2027-5	Room 260 Pod 2 @ B	SK	NA		10/5/2024					Sign
2027-6	Room 260 Pod 3 @ A	SK	NA		10/5/2024					Sign
2027-7	Room 260 Pod 3 @ B	SK	NA		10/5/2024					Sign
2027-8	Room 260 Pod 4 @ A	SK	NA		10/5/2024					Sign
2027-9	Room 260 Pod 4 @ B	SK	NA		10/5/2024					Sign
2027-10	Room 260 Pod 5 @ A	SK	NA		10/5/2024					Sign
2027-11	Room 260 Pod 5 @ B	SK	NA		10/5/2024					Sign
2027-12	Room 260 Pod 6 @ A	SK	NA		10/5/2024					Sign
2027-13	Room 260 Pod 6 @ B	SK	NA		10/5/2024					Sign
2027-14	Room 260 Pod 7 @ A	SK	NA		10/5/2024					Sign
2027-15	Room 260 Pod 7 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2027-16	Room 260 Counter	SK	NA		10/5/2024					Sign
2028-1	Room 260 Prep Room	SK	NA		10/5/2024					Sign
2029-1	Room 259 Teacher's Station	SK	NA		10/5/2024					Sign
2029-2	Room 259 Counter	SK	NA		10/5/2024					Sign
2029-3	Room 259 Pod 1 @ A	SK	NA		10/5/2024					Sign
2029-4	Room 259 Pod 1 @ B	SK	NA		10/5/2024					Sign
2029-5	Room 259 Pod 2 @ A	SK	NA		10/5/2024					Sign
2029-6	Room 259 Pod 2 @ B	SK	NA		10/5/2024					Sign
2029-7	Room 259 Pod 3 @ A	SK	NA		10/5/2024					Sign
2029-8	Room 259 Pod 3 @ B	SK	NA		10/5/2024					Sign
2029-9	Room 259 Pod 4 @ A	SK	NA		10/5/2024					Sign
2029-10	Room 259 Pod 4 @ B	SK	NA		10/5/2024					Sign
2029-11	Room 259 Pod 5 @ A	SK	NA		10/5/2024					Sign
2029-12	Room 259 Pod 5 @ B	SK	NA		10/5/2024					Sign
2029-13	Room 259 Pod 6 @ A	SK	NA		10/5/2024					Sign
2029-14	Room 259 Pod 6 @ B	SK	NA		10/5/2024					Sign
2029-15	Room 259 Pod 7 @ A	SK	NA		10/5/2024					Sign
2029-16	Room 259 Pod 7 @ B	SK	NA		10/5/2024					Sign
2030-1	Room 259 Prep Room	SK	NA		10/5/2024					Sign
2031-1	Room 258 Teacher's Station	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2031-2	Room 258 Counter	SK	NA		10/5/2024					Sign
2031-3	Room 258 Pod 1 @ A	SK	NA		10/5/2024					Sign
2031-4	Room 258 Pod 1 @ B	SK	NA		10/5/2024					Sign
2031-5	Room 258 Pod 2 @ A	SK	NA		10/5/2024					Sign
2031-6	Room 258 Pod 2 @ B	SK	NA		10/5/2024					Sign
2031-7	Room 258 Pod 3 @ A	SK	NA		10/5/2024					Sign
2031-8	Room 258 Pod 3 @ B	SK	NA		10/5/2024					Sign
2031-9	Room 258 Pod 4 @ A	SK	NA		10/5/2024					Sign
2031-10	Room 258 Pod 4 @ B	SK	NA		10/5/2024					Sign
2031-11	Room 258 Pod 5 @ A	SK	NA		10/5/2024					Sign
2031-12	Room 258 Pod 5 @ B	SK	NA		10/5/2024					Sign
2031-13	Room 258 Pod 6 @ A	SK	NA		10/5/2024					Sign
2031-14	Room 258 Pod 6 @ B	SK	NA		10/5/2024					Sign
2031-15	Room 258 Pod 7 @ A	SK	NA		10/5/2024					Sign
2031-16	Room 258 Pod 7 @ B	SK	NA		10/5/2024					Sign
2032-1	Room 257 Teacher's Station	SK	NA		10/5/2024					Sign
2032-2	Room 257 Pod 1 @ A	SK	NA		10/5/2024					Sign
2032-3	Room 257 Pod 1 @ B	SK	NA		10/5/2024					Sign
2032-4	Room 257 Pod 2 @ A	SK	NA		10/5/2024					Sign
2032-5	Room 257 Pod 2 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2032-6	Room 257 Pod 3 @ A	SK	NA		10/5/2024					Sign
2032-7	Room 257 Pod 3 @ B	SK	NA		10/5/2024					Sign
2032-8	Room 257 Pod 4 @ A	SK	NA		10/5/2024					Sign
2032-9	Room 257 Pod 4 @ B	SK	NA		10/5/2024					Sign
2032-10	Room 257 Pod 5 @ A	SK	NA		10/5/2024					Sign
2032-11	Room 257 Pod 5 @ B	SK	NA		10/5/2024					Sign
2032-12	Room 257 Pod 6 @ A	SK	NA		10/5/2024					Sign
2032-13	Room 257 Pod 6 @ B	SK	NA		10/5/2024					Sign
2032-14	Room 257 Pod 7 @ A	SK	NA		10/5/2024					Sign
2032-15	Room 257 Pod 7 @ B	SK	NA		10/5/2024					Sign
2032-16	Room 257 Counter	SK	NA		10/5/2024					Sign
2033-1	Room 254 Teacher's Station	SK	NA		10/5/2024					Sign
2033-2	Room 254 Pod 1 @ A	SK	NA		10/5/2024					Sign
2033-3	Room 254 Pod 1 @ B	SK	NA		10/5/2024					Sign
2033-4	Room 254 Pod 2 @ A	SK	NA		10/5/2024					Sign
2033-5	Room 254 Pod 2 @ B	SK	NA		10/5/2024					Sign
2033-6	Room 254 Pod 3 @ A	SK	NA		10/5/2024					Sign
2033-7	Room 254 Pod 3 @ B	SK	NA		10/5/2024					Sign
2033-8	Room 254 Pod 4 @ A	SK	NA		10/5/2024					Sign
2033-9	Room 254 Pod 4 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2033-10	Room 254 Pod 5 @ A	SK	NA		10/5/2024					Sign
2033-11	Room 254 Pod 5 @ B	SK	NA		10/5/2024					Sign
2033-12	Room 254 Pod 6 @ A	SK	NA		10/5/2024					Sign
2033-13	Room 254 Pod 6 @ B	SK	NA		10/5/2024					Sign
2033-14	Room 254 Pod 7 @ A	SK	NA		10/5/2024					Sign
2033-15	Room 254 Pod 7 @ B	SK	NA		10/5/2024					Sign
2033-16	Room 254 Counter	SK	NA		10/5/2024					Sign
2034-1	Room 254A Prep Room	SK	NA		10/5/2024					Sign
2035-1	Room 252 Teacher's Station	SK	NA		10/5/2024					Sign
2035-2	Room 252 Counter	SK	NA		10/5/2024					Sign
2035-3	Room 252 Pod 1 @ A	SK	NA		10/5/2024					Sign
2035-4	Room 252 Pod 1 @ B	SK	NA		10/5/2024					Sign
2035-5	Room 252 Pod 2 @ A	SK	NA		10/5/2024					Sign
2035-6	Room 252 Pod 2 @ B	SK	NA		10/5/2024					Sign
2035-7	Room 252 Pod 3 @ A	SK	NA		10/5/2024					Sign
2035-8	Room 252 Pod 3 @ B	SK	NA		10/5/2024					Sign
2035-9	Room 252 Pod 4 @ A	SK	NA		10/5/2024					Sign
2035-10	Room 252 Pod 4 @ B	SK	NA		10/5/2024					Sign
2035-11	Room 252 Pod 5 @ A	SK	NA		10/5/2024					Sign
2035-12	Room 252 Pod 5 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2035-13	Room 252 Pod 6 @ A	SK	NA		10/5/2024					Sign
2035-14	Room 252 Pod 6 @ B	SK	NA		10/5/2024					Sign
2035-15	Room 252 Pod 7 @ A	SK	NA		10/5/2024					Sign
2035-16	Room 252 Pod 7 @ B	SK	NA		10/5/2024					Sign
2036-1	Men's Faculty Bathroom by Room 251	SK	NA		10/5/2024					Sign
2037-1	Women's Faculty Bathroom by Room 250	SK	NA		10/5/2024					Sign
2038-1	Girl's Bathroom by Teacher's Lounge - left	SK	NA		10/5/2024					Sign
2038-2	Girl's Bathroom by Teacher's Lounge - middle	SK	NA		10/5/2024					Sign
2038-3	Girl's Bathroom by Teacher's Lounge - right	SK	NA		10/5/2024					Sign
2039-1	Custodial Closet by Teacher's Lounge	SS	NA		10/5/2024					Sign
2040-1	Hall by Teacher's Lounge	WF	App	<1.0	10/5/2024					
2041-1	Boy's Bathroom by Teacher's Lounge - left	SK	NA		10/5/2024					Removed from Service
2041-2	Boy's Bathroom by Teacher's Lounge - middle	SK	NA		10/5/2024					Removed from Service
2041-3	Boy's Bathroom by Teacher's Lounge - right	SK	NA		10/5/2024					Sign
2042-1	Teacher's Lounge Kitchenette	SK	App	6.0	10/5/2024					
2043-1	Room 244 Teacher's Station	SK	NA		10/5/2024					Sign
2043-2	Room 244 Pod 1 @ A	SK	NA		10/5/2024					Sign
2043-3	Room 244 Pod 1 @ B	SK	NA		10/5/2024					Sign
2043-4	Room 244 Pod 2 @ A	SK	NA		10/5/2024					Sign
2043-5	Room 244 Pod 2 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2043-6	Room 244 Pod 3 @ A	SK	NA		10/5/2024					Sign
2043-7	Room 244 Pod 3 @ B	SK	NA		10/5/2024					Sign
2043-8	Room 244 Pod 4 @ A	SK	NA		10/5/2024					Sign
2043-9	Room 244 Pod 4 @ B	SK	NA		10/5/2024					Sign
2043-10	Room 244 Pod 5 @ A	SK	NA		10/5/2024					Sign
2043-11	Room 244 Pod 5 @ B	SK	NA		10/5/2024					Sign
2043-12	Room 244 Pod 6 @ A	SK	NA		10/5/2024					Sign
2043-13	Room 244 Pod 6 @ B	SK	NA		10/5/2024					Sign
2043-14	Room 244 Pod 7 @ A	SK	NA		10/5/2024					Sign
2043-15	Room 244 Pod 7 @ B	SK	NA		10/5/2024					Sign
2043-16	Room 244 Counter	SK	NA		10/5/2024					Sign
2044-1	Room 246A Prep Room	SK	NA		10/5/2024					Sign
2045-1	Room 246 Teacher's Station	SK	NA		10/5/2024					Sign
2045-2	Room 246 Counter	SK	NA		10/5/2024					Sign
2045-3	Room 246 Pod 1 @ A	SK	NA		10/5/2024					Sign
2045-4	Room 246 Pod 1 @ B	SK	NA		10/5/2024					Sign
2045-5	Room 246 Pod 2 @ A	SK	NA		10/5/2024					Sign
2045-6	Room 246 Pod 2 @ B	SK	NA		10/5/2024					Sign
2045-7	Room 246 Pod 3 @ A	SK	NA		10/5/2024					Sign
2045-8	Room 246 Pod 3 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2045-9	Room 246 Pod 4 @ A	SK	NA		10/5/2024					Sign
2045-10	Room 246 Pod 4 @ B	SK	NA		10/5/2024					Sign
2045-11	Room 246 Pod 5 @ A	SK	NA		10/5/2024					Sign
2045-12	Room 246 Pod 5 @ B	SK	NA		10/5/2024					Sign
2045-13	Room 246 Pod 6 @ A	SK	NA		10/5/2024					Sign
2045-14	Room 246 Pod 6 @ B	SK	NA		10/5/2024					Sign
2045-15	Room 246 Pod 7 @ A	SK	NA		10/5/2024					Sign
2045-16	Room 246 Pod 7 @ B	SK	NA		10/5/2024					Sign
2046-1	Girl's Bathroom by Room 244 - left	SK	NA		10/5/2024					Sign
2046-2	Girl's Bathroom by Room 244 - middle	SK	NA		10/5/2024					Sign
2046-3	Girl's Bathroom by Room 244 - right	SK	NA		10/5/2024					Sign
2047-1	Custodial Closet by Room 244	SS	NA		10/5/2024					Sign
2048-1	Hall by Room 244	WF	App	<1.0	10/5/2024					
2049-1	Faculty Bathroom by Room 244	SK	NA		10/5/2024					Sign
2050-1	Boy's Bathroom by Room 246 - left	SK	NA		10/5/2024					Sign
2050-2	Boy's Bathroom by Room 246 - middle	SK	NA		10/5/2024					Sign
2050-3	Boy's Bathroom by Room 246 - right	SK	NA		10/5/2024					Removed from Service
2051-1	Room 245 Teacher's Station	SK	NA		10/5/2024					Sign
2051-2	Room 245 Counter	SK	NA		10/5/2024					Sign
2051-3	Room 245 Pod 1 @ A	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2051-4	Room 245 Pod 1 @ B	SK	NA		10/5/2024					Sign
2051-5	Room 245 Pod 2 @ A	SK	NA		10/5/2024					Sign
2051-6	Room 245 Pod 2 @ B	SK	NA		10/5/2024					Sign
2051-7	Room 245 Pod 3 @ A	SK	NA		10/5/2024					Sign
2051-8	Room 245 Pod 3 @ B	SK	NA		10/5/2024					Sign
2051-9	Room 245 Pod 4 @ A	SK	NA		10/5/2024					Sign
2051-10	Room 245 Pod 4 @ B	SK	NA		10/5/2024					Sign
2051-11	Room 245 Pod 5 @ A	SK	NA		10/5/2024					Sign
2051-12	Room 245 Pod 5 @ B	SK	NA		10/5/2024					Sign
2051-13	Room 245 Pod 6 @ A	SK	NA		10/5/2024					Sign
2051-14	Room 245 Pod 6 @ B	SK	NA		10/5/2024					Sign
2051-15	Room 245 Pod 7 @ A	SK	NA		10/5/2024					Sign
2051-16	Room 245 Pod 7 @ B	SK	NA		10/5/2024					Sign
2052-1	Room 245 Prep Room	SK	NA		10/5/2024					Sign
2053-1	Room 247 Teacher's Station	SK	NA		10/5/2024					Sign
2053-2	Room 247 Pod 1 @ A	SK	NA		10/5/2024					Sign
2053-3	Room 247 Pod 1 @ B	SK	NA		10/5/2024					Sign
2053-4	Room 247 Pod 2 @ A	SK	NA		10/5/2024					Sign
2053-5	Room 247 Pod 2 @ B	SK	NA		10/5/2024					Sign
2053-6	Room 247 Pod 3 @ A	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2053-7	Room 247 Pod 3 @ B	SK	NA		10/5/2024					Sign
2053-8	Room 247 Pod 4 @ A	SK	NA		10/5/2024					Sign
2053-9	Room 247 Pod 4 @ B	SK	NA		10/5/2024					Sign
2053-10	Room 247 Pod 5 @ A	SK	NA		10/5/2024					Sign
2053-11	Room 247 Pod 5 @ B	SK	NA		10/5/2024					Sign
2053-12	Room 247 Pod 6 @ A	SK	NA		10/5/2024					Sign
2053-13	Room 247 Pod 6 @ B	SK	NA		10/5/2024					Sign
2053-14	Room 247 Pod 7 @ A	SK	NA		10/5/2024					Sign
2053-15	Room 247 Pod 7 @ B	SK	NA		10/5/2024					Sign
2053-16	Room 247 Counter	SK	NA		10/5/2024					Sign
2054-1	Room 248 Teacher's Station	SK	NA		10/5/2024					Sign
2054-2	Room 248 Pod 1 @ A	SK	NA		10/5/2024					Sign
2054-3	Room 248 Pod 1 @ B	SK	NA		10/5/2024					Sign
2054-4	Room 248 Pod 2 @ A	SK	NA		10/5/2024					Sign
2054-5	Room 248 Pod 2 @ B	SK	NA		10/5/2024					Sign
2054-6	Room 248 Pod 3 @ A	SK	NA		10/5/2024					Sign
2054-7	Room 248 Pod 3 @ B	SK	NA		10/5/2024					Sign
2054-8	Room 248 Pod 4 @ A	SK	NA		10/5/2024					Sign
2054-9	Room 248 Pod 4 @ B	SK	NA		10/5/2024					Sign
2054-10	Room 248 Pod 5 @ A	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2054-11	Room 248 Pod 5 @ B	SK	NA		10/5/2024					Sign
2054-12	Room 248 Pod 6 @ A	SK	NA		10/5/2024					Sign
2054-13	Room 248 Pod 6 @ B	SK	NA		10/5/2024					Sign
2054-14	Room 248 Pod 7 @ A	SK	NA		10/5/2024					Sign
2054-15	Room 248 Pod 7 @ B	SK	NA		10/5/2024					Sign
2054-16	Room 248 Counter	SK	NA		10/5/2024					Sign
2055-1	Room 248A Prep Room	SK	NA		10/5/2024					Sign
2056-1	Room 249 Teacher's Station	SK	NA		10/5/2024					Sign
2056-2	Room 249 Counter	SK	NA		10/5/2024					Sign
2056-3	Room 249 Pod 1 @ A	SK	NA		10/5/2024					Sign
2056-4	Room 249 Pod 1 @ B	SK	NA		10/5/2024					Sign
2056-5	Room 249 Pod 2 @ A	SK	NA		10/5/2024					Sign
2056-6	Room 249 Pod 2 @ B	SK	NA		10/5/2024					Sign
2056-7	Room 249 Pod 3 @ A	SK	NA		10/5/2024					Sign
2056-8	Room 249 Pod 3 @ B	SK	NA		10/5/2024					Sign
2056-9	Room 249 Pod 4 @ A	SK	NA		10/5/2024					Sign
2056-10	Room 249 Pod 4 @ B	SK	NA		10/5/2024					Sign
2056-11	Room 249 Pod 5 @ A	SK	NA		10/5/2024					Sign
2056-12	Room 249 Pod 5 @ B	SK	NA		10/5/2024					Sign
2056-13	Room 249 Pod 6 @ A	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2056-14	Room 249 Pod 6 @ B	SK	NA		10/5/2024					Sign
2056-15	Room 249 Pod 7 @ A	SK	NA		10/5/2024					Sign
2056-16	Room 249 Pod 7 @ B	SK	NA		10/5/2024					Sign
2057-1	Room 223 Teacher's Station	SK	NA		10/5/2024					Sign
2057-2	Room 223 Counter @ A	SK	NA		10/5/2024					Sign
2057-3	Room 223 Counter @ B	SK	NA		10/5/2024					Sign
2057-4	Room 223 Pod 1 @ A	SK	NA		10/5/2024					Sign
2057-5	Room 223 Pod 1 @ B	SK	NA		10/5/2024					Sign
2057-6	Room 223 Pod 2 @ A	SK	NA		10/5/2024					Sign
2057-7	Room 223 Pod 2 @ B	SK	NA		10/5/2024					Sign
2057-8	Room 223 Pod 3 @ A	SK	NA		10/5/2024					Sign
2057-9	Room 223 Pod 3 @ B	SK	NA		10/5/2024					Sign
2057-10	Room 223 Pod 4 @ A	SK	NA		10/5/2024					Sign
2057-11	Room 223 Pod 4 @ B	SK	NA		10/5/2024					Sign
2057-12	Room 223 Pod 5 @ A	SK	NA		10/5/2024					Sign
2057-13	Room 223 Pod 5 @ B	SK	NA		10/5/2024					Sign
2057-14	Room 223 Pod 6 @ A	SK	NA		10/5/2024					Sign
2057-15	Room 223 Pod 6 @ B	SK	NA		10/5/2024					Sign
2057-16	Room 223 Pod 7 @ A	SK	NA		10/5/2024					Sign
2057-17	Room 223 Pod 7 @ B	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2058-1	Room 231A Prep Room	SK	NA		10/5/2024					Sign
2059-1	Room 231 Teacher's Station	SK	NA		10/5/2024					Sign
2059-2	Room 231 Pod 1 @ A	SK	NA		10/5/2024					Sign
2059-3	Room 231 Pod 1 @ B	SK	NA		10/5/2024					Sign
2059-4	Room 231 Pod 2 @ A	SK	NA		10/5/2024					Sign
2059-5	Room 231 Pod 2 @ B	SK	NA		10/5/2024					Sign
2059-6	Room 231 Pod 3 @ A	SK	NA		10/5/2024					Sign
2059-7	Room 231 Pod 3 @ B	SK	NA		10/5/2024					Sign
2059-8	Room 231 Pod 4 @ A	SK	NA		10/5/2024					Sign
2059-9	Room 231 Pod 4 @ B	SK	NA		10/5/2024					Sign
2059-10	Room 231 Pod 5 @ A	SK	NA		10/5/2024					Sign
2059-11	Room 231 Pod 5 @ B	SK	NA		10/5/2024					Sign
2059-12	Room 231 Pod 6 @ A	SK	NA		10/5/2024					Sign
2059-13	Room 231 Pod 6 @ B	SK	NA		10/5/2024					Sign
2059-14	Room 231 Pod 7 @ A	SK	NA		10/5/2024					Sign
2059-15	Room 231 Pod 7 @ B	SK	NA		10/5/2024					Sign
2059-16	Room 231 Counter @ A	SK	NA		10/5/2024					Sign
2059-17	Room 231 Counter @ B	SK	NA		10/5/2024					Sign
2060-1	Room 236 Home Economics	SK	App	<1.0	10/5/2024					
2061-1	Girl's Bathroom by Room 236 - left	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2061-2	Girl's Bathroom by Room 236 - middle	SK	NA		10/5/2024					Sign
2061-3	Girl's Bathroom by Room 236 - right	SK	NA		10/5/2024					Sign
2062-1	Custodial Closet by Room 236	SS	NA		10/5/2024					Sign
2063-1	Hall by Room 226	WF	App	3.0	10/5/2024					
2064-1	Faculty Bathroom by Room 236	SK	NA		10/5/2024					Sign
2065-1	Boy's Bathroom by Room 236 - left	SK	NA		10/5/2024					Sign
2065-2	Boy's Bathroom by Room 236 - middle	SK	NA		10/5/2024					Sign
2065-3	Boy's Bathroom by Room 236 - right	SK	NA		10/5/2024					Sign
2066-1	Room 232 Medical Assisting Teacher's Station	SK	NA		10/5/2024					Sign
2066-2	Room 232 Exam Area @ A	SK	NA		10/5/2024					Sign
2066-3	Room 232 Exam Area @ B	SK	NA		10/5/2024					Sign
2066-4	Room 232 Exam Area @ C	SK	NA		10/5/2024					Sign
2066-5	Room 232 Exam Area @ D	SK	NA		10/5/2024					Sign
2066-6	Room 232 Exam Area @ E	SK	NA		10/5/2024					Sign
2066-7	Room 232 Exam Area @ F	SK	NA		10/5/2024					Sign
2066-8	Room 232 Exam Area @ G	SK	NA		10/5/2024					Sign
2066-9	Room 232 Exam Area @ H	SK	NA		10/5/2024					Sign
2066-10	Room 232 Exam Area @ I	SK	NA		10/5/2024					Sign
2067-1	Room 229	SK	NA		10/5/2024					Sign
2068-1	Room 440	SK	NA		10/5/2024					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2069-1	Girls Bathroom by Room 416 Trough 1 @ A	SK	NA		10/5/2024					Mixed Valve; Sign
2069-2	Girls Bathroom by Room 416 Trough 1 @ B	SK	NA		10/5/2024					Mixed Valve; Sign
2069-3	Girls Bathroom by Room 416 Trough 1 @ C	SK	NA		10/5/2024					Mixed Valve; Sign
2069-4	Girls Bathroom by Room 416 Trough 2 @ A	SK	NA		10/5/2024					Mixed Valve; Sign
2069-5	Girls Bathroom by Room 416 Trough 2 @ B	SK	NA		10/5/2024					Mixed Valve; Sign
2069-6	Girls Bathroom by Room 416 Trough 2 @ C	SK	NA		10/5/2024					Mixed Valve; Sign
2070-1	Custodial Closet by Room 416	SS	NA		10/5/2024					Sign
2071-1	Hall by Room 416 - left	WF	App	<1.0	2/8/2023					
2071-2	Hall by Room 416 - right	WF	App	<1.0	2/8/2023					
2072-1	Faculty Handicap Bathroom	SK	NA		10/5/24					Sign
2073-1	Boy's Bathroom by Room 416 Trough 1 @ A	SK	NA		10/5/24					Mixed Valve; Sign
2073-2	Boy's Bathroom by Room 416 Trough 1 @ B	SK	NA		10/5/24					Mixed Valve; Sign
2073-3	Boy's Bathroom by Room 416 Trough 1 @ C	SK	NA		10/5/24					Mixed Valve; Sign
2073-4	Boy's Bathroom by Room 416 Trough 2 @ A	SK	NA		10/5/24					Mixed Valve; Sign
2073-5	Boy's Bathroom by Room 416 Trough 2 @ B	SK	NA		10/5/24					Mixed Valve; Sign
2073-6	Boy's Bathroom by Room 416 Trough 2 @ C	SK	NA		10/5/24					Mixed Valve; Sign
2074-1	Women's Bathroom by Room 416	SK	NA		10/5/24					Sign
2075-1	Men's Bathroom by Room 416	SK	NA		10/5/24					Sign
2076-1	Hall by Room 454	WF	App		2/8/2023					Non-functional
2077-1	Hall by Room 413 - left	WF	App	<1.0	2/8/2023					

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2077-2	Hall by Room 413 - right	WF	App	<1.0	2/8/2023					
2078-1	Room 407 Teacher's Station	SK	NA		10/5/24					Sign
2078-2	Room 407 Pod 1 @ A	SK	NA		10/5/24					Sign
2078-3	Room 407 Pod 1 @ B	SK	NA		10/5/24					Sign
2078-4	Room 407 Pod 2 @ A	SK	NA		10/5/24					Sign
2078-5	Room 407 Pod 2 @ B	SK	NA		10/5/24					Sign
2078-6	Room 407 Pod 3 @ A	SK	NA		10/5/24					Sign
2078-7	Room 407 Pod 3 @ B	SK	NA		10/5/24					Sign
2078-8	Room 407 Pod 4 @ A	SK	NA		10/5/24					Sign
2078-9	Room 407 Pod 4 @ B	SK	NA		10/5/24					Sign
2078-10	Room 407 Pod 5 @ A	SK	NA		10/5/24					Sign
2078-11	Room 407 Pod 5 @ B	SK	NA		10/5/24					Sign
2078-12	Room 407 Pod 6 @ A	SK	NA		10/5/24					Sign
2078-13	Room 407 Pod 6 @ B	SK	NA		10/5/24					Sign
2078-14	Room 407 Pod 7 @ A	SK	NA		10/5/24					Sign
2078-15	Room 407 Pod 7 @ B	SK	NA		10/5/24					Sign
2078-16	Room 407 Counter @ A	SK	NA		10/5/24					Sign
2078-17	Room 407 Counter @ B	SK	NA		10/5/24					Sign
2079-1	Room 405A Prep Room	SK	NA		10/5/24					Sign
2080-1	Room 408 Teacher's Station	SK	NA		10/5/24					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2080-2	Room 408 Counter @ A	SK	NA		10/5/24					Sign
2080-3	Room 408 Counter @ B	SK	NA		10/5/24					Sign
2080-4	Room 408 Pod 1 @ A	SK	NA		10/5/24					Sign
2080-5	Room 408 Pod 1 @ B	SK	NA		10/5/24					Sign
2080-6	Room 408 Pod 2 @ A	SK	NA		10/5/24					Sign
2080-7	Room 408 Pod 2 @ B	SK	NA		10/5/24					Sign
2080-8	Room 408 Pod 3 @ A	SK	NA		10/5/24					Sign
2080-9	Room 408 Pod 3 @ B	SK	NA		10/5/24					Sign
2080-10	Room 408 Pod 4 @ A	SK	NA		10/5/24					Sign
2080-11	Room 408 Pod 4 @ B	SK	NA		10/5/24					Sign
2080-12	Room 408 Pod 5 @ A	SK	NA		10/5/24					Sign
2080-13	Room 408 Pod 5 @ B	SK	NA		10/5/24					Sign
2080-14	Room 408 Pod 6 @ A	SK	NA		10/5/24					Sign
2080-15	Room 408 Pod 6 @ B	SK	NA		10/5/24					Sign
2080-16	Room 408 Pod 7 @ A	SK	NA		10/5/24					Sign
2080-17	Room 408 Pod 7 @ B	SK	NA		10/5/24					Sign
2081-1	Room 406A Prep Room	SK	NA		10/5/24					Sign
2082-1	Room 406 Teacher's Station	SK	NA		10/5/24					Sign
2082-2	Room 406 Pod 1 @ A	SK	NA		10/5/24					Sign
2082-3	Room 406 Pod 1 @ B	SK	NA		10/5/24					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2082-4	Room 406 Pod 2 @ A	SK	NA		10/5/24					Sign
2082-5	Room 406 Pod 2 @ B	SK	NA		10/5/24					Sign
2082-6	Room 406 Pod 3 @ A	SK	NA		10/5/24					Sign
2082-7	Room 406 Pod 3 @ B	SK	NA		10/5/24					Sign
2082-8	Room 406 Pod 4 @ A	SK	NA		10/5/24					Sign
2082-9	Room 406 Pod 4 @ B	SK	NA		10/5/24					Sign
2082-10	Room 406 Pod 5 @ A	SK	NA		10/5/24					Sign
2082-11	Room 406 Pod 5 @ B	SK	NA		10/5/24					Sign
2082-12	Room 406 Pod 6 @ A	SK	NA		10/5/24					Sign
2082-13	Room 406 Pod 6 @ B	SK	NA		10/5/24					Sign
2082-14	Room 406 Pod 7 @ A	SK	NA		10/5/24					Sign
2082-15	Room 406 Pod 7 @ B	SK	NA		10/5/24					Sign
2082-16	Room 406 Counter @ A	SK	NA		10/5/24					Sign
2082-17	Room 406 Counter @ B	SK	NA		10/5/24					Sign
2083-1	Room 405 Teacher's Station	SK	NA		10/5/24					Sign
2083-2	Room 405 Counter @ A	SK	NA		10/5/24					Sign
2083-3	Room 405 Counter @ B	SK	NA		10/5/24					Sign
2083-4	Room 405 Pod 1 @ A	SK	NA		10/5/24					Sign
2083-5	Room 405 Pod 1 @ B	SK	NA		10/5/24					Sign
2083-6	Room 405 Pod 2 @ A	SK	NA		10/5/24					Sign

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2083-7	Room 405 Pod 2 @ B	SK	NA		10/5/24					Sign
2083-8	Room 405 Pod 3 @ A	SK	NA		10/5/24					Sign
2083-9	Room 405 Pod 3 @ B	SK	NA		10/5/24					Sign
2083-10	Room 405 Pod 4 @ A	SK	NA		10/5/24					Sign
2083-11	Room 405 Pod 4 @ B	SK	NA		10/5/24					Sign
2083-12	Room 405 Pod 5 @ A	SK	NA		10/5/24					Sign
2083-13	Room 405 Pod 5 @ B	SK	NA		10/5/24					Sign
2083-14	Room 405 Pod 6 @ A	SK	NA		10/5/24					Sign
2083-15	Room 405 Pod 6 @ B	SK	NA		10/5/24					Sign
2083-16	Room 405 Pod 7 @ A	SK	NA		10/5/24					Sign
2083-17	Room 405 Pod 7 @ B	SK	NA		10/5/24					Sign
2084-1	Boy's Bathroom by Room 404 Trough 1 @ A	SK	NA		10/5/24					Mixed Valve; Sign
2084-2	Boy's Bathroom by Room 404 Trough 1 @ B	SK	NA		10/5/24					Mixed Valve; Sign
2084-3	Boy's Bathroom by Room 404 Trough 1 @ C	SK	NA		10/5/24					Mixed Valve; Sign
2084-4	Boy's Bathroom by Room 404 Trough 2 @ A	SK	NA		10/5/24					Mixed Valve; Sign
2084-5	Boy's Bathroom by Room 404 Trough 2 @ B	SK	NA		10/5/24					Mixed Valve; Sign
2084-6	Boy's Bathroom by Room 404 Trough 2 @ C	SK	NA		10/5/24					Mixed Valve; Sign
2085-1	Faculty Bathroom by Room 404	SK	NA		10/5/24					Sign
2086-1	Hall by Room 404 - left	WF	App	<1.0	10/5/24					
2086-2	Hall by Room 404 - right	WF	App	<1.0	10/5/24					

Space #	Sample Location	Fixture Type	App or NA	Initial 1 <sup>st</sup> Draw Results (ppb)	Initial 1st Draw Sampling Date	Resampling 1 <sup>st</sup> Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Resampling Date	Remarks
2087-1	Custodial Closet by Room 404	SS	NA		10/5/24					Sign
2088-1	Girl's Bathroom by Room 404 Trough 1 @ A	SK	NA		10/5/24					Mixed Valve; Sign
2088-2	Girl's Bathroom by Room 404 Trough 1 @ B	SK	NA		10/5/24					Mixed Valve; Sign
2088-3	Girl's Bathroom by Room 404 Trough 1 @ C	SK	NA		10/5/24					Mixed Valve; Sign
2088-4	Boy's Bathroom by Room 404 Trough 2 @ A	SK	NA		10/5/24					Mixed Valve; Sign
2088-5	Boy's Bathroom by Room 404 Trough 2 @ B	SK	NA		10/5/24					Mixed Valve; Sign
2088-6	Boy's Bathroom by Room 404 Trough 2 @ C	SK	NA		10/5/24					Mixed Valve; Sign
2089-1	Hall by Boiler Room 419 - left	WF	App	<1.0	10/5/24					
2089-2	Hall by Boiler Room 419 - right	WF	App	<1.0	10/5/24					

## Laboratory Report

NYE Report #: 230435-24087

February 13, 2023

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; William Floyd High School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 09, 2023. New York Environmental analyzed the samples on February 10, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	08 Feb 2023
Date Received:	09 Feb 2023
Date Analyzed:	10 Feb 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
230209P022	1	11 / 12 Grade Serving Line - left-WF, Initial	0.001	<0.001	mg/L	
230209P023	2	East Nurse's Office Exam Room-SK, Initial	0.001	0.019	mg/L	H
230209P024	3	Hall by Room 214-WF, Initial	0.001	<0.001	mg/L	
230209P025	4	Hall by Room 416 - left-WF, Initial	0.001	<0.001	mg/L	
230209P026	5	Hall by Room 416 - right-WF, Initial	0.001	<0.001	mg/L	
230209P027	6	Hall by Room 413 - left-WF, Initial	0.001	<0.001	mg/L	
230209P028	7	Hall by Room 413 - right-WF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

## Laboratory Report

NYE Report #: 2406231-31386

October 10, 2024

Project Manager  
Enviroscience Consultants, Inc.  
2150 Smithtown Avenue  
Ronkonkoma, NY 11779

Project: William Floyd UFSD; William Floyd High School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on October 08, 2024. New York Environmental analyzed the samples on October 09, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



---

Li Tsang, Laboratory Director

Date Collected:	05 Oct 2024
Date Received:	08 Oct 2024
Date Analyzed:	09 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241008J036	1	11/12 Grade Serving Line - left-WF, Initial	0.001	<0.001	mg/L	
241008J037	2	11/12 Grade Serving Line - right-WF, Initial	0.001	<0.001	mg/L	
241008J038	3	11/12 Grade Kitchen-IM, Initial	0.001	<0.001	mg/L	
241008J039	4	11 / 12 Grade Cafeteria - left-WF, Initial	0.001	<0.001	mg/L	
241008J040	5	11/12 Grade Cafeteria - right-WF, Initial	0.001	<0.001	mg/L	
241008J041	6	Hall by ROTC-BF, Initial	0.001	0.002	mg/L	
241008J042	7	Hall by ROTC-WF, Initial	0.001	<0.001	mg/L	
241008J043	8	Nurses Office Hallway-BF, Initial	0.001	<0.001	mg/L	
241008J044	9	Nurses Office Hallway-WF, Initial	0.001	<0.001	mg/L	
241008J045	10	East Nurse's Office-SK, Initial	0.001	0.002	mg/L	
241008J046	11	East Nurse's Office SPY, Initial	0.001	<0.001	mg/L	
241008J047	12	District Office Kitchenette-SK, Initial	0.001	<0.001	mg/L	
241008J048	13	Human Resources Break Room-SK, Initial	0.001	0.004	mg/L	
241008J049	14	Human Resources Break Room-SPY, Initial	0.001	<0.001	mg/L	
241008J050	15	Hall by Library-BF, Initial	0.001	<0.001	mg/L	
241008J051	16	Hall by Library-WF, Initial	0.001	<0.001	mg/L	
241008J052	17	Library Office-SK, Initial	0.001	0.004	mg/L	
241008J053	18	Main Office Kitchenette-SK, Initial	0.001	0.003	mg/L	
241008J054	19	Hall by Room 151-WF, Initial	0.001	<0.001	mg/L	
241008J055	20	Hall by Room 141-WF, Initial	0.001	<0.001	mg/L	
241008J056	21	West Nurse's Office-SK, Initial	0.001	<0.001	mg/L	
241008J057	22	West Gym-IM, Initial	0.001	<0.001	mg/L	
241008J058	23	West Gym Trainer's Office-SK, Initial	0.001	0.004	mg/L	
241008J059	24	Room 315 Counter-SK, Initial	0.001	<0.001	mg/L	
241008J060	25	Hall by West Wing Elevator - left-WF, Initial	0.001	<0.001	mg/L	
241008J061	26	Hall by West Wing Elevator - right-WF, Initial	0.001	<0.001	mg/L	



Date Collected:	05 Oct 2024
Date Received:	08 Oct 2024
Date Analyzed:	09 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
241008J062	27	Room 319 Counter 1 @ A-SK, Initial	0.001	<0.001	mg/L	
241008J063	28	Room 319 Counter 1 @ B-SK, Initial	0.001	<0.001	mg/L	
241008J064	29	Room 319 Counter 2-SK, Initial	0.001	<0.001	mg/L	
241008J065	30	Hall by Room 318 - left-WF, Initial	0.001	<0.001	mg/L	
241008J066	31	Hall by Room 318 - right-WF, Initial	0.001	<0.001	mg/L	
241008J067	32	Hall by Room 321-WF, Initial	0.001	<0.001	mg/L	
241008J068	33	Hall by Room 173-BF, Initial	0.001	<0.001	mg/L	
241008J069	34	Hall by Room 173-WF, Initial	0.001	<0.001	mg/L	
241008J070	35	West Gym-BF, Initial	0.001	<0.001	mg/L	
241008J071	36	West Gym-WF, Initial	0.001	<0.001	mg/L	
241008J072	37	9/10 Grade Kitchen 2-Bay Prep-SK, Initial	0.001	0.004	mg/L	
241008J073	38	9/10 Grade Kitchen Island -SK, Initial	0.001	0.009	mg/L	H
241008J074	39	9/10 Grade Kitchen - left-PF, Initial	0.001	0.003	mg/L	
241008J075	40	9/10 Grade Kitchen - right-PF, Initial	0.001	0.002	mg/L	
241008J076	41	Room 163 Kitchen Prep 2-Bay-SK, Initial	0.001	<0.001	mg/L	
241008J077	42	Culinary Kitchen Island by Baking Goods-SK, Initial	0.001	0.004	mg/L	
241008J078	43	Culinary Kitchen Island by Storage-SK, Initial	0.001	0.001	mg/L	
241008J079	44	Culinary Kitchen by Stove-PF, Initial	0.001	0.003	mg/L	
241008J080	45	Culinary Kitchen by Pot-PF, Initial	0.001	0.031	mg/L	H
241008J081	46	Hall by Room 226-WF, Initial	0.001	0.003	mg/L	
241008J082	47	Hall by Room 214-BF, Initial	0.001	<0.001	mg/L	
241008J083	48	Hall by Room 214-WF, Initial	0.001	<0.001	mg/L	
241008J084	49	Hall by Teacher's Lounge-WF, Initial	0.001	<0.001	mg/L	
241008J085	50	Teacher's Lounge Kitchenette-SK, Initial	0.001	0.006	mg/L	H
241008J086	51	Hall by Room 244-WF, Initial	0.001	<0.001	mg/L	
241008J087	52	Room 236 Home Economics-SK, Initial	0.001	<0.001	mg/L	
241008J088	53	Room 440-SK, Initial	0.001	<0.001	mg/L	



Date Collected:	05 Oct 2024
Date Received:	08 Oct 2024
Date Analyzed:	09 Oct 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
241008J089	54	Hall by Room 416 - left-WF, Initial	0.001	<0.001	mg/L	
241008J090	55	Hall by Room 416 - right-WF, Initial	0.001	<0.001	mg/L	
241008J091	56	Hall by Room 413 - left-WF, Initial	0.001	<0.001	mg/L	
241008J092	57	Hall by Room 413 - right-WF, Initial	0.001	<0.001	mg/L	
241008J093	58	Hall by Room 404 - left-WF, Initial	0.001	<0.001	mg/L	
241008J094	59	Hall by Room 404 - right-WF, Initial	0.001	<0.001	mg/L	
241008J095	60	Hall by Boiler Room 419 - left-WF, Initial	0.001	<0.001	mg/L	
241008J096	61	Hall by Boiler Room 419 - right-WF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.