LYNWOOD UNIFIED SCHOOL DISTRICT

BOARD OF EDUCATION
Julian Del Real-Calleros • Gary Hardie Jr., Ed.D.
Alfonso Morales, Esq. • Alma Carina Castro, Ed.D.• Maria G. Lopez
Superintendent: Dr. Patrick Gittisriboongul, Ed.D.

ADDENDUM 001

For

BID# 14MOT26

Firebaugh High School HVAC Units Replacement at

Administration/Library and Gym Buildings – DSA #03-125870

March 30, 2026

This Addendum forms a part of the Contract Documents and modifies the original Bidding Documents. Acknowledge receipt of this Addendum in space provided on the Bid Form. Failure to acknowledge may subject Bidder to disqualification.

1.1- Structural

1.1-1. Reference to Sheet **FRAMING PLAN S501**

1.1-2. See attached **PARTIAL FRAMING PLAN S501 ADD01**

1.1-2.1. Revise **FRAMING PLAN S501ADD01,** to include a (N) ducts work pr attachment.

1.1-2.2. **Add new detail 9/S601 TYP DUCT SUPPORT ALONG CMU WALL,** to the construction documents, per the attachment.

1.1-2.3. **Add new detail 10/S601 TYP DUCT SUPPORT AT CMU WALL,** to the construction documents, per the attachment.

1.1-2.4. **Add new detail 11/S601 TYP DUCT SUPPORT BASE DETAIL,** to the construction documents, per the attachment.

1.2- Mechanical

1.2-1. Reference to Sheet **BUILDING 2A CONSTRUCTION ROOF PLAN M3.1**


1.2-2. See attached **PARTIAL BUILDING 2A CONSTRUCTION ROOF PLAN M3.1 ADD01**

1.2-2.1. Revise **PARTIAL BUILDING 2A CONSTRUCTION ROOF PLAN ADD01,** to include a (N) ducts work pr attachment.


1.2-2.2. **Revise detail 2/M4.1 SUPPORT FOR RECTANGULAR DUCT ON ROOF FOR BLDG 2A (CONC OVER METAL DECK),** per attachment.

1.2-2.3. **Revise detail 7/M4. SUPPORT FOR RECTANGULAR DUCT ON ROOF FOR BLDG 5 (1-1/2" 16 GA METAL DECK)**, per the attachment.

PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
DSA #	03-125870	
CCD #	001	
DATE	04/2026	
PSE JOB #	2025-131	
TITLE	PARTIAL PLAN S201	

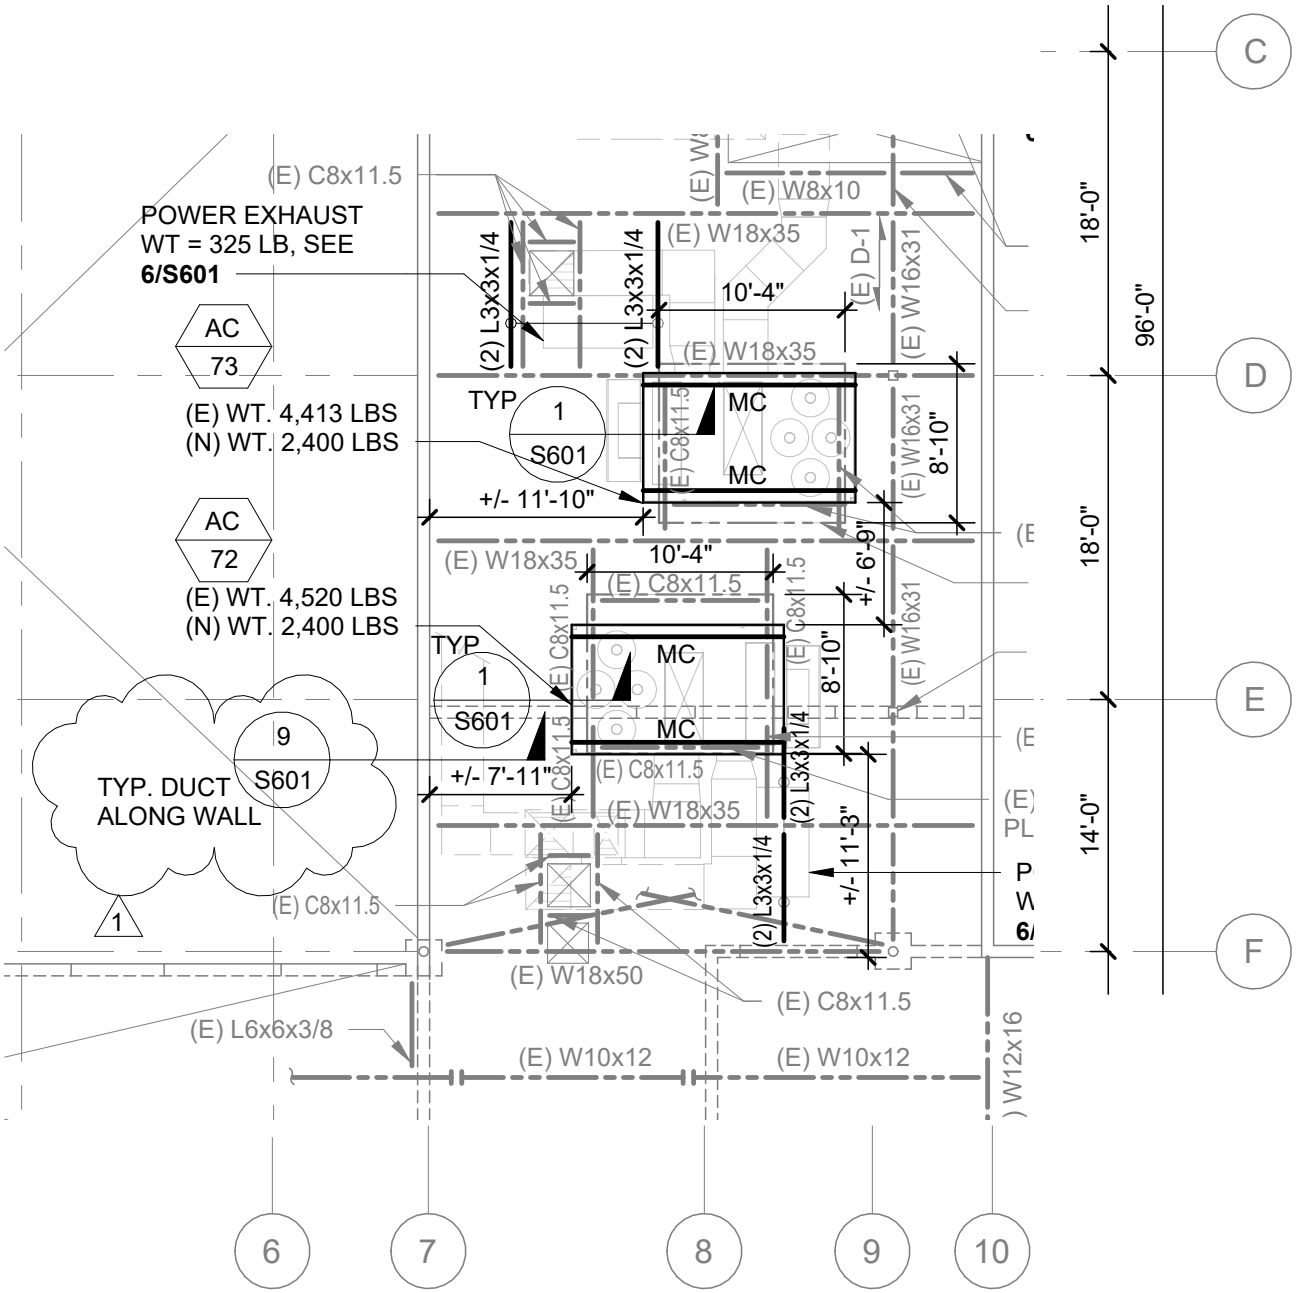


PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
DSA #	03-125870	
CCD #	001	
DATE	04/2026	
PSE JOB #	2025-131	
TITLE	PARITAL PLAN S501	

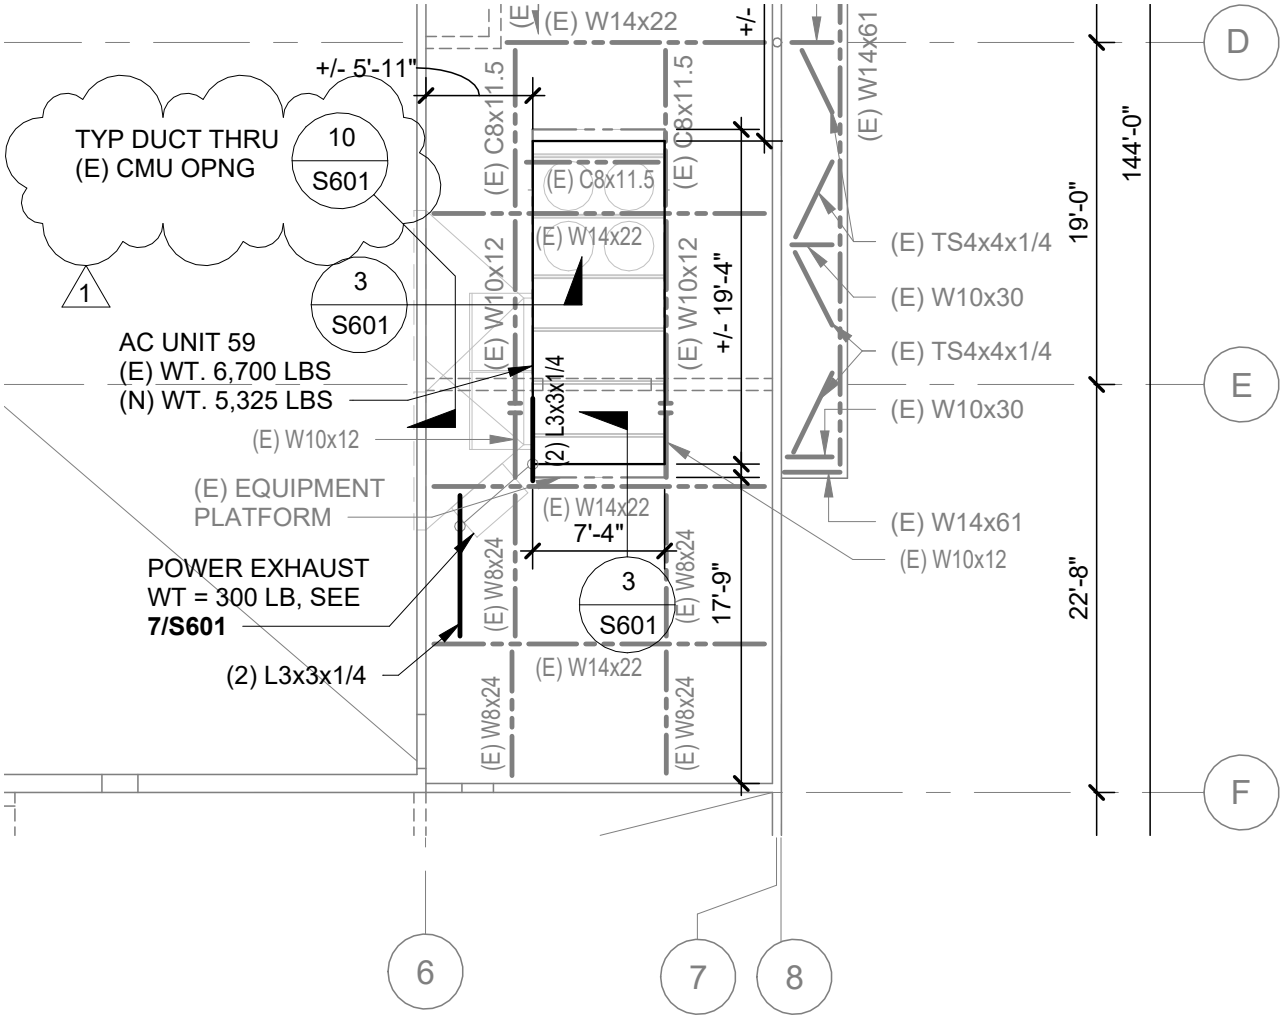

PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
DSA #	03-125870	
CCD #	001	
DATE	04/2026	
PSE JOB #	2025-131	
TITLE	NEW DETAIL 9/S601	

NOTE:
1. PROVIDE ANGLE SUPPORTS AT MAX. 6'-0" OC.

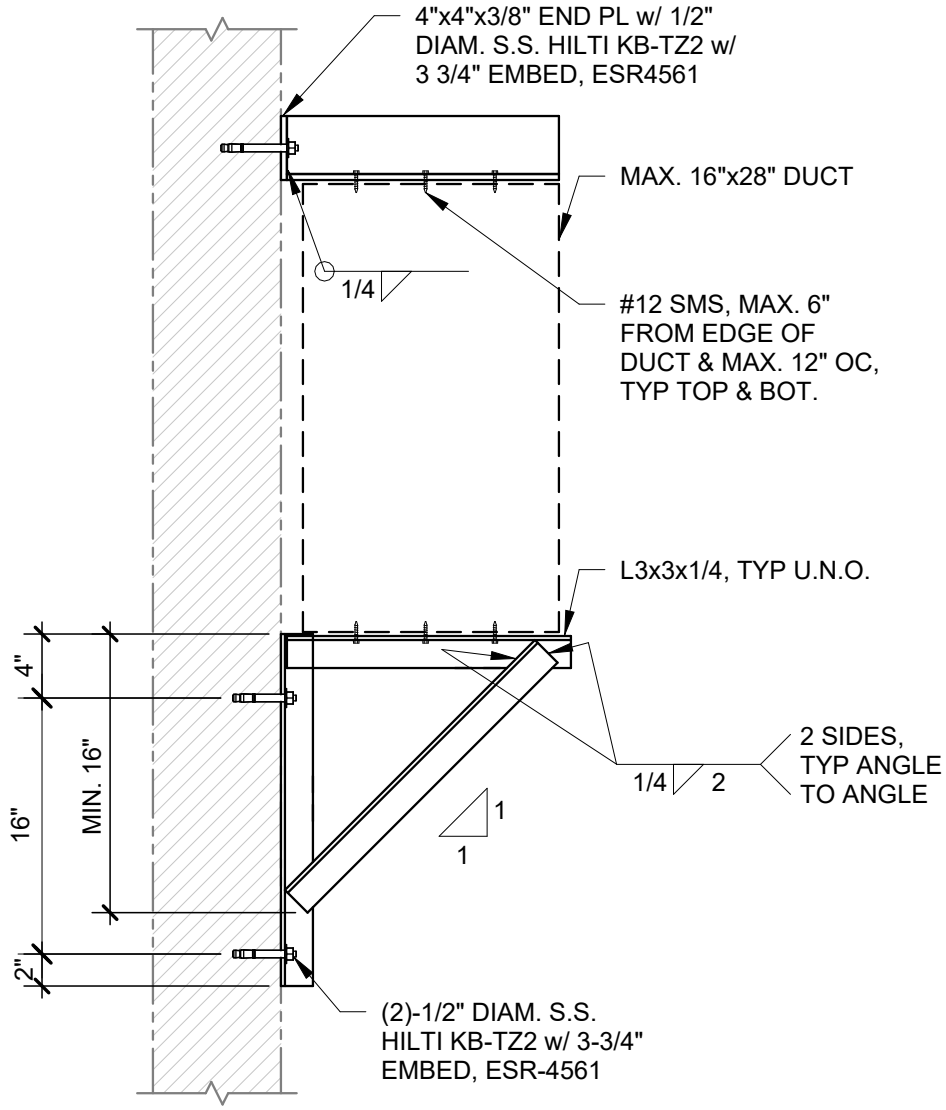


TYP DUCT SUPPORT ALONG CMU WALL

SCALE: NTS

1

9

	PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
	DSA #	03-125870	
	CCD #	001	
	DATE	04/2026	
	PSE JOB #	2025-131	
	TITLE	NEW DETAIL 10/S601	

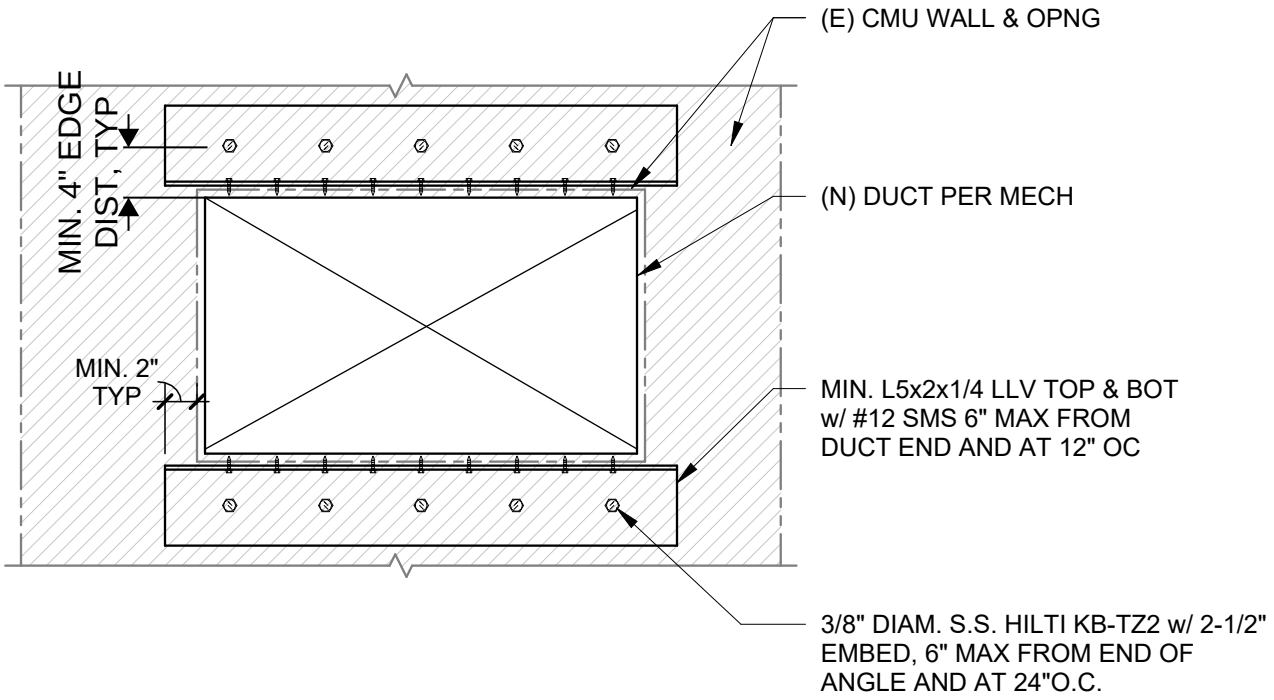


TYP DUCT SUPPORT AT CMU WALL


1

10

SCALE: NTS

	PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
	DSA #	03-125870	
	CCD #	001	
	DATE	04/2026	
	PSE JOB #	2025-131	
	TITLE	NEW DETAIL 11/S601	

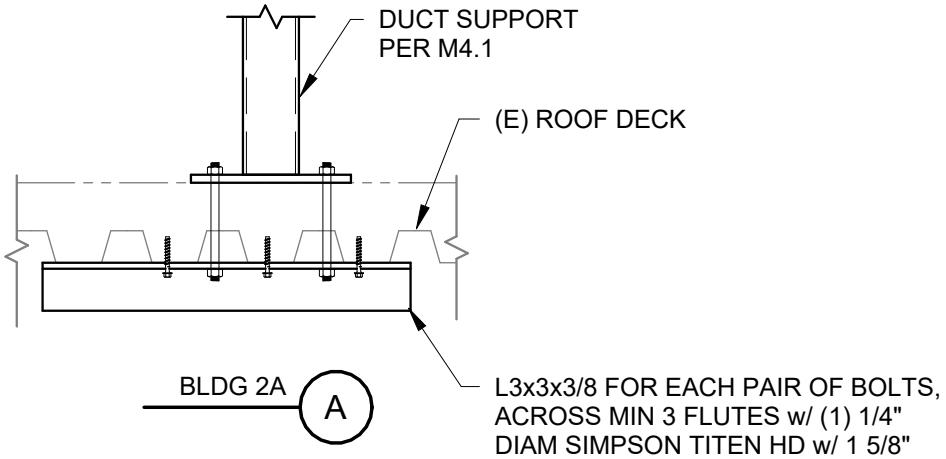

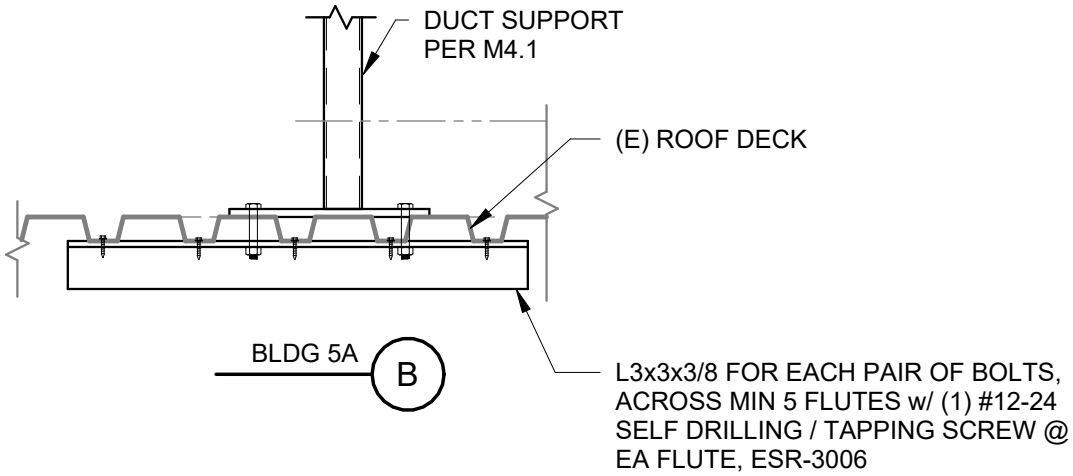


TYP DUCT SUPPORT BASE DETAIL

1


SCALE: NTS

11

	PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
	DSA #	03-125870	
	CCD #	001	
	DATE	04/2026	
	PSE JOB #	2025-131	
	TITLE	PARTIAL PLAN M3.1	

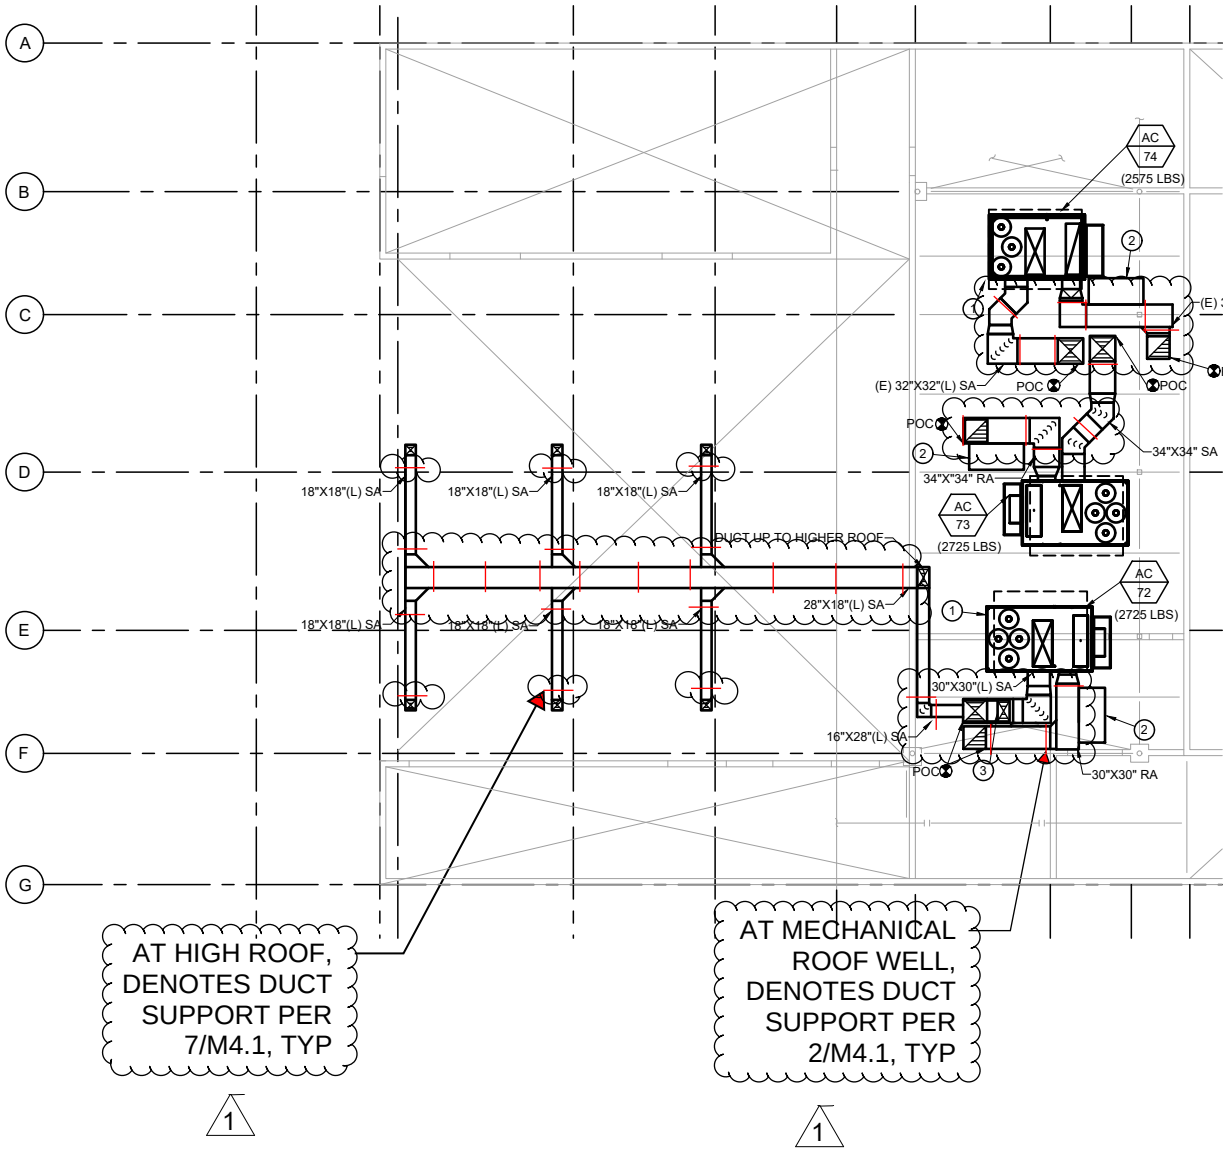


	PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
	DSA #	03-125870	
	CCD #	001	
	DATE	04/2026	
	PSE JOB #	2025-131	
	TITLE		

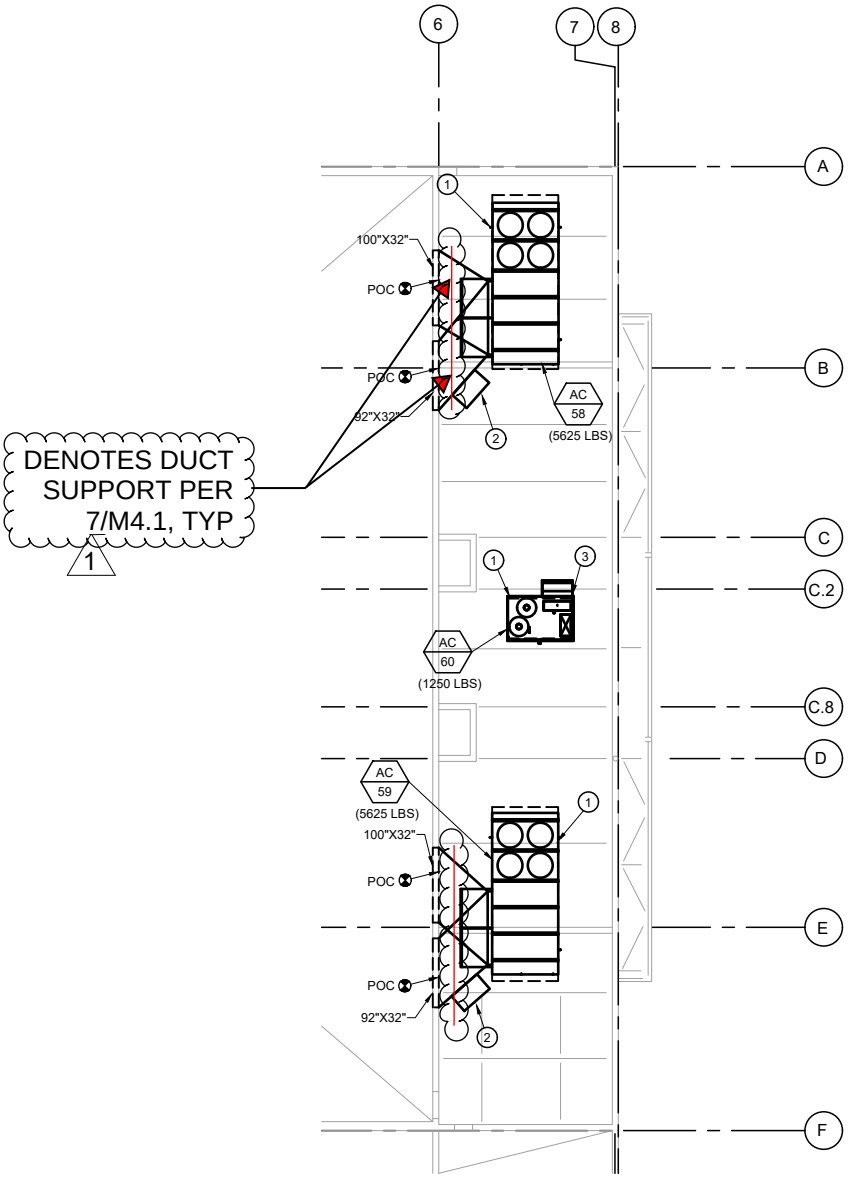

PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
DSA #	03-125870	
CCD #	001	
DATE	04/2026	
PSE JOB #	2025-131	
TITLE	REVISED DETAIL 2/M4.1	

NOTE:
DUCT SUPPORTS SHALL BE SPACED 8'-0" O.C. AND EVERY CHANGE OF DIRECTION.

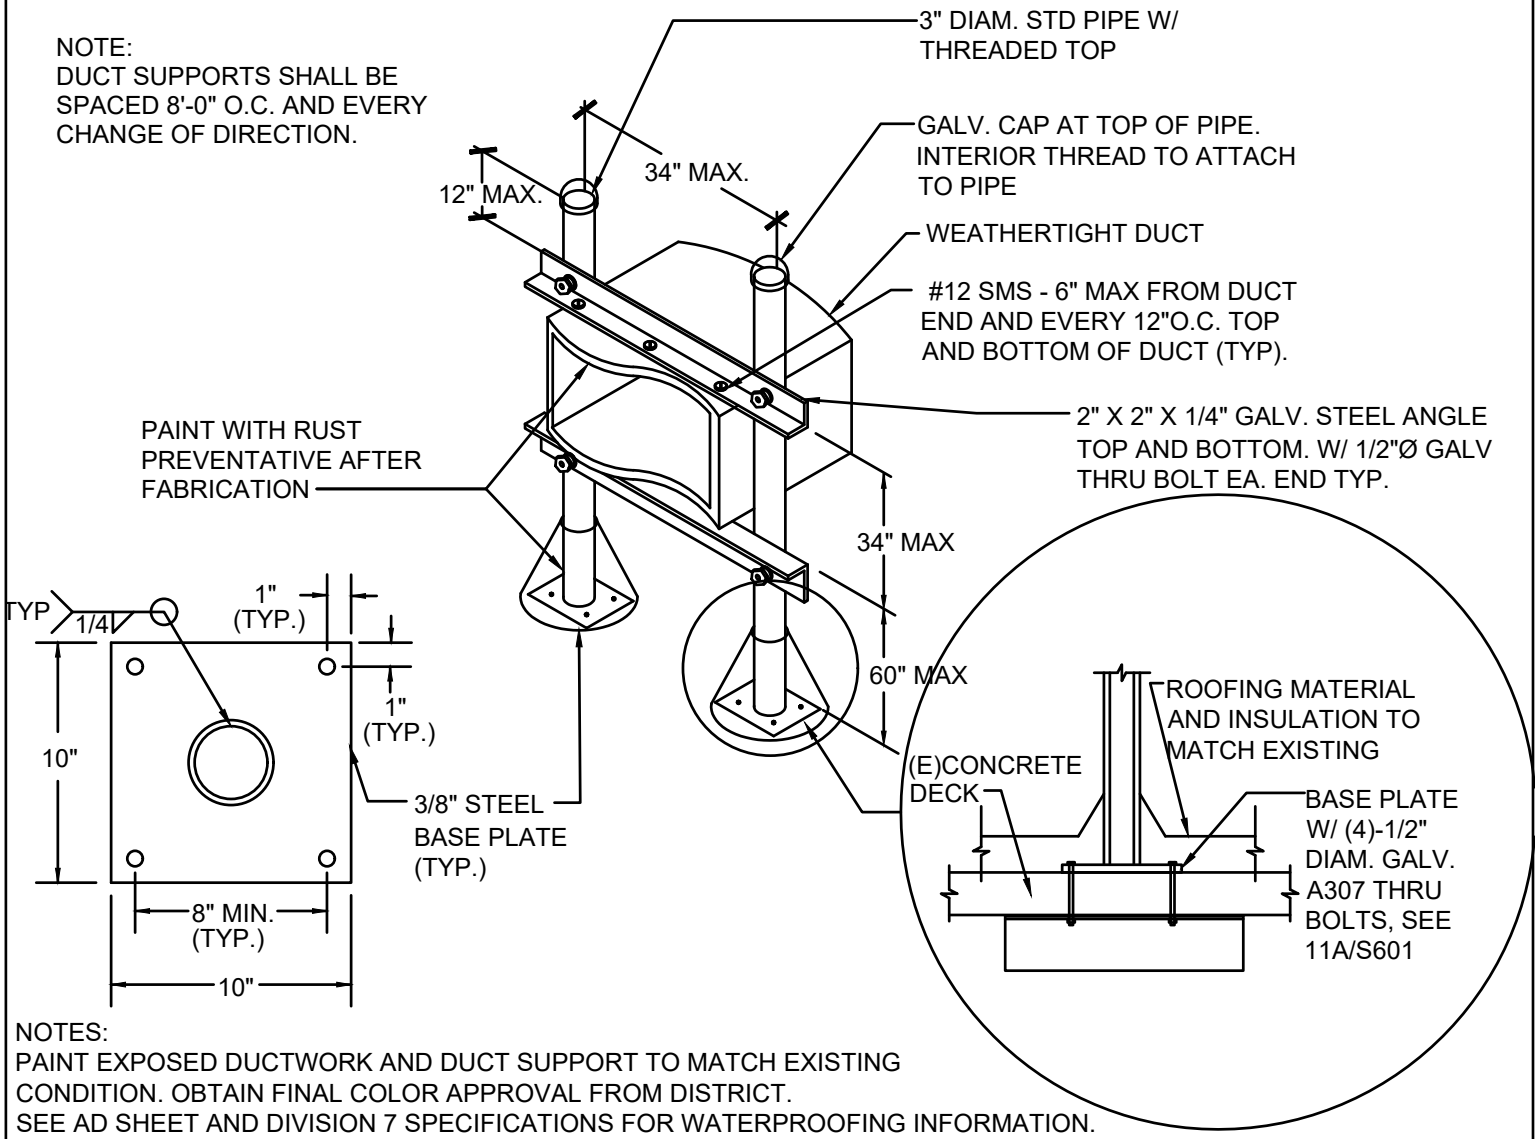

NOTES:
PAINT EXPOSED DUCTWORK AND DUCT SUPPORT TO MATCH EXISTING CONDITION. OBTAIN FINAL COLOR APPROVAL FROM DISTRICT.
SEE AD SHEET AND DIVISION 7 SPECIFICATIONS FOR WATERPROOFING INFORMATION.

SUPPORT FOR RECTANGULAR DUCT ON ROOF FOR BLDG 2A (CONC OVER METAL DECK)


SCALE NONE

2

1

PROJ. NAME	HVAC REPLACEMENT FIREBAUGH HIGH SCHOOL	APPROVAL STAMP
DSA #	03-125870	
CCD #	001	
DATE	04/2026	
PSE JOB #	2025-131	
TITLE	NEW DETAIL 7/M4.1	

NOTE:
DUCT SUPPORTS SHALL BE SPACED 4'-0" O.C. AND EVERY CHANGE OF DIRECTION.

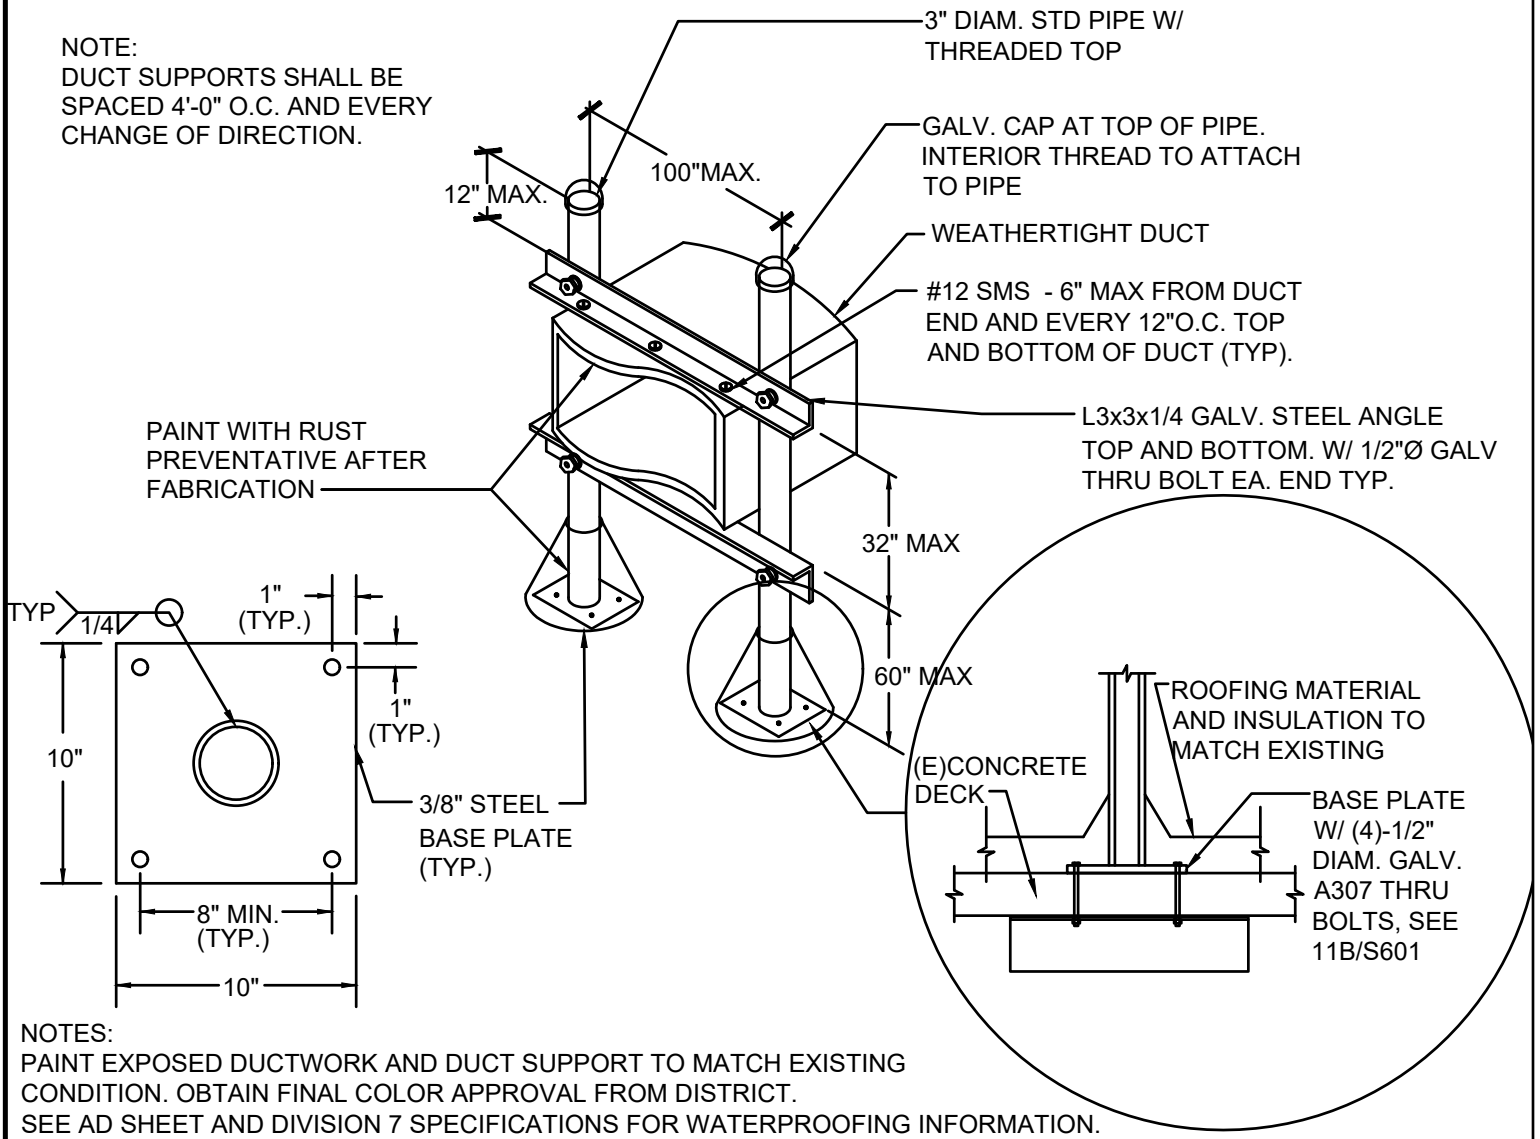

NOTES:
PAINT EXPOSED DUCTWORK AND DUCT SUPPORT TO MATCH EXISTING CONDITION. OBTAIN FINAL COLOR APPROVAL FROM DISTRICT.
SEE AD SHEET AND DIVISION 7 SPECIFICATIONS FOR WATERPROOFING INFORMATION.

SUPPORT FOR RECTANGULAR DUCT ON ROOF FOR BLDG 5 (1-1/2" 16 GA METAL DECK)

SCALE NONE

7

1