



April 6, 2026

Will Wenzloff
Hillsboro School District
4901 SE Witch Hazel Road
Hillsboro, Oregon 97123

Via email: wenzloffw@hsd.k12.or.us

Regarding: Drinking Water Sampling Report
Orenco Elementary School
7050 Northeast Birch Street
Hillsboro, Oregon
Apex Project No. 25012835 / 0004

Dear Mr. Wenzloff:

On March 21, 2026, Apex Companies LLC (Apex) collected drinking water samples at Orenco Elementary School in Hillsboro, Oregon. The testing was requested by Hillsboro School District as part of their efforts to ensure that concentrations of lead in drinking water at the school remain below the Oregon Department of Education (ODE) action level of 15 parts per billion (ppb).

Water from all fixtures at the school used for drinking or food preparation have lead concentrations below 15 ppb.

One hundred six samples were collected and delivered under chain of custody to Apex Laboratories in Tigard, Oregon, for lead analysis. The results of the sampling is shown in the table below.

Main Building – Round 1

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22392700-001KF26A	Kitchen – east double prep sink faucet	3.65
002	22392700-002KF26A	Kitchen – east double prep sink sprayer	1.05
003	22392700-003KF26A	Kitchen – pot filler faucet, first draw	1.49
004	22392700-004KF26A	Kitchen – center island single prep sink faucet	0.392
005	22392700-005KF26A	Kitchen – scullery, single sanitizing sink faucet	1.49
006	22392700-006DW26A	Cafeteria – drinking fountain at north wall sink	ND
007	22392700-007SF26A	Cafeteria – faucet at north wall sink	ND
008	22392700-008BF26A	Girls RR at cafeteria, triple-head handwash basin - left	0.769
009	22392700-009BF26A	Girls RR at cafeteria, triple-head handwash basin - center	0.293
010	22392700-010BF26A	Girls RR at cafeteria, triple-head handwash basin - right	0.245
011	22392700-011WB26A	Cafeteria hall – water bottle filler	ND
012	22392700-012DW26A	Cafeteria hall – drinking fountain	ND

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
013	22392700-013BF26A	Boys RR at cafeteria, triple-head handwash basin - left	0.201
014	22392700-014BF26A	Boys RR at cafeteria, triple-head handwash basin - center	ND
015	22392700-015BF26A	Boys RR at cafeteria, triple-head handwash basin - right	ND
016	22392700-016IM26A	Kitchen Ice Machine	ND
017	22392700-017BF26A	Kitchen back hallway restroom	0.498
018	22392700-018SF26A	Workroom in main office	0.574
019	22392700-019NS26A	Health Room, left sink	0.428
020	22392700-020NS26A	Health Room, right sink	0.354
021	22392700-021BF26A	Health Room restroom	0.949
022	22392700-022SF26A	Staff Lounge, left-side hot water tap	ND
023	22392700-023SF26A	Staff Lounge, sink faucet	0.291
024	22392700-024SF26A	Staff Lounge, right side cold-water tap	ND
025	22392700-025BF26A	Staff restroom in main office – left restroom	ND
026	22392700-026BF26A	Staff restroom in main office – right restroom	ND
027	22392700-027DW26A	Room 101, drinking fountain	0.591
028	22392700-028CF26A	Room 101, sink faucet	ND
029	22392700-029BF26A	Room 101, restroom sink faucet	0.434
030	22392700-030BF26A	Classroom hallway, east restrooms, girls RR – left sink	ND
031	22392700-031BF26A	Classroom hallway, east restrooms, girls RR – right sink	ND
032	22392700-032BF26A	Classroom hallway, east restrooms, boys RR – left sink	ND
033	22392700-033BF26A	Classroom hallway, east restrooms, boys RR – right sink	ND
034	22392700-034DW26A	Drinking fountains at east restrooms - left	0.245
035	22392700-035DW26A	Drinking fountains at east restrooms - right	0.414
036	22392700-036DW26A	Room 106, drinking fountain	ND
037	22392700-037CF26A	Room 106, sink faucet	ND
038	22392700-038DW26A	Room 107, drinking fountain	ND
039	22392700-039CF26A	Room 107, sink faucet	ND
040	22392700-040DW26A	Room 108, drinking fountain	ND
041	22392700-041CF26A	Room 108, sink faucet	0.245
042	22392700-042DW26A	Room 109, drinking fountain	0.271
043	22392700-043CF26A	Room 109, sink faucet	0.248
044	22392700-044DW26A	West hallway drinking fountains – left	ND
045	22392700-045DW26A	Wes hallway drinking fountains - right	ND
046	22392700-046BF26A	West end restrooms, boys restroom – left sink	ND
047	22392700-047BF26A	West end restrooms, boys restroom – right sink	ND
048	22392700-048BF26A	West end restrooms – ADA restroom	ND
049	22392700-049BF26A	West end restrooms, girls restroom – left sink	ND
050	22392700-050BF26A	West end restrooms, girls restroom – right sink	0.210
051	22392700-051DW26A	Room 113, drinking fountain	ND
052	22392700-052CF26A	Room 113, sink faucet	0.384
053	22392700-053DW26A	Room 112, drinking fountain	0.236

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
054	22392700-054CF26A	Room 112, sink faucet	ND
055	22392700-055DW26A	Room 111, drinking fountain	ND
056	22392700-056CF26A	Room 111, sink faucet	0.240
057	22392700-057DW26A	Room 110, drinking fountain	0.377
058	22392700-058CF26A	Room 110, sink faucet	0.848
059	22392700-059CF26A	Room 105, sink faucet	0.592
060	22392700-060DW26A	Room 104, drinking fountain	ND
061	22392700-061CF26A	Room 104, sink faucet	0.288
062	22392700-062DW26A	Room 103, drinking fountain	ND
063	22392700-063CF26A	Room 103, sink faucet	0.210
064	22392700-064DW26A	Room 102, drinking fountain	ND
065	22392700-065CF26A	Room 102, sink faucet	ND
066	22392700-066BF26A	Room 102, bathroom faucet	0.313
067	22392700-067SF26A	Media Center workroom sink faucet	0.325
068	22392700-068DW26A	Music Room, drinking fountain	0.298
069	22392700-069CF26A	Music Room, sink faucet	2.58
070	22392700-070DW26A	2 nd Floor east drinking fountains at restrooms – left	0.823
071	22392700-071DW26A	2 nd Floor east drinking fountains at restrooms – right	ND
072	22392700-072BF26A	2 nd Floor east restrooms, girls - left	0.222
073	22392700-073BF26A	2 nd Floor east restrooms, girls - right	ND
074	22392700-074BF26A	2 nd Floor east restrooms, boys - left	ND
075	22392700-075BF26A	2 nd Floor east restrooms, boys - right	ND
076	22392700-076DW26A	Room 201, drinking fountain	ND
077	22392700-077CF26A	Room 201, sink faucet	ND
078	22392700-078DW26A	Room 202, drinking fountain	ND
079	22392700-079CF26A	Room 202, sink faucet	0.229
080	22392700-080DW26A	Room 203, drinking fountain	0.357
081	22392700-081CF26A	Room 203, sink faucet	0.320
082	22392700-082DW26A	Room 204, drinking fountain	0.203
083	22392700-083CF26A	Room 204, sink faucet	0.281
084	22392700-084DW26A	Room 209, drinking fountain	ND
085	22392700-085CF26A	Room 209, sink faucet	0.344
086	22392700-086DW26A	Room 210, drinking fountain	0.438
087	22392700-087CF26A	Room 210, sink faucet	0.342
088	22392700-088DW26A	Room 211, drinking fountain	0.449
089	22392700-089CF26A	Room 211, sink faucet	0.259
090	22392700-090DW26A	Room 212, drinking fountain	ND
091	22392700-091CF26A	Room 212, sink faucet	0.266
092	22392700-092BF26A	2 nd Floor west end restrooms, boys RR – left	0.315
093	22392700-093BF26A	2 nd Floor west end restrooms, boys RR – right	ND
094	22392700-094BF26A	2 nd Floor west end ADA restroom	0.250

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
095	22392700-095BF26A	2 nd Floor west end restrooms, girls RR – left	ND
096	22392700-096BF26A	2 nd Floor west end restrooms, girls RR – right	ND
097	22392700-097DW26A	2 nd Floor west end drinking fountains - left	0.283
098	22392700-098DW26A	2 nd Floor west end drinking fountains - right	ND
099	22392700-099DW26A	Room 208, drinking fountain	ND
100	22392700-100CF26A	Room 208, sink faucet	ND
101	22392700-101DW26A	Room 207, drinking fountain	ND
102	22392700-102CF26A	Room 207, sink faucet	0.330
103	22392700-103DW26A	Room 206, drinking fountain	ND
104	22392700-104CF26A	Room 206, sink faucet	ND
105	22392700-105DW26A	Room 205, drinking fountain	ND
106	22392700-106CF26A	Room 205, sink faucet	0.282

ND = no lead detected

Please refer to the attached fixture location drawings and laboratory analytical report for additional details.

The laboratory analytical results are reported in micrograms per liter (µg/L), a unit of measure that is equivalent to ppb.

Sampling methodology and the interpretation of laboratory results were based on the Environmental Protection Agency guidance document titled *3Ts for Reducing Lead in Drinking Water in Schools*. Following this guideline, Apex collected first draw samples from each test location. First draw samples consist of the first 250 milliliters (mL) of water drawn from a fixture after the water has been sitting stagnant for at least 8 hours. The 3Ts' sampling protocol specifying 250-mL samples is designed to maximize the likelihood that the highest concentrations of lead in water used for consumption are identified.


Please feel free to contact me at 503.515.4726 or dale.voeller@apexcos.com with any questions or comments.


Sincerely,




Dale Voeller, CHMM, CSP
Senior Project Manager


Attachment: Fixture Location Drawings
Laboratory Analytical Reports

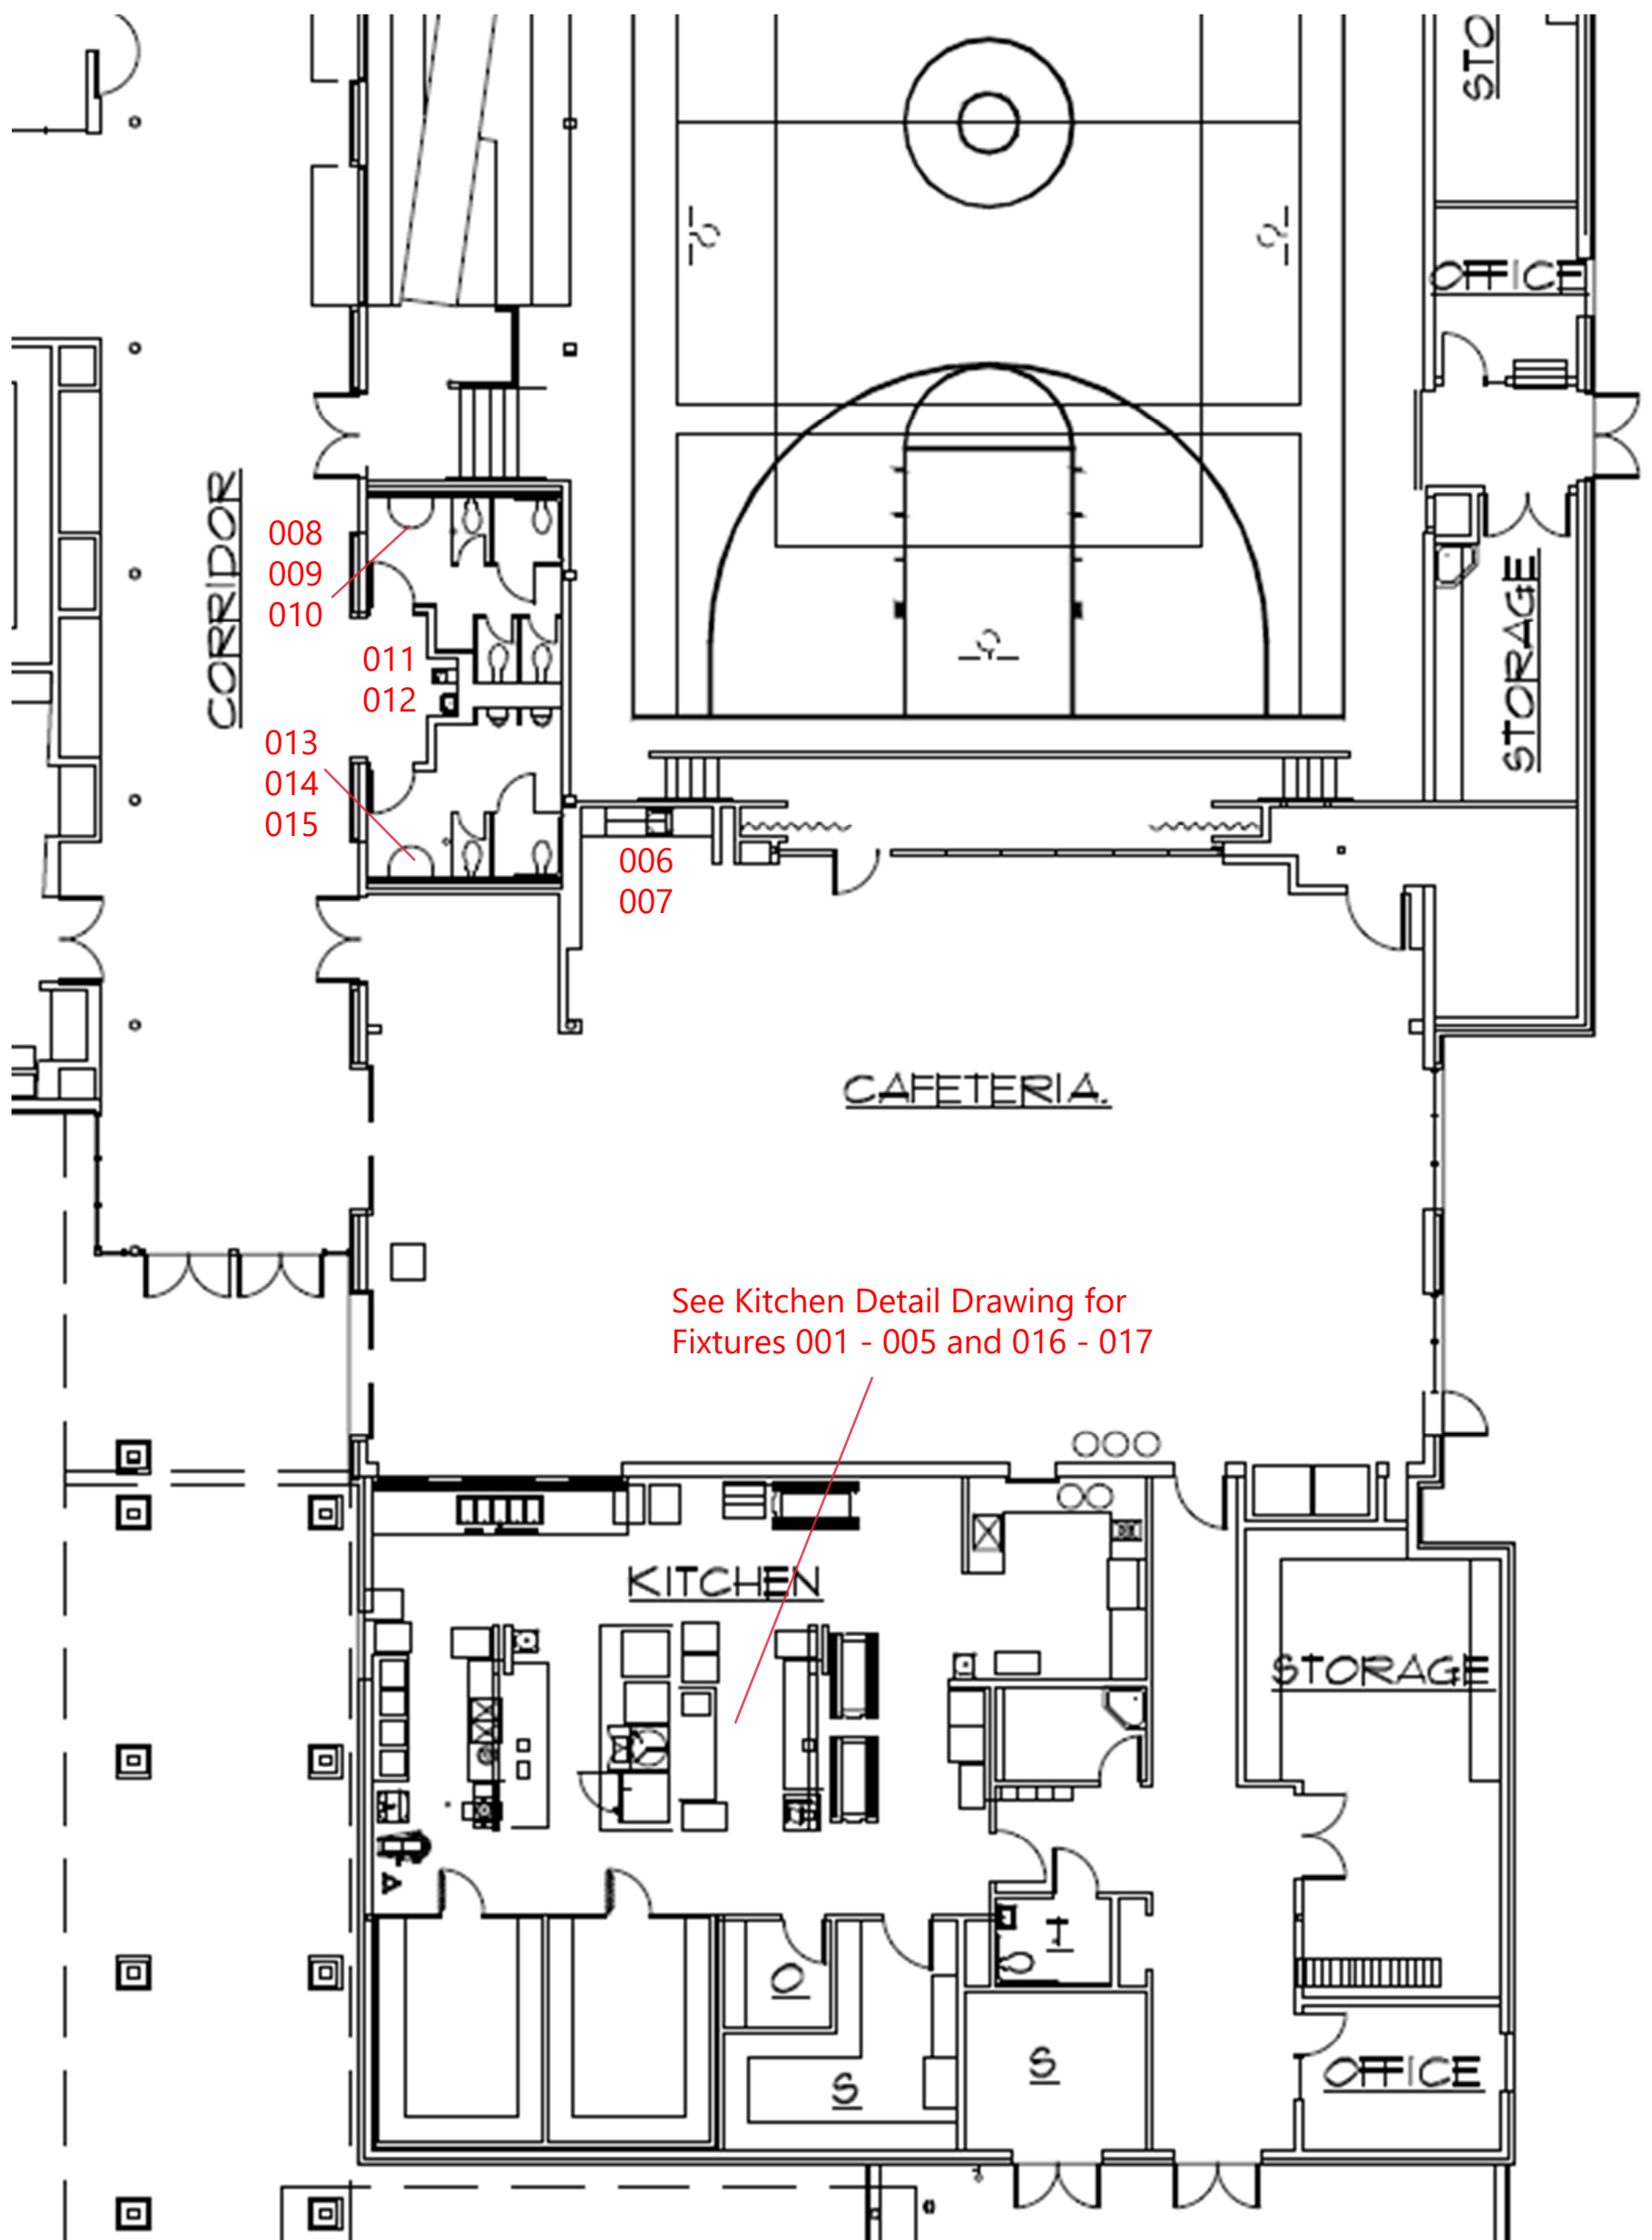

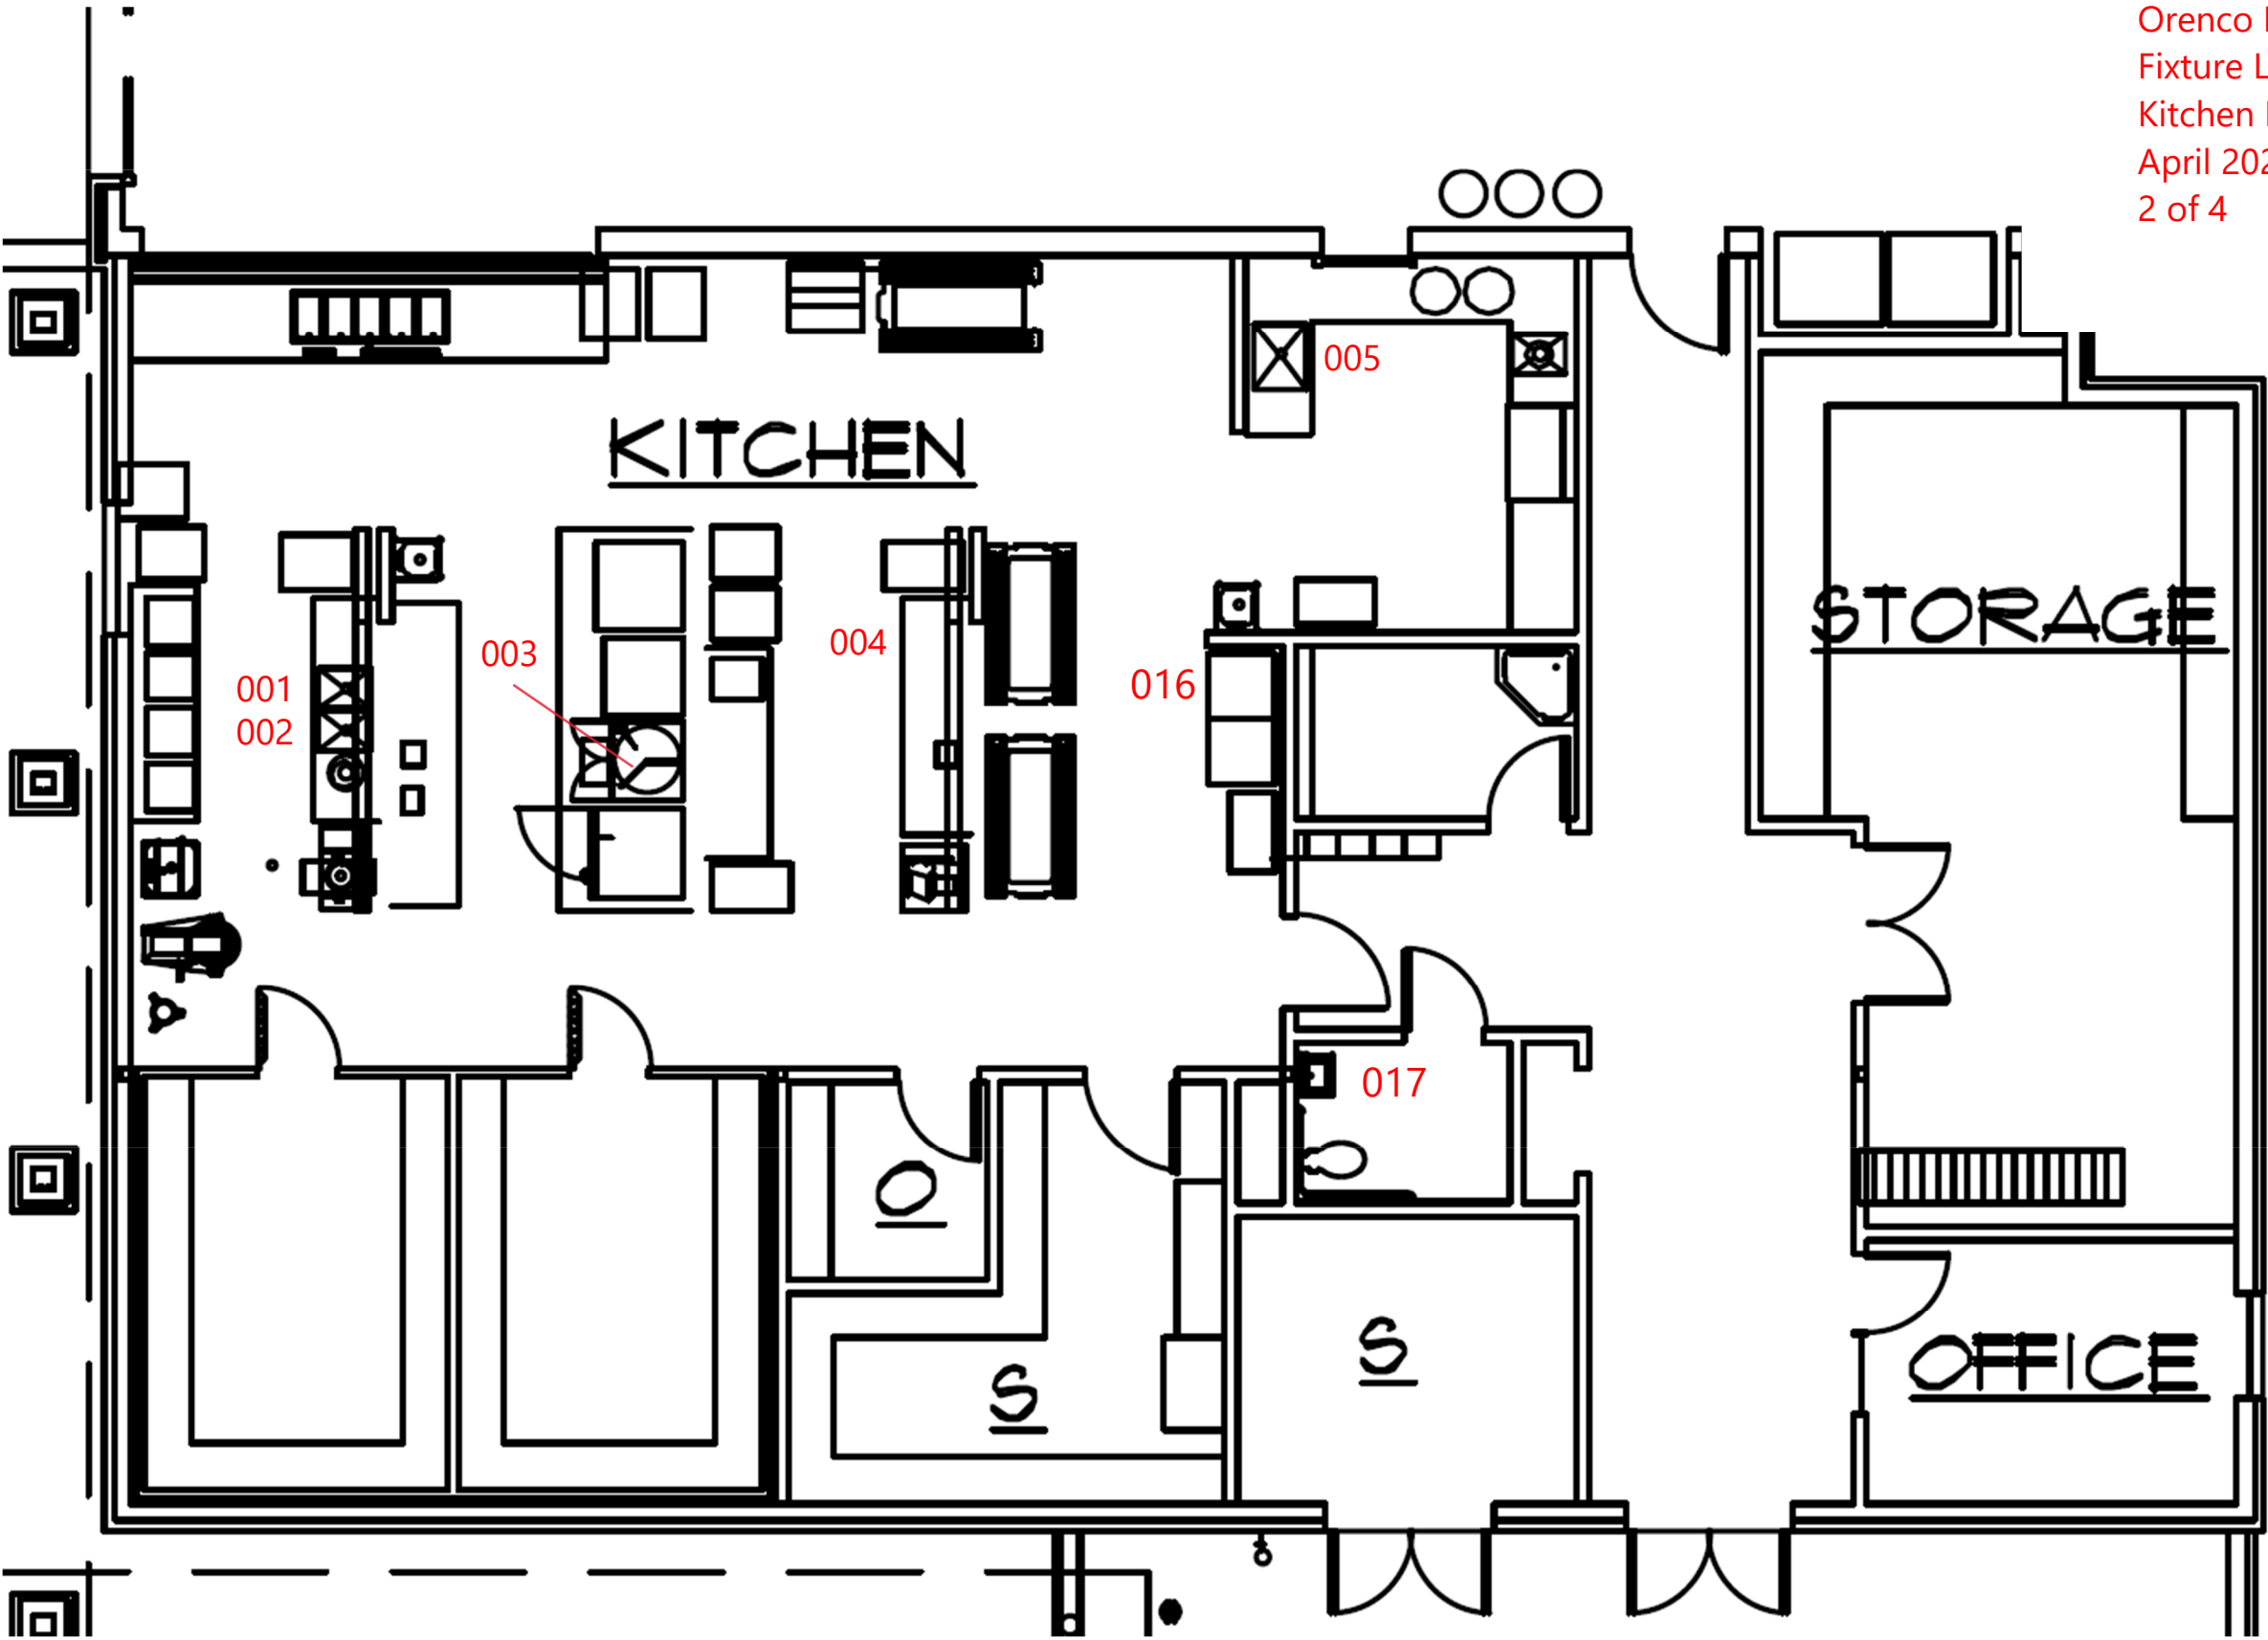

Orenco Elementary School
Fixture Location Drawing
First Floor Classroom Wing
April 2026

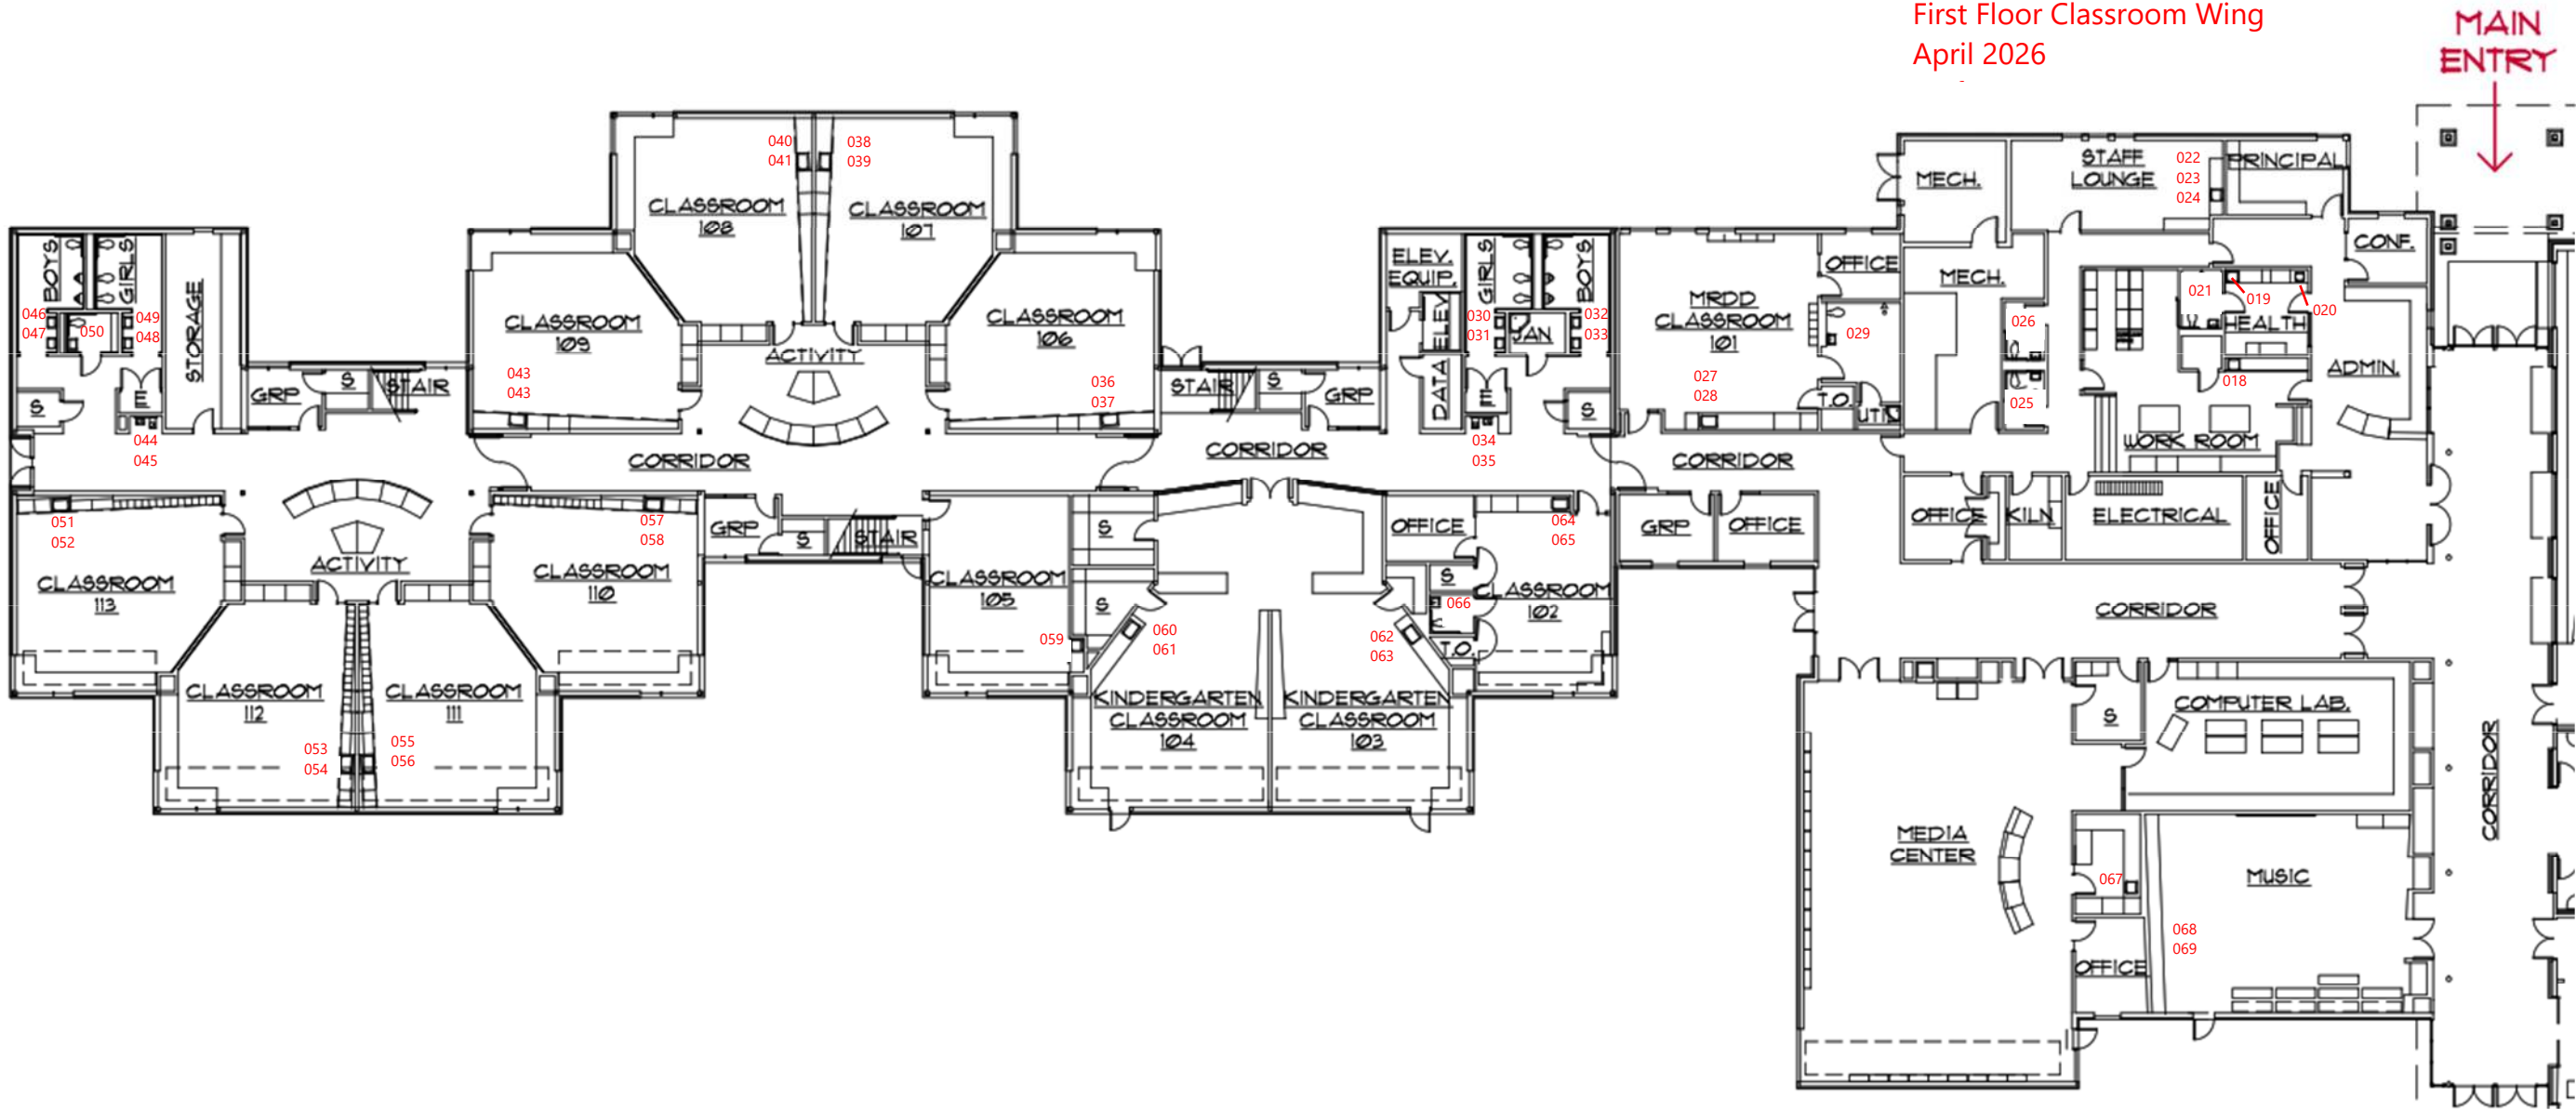

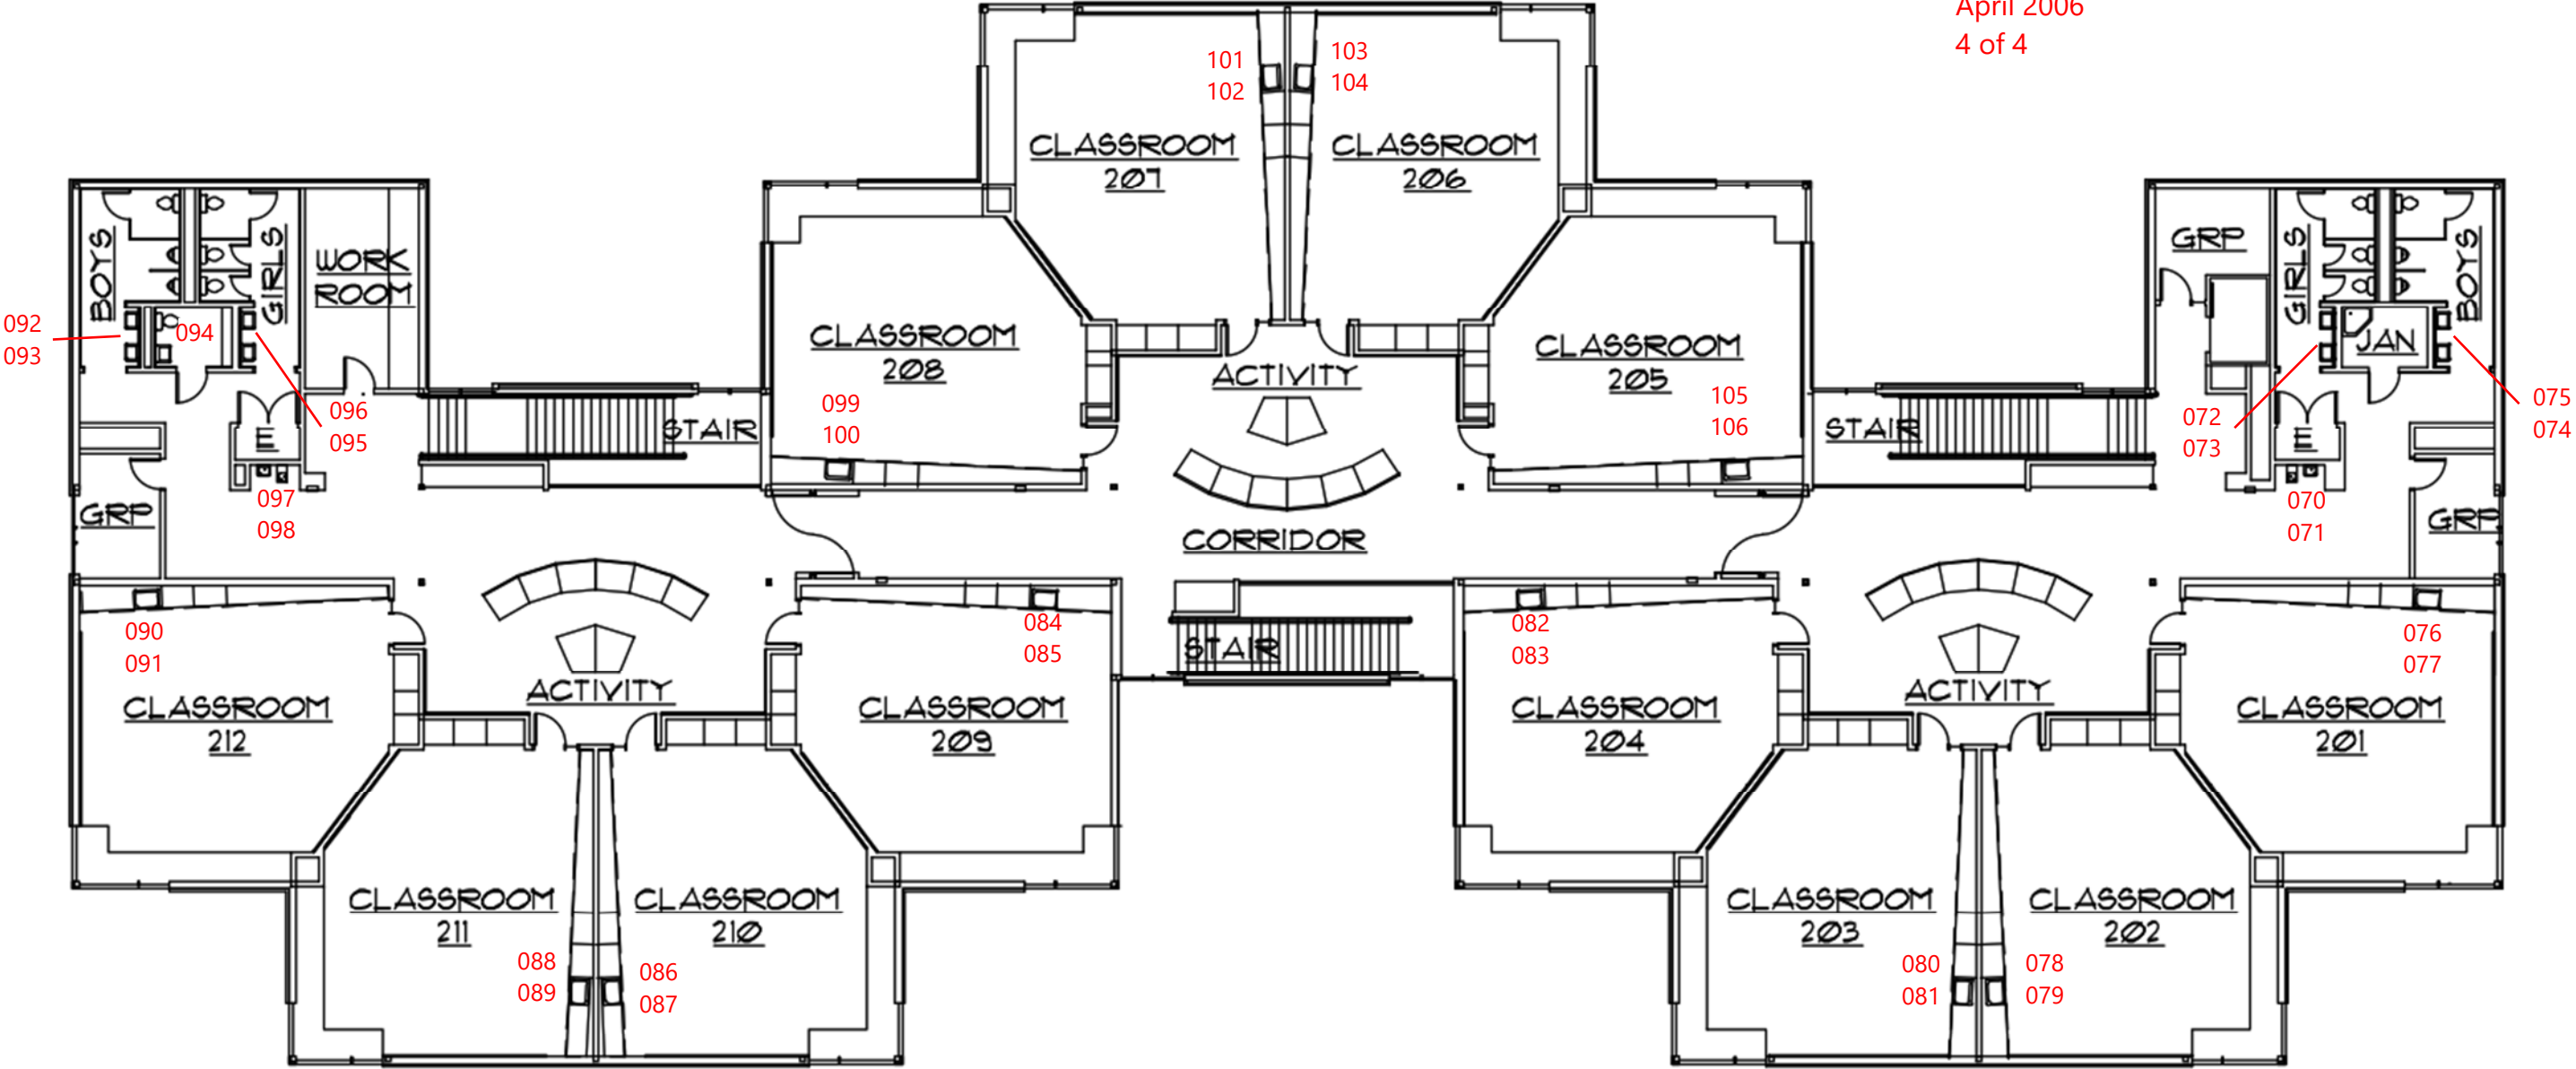



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Monday, April 6, 2026

Dale Voeller

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

RE: A6C1987 - Hillsboro School District - Orenco Elementary School/25012835

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6C1987, which was received by the laboratory on 3/23/2026 at 11:43:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information					
<u>Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.</u>					
(See Cooler Receipt Form for details)					
Cooler #1	17.5	degC	Cooler #2	16.8	degC
Cooler #3	16.8	degC			

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orencia Elementary School/**
Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392700-001KF26A	A6C1987-01	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-002KF26A	A6C1987-02	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-003KF26A	A6C1987-03	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-004KF26A	A6C1987-04	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-005KF26A	A6C1987-05	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-006DW26A	A6C1987-06	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-007SF26A	A6C1987-07	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-008BF26A	A6C1987-08	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-009BF26A	A6C1987-09	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-010BF26A	A6C1987-10	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-011WB26A	A6C1987-11	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-012DW26A	A6C1987-12	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-013BF26A	A6C1987-13	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-014BF26A	A6C1987-14	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-015BF26A	A6C1987-15	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-016IM26A	A6C1987-16	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-017BF26A	A6C1987-17	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-018SF26A	A6C1987-18	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-019NS26A	A6C1987-19	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-020NS26A	A6C1987-20	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-021BF26A	A6C1987-21	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-022SF26A	A6C1987-22	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-023SF26A	A6C1987-23	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-024SF26A	A6C1987-24	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-025BF26A	A6C1987-25	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-026BF26A	A6C1987-26	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-027DW26A	A6C1987-27	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-028CF26A	A6C1987-28	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-029BF26A	A6C1987-29	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-030BF26A	A6C1987-30	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-031BF26A	A6C1987-31	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-032BF26A	A6C1987-32	Drinking Water	03/21/26 00:00	03/23/26 11:43

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orencia Elementary School/**
Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392700-033BF26A	A6C1987-33	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-034DW26A	A6C1987-34	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-035DW26A	A6C1987-35	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-036DW26A	A6C1987-36	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-037CF26A	A6C1987-37	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-038DW26A	A6C1987-38	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-039CF26A	A6C1987-39	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-040DW26A	A6C1987-40	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-041CF26A	A6C1987-41	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-042DW26A	A6C1987-42	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-043CF26A	A6C1987-43	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-044DW26A	A6C1987-44	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-045DW26A	A6C1987-45	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-046BF26A	A6C1987-46	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-047BF26A	A6C1987-47	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-048BF26A	A6C1987-48	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-049BF26A	A6C1987-49	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-050BF26A	A6C1987-50	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-051DW26A	A6C1987-51	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-052CF26A	A6C1987-53	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-053DW26A	A6C1987-54	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-054CF26A	A6C1987-55	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-055DW26A	A6C1987-56	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-056CF26A	A6C1987-57	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-057DW26A	A6C1987-58	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-058CF26A	A6C1987-59	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-060DW26A	A6C1987-60	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-061CF26A	A6C1987-61	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-062DW26A	A6C1987-62	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-063CF26A	A6C1987-63	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-064DW26A	A6C1987-64	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-065CF26A	A6C1987-65	Drinking Water	03/21/26 00:00	03/23/26 11:43

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orencia Elementary School/**
Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392700-066BF26A	A6C1987-66	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-067SF26A	A6C1987-67	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-068DW26A	A6C1987-68	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-069CF26A	A6C1987-69	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-070DW26A	A6C1987-70	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-071DW26A	A6C1987-71	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-072BF26A	A6C1987-72	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-073BF26A	A6C1987-73	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-074BF26A	A6C1987-74	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-075BF26A	A6C1987-75	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-076DW26A	A6C1987-76	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-077CF26A	A6C1987-77	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-078DW26A	A6C1987-78	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-079CF26A	A6C1987-79	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-080DW26A	A6C1987-80	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-081CF26A	A6C1987-81	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-082DW26A	A6C1987-82	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-083CF26A	A6C1987-83	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-084DW26A	A6C1987-84	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-085CF26A	A6C1987-85	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-086DW26A	A6C1987-86	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-087CF26A	A6C1987-87	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-088DW26A	A6C1987-88	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-089CF26A	A6C1987-89	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-090DW26A	A6C1987-90	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-091CF26A	A6C1987-91	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-092BF26A	A6C1987-92	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-093BF26A	A6C1987-93	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-094BF26A	A6C1987-94	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-095BF26A	A6C1987-95	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-096BF26A	A6C1987-96	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-097DW26A	A6C1987-97	Drinking Water	03/21/26 00:00	03/23/26 11:43

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Orencia Elementary School/**

Project Manager: **Dale Voeller**

Report ID:

A6C1987 - 04 06 26 1230

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392700-098DW26A	A6C1987-98	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-099DW26A	A6C1987-99	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-100CF26A	A6C1987-AA	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-101DW26A	A6C1987-AB	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-102CF26A	A6C1987-AC	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-103DW26A	A6C1987-AD	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-104CF26A	A6C1987-AE	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-105DW26A	A6C1987-AF	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-106CF26A	A6C1987-AG	Drinking Water	03/21/26 00:00	03/23/26 11:43
22392700-059CF26A	A6C1987-AH	Drinking Water	03/21/26 00:00	03/23/26 11:43

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orengo Elementary School/**Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-001KF26A (A6C1987-01)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	3.65	---	0.200	ug/L	1	04/02/26 13:06	EPA 200.8	
22392700-002KF26A (A6C1987-02)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	1.05	---	0.200	ug/L	1	04/02/26 13:12	EPA 200.8	
22392700-003KF26A (A6C1987-03)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	1.49	---	0.200	ug/L	1	04/02/26 13:14	EPA 200.8	
22392700-004KF26A (A6C1987-04)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.392	---	0.200	ug/L	1	04/02/26 13:16	EPA 200.8	
22392700-005KF26A (A6C1987-05)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	1.49	---	0.200	ug/L	1	04/02/26 13:18	EPA 200.8	
22392700-006DW26A (A6C1987-06)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	ND	---	0.200	ug/L	1	04/02/26 13:20	EPA 200.8	
22392700-007SF26A (A6C1987-07)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	ND	---	0.200	ug/L	1	04/02/26 13:26	EPA 200.8	
22392700-008BF26A (A6C1987-08)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.769	---	0.200	ug/L	1	04/02/26 13:28	EPA 200.8	
22392700-009BF26A (A6C1987-09)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.293	---	0.200	ug/L	1	04/02/26 13:31	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-010BF26A (A6C1987-10)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.245	---	0.200	ug/L	1	04/02/26 13:33	EPA 200.8	
22392700-011WB26A (A6C1987-11)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	ND	---	0.200	ug/L	1	04/02/26 13:35	EPA 200.8	
22392700-012DW26A (A6C1987-12)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	ND	---	0.200	ug/L	1	04/02/26 13:37	EPA 200.8	
22392700-013BF26A (A6C1987-13)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.201	---	0.200	ug/L	1	04/02/26 13:39	EPA 200.8	
22392700-014BF26A (A6C1987-14)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	ND	---	0.200	ug/L	1	04/02/26 13:41	EPA 200.8	
2239700-015BF26A (A6C1987-15)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	ND	---	0.200	ug/L	1	04/02/26 13:43	EPA 200.8	
22392700-016IM26A (A6C1987-16)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	ND	---	0.200	ug/L	1	04/02/26 13:45	EPA 200.8	
22392700-017BF26A (A6C1987-17)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.498	---	0.200	ug/L	1	04/02/26 13:51	EPA 200.8	
22392700-018SF26A (A6C1987-18)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.574	---	0.200	ug/L	1	04/02/26 13:53	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-019NS26A (A6C1987-19)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.428	---	0.200	ug/L	1	04/02/26 13:55	EPA 200.8	
22392700-020NS26A (A6C1987-20)				Matrix: Drinking Water				
Batch: 26C0916								
Lead	0.354	---	0.200	ug/L	1	04/02/26 13:58	EPA 200.8	
22392700-021BF26A (A6C1987-21)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	0.949	---	0.200	ug/L	1	04/02/26 14:06	EPA 200.8	
22392700-022SF26A (A6C1987-22)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:16	EPA 200.8	
22392700-023SF26A (A6C1987-23)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	0.291	---	0.200	ug/L	1	04/02/26 14:18	EPA 200.8	
22392700-024SF26A (A6C1987-24)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:21	EPA 200.8	
22392700-025BF26A (A6C1987-25)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:23	EPA 200.8	
22392700-026BF26A (A6C1987-26)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:25	EPA 200.8	
22392700-027DW26A (A6C1987-27)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	0.591	---	0.200	ug/L	1	04/02/26 14:27	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orengo Elementary School/**Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22397200-028CF26A (A6C1987-28)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:29	EPA 200.8	
22392700-029BF26A (A6C1987-29)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	0.434	---	0.200	ug/L	1	04/02/26 14:31	EPA 200.8	
22392700-030BF26A (A6C1987-30)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:33	EPA 200.8	
22392700-031BF26A (A6C1987-31)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:35	EPA 200.8	
22392700-032BF26A (A6C1987-32)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:41	EPA 200.8	
22392700-033BF26A (A6C1987-33)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:43	EPA 200.8	
22392700-034DW26A (A6C1987-34)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	0.245	---	0.200	ug/L	1	04/02/26 14:46	EPA 200.8	
22392700-035DW26A (A6C1987-35)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	0.414	---	0.200	ug/L	1	04/02/26 14:49	EPA 200.8	
22392700-036DW26A (A6C1987-36)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:51	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orengo Elementary School/**Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-037CF26A (A6C1987-37)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:53	EPA 200.8	
22392700-038DW26A (A6C1987-38)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:55	EPA 200.8	
22392700-039CF26A (A6C1987-39)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:57	EPA 200.8	
22392700-040DW26A (A6C1987-40)				Matrix: Drinking Water				
Batch: 26C0921								
Lead	ND	---	0.200	ug/L	1	04/02/26 14:59	EPA 200.8	
22392700-041CF26A (A6C1987-41)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	0.245	---	0.200	ug/L	1	04/02/26 15:12	EPA 200.8	
22392700-042DW26A (A6C1987-42)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	0.271	---	0.200	ug/L	1	04/02/26 15:18	EPA 200.8	
22392700-043CF26A (A6C1987-43)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	0.248	---	0.200	ug/L	1	04/02/26 15:20	EPA 200.8	
22392700-044DW26A (A6C1987-44)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:22	EPA 200.8	
22392700-045DW26A (A6C1987-45)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:24	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-046BF26A (A6C1987-46)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:26	EPA 200.8	
22392700-047BF26A (A6C1987-47)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:33	EPA 200.8	
22392700-048BF26A (A6C1987-48)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:35	EPA 200.8	
22392700-049BF26A (A6C1987-49)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:37	EPA 200.8	
22392700-050BF26A (A6C1987-50)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	0.210	---	0.200	ug/L	1	04/02/26 15:39	EPA 200.8	
22392700-051DW26A (A6C1987-51)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:41	EPA 200.8	
22392700-052CF26A (A6C1987-53)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	0.384	---	0.200	ug/L	1	04/02/26 15:43	EPA 200.8	
22392700-053DW26A (A6C1987-54)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	0.236	---	0.200	ug/L	1	04/02/26 15:45	EPA 200.8	
22392700-054CF26A (A6C1987-55)				Matrix: Drinking Water				
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:47	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-055DW26A (A6C1987-56) Matrix: Drinking Water								
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 15:49	EPA 200.8	
22392700-056CF26A (A6C1987-57) Matrix: Drinking Water								
Batch: 26C0934								
Lead	0.240	---	0.200	ug/L	1	04/02/26 15:51	EPA 200.8	
22392700-057DW26A (A6C1987-58) Matrix: Drinking Water								
Batch: 26C0934								
Lead	0.377	---	0.200	ug/L	1	04/02/26 15:58	EPA 200.8	
22392700-058CF26A (A6C1987-59) Matrix: Drinking Water								
Batch: 26C0934								
Lead	0.848	---	0.200	ug/L	1	04/02/26 16:00	EPA 200.8	
22392700-060DW26A (A6C1987-60) Matrix: Drinking Water								
Batch: 26C0934								
Lead	ND	---	0.200	ug/L	1	04/02/26 16:02	EPA 200.8	
22392700-061CF26A (A6C1987-61) Matrix: Drinking Water								
Batch: 26C0934								
Lead	0.288	---	0.200	ug/L	1	04/02/26 16:06	EPA 200.8	
22392700-062DW26A (A6C1987-62) Matrix: Drinking Water								
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 18:40	EPA 200.8	
22392700-063CF26A (A6C1987-63) Matrix: Drinking Water								
Batch: 26C1036								
Lead	0.210	---	0.200	ug/L	1	04/02/26 18:46	EPA 200.8	
22392700-064DW26A (A6C1987-64) Matrix: Drinking Water								
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 18:48	EPA 200.8	

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-065CF26A (A6C1987-65)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 18:50	EPA 200.8	
22392700-066BF26A (A6C1987-66)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.313	---	0.200	ug/L	1	04/02/26 18:52	EPA 200.8	
22392700-067SF26A (A6C1987-67)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.325	---	0.200	ug/L	1	04/02/26 18:55	EPA 200.8	
22392700-068DW26A (A6C1987-68)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.298	---	0.200	ug/L	1	04/02/26 19:01	EPA 200.8	
22392700-069CF26A (A6C1987-69)				Matrix: Drinking Water				
Batch: 26C1080								
Lead	2.58	---	0.222	ug/L	1	04/03/26 16:44	EPA 200.8	DW-D
22392700-070DW26A (A6C1987-70)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.823	---	0.200	ug/L	1	04/02/26 19:03	EPA 200.8	
22392700-071DW26A (A6C1987-71)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 19:05	EPA 200.8	
22392700-072BF26A (A6C1987-72)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.222	---	0.200	ug/L	1	04/02/26 19:07	EPA 200.8	
22392700-073BF26A (A6C1987-73)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 19:09	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-074BF26A (A6C1987-74)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 19:11	EPA 200.8	
22392700-075BF26A (A6C1987-75)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 19:13	EPA 200.8	
22392700-076DW26A (A6C1987-76)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 19:15	EPA 200.8	
22392700-077CF26A (A6C1987-77)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 19:17	EPA 200.8	
22392700-078DW26A (A6C1987-78)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	ND	---	0.200	ug/L	1	04/02/26 19:19	EPA 200.8	
22392700-079CF26A (A6C1987-79)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.229	---	0.200	ug/L	1	04/02/26 19:26	EPA 200.8	
22392700-080DW26A (A6C1987-80)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.357	---	0.200	ug/L	1	04/02/26 19:28	EPA 200.8	
22392700-081CF26A (A6C1987-81)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.320	---	0.200	ug/L	1	04/02/26 19:30	EPA 200.8	
22392700-082DW26A (A6C1987-82)				Matrix: Drinking Water				
Batch: 26C1036								
Lead	0.203	---	0.200	ug/L	1	04/02/26 19:34	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orengo Elementary School/**Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-083CF26A (A6C1987-83)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.281	---	0.200	ug/L	1	04/03/26 15:05	EPA 200.8	
22392700-084DW26A (A6C1987-84)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:12	EPA 200.8	
22392700-085CF26A (A6C1987-85)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.344	---	0.200	ug/L	1	04/03/26 15:14	EPA 200.8	
22392700-086DW26A (A6C1987-86)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.438	---	0.200	ug/L	1	04/03/26 15:16	EPA 200.8	
22392700-087CF26A (A6C1987-87)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.342	---	0.200	ug/L	1	04/03/26 15:18	EPA 200.8	
22392700-088DW26A (A6C1987-88)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.449	---	0.200	ug/L	1	04/03/26 15:21	EPA 200.8	
22392700-089CF26A (A6C1987-89)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.259	---	0.200	ug/L	1	04/03/26 15:27	EPA 200.8	
22392700-090DW26A (A6C1987-90)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:29	EPA 200.8	
22392700-091CF26A (A6C1987-91)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.266	---	0.200	ug/L	1	04/03/26 15:31	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orengo Elementary School/**Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-092BF26A (A6C1987-92)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.315	---	0.200	ug/L	1	04/03/26 15:33	EPA 200.8	
22392700-093BF26A (A6C1987-93)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:35	EPA 200.8	
22392700-094BF26A (A6C1987-94)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.250	---	0.200	ug/L	1	04/03/26 15:37	EPA 200.8	
22392700-095BF26A (A6C1987-95)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:39	EPA 200.8	
22392700-096BF26A (A6C1987-96)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:41	EPA 200.8	
22392700-097DW26A (A6C1987-97)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.283	---	0.200	ug/L	1	04/03/26 15:43	EPA 200.8	
22392700-098DW26A (A6C1987-98)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:46	EPA 200.8	
22392700-099DW26A (A6C1987-99)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:52	EPA 200.8	
22392700-100CF26A (A6C1987-AA)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:54	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392700-101DW26A (A6C1987-AB)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	ND	---	0.200	ug/L	1	04/03/26 15:56	EPA 200.8	
22392700-102CF26A (A6C1987-AC)				Matrix: Drinking Water				
Batch: 26C1059								
Lead	0.330	---	0.200	ug/L	1	04/03/26 15:58	EPA 200.8	
22392700-103DW26A (A6C1987-AD)				Matrix: Drinking Water				
Batch: 26C1073								
Lead	ND	---	0.200	ug/L	1	04/03/26 16:17	EPA 200.8	
22392700-104CF26A (A6C1987-AE)				Matrix: Drinking Water				
Batch: 26C1073								
Lead	ND	---	0.200	ug/L	1	04/03/26 16:19	EPA 200.8	
22392700-105DW26A (A6C1987-AF)				Matrix: Drinking Water				
Batch: 26C1073								
Lead	ND	---	0.200	ug/L	1	04/03/26 16:21	EPA 200.8	
22392700-106CF26A (A6C1987-AG)				Matrix: Drinking Water				
Batch: 26C1073								
Lead	0.282	---	0.200	ug/L	1	04/03/26 16:23	EPA 200.8	
22392700-059CF26A (A6C1987-AH)				Matrix: Drinking Water				
Batch: 26C1073								
Lead	0.592	---	0.200	ug/L	1	04/03/26 16:25	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C0916 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26C0916-BLK1)		Prepared: 03/26/26 08:53		Analyzed: 04/02/26 13:01								
<u>EPA 200.8</u>												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26C0916-BS1)		Prepared: 03/26/26 08:53		Analyzed: 04/02/26 13:04								
<u>EPA 200.8</u>												
Lead	14.9	---	0.201	ug/L	1	15.0	---	99	85 - 115%	---	---	
Duplicate (26C0916-DUP1)		Prepared: 03/26/26 08:53		Analyzed: 04/02/26 13:08								
<u>QC Source Sample: 22392700-001KF26A (A6C1987-01)</u>												
<u>EPA 200.8</u>												
Lead	3.68	---	0.200	ug/L	1	---	3.65	---	---	0.9	20%	
Matrix Spike (26C0916-MS1)		Prepared: 03/26/26 08:53		Analyzed: 04/02/26 13:10								
<u>QC Source Sample: 22392700-001KF26A (A6C1987-01)</u>												
<u>EPA 200.8</u>												
Lead	18.6	---	0.201	ug/L	1	15.0	3.65	100	70 - 130%	---	---	
Matrix Spike (26C0916-MS2)		Prepared: 03/26/26 08:53		Analyzed: 04/02/26 14:00								
<u>QC Source Sample: 22392700-020NS26A (A6C1987-20)</u>												
<u>EPA 200.8</u>												
Lead	15.5	---	0.201	ug/L	1	15.0	0.354	101	70 - 130%	---	---	
Batch 26C0921 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26C0921-BLK1)		Prepared: 03/26/26 09:41		Analyzed: 04/02/26 14:02								
<u>EPA 200.8</u>												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26C0921-BS1)		Prepared: 03/26/26 09:41		Analyzed: 04/02/26 14:04								
<u>EPA 200.8</u>												
Lead	15.5	---	0.201	ug/L	1	15.0	---	103	85 - 115%	---	---	
Duplicate (26C0921-DUP1)		Prepared: 03/26/26 09:41		Analyzed: 04/02/26 14:08								
<u>QC Source Sample: 22392700-021BF26A (A6C1987-21)</u>												

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C0921 - EPA 200.8 Direct Analysis							Drinking Water					
Duplicate (26C0921-DUP1)			Prepared: 03/26/26 09:41		Analyzed: 04/02/26 14:08							
<u>QC Source Sample: 22392700-021BF26A (A6C1987-21)</u>												
<u>EPA 200.8</u>												
Lead	0.911	---	0.200	ug/L	1	---	0.949	---	---	4	20%	
Matrix Spike (26C0921-MS1)			Prepared: 03/26/26 09:41		Analyzed: 04/02/26 14:10							
<u>QC Source Sample: 22392700-021BF26A (A6C1987-21)</u>												
<u>EPA 200.8</u>												
Lead	16.1	---	0.201	ug/L	1	15.0	0.949	101	70 - 130%	---	---	
Matrix Spike (26C0921-MS2)			Prepared: 03/26/26 09:41		Analyzed: 04/02/26 15:01							
<u>QC Source Sample: 22392700-040DW26A (A6C1987-40)</u>												
<u>EPA 200.8</u>												
Lead	14.8	---	0.201	ug/L	1	15.0	ND	99	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C0934 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26C0934-BLK1)		Prepared: 03/26/26 11:40			Analyzed: 04/02/26 15:08							
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26C0934-BS1)		Prepared: 03/26/26 11:40			Analyzed: 04/02/26 15:10							
EPA 200.8												
Lead	15.1	---	0.201	ug/L	1	15.0	---	100	85 - 115%	---	---	
Duplicate (26C0934-DUP1)		Prepared: 03/26/26 11:40			Analyzed: 04/02/26 15:14							
QC Source Sample: 22392700-041CF26A (A6C1987-41)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	0.245	---	---	***	20%	Q-05
Matrix Spike (26C0934-MS1)		Prepared: 03/26/26 11:40			Analyzed: 04/02/26 15:16							
QC Source Sample: 22392700-041CF26A (A6C1987-41)												
EPA 200.8												
Lead	15.3	---	0.201	ug/L	1	15.0	0.245	100	70 - 130%	---	---	
Matrix Spike (26C0934-MS2)		Prepared: 03/26/26 11:40			Analyzed: 04/02/26 16:04							
QC Source Sample: 22392700-060DW26A (A6C1987-60)												
EPA 200.8												
Lead	14.8	---	0.201	ug/L	1	15.0	ND	99	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C1036 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26C1036-BLK1)		Prepared: 03/31/26 07:34 Analyzed: 04/02/26 18:36										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26C1036-BS1)		Prepared: 03/31/26 07:34 Analyzed: 04/02/26 18:38										
EPA 200.8												
Lead	14.6	---	0.201	ug/L	1	15.0	---	97	85 - 115%	---	---	
Duplicate (26C1036-DUP1)		Prepared: 03/31/26 07:34 Analyzed: 04/02/26 18:42										
QC Source Sample: 22392700-062DW26A (A6C1987-62)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	0.158	---	---	***	20%	
Matrix Spike (26C1036-MS1)		Prepared: 03/31/26 07:34 Analyzed: 04/02/26 18:44										
QC Source Sample: 22392700-062DW26A (A6C1987-62)												
EPA 200.8												
Lead	14.4	---	0.201	ug/L	1	15.0	0.158	95	70 - 130%	---	---	
Matrix Spike (26C1036-MS2)		Prepared: 03/31/26 07:34 Analyzed: 04/02/26 19:32										
QC Source Sample: 22392700-081CF26A (A6C1987-81)												
EPA 200.8												
Lead	13.9	---	0.201	ug/L	1	15.0	0.320	91	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C1059 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26C1059-BLK1)		Prepared: 03/31/26 10:58			Analyzed: 04/03/26 15:01							
<u>EPA 200.8</u>												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26C1059-BS1)		Prepared: 03/31/26 10:58			Analyzed: 04/03/26 15:03							
<u>EPA 200.8</u>												
Lead	14.5	---	0.201	ug/L	1	15.0	---	97	85 - 115%	---	---	
Duplicate (26C1059-DUP1)		Prepared: 03/31/26 10:58			Analyzed: 04/03/26 15:08							
<u>QC Source Sample: 22392700-083CF26A (A6C1987-83)</u>												
<u>EPA 200.8</u>												
Lead	0.226	---	0.200	ug/L	1	---	0.281	---	---	22	20%	Q-05
Matrix Spike (26C1059-MS1)		Prepared: 03/31/26 10:58			Analyzed: 04/03/26 15:10							
<u>QC Source Sample: 22392700-083CF26A (A6C1987-83)</u>												
<u>EPA 200.8</u>												
Lead	14.6	---	0.201	ug/L	1	15.0	0.281	95	70 - 130%	---	---	
Matrix Spike (26C1059-MS2)		Prepared: 03/31/26 10:58			Analyzed: 04/03/26 16:00							
<u>QC Source Sample: 22392700-102CF26A (A6C1987-AC)</u>												
<u>EPA 200.8</u>												
Lead	14.6	---	0.201	ug/L	1	15.0	0.330	95	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Orencia Elementary School/**
Project Manager: **Dale Voeller**

Report ID:

A6C1987 - 04 06 26 1230

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C1073 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26C1073-BLK1)		Prepared: 03/31/26 13:58 Analyzed: 04/03/26 16:02										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26C1073-BS1)		Prepared: 03/31/26 13:58 Analyzed: 04/03/26 16:04										
EPA 200.8												
Lead	14.3	---	0.201	ug/L	1	15.0	---	95	85 - 115%	---	---	

No Client related Batch QC samples analyzed for this batch. See notes page for more information.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C1080 - EPA 200.2						Drinking Water						
Blank (26C1080-BLK1)		Prepared: 04/01/26 08:32 Analyzed: 04/03/26 16:29										
EPA 200.8												
Lead	ND	---	0.222	ug/L	1	---	---	---	---	---	---	
LCS (26C1080-BS1)		Prepared: 04/01/26 08:32 Analyzed: 04/03/26 16:31										
EPA 200.8												
Lead	17.9	---	0.222	ug/L	1	16.7	---	107	85 - 115%	---	---	

No Client related Batch QC samples analyzed for this batch. See notes page for more information.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orencia Elementary School/**
Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.2**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26C1080							
A6C1987-69	Drinking Water	EPA 200.8	03/21/26 00:00	04/01/26 08:32	45mL/50mL	10mL/10mL	1.11

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26C0916							
A6C1987-01	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-02	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-03	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-04	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-05	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-06	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-07	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-08	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-09	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-10	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-11	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-12	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-13	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-14	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-15	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-16	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-17	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-18	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-19	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
A6C1987-20	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 08:53	10mL/10mL	10mL/10mL	1.00
Batch: 26C0921							
A6C1987-21	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-22	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-23	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-24	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-25	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-26	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-27	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-28	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-29	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-30	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Orencia Elementary School/**Project Manager: **Dale Voeller****Report ID:****A6C1987 - 04 06 26 1230****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
A6C1987-31	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-32	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-33	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-34	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-35	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-36	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-37	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-38	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-39	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
A6C1987-40	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 09:41	10mL/10mL	10mL/10mL	1.00
Batch: 26C0934							
A6C1987-41	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-42	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-43	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-44	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-45	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-46	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-47	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-48	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-49	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-50	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-51	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-53	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-54	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-55	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-56	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-57	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-58	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-59	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-60	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
A6C1987-61	Drinking Water	EPA 200.8	03/21/26 00:00	03/26/26 11:40	10mL/10mL	10mL/10mL	1.00
Batch: 26C1036							
A6C1987-62	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-63	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-64	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-65	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/

Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
A6C1987-66	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-67	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-68	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-70	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-71	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-72	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-73	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-74	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-75	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-76	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-77	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-78	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-79	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-80	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-81	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
A6C1987-82	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 07:34	10mL/10mL	10mL/10mL	1.00
Batch: 26C1059							
A6C1987-83	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-84	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-85	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-86	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-87	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-88	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-89	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-90	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-91	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-92	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-93	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-94	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-95	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-96	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-97	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-98	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-99	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-AA	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-AB	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00
A6C1987-AC	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 10:58	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26C1073							
A6C1987-AD	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 13:58	10mL/10mL	10mL/10mL	1.00
A6C1987-AE	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 13:58	10mL/10mL	10mL/10mL	1.00
A6C1987-AF	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 13:58	10mL/10mL	10mL/10mL	1.00
A6C1987-AG	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 13:58	10mL/10mL	10mL/10mL	1.00
A6C1987-AH	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 13:58	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Orengo Elementary School/**

Project Manager: **Dale Voeller**

Report ID:

A6C1987 - 04 06 26 1230

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

Apex Laboratories

- DW-D** Turbidity greater than 1 NTU. Sample was digested per EPA Method 200.8.
- Q-05** Analyses are not controlled on RPD values from sample and duplicate concentrations that are below 5 times the reporting level.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Orencia Elementary School/**
Project Manager: **Dale Voeller**

Report ID:

A6C1987 - 04 06 26 1230

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or " " (blank) designation.
"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.
"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.
" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.
" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orencia Elementary School/

Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Orengo Elementary School/**
Project Manager: **Dale Voeller**

Report ID:

A6C1987 - 04 06 26 1230

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Orencia Elementary School/**
Project Manager: **Dale Voeller**

Report ID:

A6C1987 - 04 06 26 1230

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

Lead in Drinking Water Testing Program

Date Collected: 03/21/2026

PBS Project: 25012835 / 0004

School Name: Orenco Elementary School

Building: Main Building - Round 1

Building Number: 22392700

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	001	22392700-001KF26A	Kitchen - east double prep sink faucet
2	002	22392700-002KF26A	Kitchen - east double prep sink sprayer
3	003	22392700-003KF26A	Kitchen - pot filler faucet, first draw
4	004	22392700-004KF26A	Kitchen - center island single prep sink faucet
5	005	22392700-005KF26A	Kitchen - scullery, single sanitizing sink faucet
6	006	22392700-006DW26A	Cafeteria - drinking fountain at north wall sink
7	007	22392700-007SF26A	Cafeteria - faucet at north wall sink
8	008	22392700-008BF26A	Girls RR at cafeteria, triple-head handwash basin - left
9	009	22392700-009BF26A	Girls RR at cafeteria, triple-head handwash basin - center
10	010	22392700-010BF26A	Girls RR at cafeteria, triple-head handwash basin - right
11	011	22392700-011WB26A	Cafeteria hall - water bottle filler
12	012	22392700-012DW26A	Cafeteria hall - drinking fountain
13	013	22392700-013BF26A	Boys RR at cafeteria, triple-head handwash basin - left
14	014	22392700-014BF26A	Boys RR at cafeteria, triple-head handwash basin - center
15	015	22392700-015BF26A	Boys RR at cafeteria, triple-head handwash basin - right
16	016	22392700-016IM26A	Kitchen Ice Machine
17	017	22392700-017BF26A	Kitchen back hallway restroom
18	018	22392700-018SF26A	Workroom in main office
19	019	22392700-019NS26A	Health Room, left sink
20	020	22392700-020NS26A	Health Room, right sink
21	021	22392700-021BF26A	Health Room restroom
22	022	22392700-022SF26A	Staff Lounge, left-side hot water tap
23	023	22392700-023SF26A	Staff Lounge, sink faucet
24	024	22392700-024SF26A	Staff Lounge, right side cold-water tap
25	025	22392700-025BF26A	Staff restroom in main office - left restroom

1 of 4

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orencia Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

Lead in Drinking Water Testing Program

A6C1987

Hillsboro School District

Date Collected: 03/21/2026

School Name: Orencia Elementary School

	Fixture Number	Sample Number	Location / Description
26	026	22392700-026BF26A	Staff restroom in main office - right restroom
27	027	22392700-027DW26A	Room 101, drinking fountain
28	028	22392700-028CF26A	Room 101, sink faucet
29	029	22392700-029BF26A	Room 101, restroom sink faucet
30	030	22392700-030BF26A	Classroom hallway, east restrooms, girls RR - left sink
31	031	22392700-031BF26A	Classroom hallway, east restrooms, girls RR - right sink
32	032	22392700-032BF26A	Classroom hallway, east restrooms, boys RR - left sink
33	033	22392700-033BF26A	Classroom hallway, east restrooms, boys RR - right sink
34	034	22392700-034DW26A	Drinking fountains at east restrooms - left
35	035	22392700-035DW26A	Drinking fountains at east restrooms - right
36	036	22392700-036DW26A	Room 106, drinking fountain
37	037	22392700-037CF26A	Room 106, sink faucet
38	038	22392700-038DW26A	Room 107, drinking fountain
39	039	22392700-039CF26A	Room 107, sink faucet
40	040	22392700-040DW26A	Room 108, drinking fountain
41	041	22392700-041CF26A	Room 108, sink faucet
42	042	22392700-042DW26A	Room 109, drinking fountain
43	043	22392700-043CF26A	Room 109, sink faucet
44	044	22392700-044DW26A	West hallway drinking fountains - left
45	045	22392700-045DW26A	West hallway drinking fountains - right
46	046	22392700-046BF26A	West end restrooms, boys restroom - left sink
47	047	22392700-047BF26A	West end restrooms, boys restroom - right sink
48	048	22392700-048BF26A	West end restrooms - ADA restroom
49	049	22392700-049BF26A	West end restrooms, girls restroom - left sink
50	050	22392700-050BF26A	West end restrooms, girls restroom - right sink
51	051	22392700-051DW26A	Room 113, drinking fountain
52	052	22392700-052CF26A	Room 113, sink faucet
53	053	22392700-053DW26A	Room 112, drinking fountain
54	054	22392700-054CF26A	Room 112, sink faucet
55	055	22392700-055DW26A	Room 111, drinking fountain
56	056	22392700-056CF26A	Room 111, sink faucet



2 of 4

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orencia Elementary School/

Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

Lead in Drinking Water Testing Program

A6C1987

Hillsboro School District

Date Collected: 03/21/2026

School Name: Orencia Elementary School

	Fixture Number	Sample Number	Location / Description
57	057	22392700-057DW26A	Room 110, drinking fountain
58	058	22392700-058CF26A	Room 110, sink faucet
59	059	22392700-059CF26A	Room 105, sink faucet
60	060	22392700-060DW26A	Room 104, drinking fountain
61	061	22392700-061CF26A	Room 104, sink faucet
62	062	22392700-062DW26A	Room 103, drinking fountain
63	063	22392700-063CF26A	Room 103, sink faucet
64	064	22392700-064DW26A	Room 102, drinking fountain
65	065	22392700-065CF26A	Room 102, sink faucet
66	066	22392700-066BF26A	Room 102, bathroom faucet
67	067	22392700-067SF26A	Media Center workroom sink faucet
68	068	22392700-068DW26A	Music Room, drinking fountain
69	069	22392700-069CF26A	Music Room, sink faucet
70	070	22392700-070DW26A	2nd Floor east drinking fountains at restrooms - left
71	071	22392700-071DW26A	2nd Floor east drinking fountains at restrooms - right
72	072	22392700-072BF26A	2nd Floor east restrooms, girls - left
73	073	22392700-073BF26A	2nd Floor east restrooms, girls - right
74	074	22392700-074BF26A	2nd Floor east restrooms, boys - left
75	075	22392700-075BF26A	2nd Floor east restrooms, boys - right
76	076	22392700-076DW26A	Room 201, drinking fountain
77	077	22392700-077CF26A	Room 201, sink faucet
78	078	22392700-078DW26A	Room 202, drinking fountain
79	079	22392700-079CF26A	Room 202, sink faucet
80	080	22392700-080DW26A	Room 203, drinking fountain
81	081	22392700-081CF26A	Room 203, sink faucet
82	082	22392700-082DW26A	Room 204, drinking fountain
83	083	22392700-083CF26A	Room 204, sink faucet
84	084	22392700-084DW26A	Room 209, drinking fountain
85	085	22392700-085CF26A	Room 209, sink faucet
86	086	22392700-086DW26A	Room 210, drinking fountain
87	087	22392700-087CF26A	Room 210, sink faucet



3 of 4

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

Page 36 of 38



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

Lead in Drinking Water Testing Program

A6C1987

Hillsboro School District

Date Collected: 03/21/2026

School Name: Orenco Elementary School

	Fixture Number	Sample Number	Location / Description
88	088	22392700-088DW26A	Room 211, drinking fountain
89	089	22392700-089CF26A	Room 211, sink faucet
90	090	22392700-090DW26A	Room 212, drinking fountain
91	091	22392700-091CF26A	Room 212, sink faucet
92	092	22392700-092BF26A	2nd Floor west end restrooms, boys RR - left
93	093	22392700-093BF26A	2nd Floor west end restrooms, boys RR - right
94	094	22392700-094BF26A	2nd Floor west end ADA restroom
95	095	22392700-095BF26A	2nd Floor west end restrooms, girls RR - left
96	096	22392700-096BF26A	2nd Floor west end restrooms, girls RR - right
97	097	22392700-097DW26A	2nd Floor west end drinking fountains - left
98	098	22392700-098DW26A	2nd Floor west end drinking fountains - right
99	099	22392700-099DW26A	Room 208, drinking fountain
100	100	22392700-100CF26A	Room 208, sink faucet
101	101	22392700-101DW26A	Room 207, drinking fountain
102	102	22392700-102CF26A	Room 207, sink faucet
103	103	22392700-103DW26A	Room 206, drinking fountain
104	104	22392700-104CF26A	Room 206, sink faucet
105	105	22392700-105DW26A	Room 205, drinking fountain
106	106	22392700-106CF26A	Room 205, sink faucet

Relinquished By/Signature

Dale Voeller

Date/Time: 3/21/26 @ 1:50 PM

Received By/Signature:

AL *APEX LABS*

Date/Time:

3/23/26 1143



4 of 4

Apex Laboratories

Jason Woodcock

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Orenco Elementary School/
Project Manager: Dale Voeller

Report ID:

A6C1987 - 04 06 26 1230

APEX LABS COOLER RECEIPT FORM

Client: Apex LO - FAX Element WO#: A6 C1987
Project/Project #: Orenco Elementary school 25012035/0004
22392700

Delivery Info:

Date/time received: 3/23/26 @ 1143 By: EST
Delivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒
Cooler Inspection Date/time inspected: 3/23/26 @ 1312 By: ESTChain of Custody included? Yes ☒ No ☐
Signed/dated by client? Yes ☒ No ☐
Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>17.5</u>	<u>16.8</u>	<u>16.8</u>				
Custody seals? (Y/N)	<u>N</u>	<u>N</u>	<u>N</u>				
Received on ice? (Y/N)	<u>N</u>	<u>N</u>	<u>N</u>				
Temp. blanks? (Y/N)	<u>N</u>	<u>N</u>	<u>N</u>				
Ice type: (Gel/Real/Other)	<u>NA</u>	<u>NA</u>	<u>NA</u>				
Condition (In/Out):	<u>OUT</u>	<u>OUT</u>	<u>OUT</u>				

Cooler out of temp? (Y/N) Possible reason why: DU
Green dots applied to out of temperature samples? Yes ☐ No ☒
Out of temperature samples form initiated? Yes ☐ No ☒
Sample Inspection: Date/time inspected: 3/24/26 @ 1248 By: AAWAll samples intact? Yes ☒ No ☐ Comments: _____Bottle labels/COCs agree? Yes ☒ No ☐ Comments: _____COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: _____Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments: _____

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A256271

Comments: _____

Labeled by: MLGWitness: bCooler Inspected by: AAW

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.