



April 10, 2026

Will Wenzloff
Hillsboro School District
4901 SE Witch Hazel Road
Hillsboro, Oregon 97123

Via email: wenzloffw@hsd.k12.or.us

Regarding: Drinking Water Sampling Report
Jackson Elementary School
675 NE Estate Drive
Hillsboro, Oregon
Apex Project No. 25012835 / 0002

Dear Mr. Wenzloff:

Between January 15 and March 21, 2026, Apex Companies LLC (Apex) collected drinking water samples at Jackson Elementary School in Hillsboro, Oregon. The testing was requested by Hillsboro School District as part of their efforts to ensure that concentrations of lead in drinking water at the school remain below the Oregon Department of Education (ODE) action level of 15 parts per billion (ppb). Testing included the main building and stand-alone gymnasium.

The initial round of sampling showed that the faucet behind the librarians desk in the media center (fixture number 061) had lead concentrations above 15ppb. The aerator on the faucet was subsequently cleaned and the fixture was resampled. The second round of sampling also showed lead concentrations above 15 ppb. A third sample, collected after the fixture was replaced, showed lead concentrations well above 15 ppb. Given the anticipated difficulty and expense of re-plumbing the fixture, the District has decided to remove the faucet, adjacent bubbler, and sink.

With the removal of the fixtures noted above, water from all fixtures at the school used for drinking or food preparation now have lead concentrations below 15 ppb.

Sixty-seven samples were collected and delivered under chain of custody to Apex Laboratories in Tigard, Oregon, for lead analysis. The results of the sampling is shown in the tables below.

Main Building – Round 1

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22392300-001KF26A	Kitchen – north wall triple sink – left faucet	4.96
002	22392300-002KF26A	Kitchen – north wall triple sink – right faucet	ND
003	22392300-003KF26A	Kitchen – pot filler faucet	8.26
004	22392300-004DW26A	Cafeteria – drinking fountain	ND
005	Not Sampled	Fixture number vacated	

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
006	Not Sampled	Fixture number vacated	
007	22392300-007BF26A	Boys NE restroom, triple-head wash basin - left	ND
008	22392300-008BF26A	Boys NE restroom, triple-head wash basin - center	ND
009	22392300-009BF26A	Boys NE restroom, triple-head wash basin - right	ND
010	22392300-010BF26A	Girls NE restroom, triple-head wash basin - left	0.246
011	22392300-011BF26A	Girls NE restroom, triple-head wash basin - center	ND
012	22392300-012BF26A	Girls NE restroom, triple-head wash basin - right	ND
013	22392300-013WB26A	Kindergarten hall, water bottle filler	ND
014	22392300-014DW26A	Kindergarten hall, drinking fountain – left	ND
015	22392300-015DW26A	Kindergarten hall, drinking fountain - right	ND
016	Not Sampled	Girls locker room handwash basin – left spray head – NOT WORKING	
017	22392300-017BF26A	Girls locker room handwash basin – center spray head	7.61
018	22392300-018BF26A	Girls locker room handwash basin – right spray head	3.99
019	Not Sampled	Boys locker room handwash basin – left spray head – NOT WORKING	
020	Not Sampled	Boys locker room handwash basin – center spray head – NOT WORKING	
021	Not Sampled	Boys locker room handwash basin – right spray head – NOT WORKING	
022	223902300-022BF26A	Mens staff restroom sink faucet	0.678
023	223902300-023BF26A	Womens staff restroom sink faucet	0.455
024	223902300-024SF26A	Staff breakroom sink faucet	0.378
025	223902300-025WC26A	Staff breakroom water cooler	ND
026	223902300-026BF26A	Kindergarten pod, sink at restrooms	0.375
027	223902300-027DW26A	Room 2 – east sink drinking fountain	2.28
028	223902300-028CF26A	Room 2 – east sink faucet	1.93
029	223902300-029CF26A	Room 2 – south sink faucet	2.07
030	223902300-030SF26A	Work room at main office, sink faucet	4.70
031	223902300-031NS26A	Health Room sink faucet	3.08
032	223902300-032CF26A	Rooms 3/4/5 activity room – left sink faucet	0.733
033	223902300-033DW26A	Rooms 3/4/5 activity room – right sink drinking fountain	0.851
034	223902300-034CF26A	Rooms 3/4/5 activity room – right sink faucet	0.411
035	223902300-035DW26A	Rooms 6/7/8 activity room – left sink drinking fountain	1.45
036	223902300-036CF26A	Rooms 6/7/8 activity room – left sink faucet	0.445
037	223902300-037CF26A	Rooms 6/7/8 activity room – right sink faucet	0.847
038	223902300-038BF26A	Boys SW restroom, triple-head wash basin - left	1.04
039	223902300-039BF26A	Boys SW restroom, triple-head wash basin - center	0.358
040	223902300-040BF26A	Boys SW restroom, triple-head wash basin - right	0.434
041	223902300-041BF26A	Girls SW restroom, triple-head wash basin - left	1.19
042	223902300-042BF26A	Girls SW restroom, triple-head wash basin - center	0.259
043	223902300-043BF26A	Girls SW restroom, triple-head wash basin - right	0.210
044	223902300-044DW26A	Drinking fountain in hall at SW restrooms	0.843

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
045	223902300-045DW26A	Rooms 9/10/11 activity room – left sink drinking fountain	0.736
046	223902300-046CF26A	Rooms 9/10/11 activity room – left sink faucet	0.543
047	223902300-047CF26A	Rooms 9/10/11 activity room – right sink faucet	0.461
048	223902300-048CF26A	Rooms 12/13/14 activity room – left sink faucet	0.329
049	22392300-049DW26A	Rooms 12/13/14 activity room – right sink drinking fountain	1.38
050	22392300-050CF26A	Rooms 12/13/14 activity room – right sink faucet	0.455
051	22392300-051DW26A	Rooms 15/16/17 activity room – left sink drinking fountain	1.28
052	22392300-052CF26A	Rooms 15/16/17 activity room – left sink faucet	0.749
053	22392300-053CF26A	Rooms 15/16/17 activity room – right sink faucet	1.23
054	22392300-054CF26A	Rooms 18/19/20 activity room – left sink faucet	1.08
055	22392300-055DW26A	Rooms 18/19/20 activity room – right sink drinking fountain	1.52
056	22392300-056CF26A	Rooms 18/19/20 activity room – right sink faucet	0.931
057	22392300-057DW26A	Drinking fountain at NE ADA restroom	0.492
058	22392300-058BF26A	NE ADA restroom sink faucet	ND
059	22392300-059CF26A	Media Center, NE corner, sink faucet	3.15
060	22392300-060DW26A	Media Center – librarian’s desk drinking fountain	11.6
061	22392300-061SF26A	Media Center – librarian’s desk sink faucet	26.5

ND = no lead detected

Main Building – Round 2

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
061	22392300-061SF26B	Media Center – librarian’s desk sink faucet – First Draw (after aerator cleaning)	31.8
061	22392300-061SF26C	Media Center – librarian’s desk sink faucet – Flush (after aerator cleaning)	1.26

Main Building – Round 3

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
061	22392300-061SF26D	Media Center – librarian’s desk sink faucet – First Draw (after fixture replacement)	253
061	22392300-061SF26E	Media Center – librarian’s desk sink faucet – Flush (after fixture replacement)	6.55

Sampling Notes:

1. The handwash basins in the former girls and boys locker rooms in the main building were previously assigned fixture numbers 005 and 006, respectively. However, these handwash basins each have three separate spray heads. Fixture numbers 005 and 006 were vacated and fixture numbers 016, 017, and 018 were assigned to the wash basin in the girls locker room and fixture numbers 019, 020, and 021 were assigned to the wash basin in the boys locker room. Note that left spray head in the girls locker room is

not currently working and none of the spray heads in the boys locker room are working. The District is not planning to repair these fixtures.

2. The drinking fountain and sink faucet behind the librarian's desk in the media center, fixture numbers 060 and 061, have been removed.

Gymnasium – Round 1

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22392304-001WB26A	Lobby – water bottle filler	ND
002	22392304-002DW26A	Lobby – drinking fountain, left	ND
003	22392304-003DW26A	Lobby – drinking fountain, right	ND
004	22392304-004BF26A	Restroom sink faucets, left to right (1)	ND
005	22392304-005BF26A	Restroom sink faucets, left to right (2)	0.354
006	22392304-006BF26A	Restroom sink faucets, left to right (3)	ND
007	22392304-007BF26A	Restroom sink faucets, left to right (4)	0.580
008	22392304-008BF26A	Private restroom sink faucet	ND

ND = no lead detected

Please refer to the attached fixture location drawings and laboratory analytical report for additional details. The laboratory analytical results are reported in micrograms per liter ($\mu\text{g/L}$), a unit of measure that is equivalent to ppb.

Sampling methodology and the interpretation of laboratory results were based on the Environmental Protection Agency guidance document titled *3Ts for Reducing Lead in Drinking Water in Schools*. Following this guideline, Apex collected first draw samples from each test location. First draw samples consist of the first 250 milliliters (mL) of water drawn from a fixture after the water has been sitting stagnant for at least 8 hours. The 3Ts' sampling protocol specifying 250-mL samples is designed to maximize the likelihood that the highest concentrations of lead in water used for consumption are identified.


Please feel free to contact me at 503.515.4726 or dale.voeller@apexc.com with any questions or comments.


Sincerely,




Dale Voeller, CHMM, CSP
Senior Project Manager


Attachment: Fixture Location Drawings
Laboratory Analytical Reports

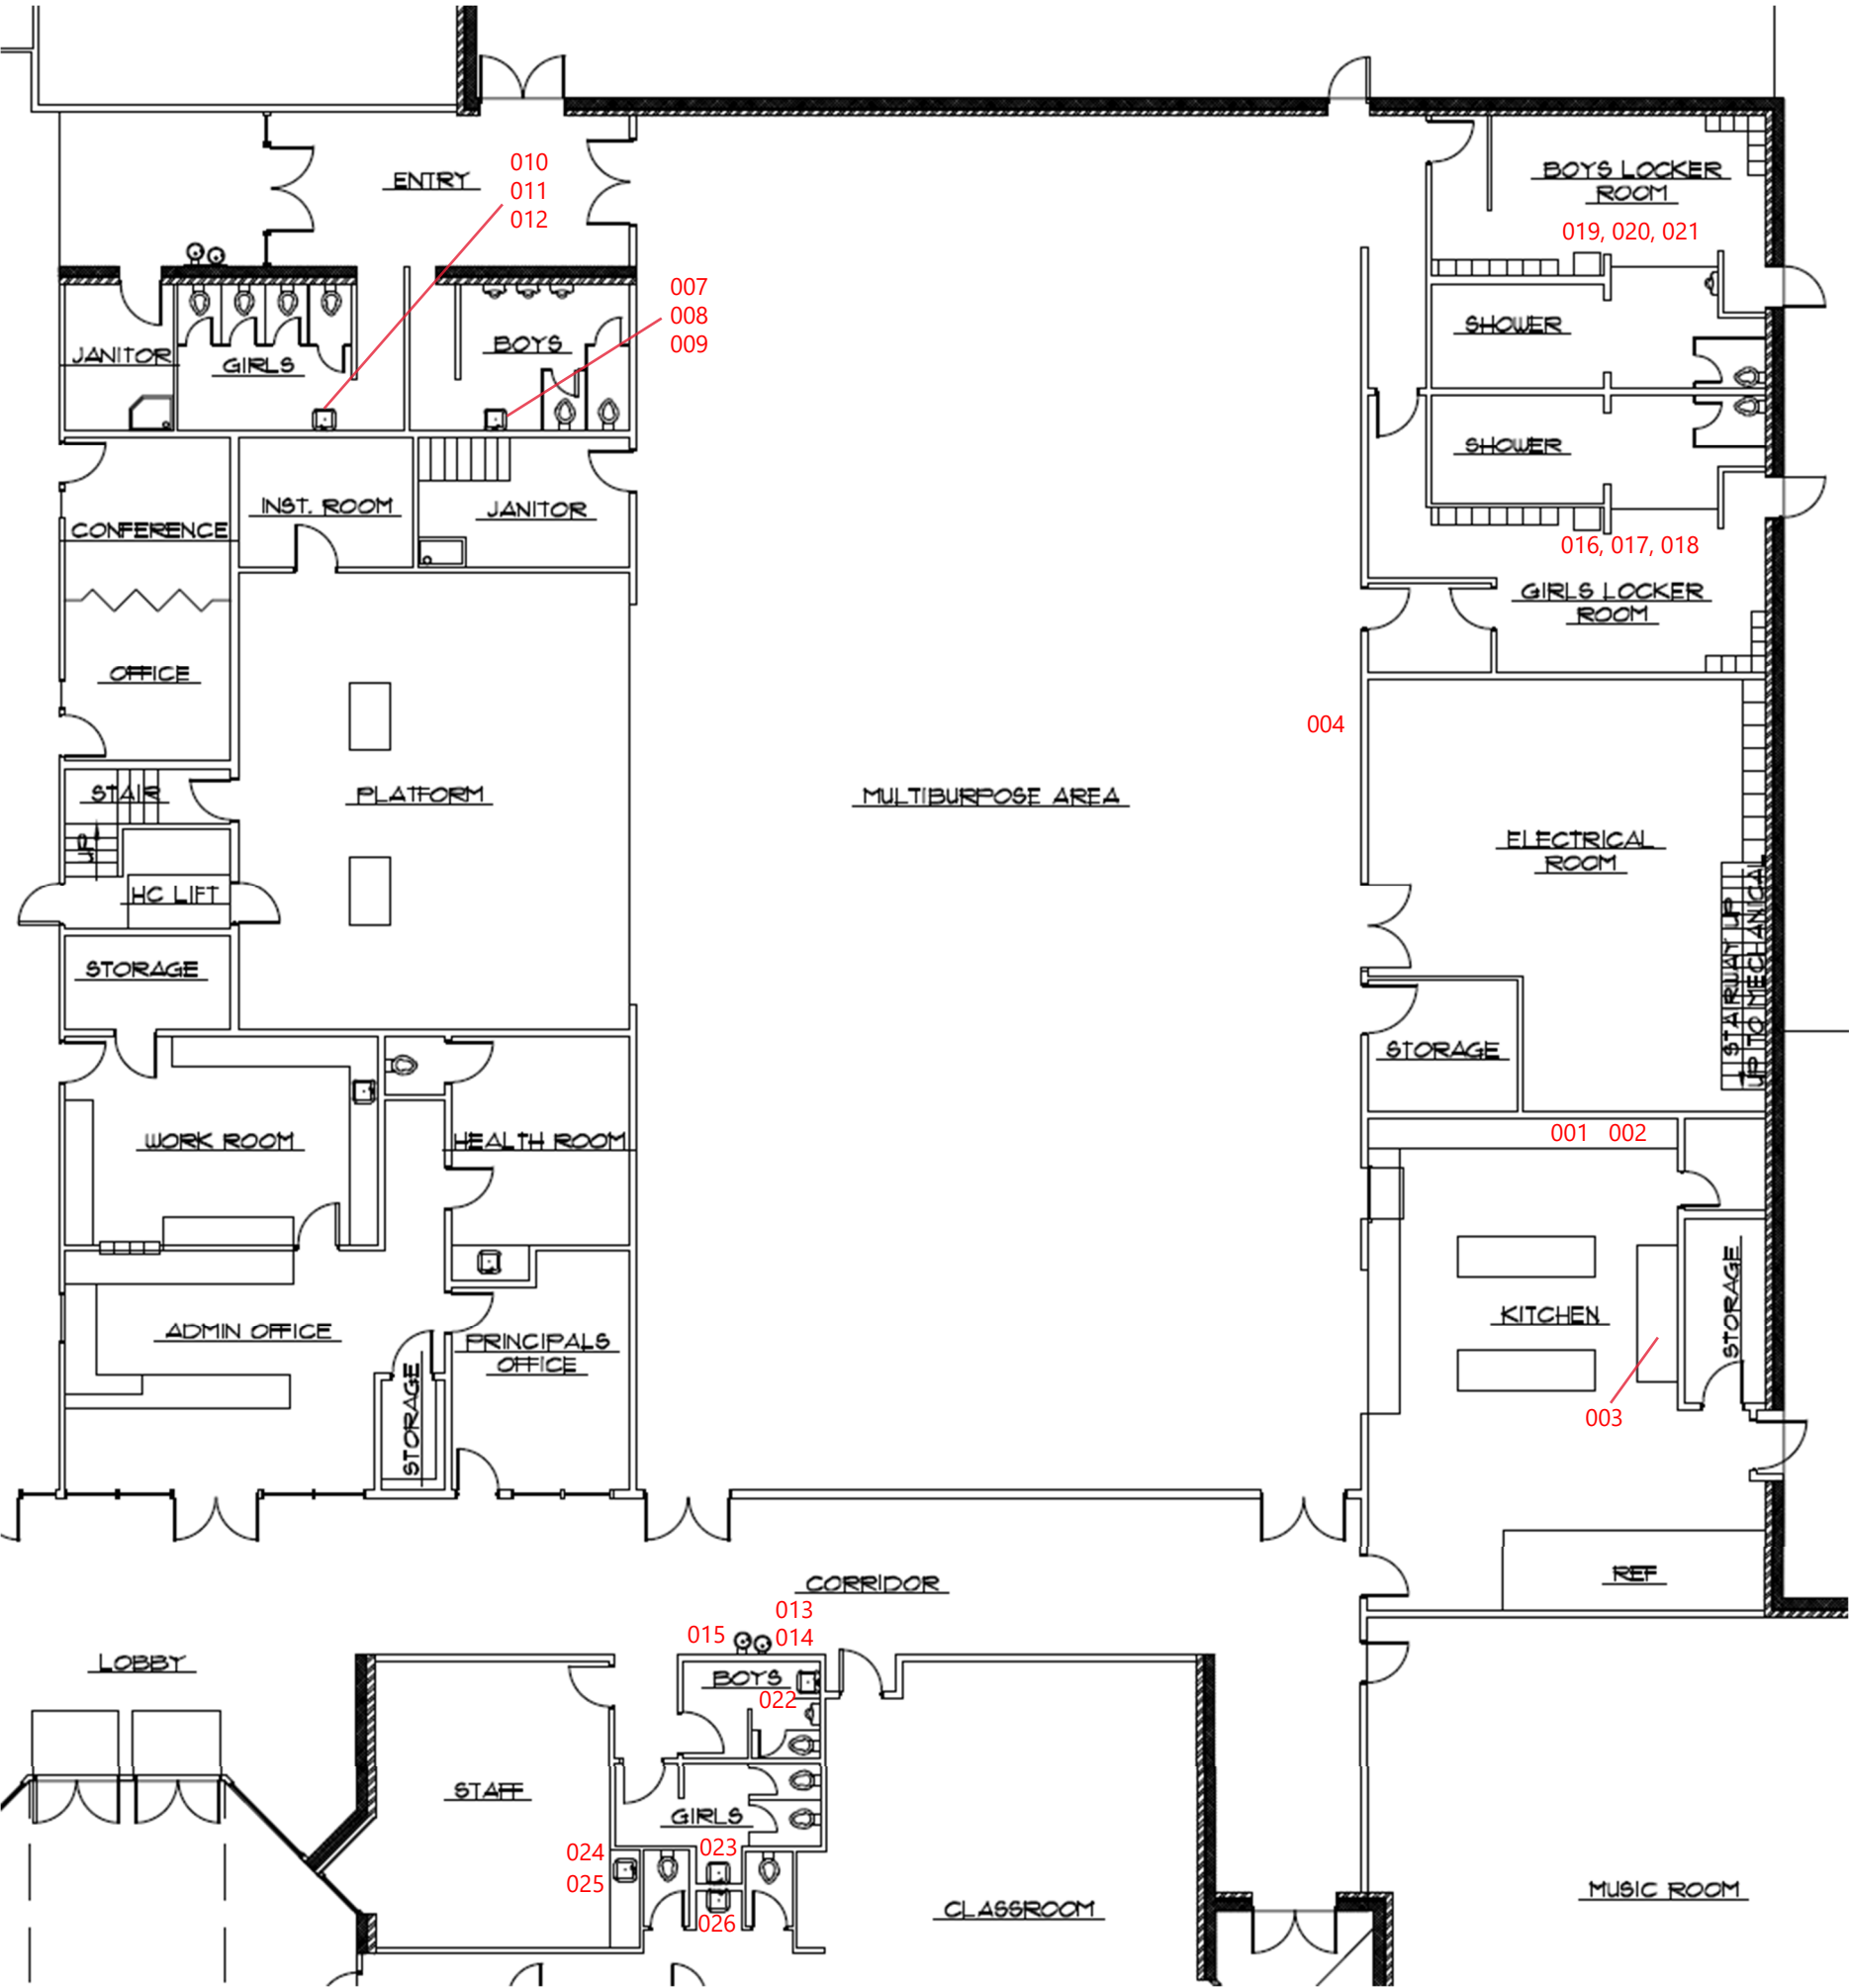

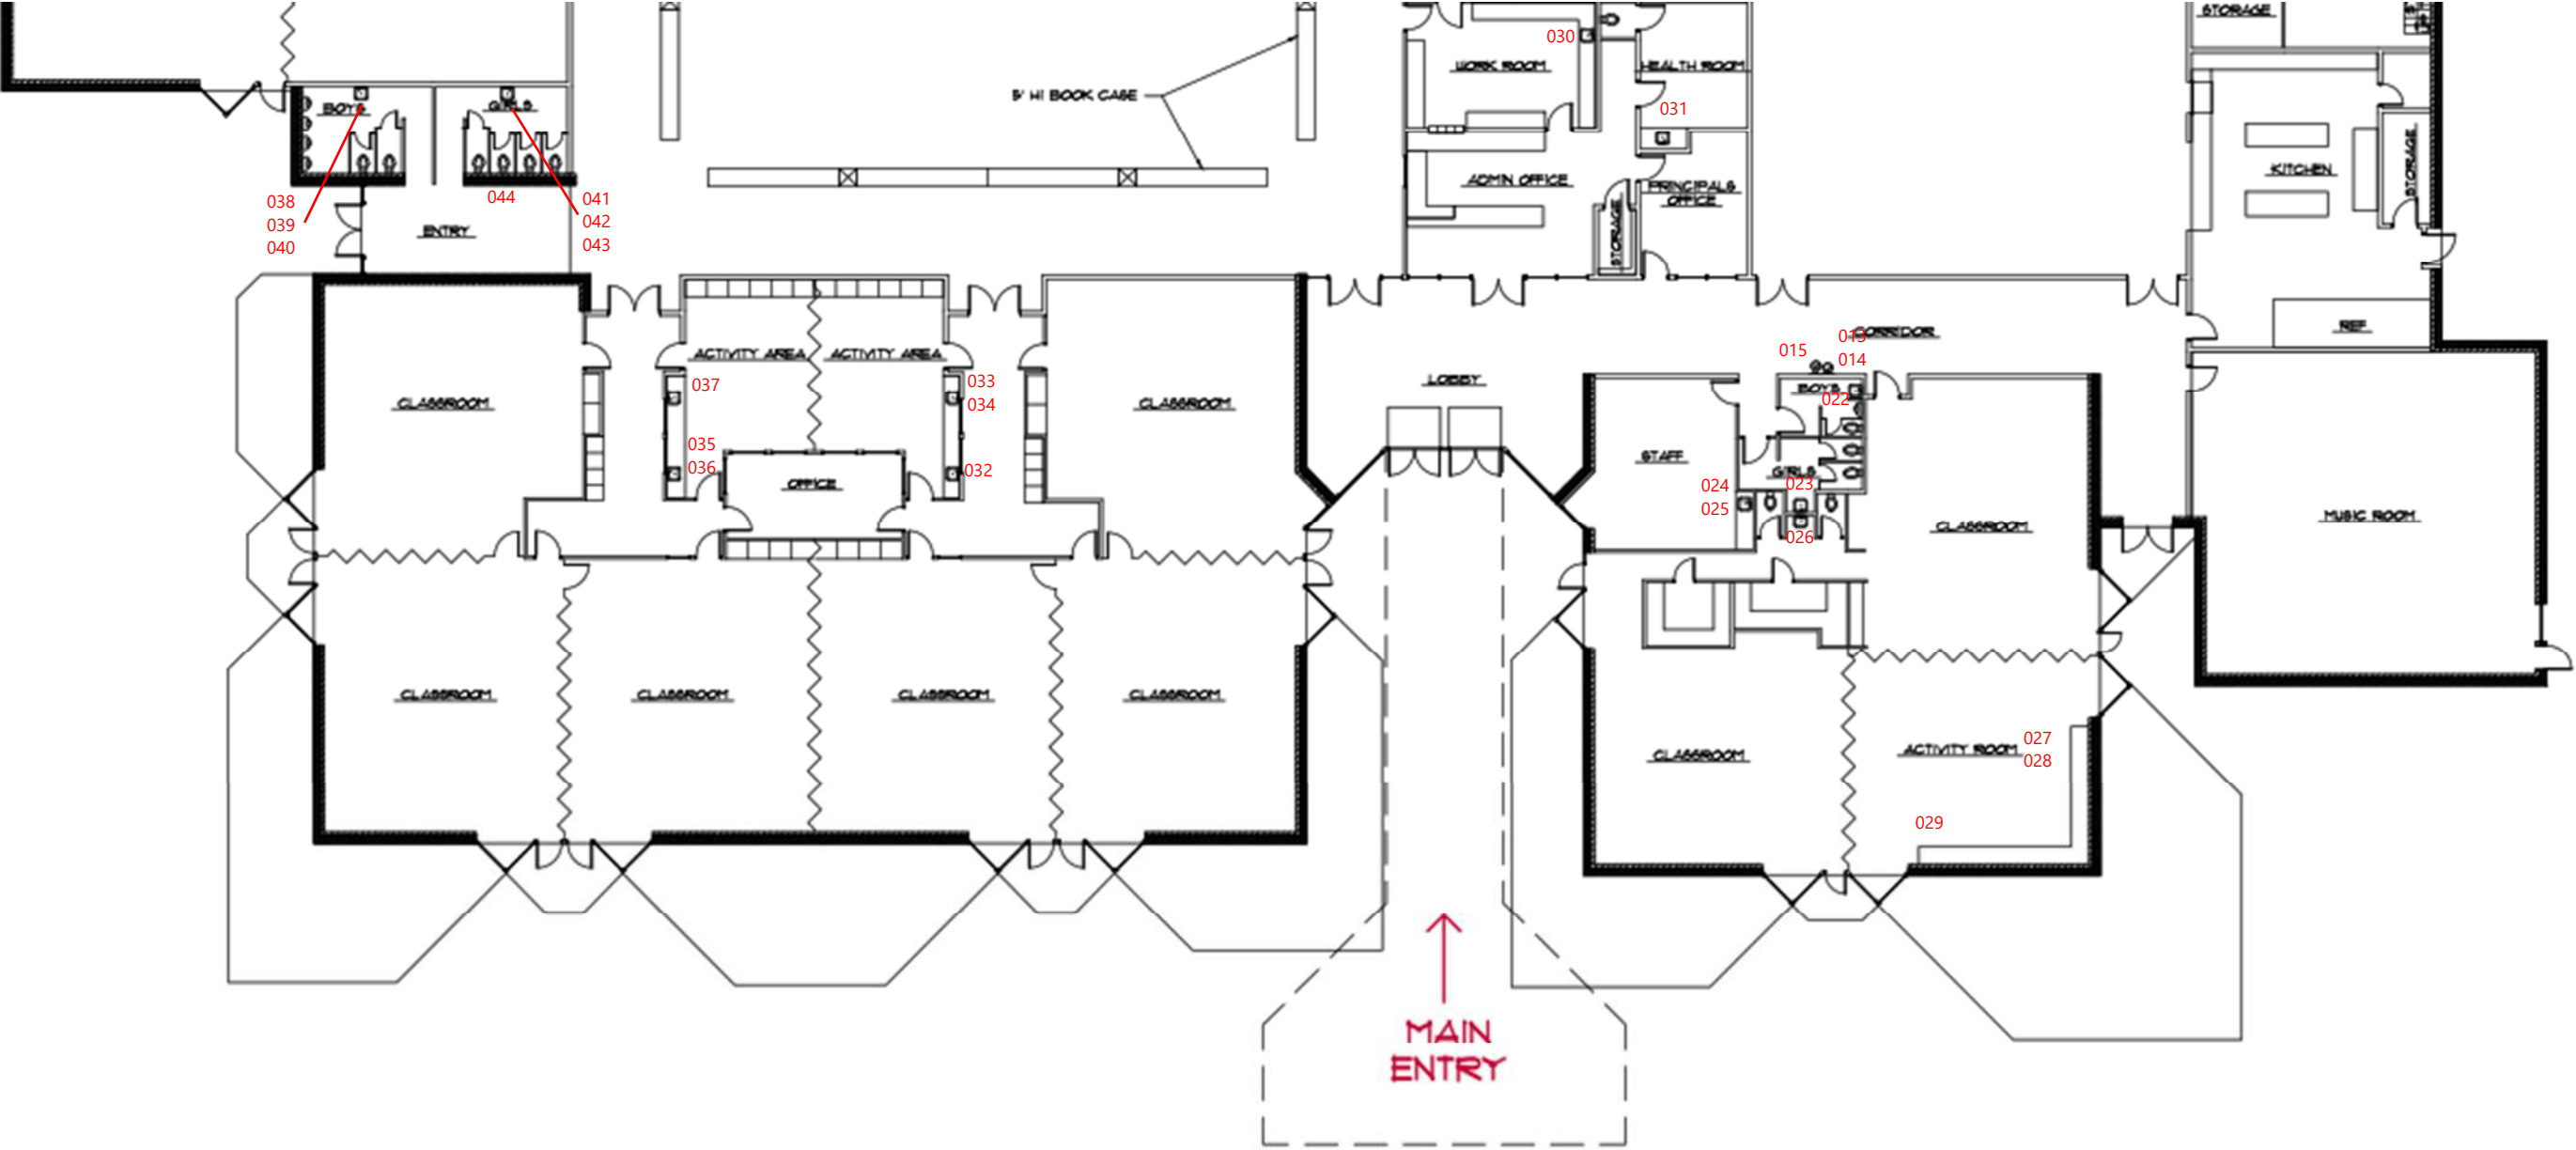

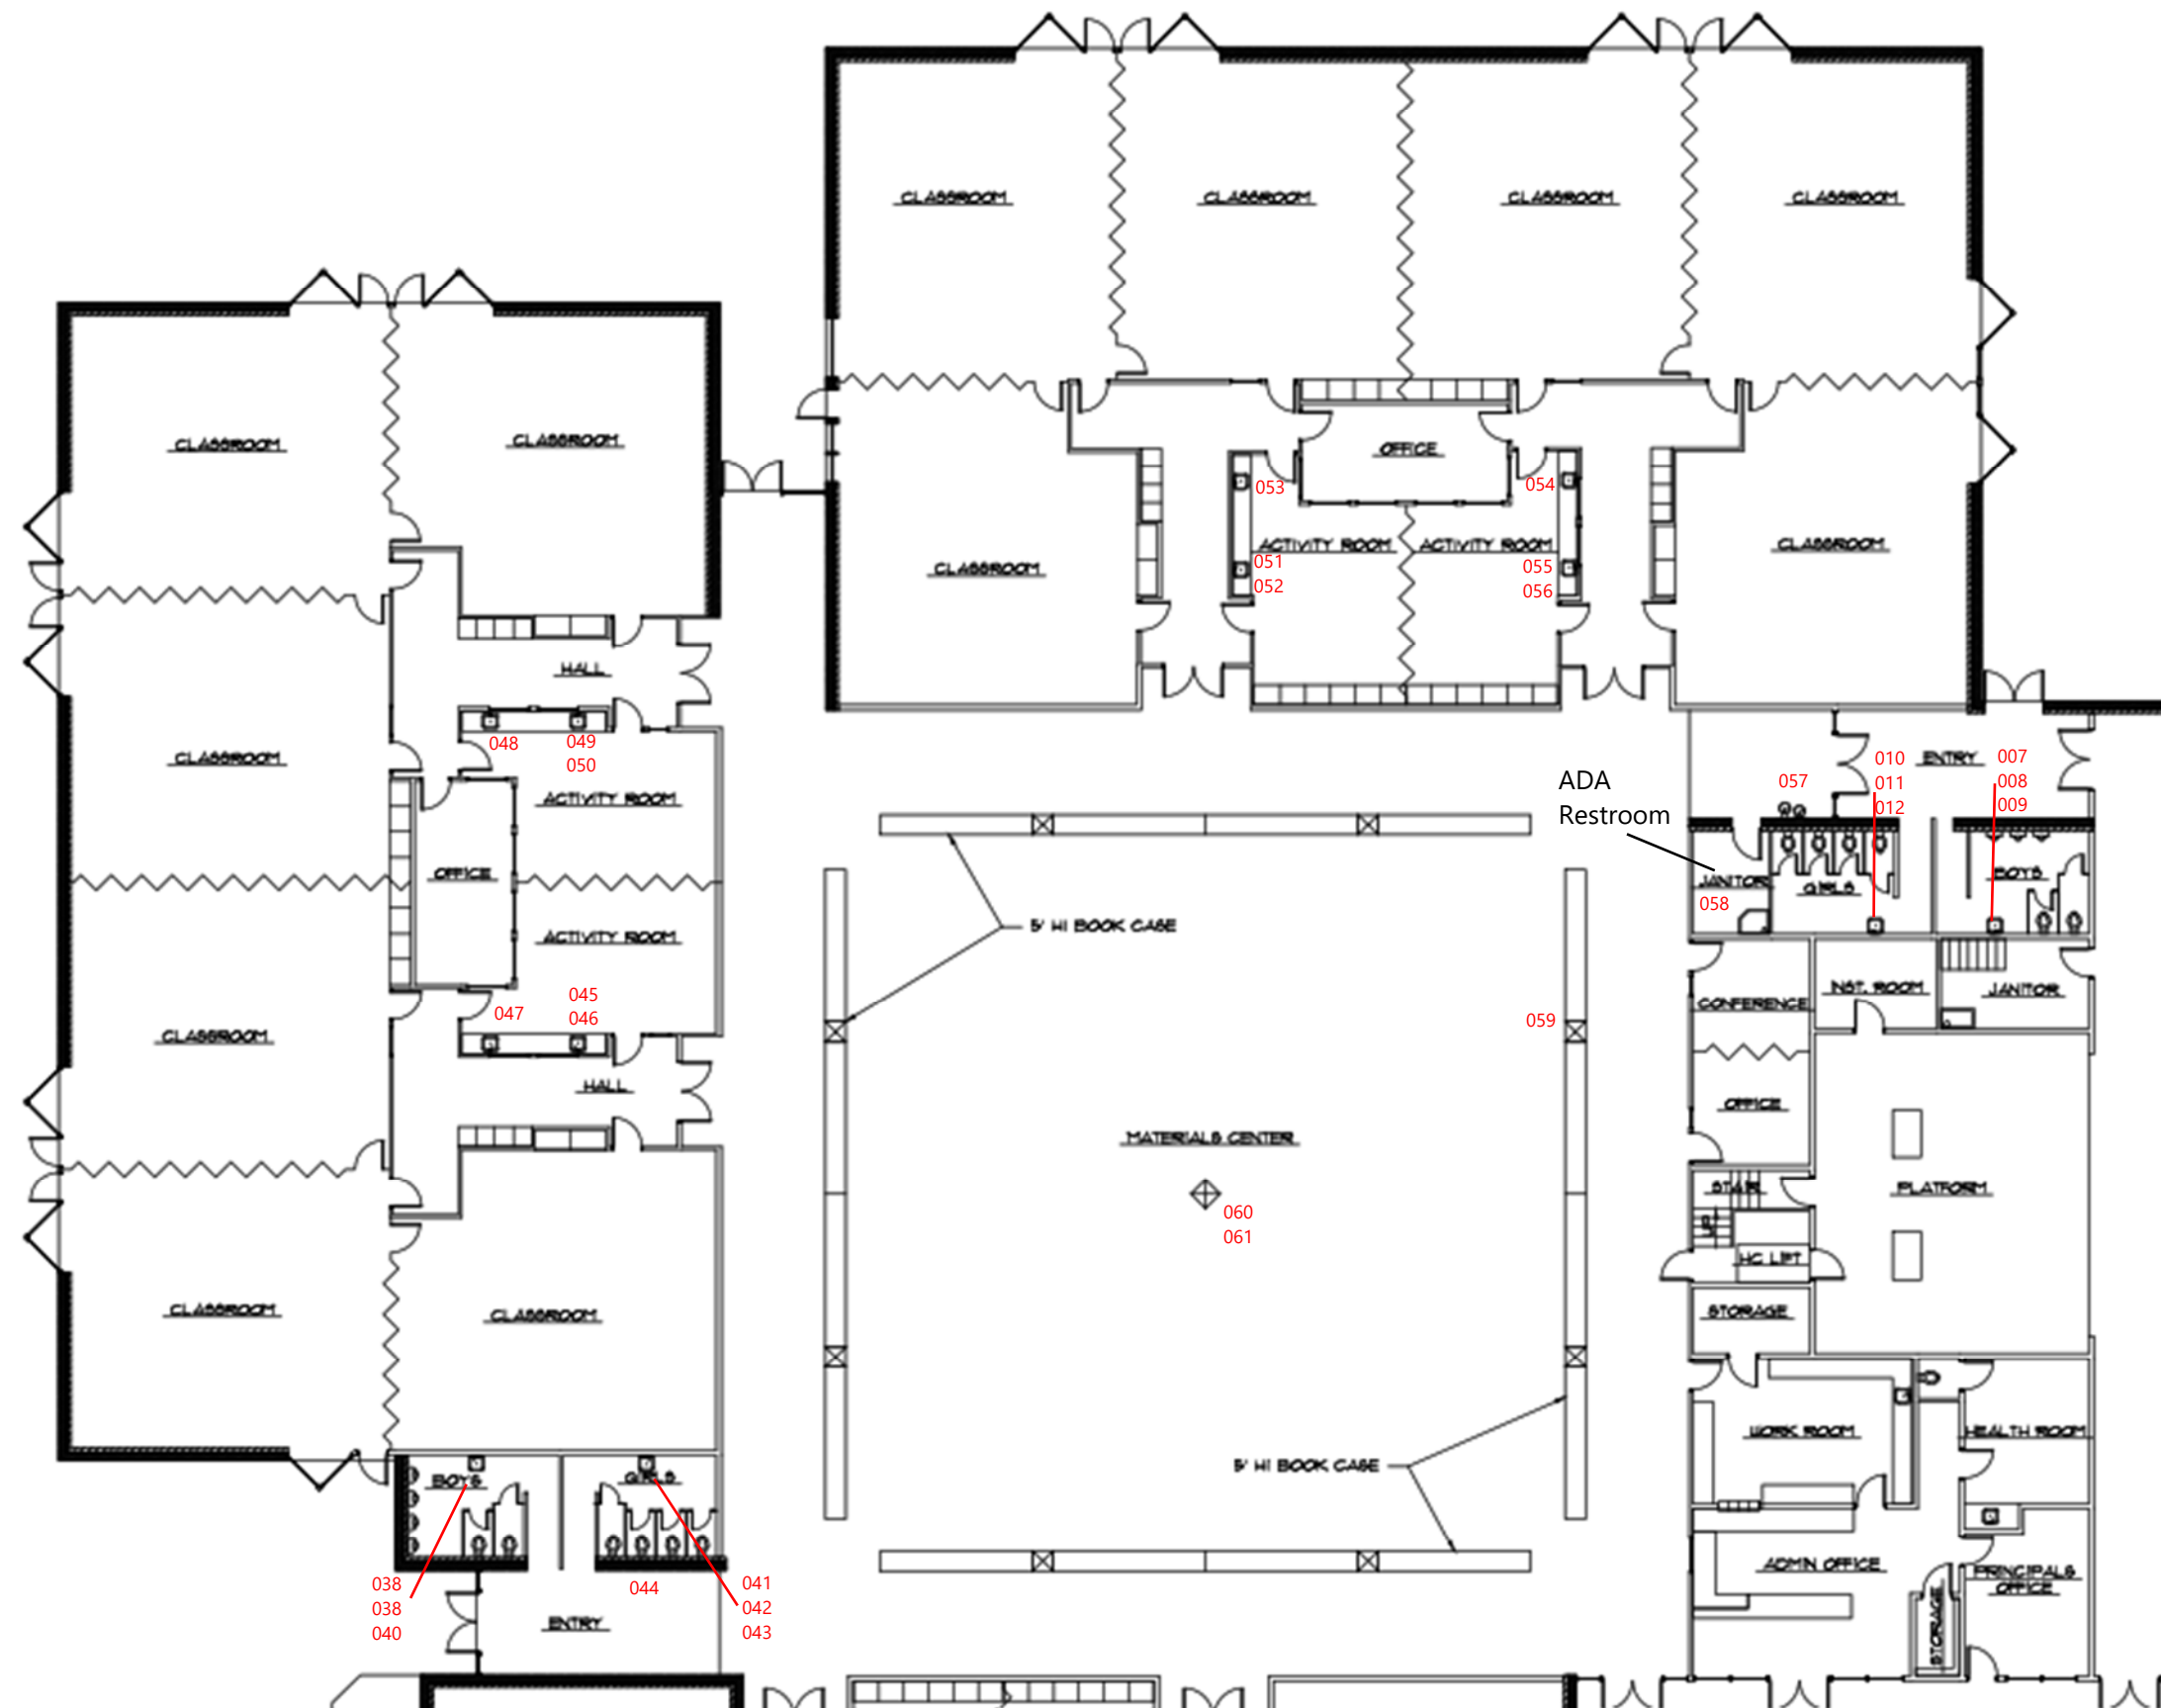

Jackson ES
Gymnasium Building
Drinking Water Fixture Location Drawing
September 25, 2021

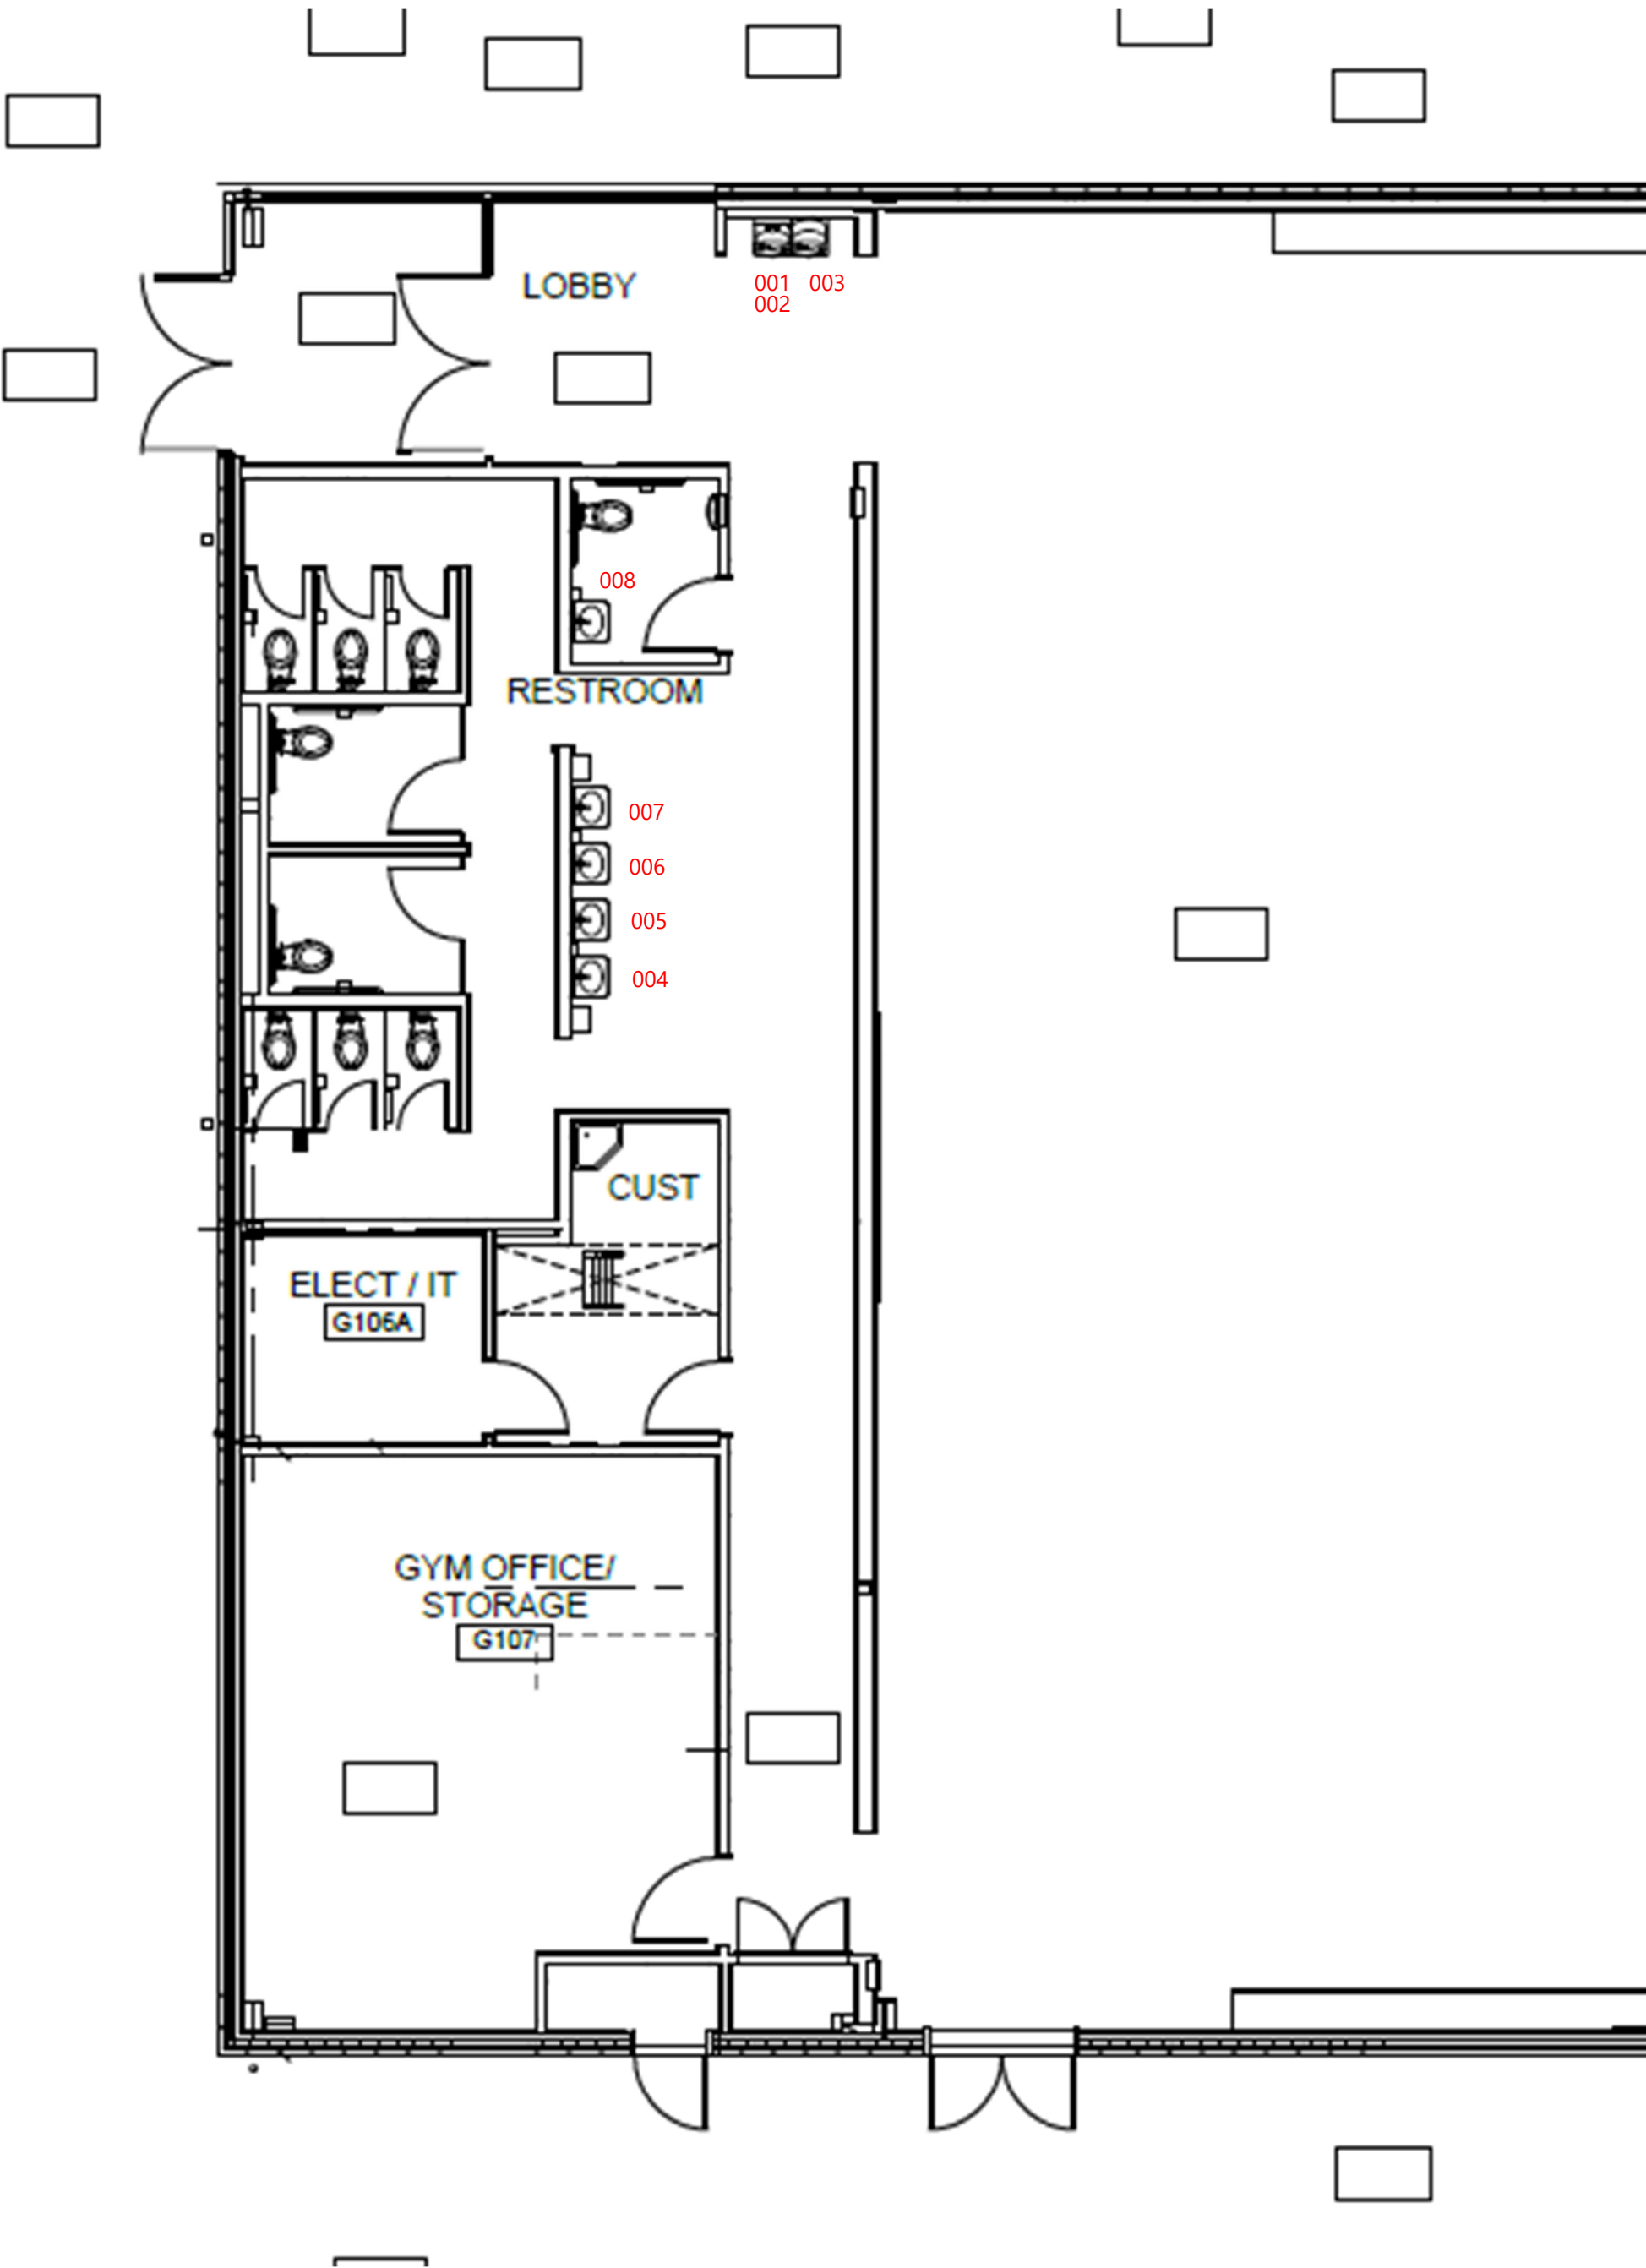



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Friday, February 6, 2026

Dale Voeller

Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

RE: A6A1697 - Hillsboro School District - Jackson Elementary School/25012385

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6A1697, which was received by the laboratory on 1/26/2026 at 12:00:00PM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information		
<u>Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.</u>		
(See Cooler Receipt Form for details)		
Default Cooler	17.4	degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1697 - 02 06 26 1652

ANALYTICAL REPORT FOR SAMPLES**SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392300-001KF26A	A6A1697-01	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-002KF26A	A6A1697-02	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-003KF26A	A6A1697-03	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-004DW26A	A6A1697-04	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-007BF26A	A6A1697-05	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-008BF26A	A6A1697-06	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-009BF26A	A6A1697-07	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-010BF26A	A6A1697-08	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-011BF26A	A6A1697-09	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-012BF26A	A6A1697-10	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-013WB26A	A6A1697-11	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-014DW26A	A6A1697-12	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-015DW26A	A6A1697-13	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-017BF26A	A6A1697-14	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-018BF26A	A6A1697-15	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-022BF26A	A6A1697-16	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-023BF26A	A6A1697-17	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-024SF26A	A6A1697-18	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-025WC26A	A6A1697-19	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-026BF26A	A6A1697-20	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-027DW26A	A6A1697-21	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-028CF26A	A6A1697-22	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-029CF26A	A6A1697-23	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-030SF26A	A6A1697-24	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-031NS26A	A6A1697-25	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-032CF26A	A6A1697-26	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-033DW26A	A6A1697-27	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-034CF26A	A6A1697-28	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-035DW26A	A6A1697-29	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-036CF26A	A6A1697-30	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-037CF26A	A6A1697-31	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-038BF26A	A6A1697-32	Drinking Water	01/17/26 00:00	01/26/26 12:00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392300-039BF26A	A6A1697-33	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-040BF26A	A6A1697-34	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-041BF26A	A6A1697-35	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-042BF26A	A6A1697-36	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-043BF26A	A6A1697-37	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-044DW26A	A6A1697-38	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-045DW26A	A6A1697-39	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-046CF26A	A6A1697-40	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-047CF26A	A6A1697-41	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-048CF26A	A6A1697-42	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-049DW26A	A6A1697-43	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-050CF26A	A6A1697-44	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-051DW26A	A6A1697-45	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-052CF26A	A6A1697-46	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-053CF26A	A6A1697-47	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-054CF26A	A6A1697-48	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-055DW26A	A6A1697-49	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-056CF26A	A6A1697-50	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-057DW26A	A6A1697-51	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-058BF26A	A6A1697-52	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-059CF26A	A6A1697-53	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-060DW26A	A6A1697-54	Drinking Water	01/17/26 00:00	01/26/26 12:00
22392300-061SF26A	A6A1697-55	Drinking Water	01/17/26 00:00	01/26/26 12:00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-001KF26A (A6A1697-01)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	4.96	---	0.200	ug/L	1	01/31/26 17:02	EPA 200.8	
22392300-002KF26A (A6A1697-02RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:05	EPA 200.8	
22392300-003KF26A (A6A1697-03RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	8.26	---	0.200	ug/L	1	01/31/26 18:07	EPA 200.8	
22392300-004DW26A (A6A1697-04RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:09	EPA 200.8	
22392300-007BF26A (A6A1697-05RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:11	EPA 200.8	
22392300-008BF26A (A6A1697-06RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:13	EPA 200.8	
22392300-009BF26A (A6A1697-07RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:14	EPA 200.8	
22392300-010BF26A (A6A1697-08RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	0.246	---	0.200	ug/L	1	01/31/26 18:16	EPA 200.8	
22392300-011BF26A (A6A1697-09RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:18	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-012BF26A (A6A1697-10RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:20	EPA 200.8	
22392300-013WB26A (A6A1697-11RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:26	EPA 200.8	
22392300-014DW26A (A6A1697-12RE1)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:27	EPA 200.8	
22392300-015DW26A (A6A1697-13)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:35	EPA 200.8	
22392300-017BF26A (A6A1697-14)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	7.61	---	0.200	ug/L	1	01/31/26 18:40	EPA 200.8	
22392300-018BF26A (A6A1697-15)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	3.99	---	0.200	ug/L	1	01/31/26 18:42	EPA 200.8	
22392300-022BF26A (A6A1697-16)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.678	---	0.200	ug/L	1	01/31/26 18:50	EPA 200.8	
22392300-023BF26A (A6A1697-17)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.455	---	0.200	ug/L	1	01/31/26 18:52	EPA 200.8	
22392300-024SF26A (A6A1697-18)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.378	---	0.200	ug/L	1	01/31/26 18:54	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-025WC26A (A6A1697-19)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	ND	---	0.200	ug/L	1	01/31/26 18:56	EPA 200.8	
22392300-026BF26A (A6A1697-20)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.375	---	0.200	ug/L	1	01/31/26 18:58	EPA 200.8	
22392300-027DW26A (A6A1697-21)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	2.28	---	0.200	ug/L	1	01/31/26 19:00	EPA 200.8	
22392300-028CF26A (A6A1697-22)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	1.93	---	0.200	ug/L	1	01/31/26 19:02	EPA 200.8	
22392300-029CF26A (A6A1697-23)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	2.07	---	0.200	ug/L	1	01/31/26 19:03	EPA 200.8	
22392300-030SF26A (A6A1697-24)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	4.70	---	0.200	ug/L	1	01/31/26 19:05	EPA 200.8	
22392300-031NS26A (A6A1697-25)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	3.08	---	0.200	ug/L	1	01/31/26 19:07	EPA 200.8	
22392300-032CF26A (A6A1697-26)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.733	---	0.200	ug/L	1	01/31/26 19:13	EPA 200.8	
22392300-033DW26A (A6A1697-27)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.851	---	0.200	ug/L	1	01/31/26 19:15	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-034CF26A (A6A1697-28)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.411	---	0.200	ug/L	1	01/31/26 19:17	EPA 200.8	
22392300-035DW26A (A6A1697-29)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	1.45	---	0.200	ug/L	1	01/31/26 19:18	EPA 200.8	
22392300-036CF26A (A6A1697-30)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.445	---	0.200	ug/L	1	01/31/26 19:20	EPA 200.8	
22392300-037CF26A (A6A1697-31)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	0.847	---	0.200	ug/L	1	01/31/26 19:22	EPA 200.8	
22392300-038BF26A (A6A1697-32)				Matrix: Drinking Water				
Batch: 26A0796								
Lead	1.04	---	0.200	ug/L	1	01/31/26 19:24	EPA 200.8	
22392300-039BF26A (A6A1697-33)				Matrix: Drinking Water				
Batch: 26A0826								
Lead	0.358	---	0.200	ug/L	1	01/31/26 19:39	EPA 200.8	
22392300-040BF26A (A6A1697-34)				Matrix: Drinking Water				
Batch: 26A0826								
Lead	0.434	---	0.200	ug/L	1	01/31/26 19:45	EPA 200.8	
22392300-041BF26A (A6A1697-35)				Matrix: Drinking Water				
Batch: 26A0826								
Lead	1.19	---	0.200	ug/L	1	01/31/26 19:46	EPA 200.8	
22392300-042BF26A (A6A1697-36)				Matrix: Drinking Water				
Batch: 26A0826								
Lead	0.259	---	0.200	ug/L	1	01/31/26 19:48	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1697 - 02 06 26 1652

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-043BF26A (A6A1697-37) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.210	---	0.200	ug/L	1	01/31/26 19:50	EPA 200.8	
22392300-044DW26A (A6A1697-38) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.843	---	0.200	ug/L	1	01/31/26 19:52	EPA 200.8	
22392300-045DW26A (A6A1697-39) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.736	---	0.200	ug/L	1	01/31/26 20:00	EPA 200.8	
22392300-046CF26A (A6A1697-40) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.543	---	0.200	ug/L	1	01/31/26 20:02	EPA 200.8	
22392300-047CF26A (A6A1697-41) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.461	---	0.200	ug/L	1	01/31/26 20:03	EPA 200.8	
22392300-048CF26A (A6A1697-42) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.329	---	0.200	ug/L	1	01/31/26 20:05	EPA 200.8	
22392300-049DW26A (A6A1697-43) Matrix: Drinking Water								
Batch: 26A0826								
Lead	1.38	---	0.200	ug/L	1	01/31/26 20:07	EPA 200.8	
22392300-050CF26A (A6A1697-44) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.455	---	0.200	ug/L	1	01/31/26 20:09	EPA 200.8	
22392300-051DW26A (A6A1697-45) Matrix: Drinking Water								
Batch: 26A0826								
Lead	1.28	---	0.200	ug/L	1	01/31/26 20:11	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**
4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**
Project Number: **Jackson Elementary School**
Project Manager: **Dale Voeller****Report ID:**
A6A1697 - 02 06 26 1652**ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-052CF26A (A6A1697-46) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.749	---	0.200	ug/L	1	01/31/26 20:13	EPA 200.8	
22392300-053CF26A (A6A1697-47) Matrix: Drinking Water								
Batch: 26A0826								
Lead	1.23	---	0.200	ug/L	1	01/31/26 20:15	EPA 200.8	
22392300-054CF26A (A6A1697-48) Matrix: Drinking Water								
Batch: 26A0826								
Lead	1.08	---	0.200	ug/L	1	01/31/26 20:17	EPA 200.8	
22392300-055DW26A (A6A1697-49) Matrix: Drinking Water								
Batch: 26A0826								
Lead	1.52	---	0.200	ug/L	1	01/31/26 20:22	EPA 200.8	
22392300-056CF26A (A6A1697-50) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.931	---	0.200	ug/L	1	01/31/26 20:24	EPA 200.8	
22392300-057DW26A (A6A1697-51) Matrix: Drinking Water								
Batch: 26A0826								
Lead	0.492	---	0.200	ug/L	1	01/31/26 20:26	EPA 200.8	
22392300-058BF26A (A6A1697-52) Matrix: Drinking Water								
Batch: 26A0826								
Lead	ND	---	0.200	ug/L	1	01/31/26 20:28	EPA 200.8	
22392300-059CF26A (A6A1697-53) Matrix: Drinking Water								
Batch: 26A0879								
Lead	3.15	---	0.200	ug/L	1	02/04/26 15:35	EPA 200.8	
22392300-060DW26A (A6A1697-54) Matrix: Drinking Water								
Batch: 26A0879								
Lead	11.6	---	0.200	ug/L	1	02/04/26 15:41	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-061SF26A (A6A1697-55)				Matrix: Drinking Water				
Batch: 26A0879								
Lead	26.5	---	0.200	ug/L	1	02/04/26 15:43	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239Project: Hillsboro School District
Project Number: Jackson Elementary School
Project Manager: Dale VoellerReport ID:
A6A1697 - 02 06 26 1652

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26A0794 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26A0794-BLK1)		Prepared: 01/27/26 06:49		Analyzed: 01/31/26 16:32								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26A0794-BS1)		Prepared: 01/27/26 06:49		Analyzed: 01/31/26 16:37								
EPA 200.8												
Lead	14.2	---	0.201	ug/L	1	15.0	---	95	85 - 115%	---	---	
Matrix Spike (26A0794-MS2)		Prepared: 01/27/26 06:49		Analyzed: 01/31/26 18:29								
QC Source Sample: 22392300-014DW26A (A6A1697-12RE1)												
EPA 200.8												
Lead	15.3	---	0.201	ug/L	1	15.0	ND	102	70 - 130%	---	---	
Batch 26A0796 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26A0796-BLK1)		Prepared: 01/27/26 07:32		Analyzed: 01/31/26 18:31								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26A0796-BS1)		Prepared: 01/27/26 07:32		Analyzed: 01/31/26 18:33								
EPA 200.8												
Lead	15.6	---	0.201	ug/L	1	15.0	---	104	85 - 115%	---	---	
Duplicate (26A0796-DUP1)		Prepared: 01/27/26 07:32		Analyzed: 01/31/26 18:37								
QC Source Sample: 22392300-015DW26A (A6A1697-13)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	ND	---	---	---	20%	
Matrix Spike (26A0796-MS1)		Prepared: 01/27/26 07:32		Analyzed: 01/31/26 18:39								
QC Source Sample: 22392300-015DW26A (A6A1697-13)												
EPA 200.8												
Lead	15.3	---	0.201	ug/L	1	15.0	ND	102	70 - 130%	---	---	
Matrix Spike (26A0796-MS2)		Prepared: 01/27/26 07:32		Analyzed: 01/31/26 19:26								
QC Source Sample: 22392300-038BF26A (A6A1697-32)												

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1697 - 02 06 26 1652

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26A0796 - EPA 200.8 Direct Analysis							Drinking Water					
Matrix Spike (26A0796-MS2)		Prepared: 01/27/26 07:32 Analyzed: 01/31/26 19:26										
QC Source Sample: 22392300-038BF26A (A6A1697-32)												
EPA 200.8												
Lead	15.5	---	0.201	ug/L	1	15.0	1.04	97	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****QUALITY CONTROL (QC) SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26A0826 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26A0826-BLK1)		Prepared: 01/27/26 13:48			Analyzed: 01/31/26 19:35							
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26A0826-BS1)		Prepared: 01/27/26 13:48			Analyzed: 01/31/26 19:37							
EPA 200.8												
Lead	15.0	---	0.201	ug/L	1	15.0	---	100	85 - 115%	---	---	
Duplicate (26A0826-DUP1)		Prepared: 01/27/26 13:48			Analyzed: 01/31/26 19:41							
QC Source Sample: 22392300-039BF26A (A6A1697-33)												
EPA 200.8												
Lead	0.326	---	0.200	ug/L	1	---	0.358	---	---	9	20%	
Matrix Spike (26A0826-MS1)		Prepared: 01/27/26 13:48			Analyzed: 01/31/26 19:43							
QC Source Sample: 22392300-039BF26A (A6A1697-33)												
EPA 200.8												
Lead	14.7	---	0.201	ug/L	1	15.0	0.358	96	70 - 130%	---	---	
Matrix Spike (26A0826-MS2)		Prepared: 01/27/26 13:48			Analyzed: 01/31/26 20:30							
QC Source Sample: 22392300-058BF26A (A6A1697-52)												
EPA 200.8												
Lead	14.2	---	0.201	ug/L	1	15.0	0.151	94	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School
Project Manager: Dale Voeller

Report ID:

A6A1697 - 02 06 26 1652

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26A0879 - EPA 200.8 Direct Analysis						Drinking Water						
Blank (26A0879-BLK1)		Prepared: 01/28/26 13:38 Analyzed: 02/04/26 15:31										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26A0879-BS1)		Prepared: 01/28/26 13:38 Analyzed: 02/04/26 15:33										
EPA 200.8												
Lead	14.7	---	0.201	ug/L	1	15.0	---	98	85 - 115%	---	---	
Duplicate (26A0879-DUP1)		Prepared: 01/28/26 13:38 Analyzed: 02/04/26 15:37										
QC Source Sample: 22392300-059CF26A (A6A1697-53)												
EPA 200.8												
Lead	3.07	---	0.200	ug/L	1	---	3.15	---	---	3	20%	
Matrix Spike (26A0879-MS1)		Prepared: 01/28/26 13:38 Analyzed: 02/04/26 15:39										
QC Source Sample: 22392300-059CF26A (A6A1697-53)												
EPA 200.8												
Lead	17.4	---	0.201	ug/L	1	15.0	3.15	95	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC****6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062****Apex Companies, LLC - Portland****4412 S Corbett Ave
Portland, OR 97239**Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26A0794							
A6A1697-01	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-02RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-03RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-04RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-05RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-06RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-07RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-08RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-09RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-10RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-11RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1697-12RE1	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
Batch: 26A0796							
A6A1697-13	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-14	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-15	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-16	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-17	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-18	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-19	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-20	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-21	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-22	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-23	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-24	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-25	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-26	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-27	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-28	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-29	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-30	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-31	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
A6A1697-32	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 07:32	10mL/10mL	10mL/10mL	1.00
Batch: 26A0826							
A6A1697-33	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1697 - 02 06 26 1652****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
A6A1697-34	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-35	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-36	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-37	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-38	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-39	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-40	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-41	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-42	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-43	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-44	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-45	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-46	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-47	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-48	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-49	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-50	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-51	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
A6A1697-52	Drinking Water	EPA 200.8	01/17/26 00:00	01/27/26 13:48	10mL/10mL	10mL/10mL	1.00
Batch: 26A0879							
A6A1697-53	Drinking Water	EPA 200.8	01/17/26 00:00	01/28/26 13:38	10mL/10mL	10mL/10mL	1.00
A6A1697-54	Drinking Water	EPA 200.8	01/17/26 00:00	01/28/26 13:38	10mL/10mL	10mL/10mL	1.00
A6A1697-55	Drinking Water	EPA 200.8	01/17/26 00:00	01/28/26 13:38	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1697 - 02 06 26 1652

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1697 - 02 06 26 1652

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or " " (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1697 - 02 06 26 1652

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between $\frac{1}{2}$ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1697 - 02 06 26 1652

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1697 - 02 06 26 1652

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1697 - 02 06 26 1652

Lead in Drinking Water Testing Program

Date Collected: 01/17/2026

Apex Project: 25012385 / 0002

A6A1697

School Name: Jackson Elementary School

Building: Main Building - Round 1

Building Number: 22392300

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	001	22392300-001KF26A	Kitchen - north wall triple sink - left faucet
2	002	22392300-002KF26A	Kitchen - north wall triple sink - right faucet
3	003	22392300-003KF26A	Kitchen - pot filler faucet
4	004	22392300-004DW26A	Cafeteria - drinking fountain
5	005	Not Sampled	
6	006	Not Sampled	
7	007	22392300-007BF26A	Boys NE restroom, triple-head wash basin - left
8	008	22392300-008BF26A	Boys NE restroom, triple-head wash basin - center
9	009	22392300-009BF26A	Boys NE restroom, triple-head wash basin - right
10	010	22392300-010BF26A	Girls NE restroom, triple-head wash basin - left
11	011	22392300-011BF26A	Girls NE restroom, triple-head wash basin - center
12	012	22392300-012BF26A	Girls NE restroom, triple-head wash basin - right
13	013	22392300-013WB26A	Kindergarten hall, water bottle filler
14	014	22392300-014DW26A	Kindergarten hall, drinking fountain - left
15	015	22392300-015DW26A	Kindergarten hall, drinking fountain - right
16	016	Not Sampled	Girls locker room handwash basin - left spray head - NOT WORKING
17	017	22392300-017BF26A	Girls locker room handwash basin - center spray head
18	018	22392300-018BF26A	Girls locker room handwash basin - right spray head
19	019	Not Sampled	Boys locker room handwash basin - left spray head - NOT WORKING
20	020	Not Sampled	Boys locker room handwash basin - center spray head - NOT WORKING
21	021	Not Sampled	Boys locker room handwash basin - right spray head - NOT WORKING
22	022	223902300-022BF26A	Mens staff restroom sink faucet
23	023	223902300-023BF26A	Womens staff restroom sink faucet
24	024	223902300-024SF26A	Staff breakroom sink faucet
25	025	223902300-025WC26A	Staff breakroom water cooler
26	026	223902300-026BF26A	Kindergarten pod, sink at restrooms
27	027	223902300-027DW26A	Room 2 - east sink drinking fountain

1 of 3

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1697 - 02 06 26 1652

Lead in Drinking Water Testing Program

A6A1697

Hillsboro School District

Date Collected: 01/17/2026

School Name: Jackson Elementary School

	Fixture Number	Sample Number	Location / Description
28	028	223902300-028CF26A	Room 2 – east sink faucet
29	029	223902300-029CF26A	Room 2 – south sink faucet
30	030	223902300-030SF26A	Work room at main office, sink faucet
31	031	223902300-031NS26A	Health Room sink faucet
32	032	223902300-032CF26A	Rooms 3/4/5 activity room – left sink faucet
33	033	223902300-033DW26A	Rooms 3/4/5 activity room – right sink drinking fountain
34	034	223902300-034CF26A	Rooms 3/4/5 activity room – right sink faucet
35	035	223902300-035DW26A	Rooms 6/7/8 activity room – left sink drinking fountain
36	036	223902300-036CF26A	Rooms 6/7/8 activity room – left sink faucet
37	037	223902300-037CF26A	Rooms 6/7/8 activity room – right sink faucet
38	038	223902300-038BF26A	Boys SW restroom, triple-head wash basin - left
39	039	223902300-039BF26A	Boys SW restroom, triple-head wash basin - center
40	040	223902300-040BF26A	Boys SW restroom, triple-head wash basin - right
41	041	223902300-041BF26A	Girls SW restroom, triple-head wash basin - left
42	042	223902300-042BF26A	Girls SW restroom, triple-head wash basin - center
43	043	223902300-043BF26A	Girls SW restroom, triple-head wash basin - right
44	044	223902300-044DW26A	Drinking fountain in hall at SW restrooms
45	045	223902300-045DW26A	Rooms 9/10/11 activity room – left sink drinking fountain
46	046	223902300-046CF26A	Rooms 9/10/11 activity room – left sink faucet
47	047	223902300-047CF26A	Rooms 9/10/11 activity room – right sink faucet
48	48	223902300-048CF26A	Rooms 12/13/14 activity room – left sink faucet
49	49	22392300-049DW26A	Rooms 12/13/14 activity room – right sink drinking fountain
50	50	22392300-050CF26A	Rooms 12/13/14 activity room – right sink faucet
51	51	22392300-051DW26A	Rooms 15/16/17 activity room – left sink drinking fountain
52	52	22392300-052CF26A	Rooms 15/16/17 activity room – left sink faucet
53	53	22392300-053CF26A	Rooms 15/16/17 activity room – right sink faucet
54	54	22392300-054CF26A	Rooms 18/19/20 activity room – left sink faucet
055	055	22392300-055DW26A	Rooms 18/19/20 activity room – right sink drinking fountain
056	056	22392300-056CF26A	Rooms 18/19/20 activity room – right sink faucet
057	057	22392300-057DW26A	Drinking fountain at NE ADA restroom
058	058	22392300-058BF26A	NE ADA restroom sink faucet
059	059	22392300-059CF26A	Media Center, NE corner, sink faucet
060	060	22392300-060DW26A	Media Center – librarian's desk drinking fountain



2 of 3

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District
Project Number: Jackson Elementary School
Project Manager: Dale Voeller

Report ID:
A6A1697 - 02 06 26 1652

Lead in Drinking Water Testing Program

A6A1697 Hillsboro School District

Date Collected: 01/17/2026

School Name: Jackson Elementary School

	Fixture Number	Sample Number	Location / Description
061	061	22392300-061SF26A	Media Center – librarian's desk sink faucet

Relinquished By/Signature

Dale Voeller

Date/Time:

1/26/26 @ 11:16 AM

Received By/Signature

Jason Woodcock

Date/Time:

1/26/26 1200



3 of 3

Apex Laboratories

Jason Woodcock

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1697 - 02 06 26 1652

APEX LABS COOLER RECEIPT FORM

Client: Apex Companies Element WO#: A6A1697Project/Project #: Jackson Elementary School / 25012385 / 0002

Delivery Info:

Date/time received: 1/26/26 @ 1200 By: JPEDelivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒Cooler Inspection Date/time inspected: 1/26/26 @ 1308 By: JPEChain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>17.4</u>						
Custody seals? (Y/N)	<u>N</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>N</u>						
Ice type: (Gel/Real/Other)	<u>None</u>						
Condition (In/Out)	<u>Out</u>						

Cooler out of temp? (Y/N) Possible reason why: NoneGreen dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐Sample Inspection: Date/time inspected: 1-26-26 @ 14:00 By: JAAll samples intact? Yes ☒ No ☐ Comments: Bottle labels/COCs agree? Yes ☒ No ☐ Comments: COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒Comments: Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A256271Comments: Labeled by: JAWitness: JAMCooler Inspected by: JA

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Friday, March 6, 2026

Dale Voeller

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

RE: A6B1914 - Hillsboro School District - Jackson ES/25012385

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6B1914, which was received by the laboratory on 2/23/2026 at 10:20:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information		
<u>Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.</u>		
(See Cooler Receipt Form for details)		
Default Cooler	18.3	degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A6B1914 - 03 06 26 1646

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392300-061SF26B	A6B1914-01	Drinking Water	02/21/26 00:00	02/23/26 10:20
22392300-061SF26C	A6B1914-02	Drinking Water	02/21/26 00:00	02/23/26 10:20

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson ES/25012385**Project Manager: **Dale Voeller****Report ID:****A6B1914 - 03 06 26 1646****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-061SF26B (A6B1914-01)				Matrix: Drinking Water				
Batch: 26B0974								
Lead	31.8	---	0.200	ug/L	1	03/03/26 14:42	EPA 200.8	
22392300-061SF26C (A6B1914-02)				Matrix: Drinking Water				
Batch: 26B0974								
Lead	1.26	---	0.200	ug/L	1	03/03/26 14:44	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson ES/25012385

Project Manager: Dale Voeller

Report ID:

A6B1914 - 03 06 26 1646

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26B0974 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26B0974-BLK1)		Prepared: 02/27/26 13:22 Analyzed: 03/03/26 14:17										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26B0974-BS1)		Prepared: 02/27/26 13:22 Analyzed: 03/03/26 14:19										
EPA 200.8												
Lead	15.1	---	0.201	ug/L	1	15.0	---	101	85 - 115%	---	---	

No Client related Batch QC samples analyzed for this batch. See notes page for more information.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A6B1914 - 03 06 26 1646

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
<u>Batch: 26B0974</u>							
A6B1914-01	Drinking Water	EPA 200.8	02/21/26 00:00	02/27/26 13:22	10mL/10mL	10mL/10mL	1.00
A6B1914-02	Drinking Water	EPA 200.8	02/21/26 00:00	02/27/26 13:22	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson ES/25012385

Project Manager: Dale Voeller

Report ID:

A6B1914 - 03 06 26 1646

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A6B1914 - 03 06 26 1646

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or " " (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A6B1914 - 03 06 26 1646

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A6B1914 - 03 06 26 1646

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A6B1914 - 03 06 26 1646

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson ES/25012385

Project Manager: Dale Voeller

Report ID:

A6B1914 - 03 06 26 1646

Lead in Drinking Water Testing Program

Date Collected: 02/21/2026

Apex Project: 25012385 / 0002

School Name: Jackson Elementary School

Building: Main Building - Round 2

Building Number: 22392300

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	061	22392300-061SF26B	Media Center - librarian's desk sink faucet - (after aerator cleaning)
2	061	22392300-061SF26C	Media Center - librarian's desk sink faucet - flush sample
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

Relinquished By/Signature: Dale Voeller

Date/Time: 2/22/26 @ 12:10 PM

Received By/Signature: Jason Woodcock

Date/Time: 2/23/26 @ 1020

Apex

1 of 1

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson ES/25012385

Project Manager: Dale Voeller

Report ID:

A6B1914 - 03 06 26 1646

APEX LABS COOLER RECEIPT FORM

Client: Apex Companies Element WO#: A6B1914Project/Project #: Jackson Elementary School / 25012385 / 0002

Delivery Info:

Date/time received: 2/23/26 @ 1020 By: JREDelivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒Cooler Inspection Date/time inspected: 2/23/26 @ 1108 By: JREChain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>18.3</u>						
Custody seals? (Y/N)	<u>N</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>N</u>						
Ice type: (Gel/Real/Other)	<u>none</u>						
Condition (In/Out)	<u>out</u>						

Cooler out of temp? (Y/N) Possible reason why: Drinking waterGreen dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐Sample Inspection: Date/time inspected: 2/23/26 @ 1112 By: APWAll samples intact? Yes ☒ No ☐ Comments: Bottle labels/COCs agree? Yes ☒ No ☐ Comments: COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒Comments: Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: APWComments: Labeled by: APWWitness: VSCooler Inspected by: APW

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Monday, April 6, 2026

Dale Voeller

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

RE: A6C1960 - Hillsboro School District - Jackson Elementary School/25012835

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6C1960, which was received by the laboratory on 3/24/2026 at 11:43:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information		
<u>Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.</u>		
(See Cooler Receipt Form for details)		
Default Cooler	17.5	degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6C1960 - 04 06 26 1656

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392300-061SF26D	A6C1960-01	Drinking Water	03/21/26 00:00	03/24/26 11:43
22392300-061SF26E	A6C1960-02	Drinking Water	03/21/26 00:00	03/24/26 11:43

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6C1960 - 04 06 26 1656****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392300-061SF26D (A6C1960-01RE1)				Matrix: Drinking Water				
Batch: 26C1080								
Lead	253	---	2.22	ug/L	10	04/03/26 18:34	EPA 200.8	DW-D
22392300-061SF26E (A6C1960-02)				Matrix: Drinking Water				
Batch: 26C1073								
Lead	6.55	---	0.200	ug/L	1	04/03/26 16:06	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School
Project Manager: Dale Voeller

Report ID:

A6C1960 - 04 06 26 1656

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C1073 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26C1073-BLK1)		Prepared: 03/31/26 13:58			Analyzed: 04/03/26 16:02							
<u>EPA 200.8</u>												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26C1073-BS1)		Prepared: 03/31/26 13:58			Analyzed: 04/03/26 16:04							
<u>EPA 200.8</u>												
Lead	14.3	---	0.201	ug/L	1	15.0	---	95	85 - 115%	---	---	
Duplicate (26C1073-DUP1)		Prepared: 03/31/26 13:58			Analyzed: 04/03/26 16:08							
<u>QC Source Sample: 22392300-061SF26E (A6C1960-02)</u>												
<u>EPA 200.8</u>												
Lead	6.30	---	0.200	ug/L	1	---	6.55	---	---	4	20%	
Matrix Spike (26C1073-MS1)		Prepared: 03/31/26 13:58			Analyzed: 04/03/26 16:11							
<u>QC Source Sample: 22392300-061SF26E (A6C1960-02)</u>												
<u>EPA 200.8</u>												
Lead	20.9	---	0.201	ug/L	1	15.0	6.55	96	70 - 130%	---	---	
Batch 26C1080 - EPA 200.2							Drinking Water					
Blank (26C1080-BLK1)		Prepared: 04/01/26 08:32			Analyzed: 04/03/26 16:29							
<u>EPA 200.8</u>												
Lead	ND	---	0.222	ug/L	1	---	---	---	---	---	---	
LCS (26C1080-BS1)		Prepared: 04/01/26 08:32			Analyzed: 04/03/26 16:31							
<u>EPA 200.8</u>												
Lead	17.9	---	0.222	ug/L	1	16.7	---	107	85 - 115%	---	---	
Duplicate (26C1080-DUP2)		Prepared: 04/01/26 08:32			Analyzed: 04/03/26 18:36							
<u>QC Source Sample: 22392300-061SF26D (A6C1960-01RE1)</u>												
<u>EPA 200.8</u>												
Lead	257	---	2.22	ug/L	10	---	253	---	---	2	20%	DW-D,Q-16
Matrix Spike (26C1080-MS1)		Prepared: 04/01/26 08:32			Analyzed: 04/03/26 16:42							
<u>QC Source Sample: 22392300-061SF26D (A6C1960-01)</u>												

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**
Project Number: **Jackson Elementary School**
Project Manager: **Dale Voeller**

Report ID:
A6C1960 - 04 06 26 1656

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26C1080 - EPA 200.2							Drinking Water					
Matrix Spike (26C1080-MS1)		Prepared: 04/01/26 08:32 Analyzed: 04/03/26 16:42										
QC Source Sample: 22392300-061SF26D (A6C1960-01)												
EPA 200.8												
Lead	324	---	0.222	ug/L	1	16.7	305	113	70 - 130%	---	---	DW-D,E

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC****6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062****Apex Companies, LLC - Portland****4412 S Corbett Ave
Portland, OR 97239**Project: **Hillsboro School District**Project Number: **Jackson Elementary School**Project Manager: **Dale Voeller****Report ID:****A6C1960 - 04 06 26 1656****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.2**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26C1080							
A6C1960-01RE1	Drinking Water	EPA 200.8	03/21/26 00:00	04/01/26 08:32	45mL/50mL	10mL/10mL	1.11

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26C1073							
A6C1960-02	Drinking Water	EPA 200.8	03/21/26 00:00	03/31/26 13:58	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6C1960 - 04 06 26 1656

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

Apex Laboratories

- DW-D** Turbidity greater than 1 NTU. Sample was digested per EPA Method 200.8.
- E** Estimated Value. The result is above the calibration range of the instrument.
- Q-16** Reanalysis of an original Batch QC sample.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6C1960 - 04 06 26 1656

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or "" (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6C1960 - 04 06 26 1656

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A6C1960 - 04 06 26 1656

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6C1960 - 04 06 26 1656

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6C1960 - 04 06 26 1656

A6C1960

Lead in Drinking Water Testing Program

Date Collected: 03/21/2026

Apex Project: 25012835 / 0002

School Name: Jackson Elementary School

Building: Main Building - Round 3

Building Number: 22392300

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	061	22392300-061SF26D	Media Center - librarian's desk sink faucet - (after aerator cleaning)
2	061	22392300-061SF26E	Media Center - librarian's desk sink faucet - flush sample
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

Relinquished By/Signature

James Johnson

Date/Time: 3/21/26 @ 2:18 PM

Received By/Signature:

DALE VOELLER APEX LABS

Date/Time: 3/22/26 1143

1 of 1

Apex Laboratories

Jason Woodcock

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson Elementary School

Project Manager: Dale Voeller

Report ID:

A6C1960 - 04 06 26 1656

APEX LABS COOLER RECEIPT FORM

Client: Apex Co - FAX Element WO#: A6 C1960
Project/Project #: Jackson Elementary School 250 12035 / 0002
22 392300

Delivery Info:

Date/time received: 3/23/26 @ 1143 By: EST
Delivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐

From USDA Regulated Origin? Yes ☐ No ☒
Cooler Inspection Date/time inspected: 3/23/26 @ 1312 By: EST

Chain of Custody included? Yes ☒ No ☐
Signed/dated by client? Yes ☒ No ☐
Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>17.5</u>						
Custody seals? (Y/N)	<u>N</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>N</u>						
Ice type: (Gel/Real/Other)	<u>NA</u>						
Condition (In/Out):	<u>OUT</u>						

Cooler out of temp? ☒ (Y/N) Possible reason why: DW
Green dots applied to out of temperature samples? Yes ☐ No ☒
Out of temperature samples form initiated? Yes ☐ No ☒

Sample Inspection: Date/time inspected: 3/24/26 @ 1413 By: KN
All samples intact? Yes ☒ No ☐ Comments: _____

Bottle labels/COCs agree? Yes ☒ No ☐ Comments: _____

COC/container discrepancies form initiated? Yes ☐ No ☒

Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: _____

Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments: _____

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A2561271

Comments: _____

Labeled by:

KN

Witness:

AW

Cooler Inspected by:

KN

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Friday, February 6, 2026

Dale Voeller

Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

RE: A6A1694 - Hillsboro School District - Jackson ES/25012835

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6A1694, which was received by the laboratory on 1/26/2026 at 12:00:00PM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information		
<u>Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.</u>		
(See Cooler Receipt Form for details)		
Default Cooler	18.7	degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012835**

Project Manager: **Dale Voeller**

Report ID:

A6A1694 - 02 06 26 1648

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22392304-001WB26A	A6A1694-01	Drinking Water	01/16/26 00:00	01/26/26 12:00
22392304-002DW26A	A6A1694-02	Drinking Water	01/16/26 00:00	01/26/26 12:00
22392304-003DW26A	A6A1694-03	Drinking Water	01/16/26 00:00	01/26/26 12:00
22392304-004BF26A	A6A1694-04	Drinking Water	01/16/26 00:00	01/26/26 12:00
22392304-005BF26A	A6A1694-05	Drinking Water	01/16/26 00:00	01/26/26 12:00
22392304-006BF26A	A6A1694-06	Drinking Water	01/16/26 00:00	01/26/26 12:00
22392304-007BF26A	A6A1694-07	Drinking Water	01/16/26 00:00	01/26/26 12:00
22392304-008BF26A	A6A1694-08	Drinking Water	01/16/26 00:00	01/26/26 12:00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Jackson ES/25012835**Project Manager: **Dale Voeller****Report ID:****A6A1694 - 02 06 26 1648****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22392304-001WB26A (A6A1694-01)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 16:39	EPA 200.8	
22392304-002DW26A (A6A1694-02)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 16:49	EPA 200.8	
22392304-003DW26A (A6A1694-03)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 16:51	EPA 200.8	
22392304-004BF26A (A6A1694-04)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 16:52	EPA 200.8	
22392304-005BF26A (A6A1694-05)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	0.354	---	0.200	ug/L	1	01/31/26 16:54	EPA 200.8	
22392304-006BF26A (A6A1694-06)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 16:56	EPA 200.8	
22392304-007BF26A (A6A1694-07)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	0.580	---	0.200	ug/L	1	01/31/26 16:58	EPA 200.8	
22392304-008BF26A (A6A1694-08)				Matrix: Drinking Water				
Batch: 26A0794								
Lead	ND	---	0.200	ug/L	1	01/31/26 17:00	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District
Project Number: Jackson ES/25012835
Project Manager: Dale Voeller

Report ID:
A6A1694 - 02 06 26 1648

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26A0794 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26A0794-BLK1)		Prepared: 01/27/26 06:49		Analyzed: 01/31/26 16:32								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26A0794-BS1)		Prepared: 01/27/26 06:49		Analyzed: 01/31/26 16:37								
EPA 200.8												
Lead	14.2	---	0.201	ug/L	1	15.0	---	95	85 - 115%	---	---	
Duplicate (26A0794-DUP1)		Prepared: 01/27/26 06:49		Analyzed: 01/31/26 16:45								
QC Source Sample: 22392304-001WB26A (A6A1694-01)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	ND	---	---	---	20%	
Matrix Spike (26A0794-MS1)		Prepared: 01/27/26 06:49		Analyzed: 01/31/26 16:47								
QC Source Sample: 22392304-001WB26A (A6A1694-01)												
EPA 200.8												
Lead	13.4	---	0.201	ug/L	1	15.0	ND	90	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012835**

Project Manager: **Dale Voeller**

Report ID:

A6A1694 - 02 06 26 1648

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
<u>Batch: 26A0794</u>							
A6A1694-01	Drinking Water	EPA 200.8	01/16/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1694-02	Drinking Water	EPA 200.8	01/16/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1694-03	Drinking Water	EPA 200.8	01/16/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1694-04	Drinking Water	EPA 200.8	01/16/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1694-05	Drinking Water	EPA 200.8	01/16/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1694-06	Drinking Water	EPA 200.8	01/16/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1694-07	Drinking Water	EPA 200.8	01/16/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00
A6A1694-08	Drinking Water	EPA 200.8	01/16/26 00:00	01/27/26 06:49	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson ES/25012835

Project Manager: Dale Voeller

Report ID:

A6A1694 - 02 06 26 1648

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012835**

Project Manager: **Dale Voeller**

Report ID:

A6A1694 - 02 06 26 1648

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or " " (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012835**

Project Manager: **Dale Voeller**

Report ID:

A6A1694 - 02 06 26 1648

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between $\frac{1}{2}$ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012835**

Project Manager: **Dale Voeller**

Report ID:

A6A1694 - 02 06 26 1648

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Jackson ES/25012835**

Project Manager: **Dale Voeller**

Report ID:

A6A1694 - 02 06 26 1648

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson ES/25012835

Project Manager: Dale Voeller

Report ID:

A6A1694 - 02 06 26 1648

Lead in Drinking Water Testing Program

Date Collected: 01/16/2026

Apex Project: 25012835 / 0002

School Name: Jackson ES

District: Hillsboro School District

Building: Gymnasium - Round 1

Building Number: 22392304

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Room / Location
1	001	22392304-001WB26A	Lobby - water bottle filler
2	002	22392304-002DW26A	Lobby - drinking fountain, left
3	003	22392304-003DW26A	Lobby - drinking fountain, right
4	004	22392304-004BF26A	Restroom sink faucets, left to right (1)
5	005	22392304-005BF26A	Restroom sink faucets, left to right (2)
6	006	22392304-006BF26A	Restroom sink faucets, left to right (3)
7	007	22392304-007BF26A	Restroom sink faucets, left to right (4)
8	008	22392304-008BF26A	Private restroom sink faucet
9	009		
10	010		
11	011		
12	12		
13	13		
14	14		
15	15		
16	16		
17	17		
18	18		
19	19		
20	20		

Relinquished By/Signature: Dale Voeller

Date/Time: 1/26/26 @ 11:16 AM

Received By/Signature: Justin Eskari

Date/Time: 1/26/26 12:00



1 of 1

Apex Laboratories

Jason Woodcock

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Jackson ES/25012835

Project Manager: Dale Voeller

Report ID:

A6A1694 - 02 06 26 1648

APEX LABS COOLER RECEIPT FORM

Client: Apex Companies Element WO#: A6 A1694

Project/Project #: Jackson ES / District: Hillsboro School District / 25012835/002

Delivery Info:

Date/time received: 4/26/26 @ 1200 By: JPC

Delivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ OtherFrom USDA Regulated Origin? Yes ☐ No ☒

Cooler Inspection Date/time inspected: 4/26/26 @ 1308 By: JPC

Chain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	18.7						
Custody seals? (Y/N)	☒						
Received on ice? (Y/N)	☒						
Temp. blanks? (Y/N)	☒						
Ice type: (Gel/Real/Other)	None						
Condition (In/Out)	out						

Cooler out of temp? (Y/N) Possible reason why: Drinking Waters

Green dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐

Sample Inspection: Date/time inspected: 4/26/26 @ 1322 By: KMS

All samples intact? Yes ☒ No ☐ Comments:Bottle labels/COCs agree? Yes ☒ No ☐ Comments:COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments:Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments:

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A256271

Comments:

Labeled by:

Witness:

Cooler Inspected by:

Form Y-003 R-02

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

Page 12 of 12