

ARCHITECT'S ADDENDUM

Addendum Number: 01

Date: 04/14/2026

RE: EAHS 2026 Secured Entrance

Prepared By: Gabe David
Cordogan, Clark & Associates

CCA Project No.: 251008

To: Prospective Bidders

Subject: Addendum 01 to the Construction Documents for the East Aurora High School 2026 Secured Entrance Project.

This Addendum forms a part of the Construction Documents and modifies the original Construction Documents, dated 04.07.2026. Acknowledge receipt of this Addendum in space provided on the *Bid Form*. *Failure to do so may subject Bidder to disqualification*

THE FOLLOWING ITEMS ARE TO BE INCLUDED IN THE PROPOSAL.

General Clarifications:

- 1) Pre-Bid Meeting Agenda has been attached for reference.
- 2) Pre-Bid Meeting Sign-In Sheet has been attached for reference.
- 3) **The mandatory Pre-Bid Meeting Requirement has been lifted. Bidders are still required to visit the site. Refer to the Pre-Bid Meeting Agenda for site visit scheduling and contacts. Attendance on the 04.09.2026 Pre-Bid Meeting qualifies as having visited the site.**

Clarifications To the Drawings:

- 1) A1.00 – PARTIAL FIRST FLOOR PLANS – AREA B
 - a) Removed CMU partition dividing wall from scope of work from Plan 1/A1.00.
 - b) Removed Door 002 and Door B101A from scope of work. Door Schedule and Door Type Legend have been updated to reflect this change.
 - c) Added plan note, "UPPER CABINETS TO BE REMOVED BY OWNER" on Plan 2/A1.00.
 - d) Updated demolition scope of work to existing ticket window. Revised note, "DEMOLISH EXISTING TICKET WINDOW GLAZING AND COUNTER. WOOD DISPLAY CASE TO REMAIN. PREP FOR NEW CONDITION".
 - e) Removed ceiling scope of work from Storage Rooms. Existing ceilings are to remain.
 - f) Removed flooring scope in Security Room B101. Existing flooring is to remain. Floor Finish Plan and Finish Material Legend have been updated to reflect this change.
 - g) Updated plastic laminate countertop depth to 19".
 - h) Updated new work scope at ticket window Added Plan Note, "PATCH AND INFILL WALL WITH MASONRY TO MATCH SURROUNDING CONDITIONS".
 - i) Added plan note, "PROVIDE MECHANICAL GRILLE TO EXISTING DOOR".
 - j) Revised plan note, "DEMOLISH EXISTING TICKET WINDOW. OPENING TO BE USED FOR NEW TRANSACTION WINDOW. OPENING TO BE MADE LARGER DOWNWARD. SAWCUT EXISTING MASONRY TO ENLARGE WINDOW AS REQUIRED FOR NEW WINDOW" on Plan 2/A1.00.

- 2) A2.00 – INTERIOR ELEVATIONS, STOREFRONT ELEVATIONS, WALL TYPES, & DETAILS
 - a) Adjusted the height of transaction window on Elevation 3/A2.00.
 - b) Adjusted top of worktop counter to 30" AFF on Section 2/A2.00.
 - c) Added note to Fixed Transaction Window Section, "EXISTING MASONRY OPENING TO BE EXTENDED DOWN TO 30" AFF".
 - d) Added dotted line region showing extend of masonry demolition on Elevation 3/A2.00.
 - e) Added note to Transaction Window Elevation, "DEMOLISH EXISTING MASONRY DOWN TO NEW HEIGHT TO ACCOMMODATE NEW WINDOW AS DRAWN".

- 3) M1.00 – B – PARTIAL MECHANICAL FIRST FLOOR PLANS – AREA B
 - a) Relocated EF-2 to be within the Security Room.
 - b) Add door grille to existing door.
 - c) Relocated FT-2 within Security Room.
 - d) Revised FT-2 callout to FT-1 on Detail 2/M1.00-B.
 - e) Updated demolition plan note, "DEMOLISH STEAM FIN TUBE AND ASSOCIATED CONTROLS".
 - f) Updated demolition plan note, "DEMOLISH STEAM HEATER AND ASSOCIATED CONTROLS".
 - g) Add pipe curb location to Area B Roof Plan 3/M1.00-B.

- 4) E1.00 – PARTIAL ELECTRICAL FIRST FLOOR PLANS – AREA B
 - a) Add (1) LITHONIA 2BLT4-40L-ADP-EZ1-LP835 lighting fixture
 - b) Remove (2) nLIGHT RPODU-DX-WH-G@ switch
 - c) Remove (2) LITHONIA BLWP4-48L-ADPT-EZ1-LP835-NLTAIR2-RES7

Attachments:

- 1) Pre-Bid Meeting Agenda
- 2) Pre-Bid Meeting Sign-in Sheet
- 3) Sheet A1.00
- 4) Sheet A2.00
- 5) Sheet M1.00-B
- 6) Sheet E1.00

End Of Addendum No. 01

PRE-BID CONFERENCE AGENDA

DATE: 04.09.2026

RE: EASD East Aurora High School – Secured Entrance Project

CC Project No.: 251008

TIME: 11:00 am

LOCATION: 500 Tomcat Lane, Aurora, IL 60506

AGENDA NO.: PRE-BID Conference

Introductions:

Andrew J. Allen	EASD Assistant Superintendent for Operations
Nathan Messenger	CC Project Manager
Luca Muench	CC Construction Manager
Gabe David	CC Architectural Designer

- A. East Aurora School District (hereinafter referred to as the Owner) will receive bids for the following projects until 10:00 A.M., local time, on April 23, 2026 at the District Office of East Aurora School District #131, 310 Seminary Avenue, Aurora, IL 60506. Any bids received after this time may be rejected. Proposals shall be addressed to:
- East Aurora School District #131
310 Seminary Avenue
Aurora, IL 60505
Attention: Andy Allen, EASD Assistant Superintendent for Operations
Do Not Open
- B. Bids will be publicly opened and read at 10:00 am at the location noted above.
- C. Bids will be accepted as a Bid Build Contract, based on Lump Sum bid format. Proposal award will be issued to a single Bidder for all or select buildings depending upon the lowest aggregate responsive and responsible Bid(s) from qualified Bidders.
- D. Contract Documents may be obtained by Bidding Contractors from Vesco Reprographics 630-896-2115 or <http://www.cordoganclarkplanroom.com>, on or after, April 7, 2026.
- E. All bids must be accompanied by a Bid Security in the form of Bid Bond in the amount of 10% of the Base Bid (plus additive alternates) made payable to the Owner.
- F. Mandatory Pre-bid conference will be on site. Attendance is required. **MAKE SURE YOU sign in.**
- G. All bidders are required to visit the site. The project site is available for inspection on a limited basis after the pre-bid meeting. We highly recommend that your team utilizes this time to review all existing conditions impacting the project. Should a bidder find discrepancies or ambiguities in, or omissions from documents, or should they be in doubt as to their meaning, they shall, at once, and in any event, not later than 72 hours prior to bid due date, notify Cordogan and Clark, who will, if necessary, send written addendum to all bidders. The EASD #131 nor Cordogan and Clark shall not be responsible for any oral instructions.

- H. The Contractor shall pay, if applicable, not less than the prevailing rate of wages as established, to all laborers, workmen and mechanics in the performance of Work under this Contract in accordance with “An Act regulating wages of laborers, mechanics and other employed under contracts of Public Works.” 820 ILCS 130/1 et seq.
- I. The Owner reserves the right to reject any and all bids, to waive any informality in bidding, or accept the bid that, in his opinion, will serve his best interests.
- J. This Project is exempt from Taxes.
- K. Insurance Requirements are as noted in the Specifications Section 003500-5 1.6
- L. Contractor Qualifications – AIA A-305 Contractor Qualification Form must be filled out in its entirety and duly executed.
- M. The Contractor is required to perform their work within the following Preliminary Construction Schedule. The schedule implies an aggressive construction operation. By submitting a bid, the Contractor guarantees they can meet the proposed Construction Schedule. The Contractor shall assume multiple mobilizations may be required to perform the scope of work.
 - 1. Notice to Proceed: May 19, 2026
 - 2. Contractor Access: June 1, 2026
 - 3. Submittal Deadline: June 2, 2026
 - 4. Demolition and Foundation Substantial Completion: July 31, 2026
 - 5. Balance of Work Substantial Completion (Including ROE Walkthroughs): October 16, 2026
- N. Background Checks - EASD #131 requires finger printing and background checks for all Contractors working in the School District. It is the Contractors responsibility for all associated costs for the finger printing and background checks.
- O. QUESTIONS AND ANSWERS
- P. SITE WALK THROUGHS
 - a. Pre-bid walk-throughs after prebid meeting will be held by appointment only, between the dates of April 13-15, 2026.

Contact information:

Luca Muench lmuench@cordoganclark.com 612-226-6529

MEETING SIGN-IN SHEET

Meeting Number: Pre-Bid Meeting

Date: April 9, 2026

Time: 11:00 am

Project No.: 251008




Prepared By: Gabe David
Cordogan Clark

RE: EASD #131
East Aurora High School
2026 Secured Entrance
Project

NAME / TITLE	COMPANY	PHONE / EMAIL
Abe Assaf	Petra Builder, Inc.	630-999-9921 aassaf@petrabuilder.com
Phil Moser, President	MC Building, Inc.	630-852-5887 philip@mcbuildinginc.com
Alfred Ladores	AHAL Construction, Inc.	630-533-2468 alfred@ahalconstruction.com
Dipesh Thakkar	Paul Borg Construction, Inc.	312-369-0305 dipesh@paulborgconstruction.com
Jordan Scher	Maman Corp.	224-527-0815 jscher@maman-corp.com
Stephen Bykowski	Biko Construction	773-818-9295 stephen@bikoconstruction.com
Tom Carnevale	Umbrella Security	tcc@umbrellasecurity.com




EXISTING CONDITIONS PHOTOGRAPHS - HIGH SCHOOL

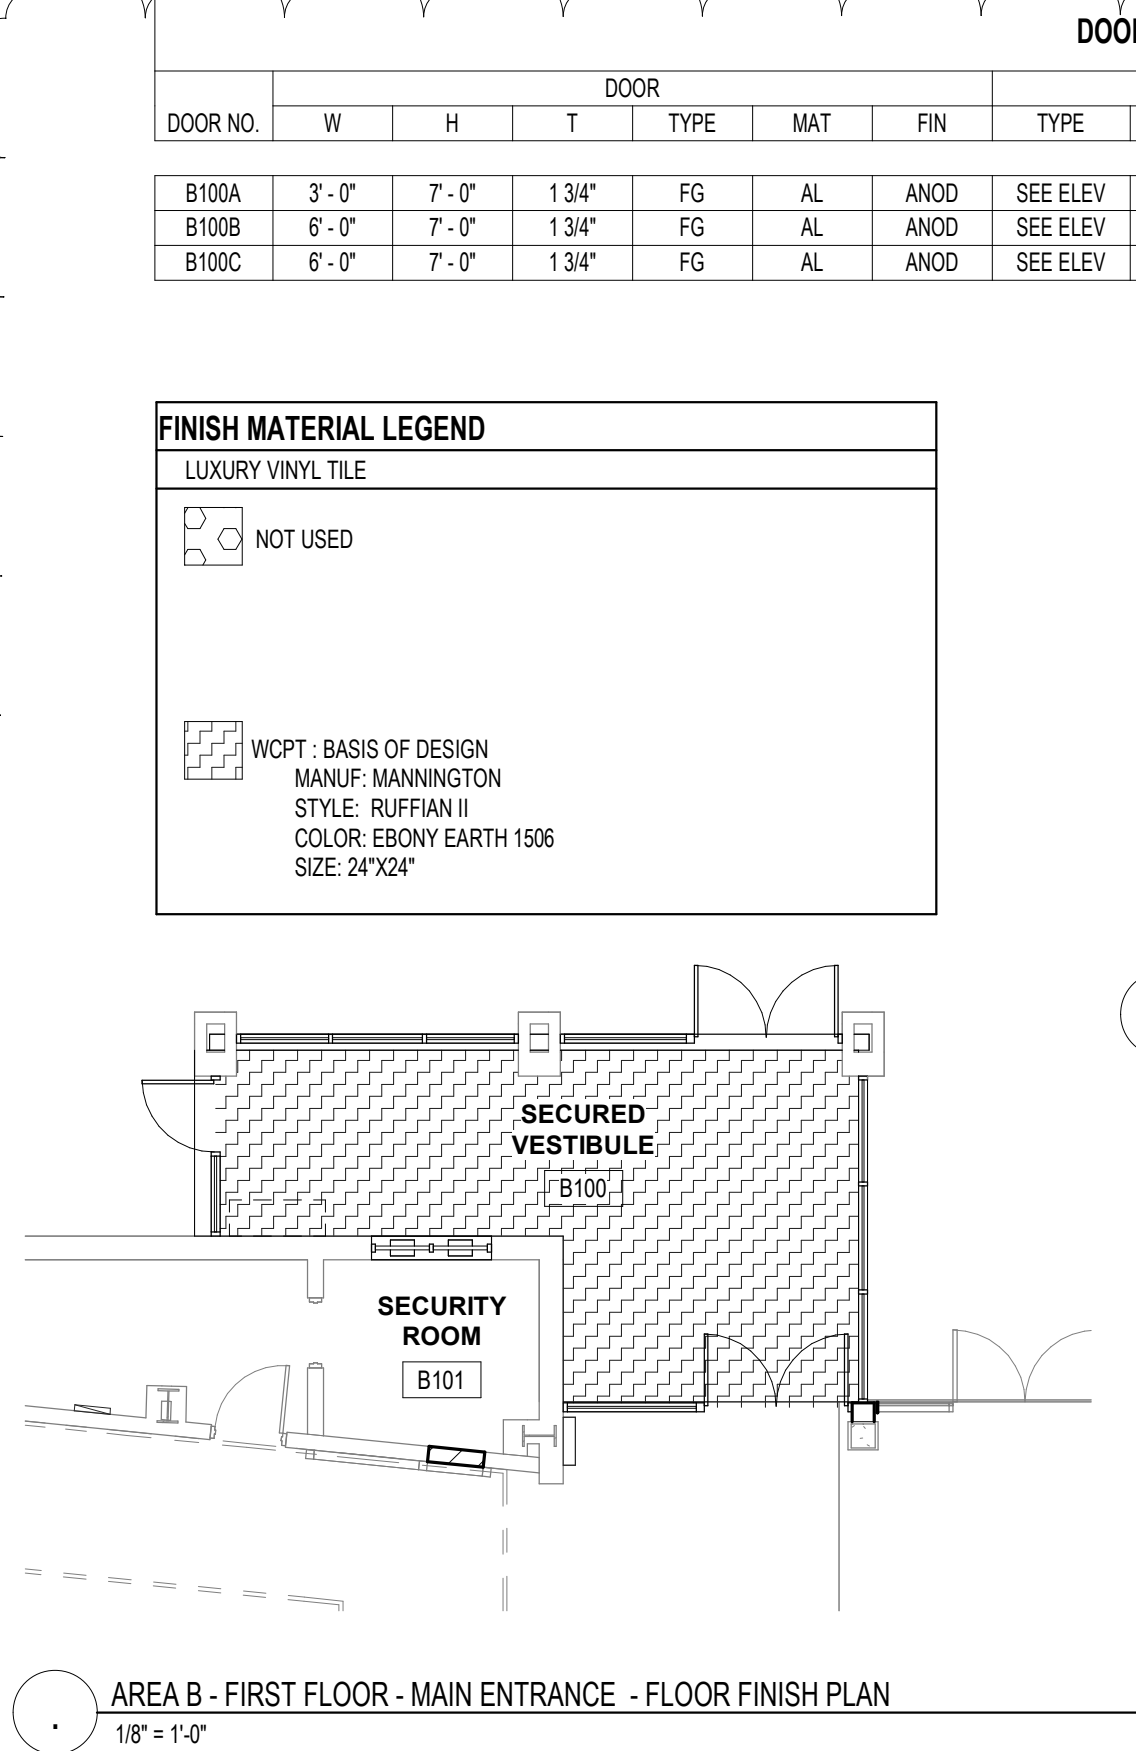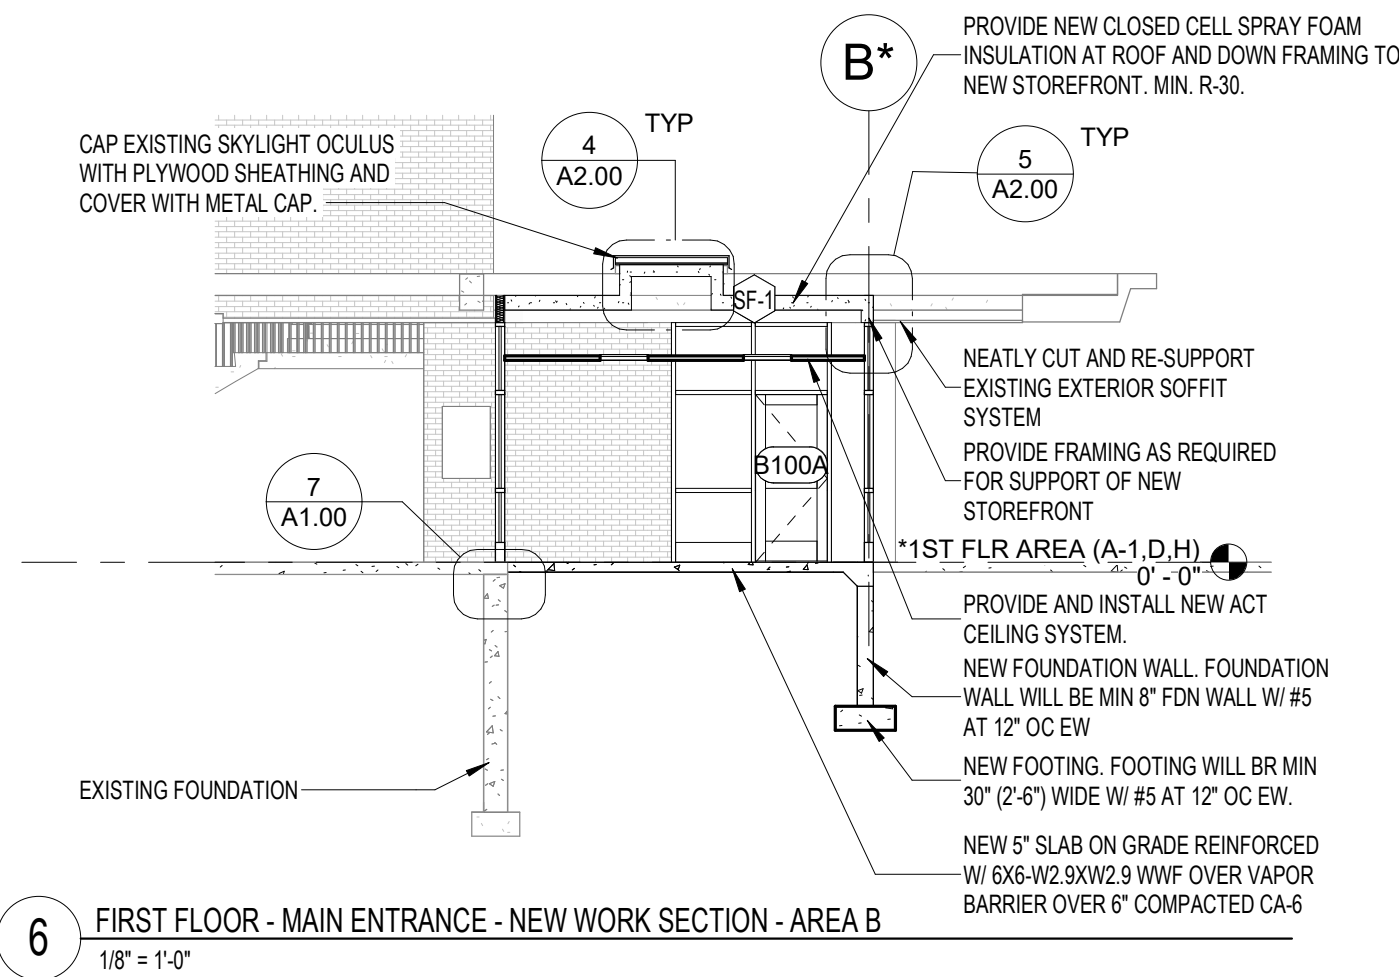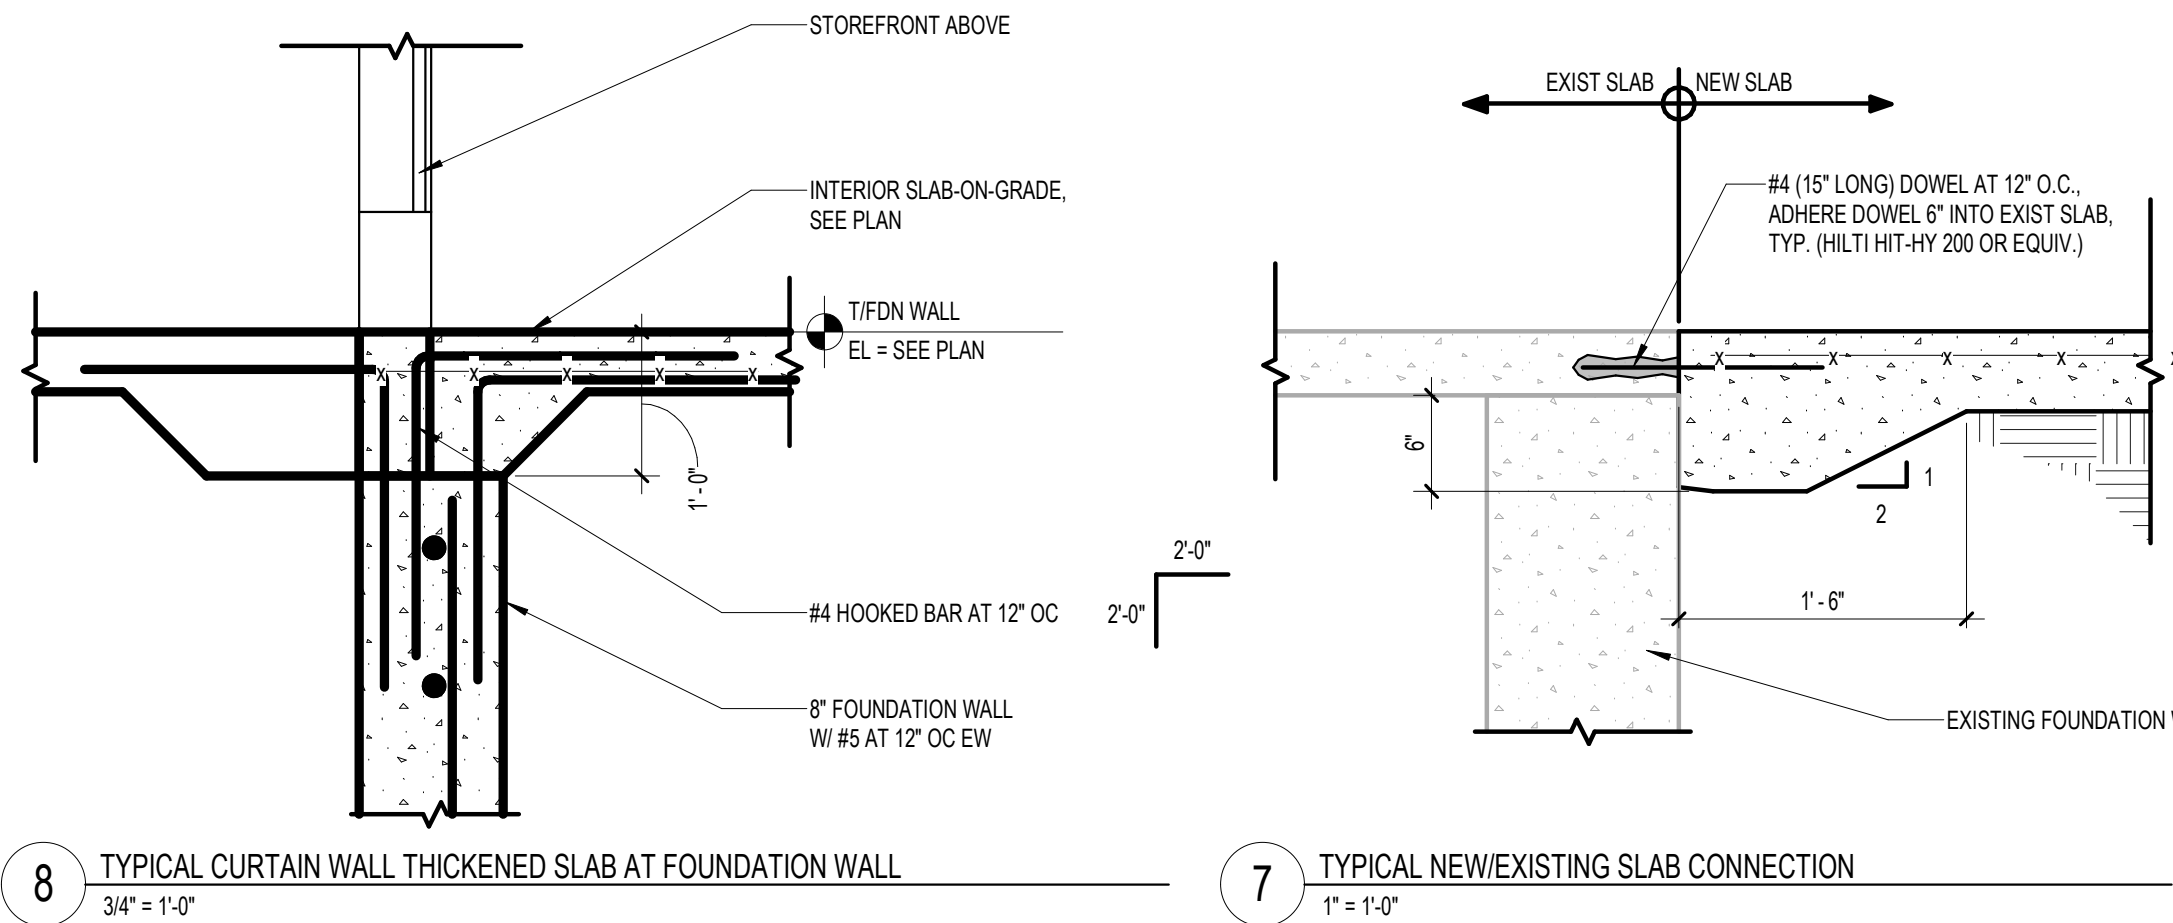







DOOR SCHEDULE											
DOOR NO.	DOOR						FRAME		HARDWARE		REMARKS
	W	H	T	TYPE	MAT	FIN	TYPE	MAT	FIN	SET	
B100A	3'-0"	7'-0"	1-3/4"	FG	AL	ANOD	SEE ELEV	AL	ANOD	02	
B100B	6'-0"	7'-0"	1-3/4"	FG	AL	ANOD	SEE ELEV	AL	ANOD	04	
B100C	6'-0"	7'-0"	1-3/4"	FG	AL	ANOD	SEE ELEV	AL	ANOD	03	

FINISH MATERIAL LEGEND	
LUXURY VINYL TILE	
NOT USED	
WCPT : BASIS OF DESIGN MANUF: MANNINGTON STYLE: RUFFIAN II COLOR: EBONY EARTH 1506 SIZE: 24"x24"	

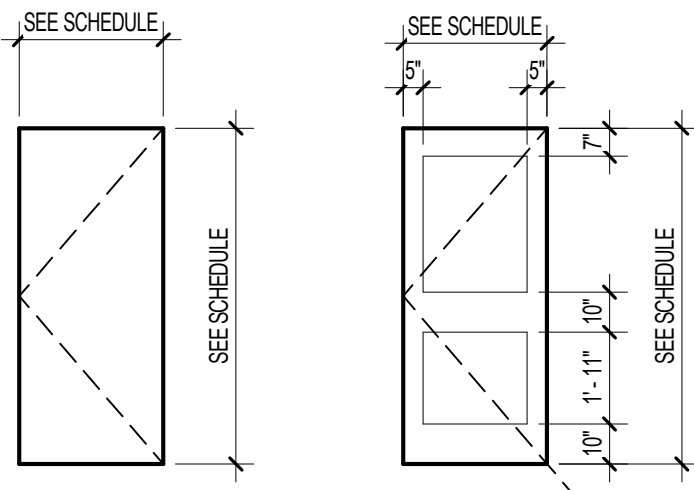

DOOR TYPE LEGEND	
1/4" = 1'-0"	
DOOR & FRAME LEGEND	
AL	ALUMINUM
ANOD	ANODIZED
MANU	MANUFACTURER'S STANDARD DETAILING
HM	HOLLOW METAL
PR	PAIR
PT	PAINT
ST	STAIN - PREFINISHED
WD	SOLID WOOD CORE

- GENERAL NOTES
- REFER TO DRAWING G1.00 FOR FULL GENERAL DEMOLITION NOTES.
 - REFER TO MECHANICAL, PLUMBING, AND ELECTRICAL DRAWINGS FOR FULL MECHANICAL, PLUMBING, AND ELECTRICAL DEMOLITION SCOPE OF WORK.
 - IN AREAS WHERE EXISTING WALLS, PARTITIONS, ETC. ARE TO BE REMOVED, IT SHALL BE NECESSARY TO REPAIR EXISTING CEILINGS, ADJUST AND RELOCATE OR REWIRE LIGHTING FIXTURES, AND REMOVE OR RELOCATE ELECTRICAL AND MECHANICAL COMPONENTS AS REQUIRED OR DIRECTED. DEMOLITION AREAS SHOWN ON PLAN ARE REPRESENTATIONAL ONLY AND SHOULD NOT BE CONSIDERED ALL ENCOMPASSING. CONTRACTOR WILL BE RESPONSIBLE FOR ALL REMOVAL AND REPLACEMENT OF ADJACENT CONSTRUCTION NECESSARY TO COMPLETE THE WORK.
 - WASH AND CLEAN ALL EXISTING INTERIOR HVAC GRILLES AND DIFFUSERS WHICH ARE TO REMAIN (CEILING AND WALL MOUNTED, AND FREESTANDING AT EXPOSED CONSTRUCTION).
 - EXISTING WALLS, FLOORS, AND CEILINGS WHICH ARE DAMAGED AND ARE TO REMAIN SHALL BE PATCHED AND REBUILT AS REQUIRED TO MATCH SURROUNDING CONSTRUCTION, AT NO ADDITIONAL COST TO THE OWNER.
 - ACTIVE PIPES, CONDUITS, AND OTHER UTILITIES OF ALL TYPES, WHETHER SHOWN IN THE CONSTRUCTION DOCUMENTS OR NOT, MUST BE PROTECTED AT ALL TIMES DURING THE CONSTRUCTION OF THE WORK. EXTREME CARE SHALL BE EXERCISED AT ALL TIMES NOT TO DAMAGE ANY SUCH PIPES AND CONDUITS. WHERE DAMAGE OCCURS, CONTRACTOR CAUSING THE DAMAGE SHALL REPAIR SUCH DAMAGE IN A MANNER APPROVED BY THE ARCHITECT AND OWNER, AND AT NO CHANGE IN THE CONTRACT PRICES OF CONTRACTOR.
 - IN AREAS WHERE EXISTING DOORS, WINDOWS, ETC. ARE REQUIRED TO BE REMOVED TO DISPOSE OF EXISTING MECHANICAL SYSTEM, CONTRACTORS MUST REINSTALL, REPAIR, OR REBUILD CONDITION TO MATCH SURROUNDING CONSTRUCTION OR BETTER, AT NO ADDITIONAL COST TO THE OWNER.
 - ALL SUPPLY AND RETURN DIFFUSERS NOT ORIGINAL TO BUILDING AND ARE BEING ABANDONED SHALL BE REMOVED.
 - ALL CORING REQUIRED FOR NEW WORK IS TO BE INCLUDED IN THE BASE BID. ALL PENETRATIONS TO BE COORDINATED WITH ADJACENT STRUCTURE. REFER TO ROOM FINISH SCHEDULE FOR EXISTING WALL/ FLOOR/ CEILING MATERIALS. NO EXTRAS WILL BE CONSIDERED FOR MULTIPLE PASSES REQUIRED TO CORE THROUGH MULTIPLE MATERIALS. CLEANING OF ALL DEBRIS AND WET DRILL RUNOFF WILL BE REQUIRED TO RESTORE ADJACENT CONSTRUCTION TO ITS FORMER CONDITION.
 - PROTECT ALL FLOORS THROUGHOUT THE PROJECT PER THE GENERAL NOTES ON G1.00. ANY DAMAGE TO EXISTING FLOORS MUST BE REPLACED, IN KIND, AT THE EXPENSE OF THE CONTRACTOR CAUSING THE DAMAGE.

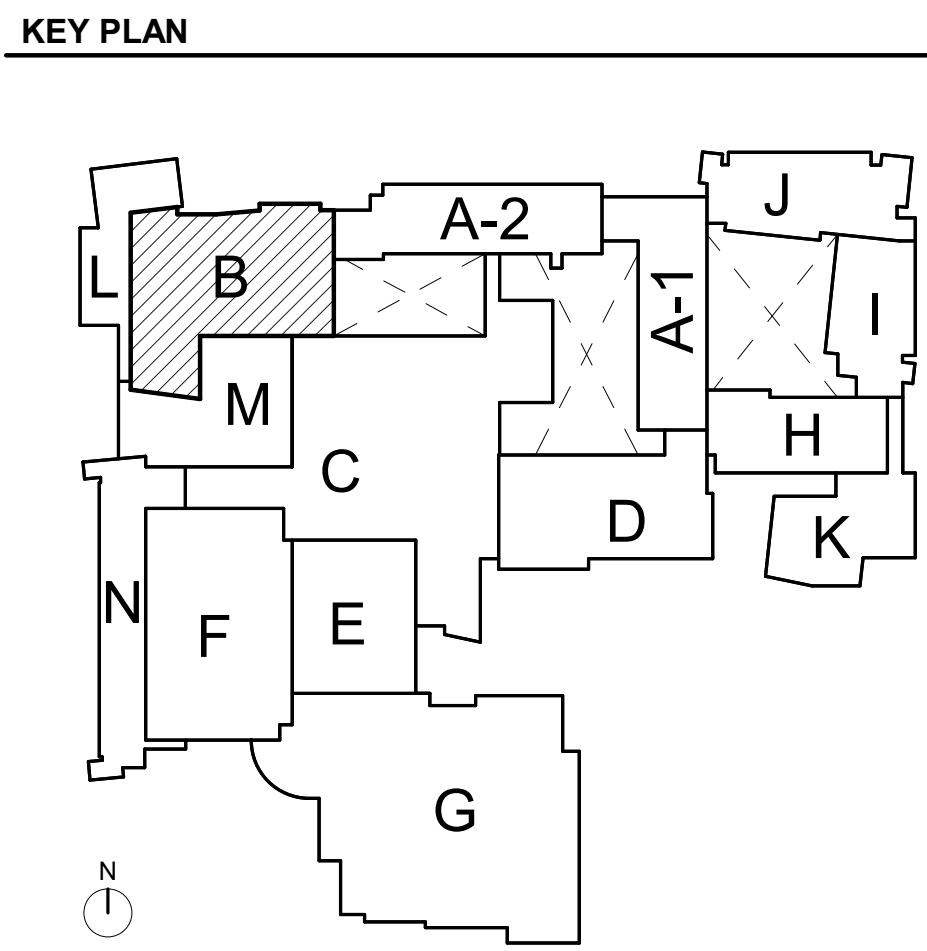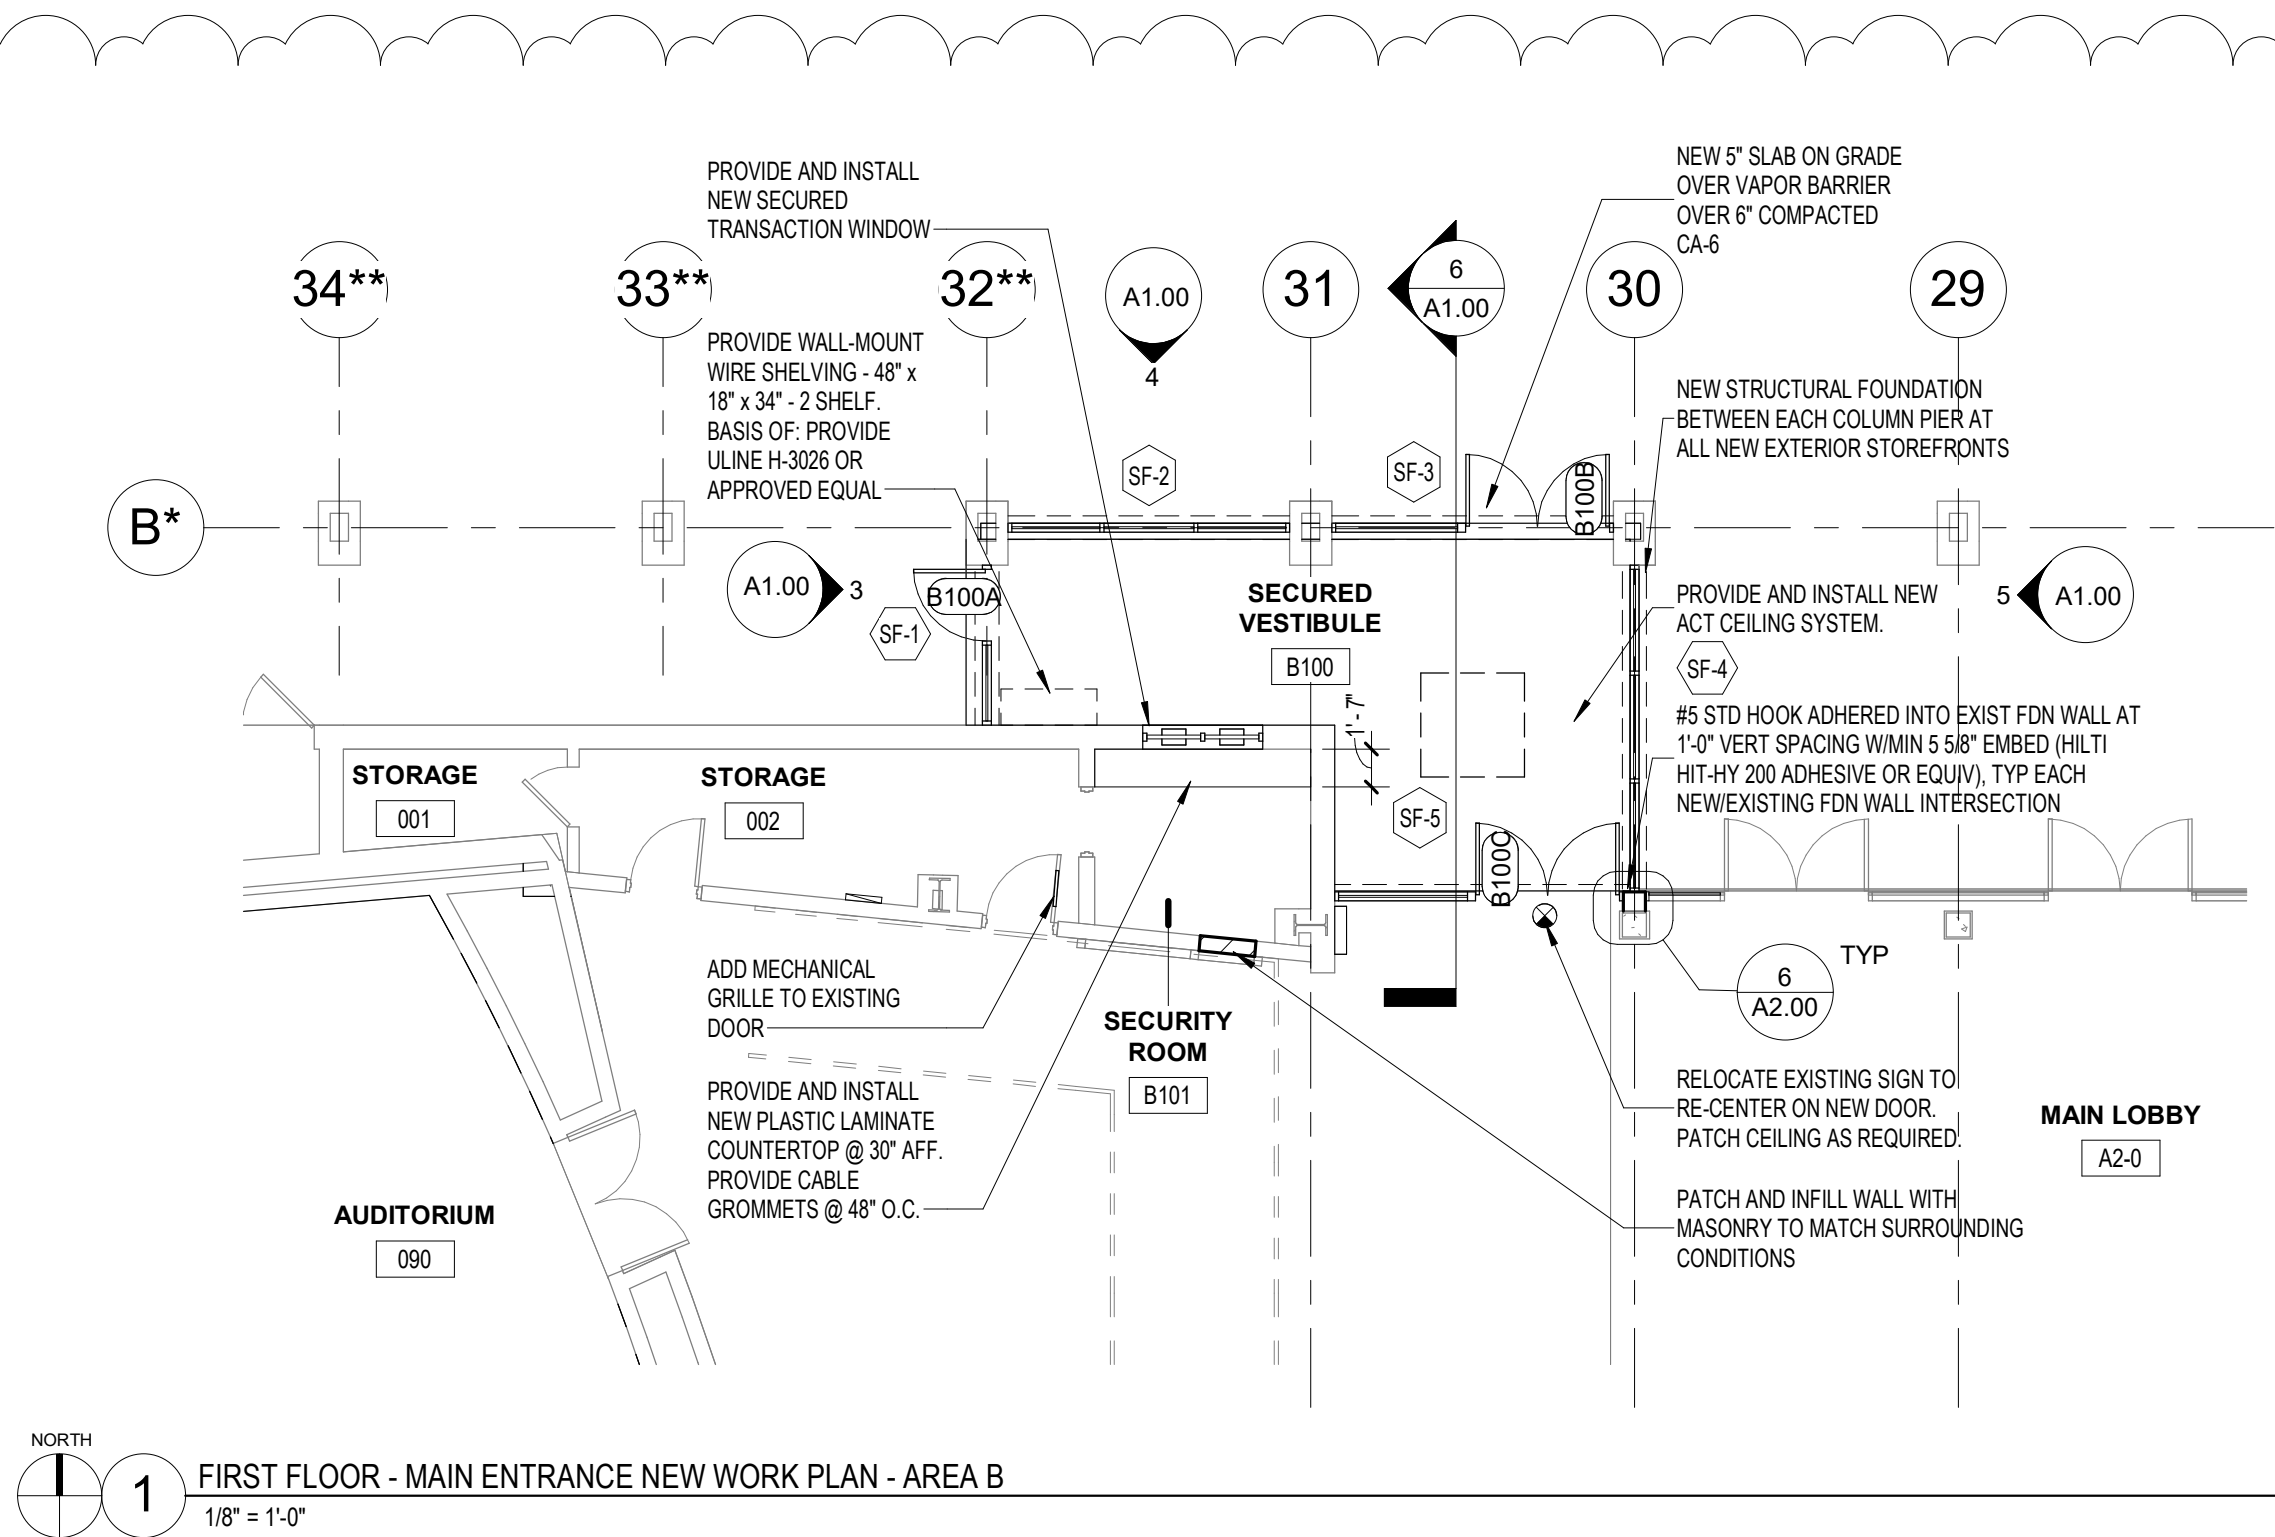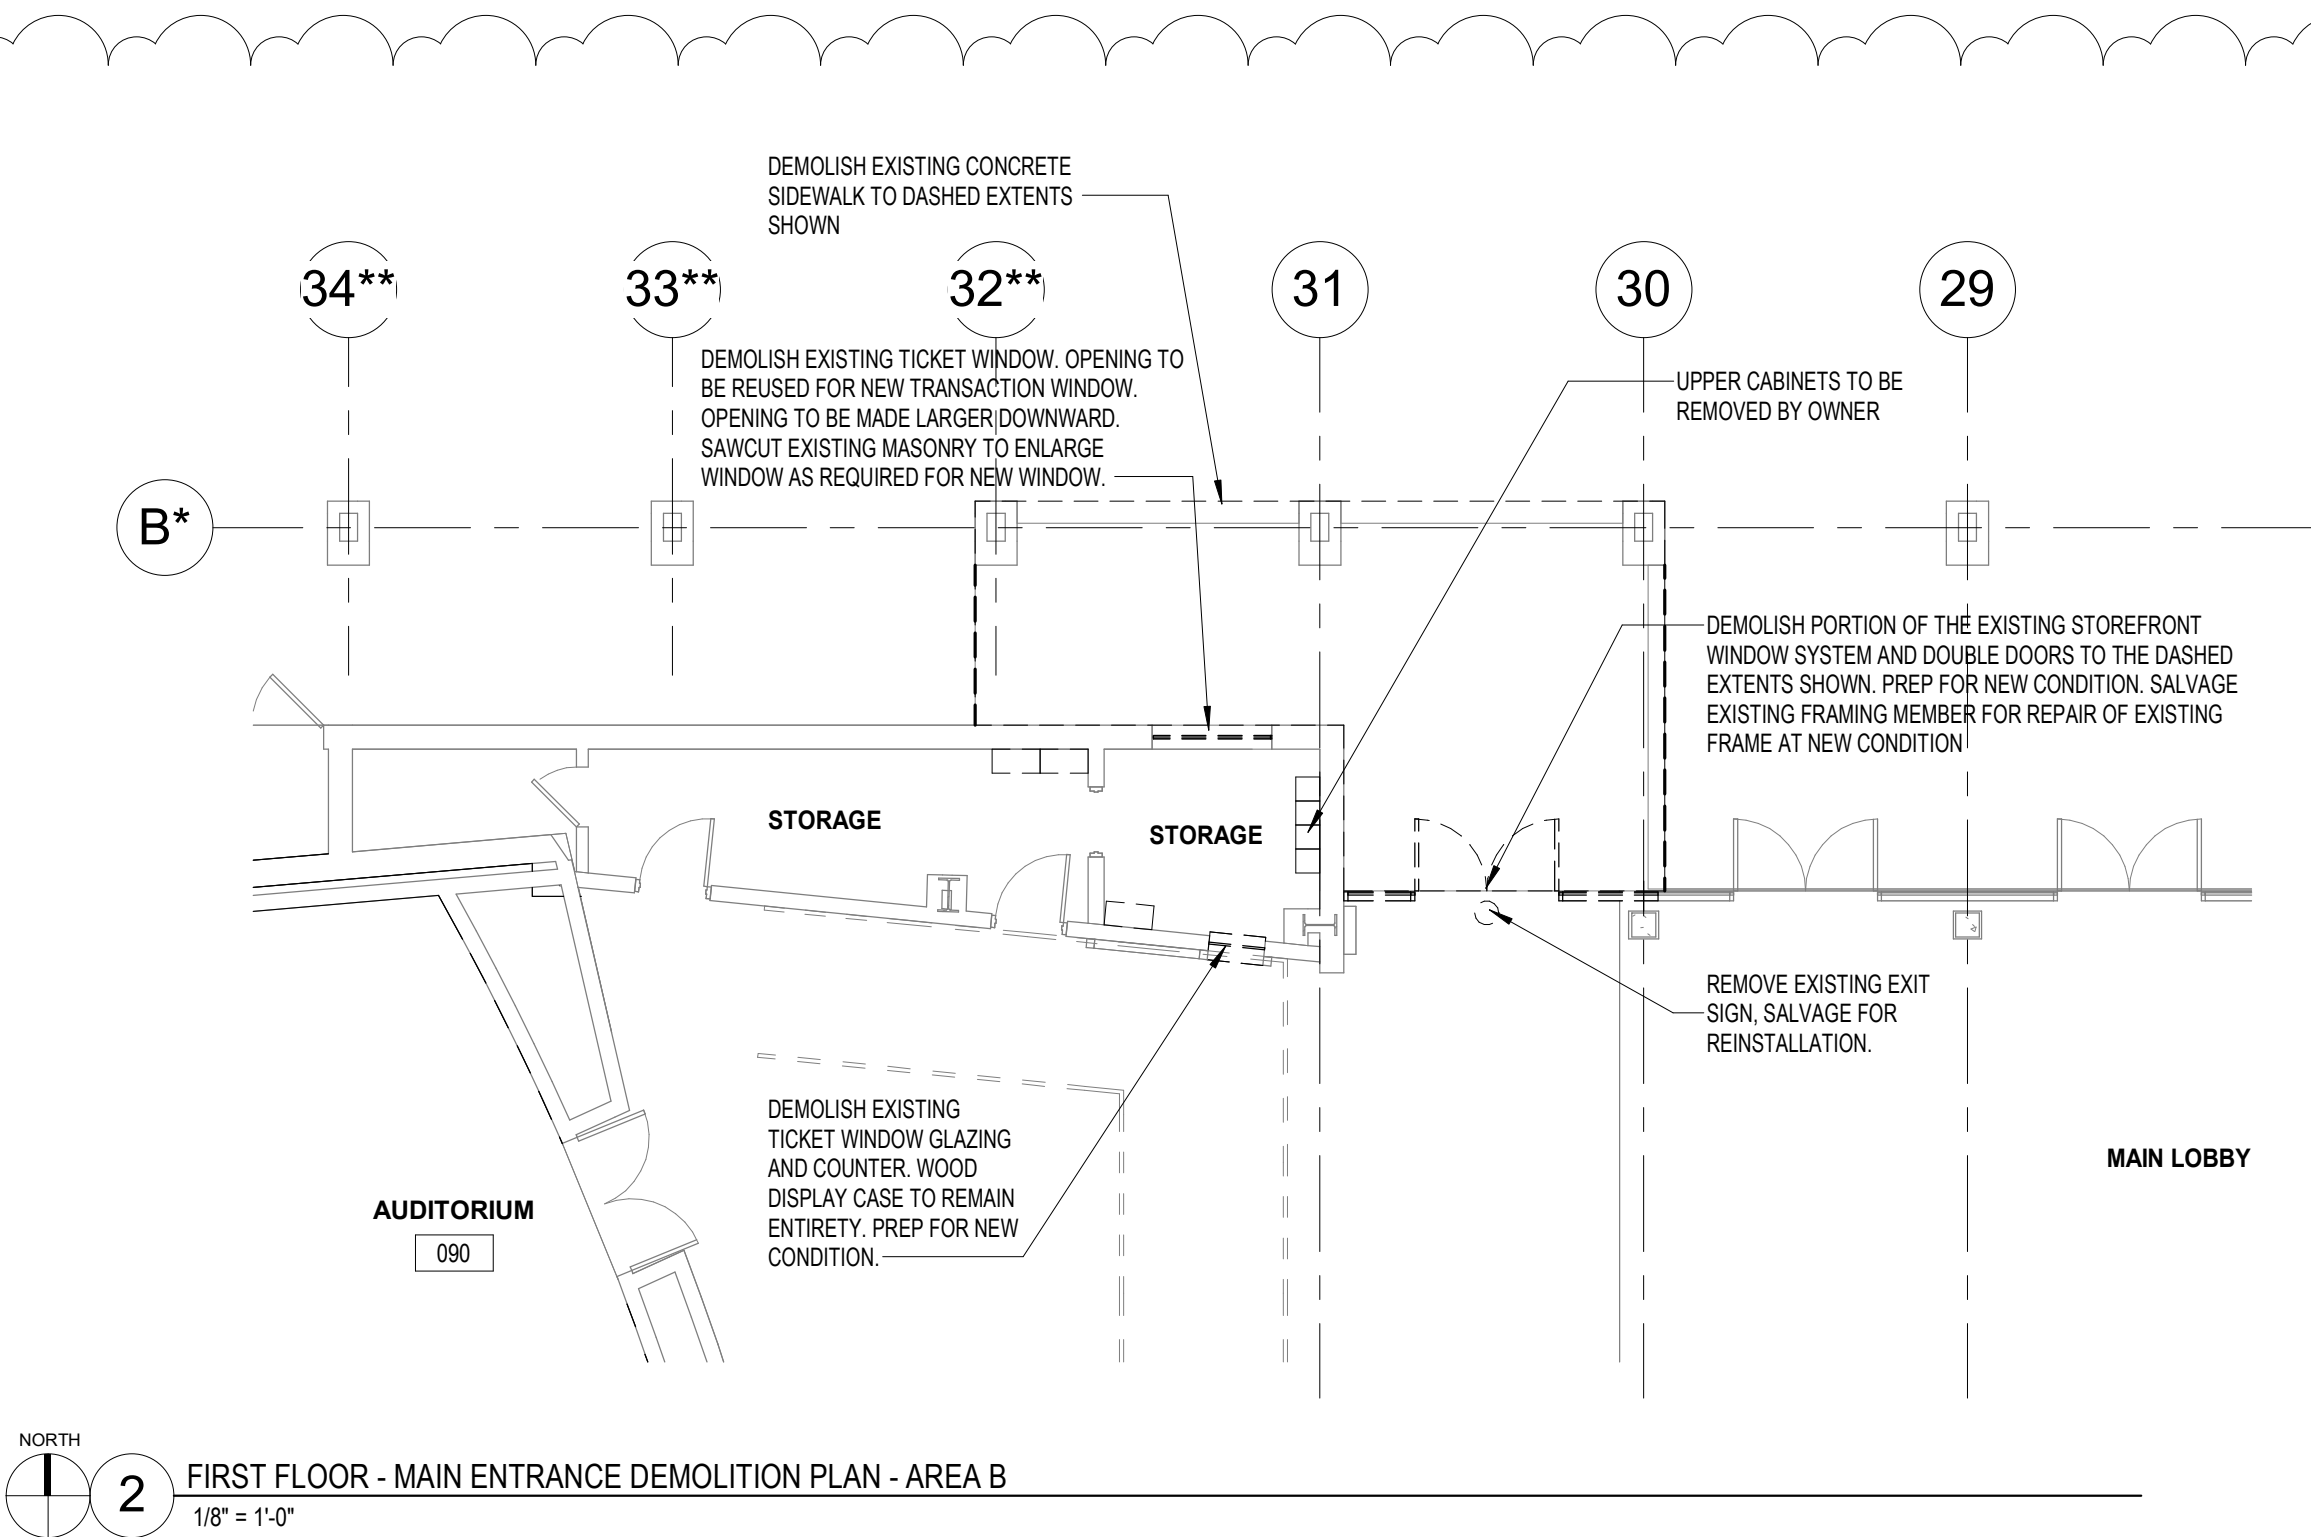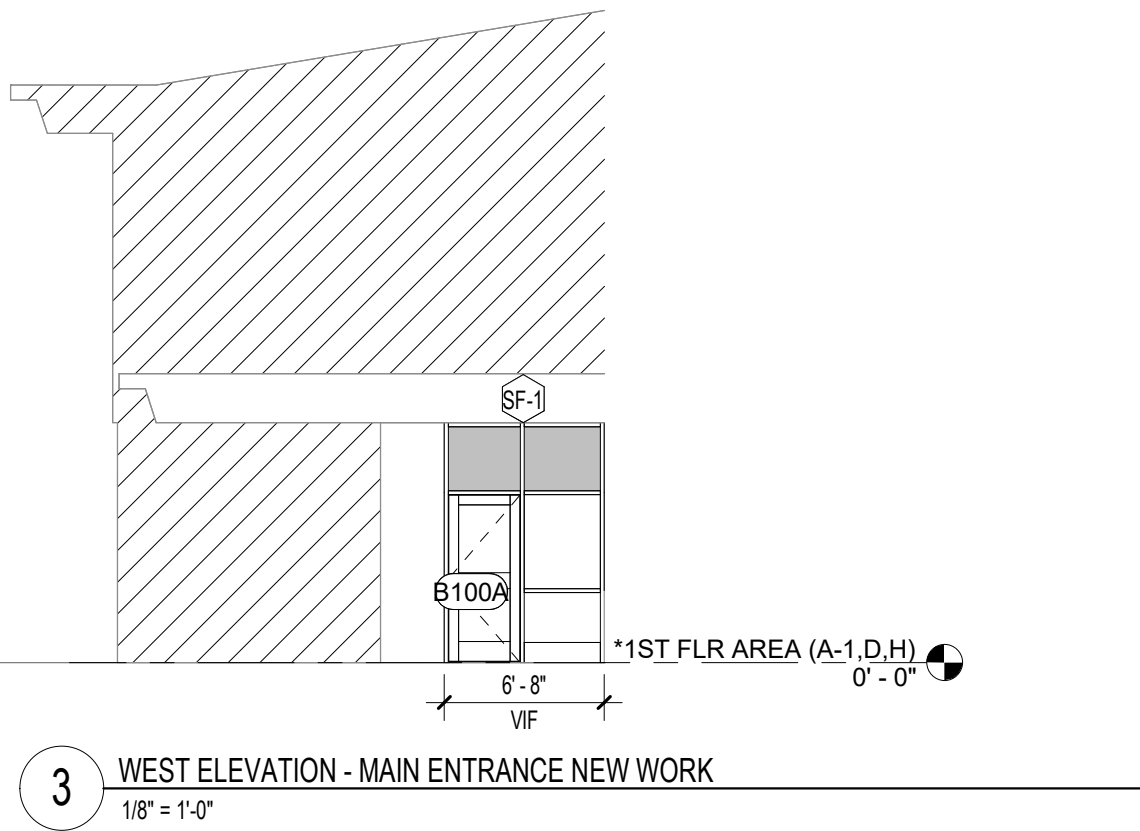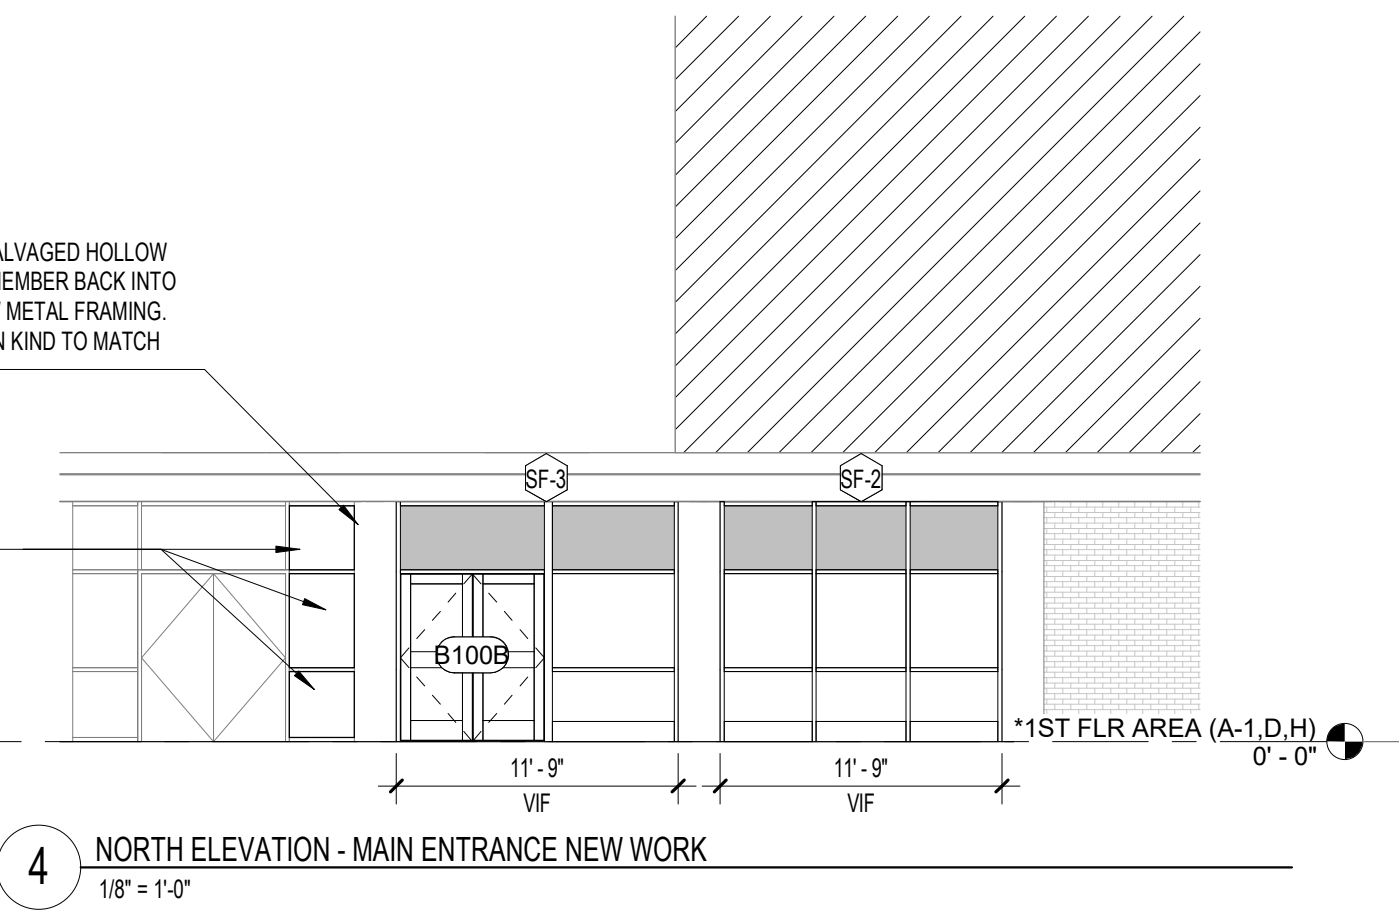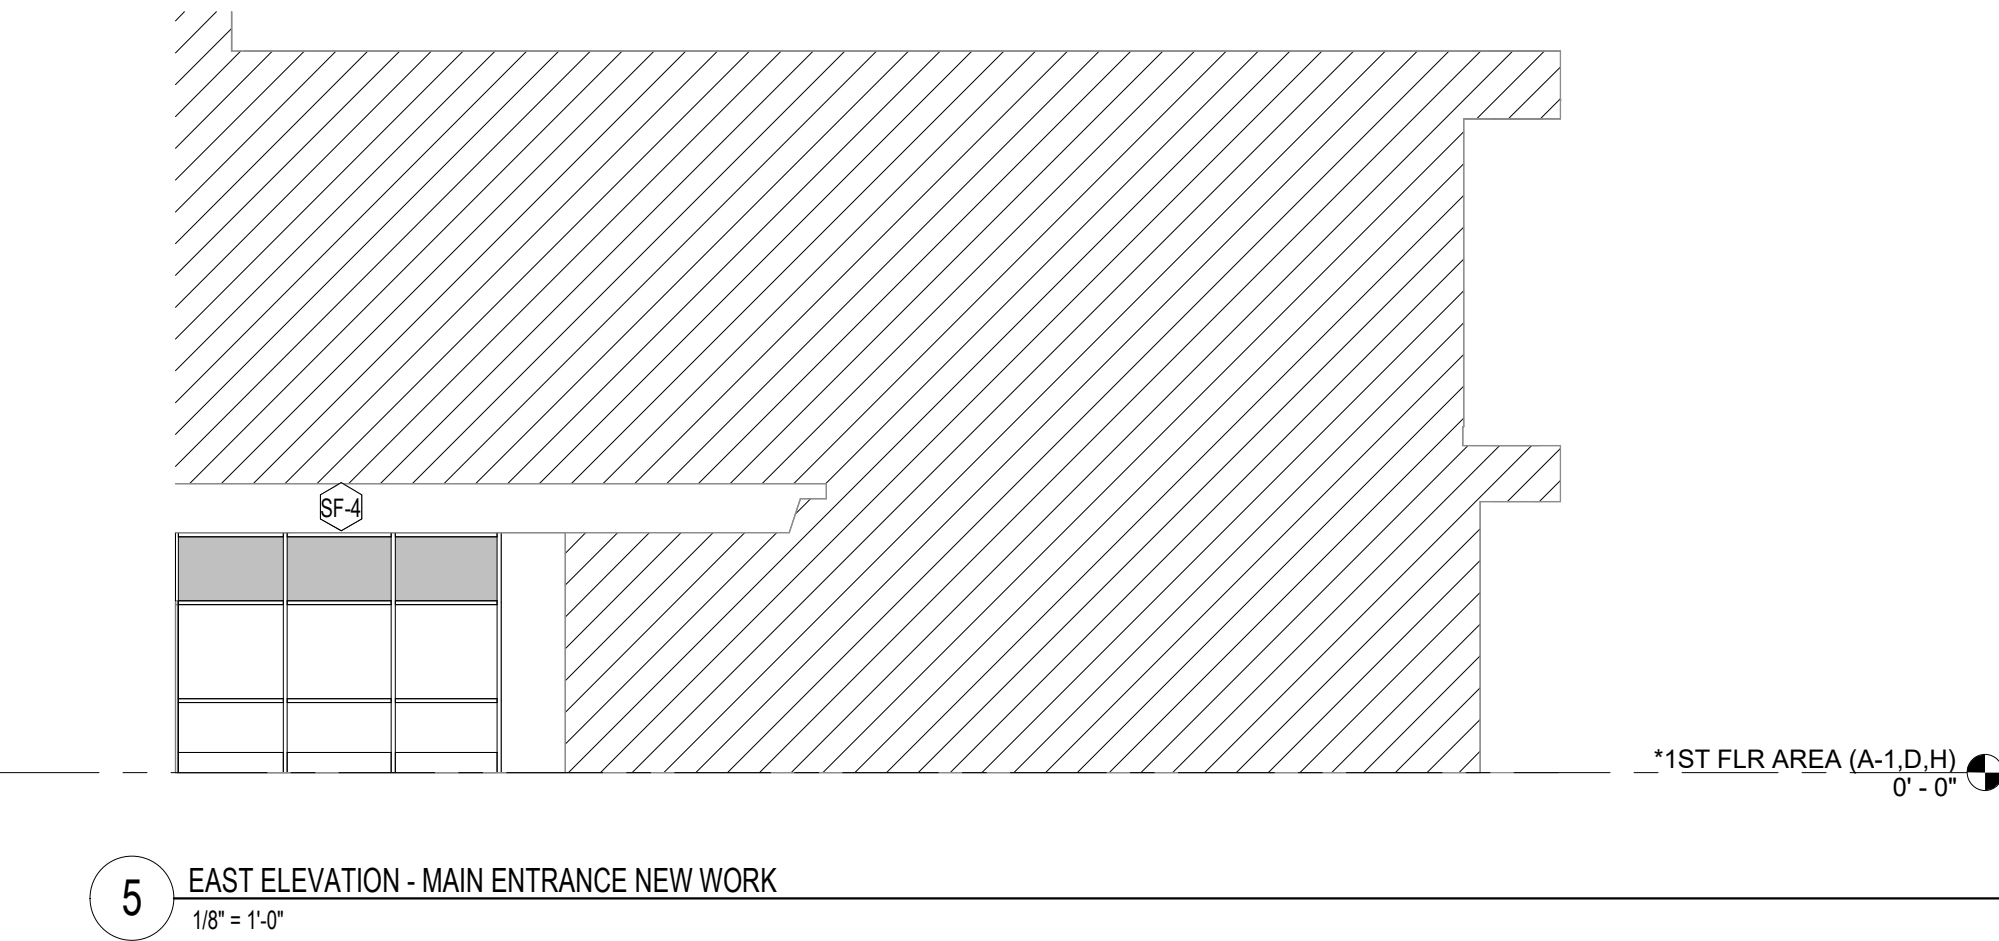

CORDOGAN CLARK
ARCHITECTURE • ENGINEERING • CONSTRUCTION

EA

EAST AURORA SCHOOL DISTRICT #131
EAHS SECURED ENTRANCE - DOOR 1
500 TOMCAT LN.
AURORA, IL 60506

COPYRIGHT © CORDOGAN CLARK & ASSOCIATES, INC.

CC JOB NUMBER 25-1008
DATE 04.07.2026


REVISIONS:

#	Description	Date
1	ISSUED FOR BID	04.07.26
1	ADDENDUM 01	04.14.26


DRAWING TITLE:
PARTIAL FIRST FLOOR PLANS - AREA B

A1.00


ADDENDUM 01 - 04.14.2026

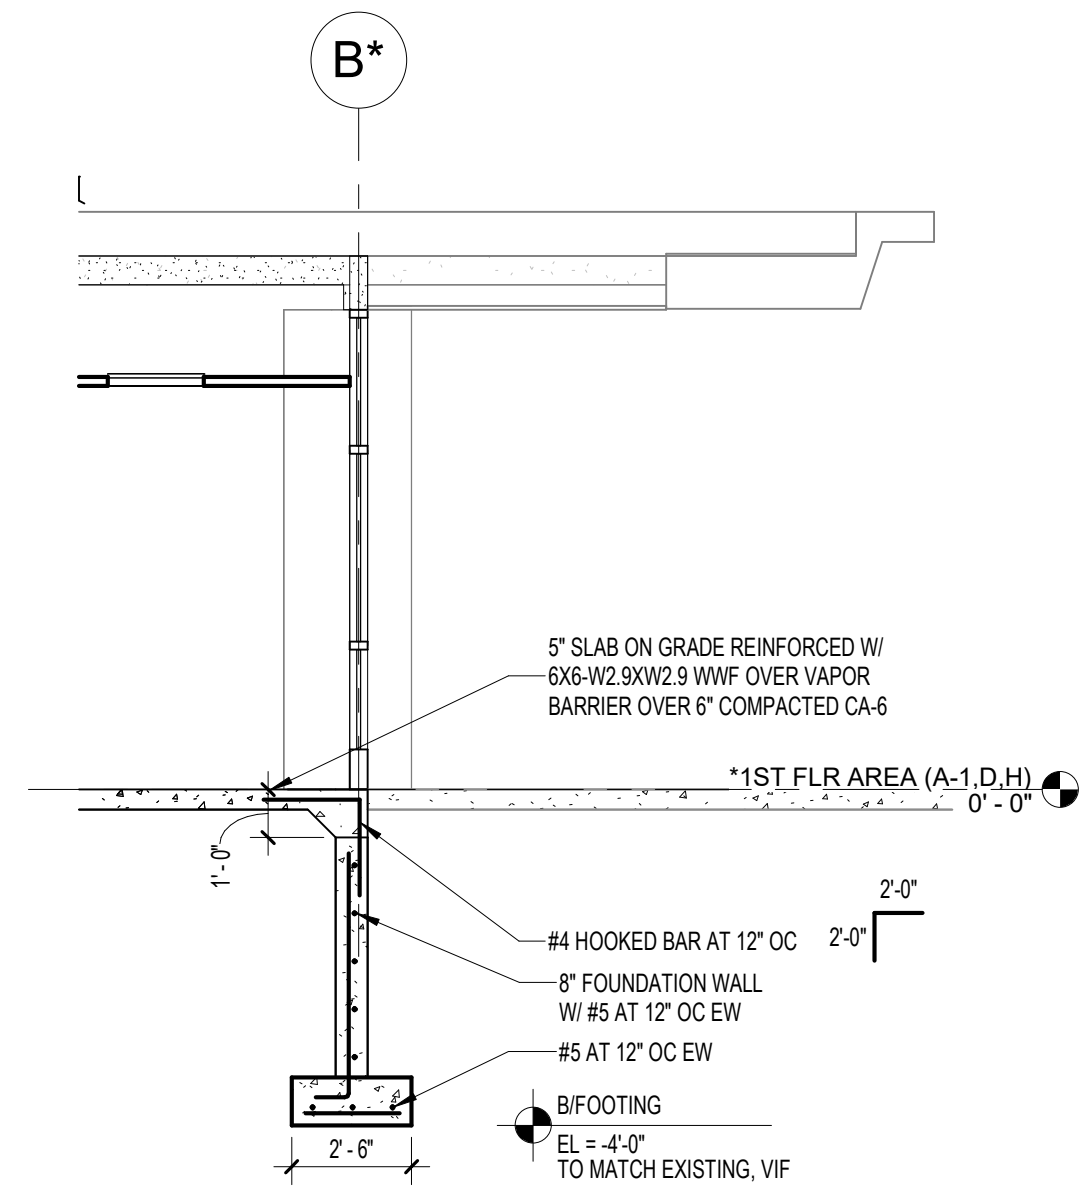


7 FIRST FLOOR - MAIN ENTRANCE - ENLARGED WALL SECTION - AREA B
1/4" = 1'-0"

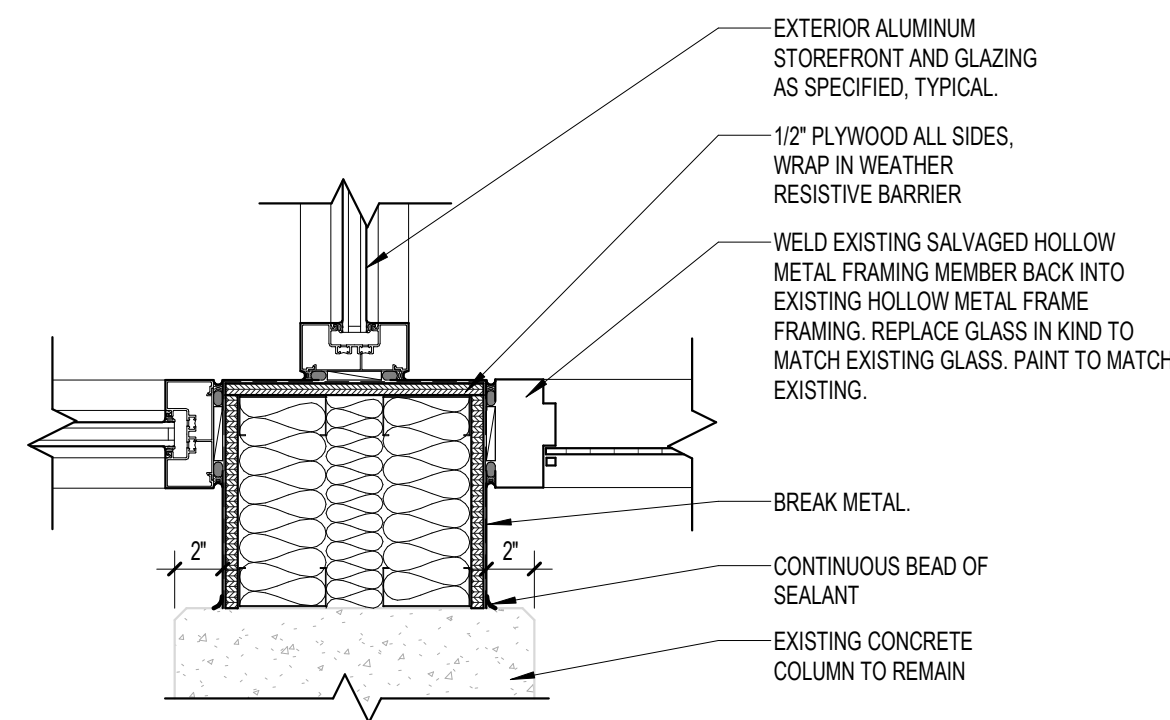


6 PLAN DETAIL - STOREFRONT JAMB TO COLUMN CONNECTION
1 1/2" = 1'-0"

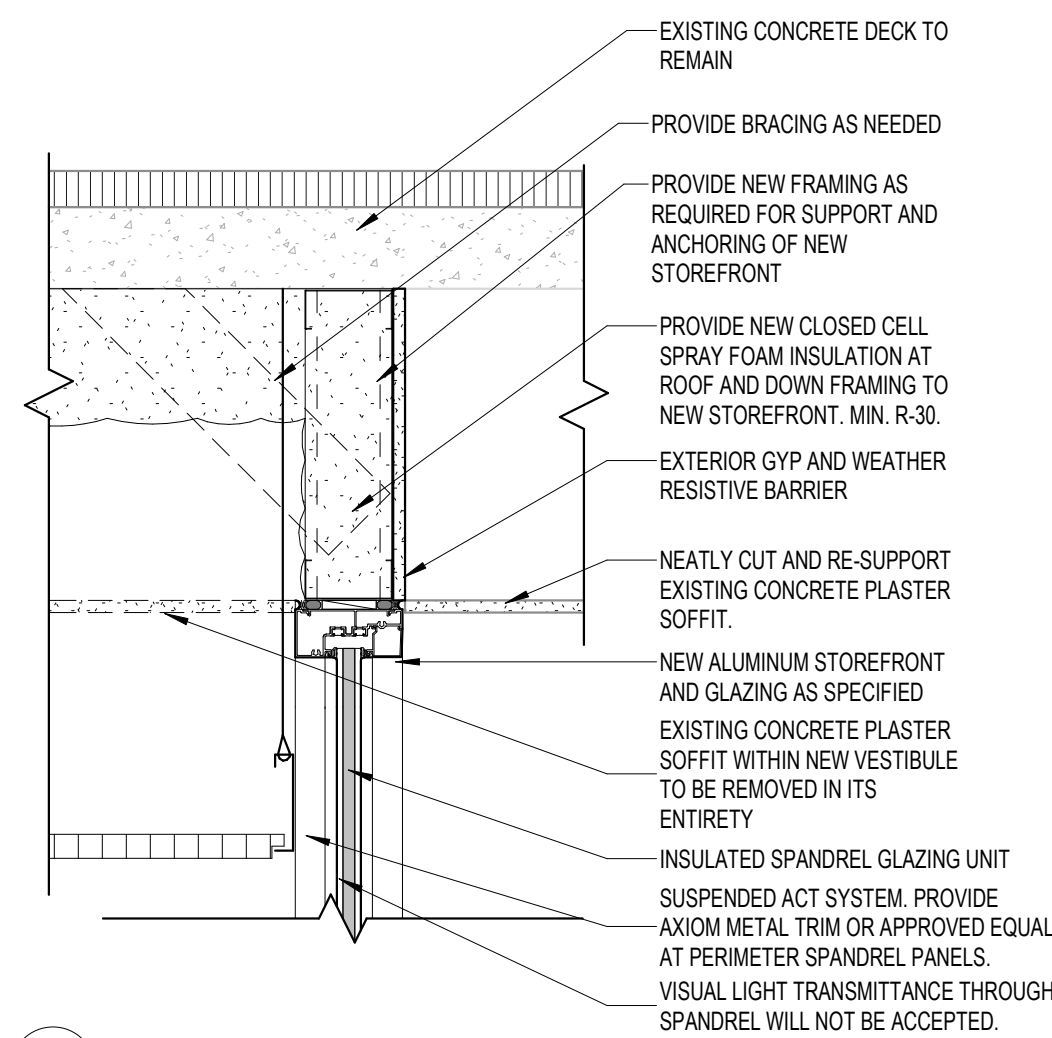


5 TYPICAL HEADER DETAIL - MAIN ENTRANCE
1 1/2" = 1'-0"

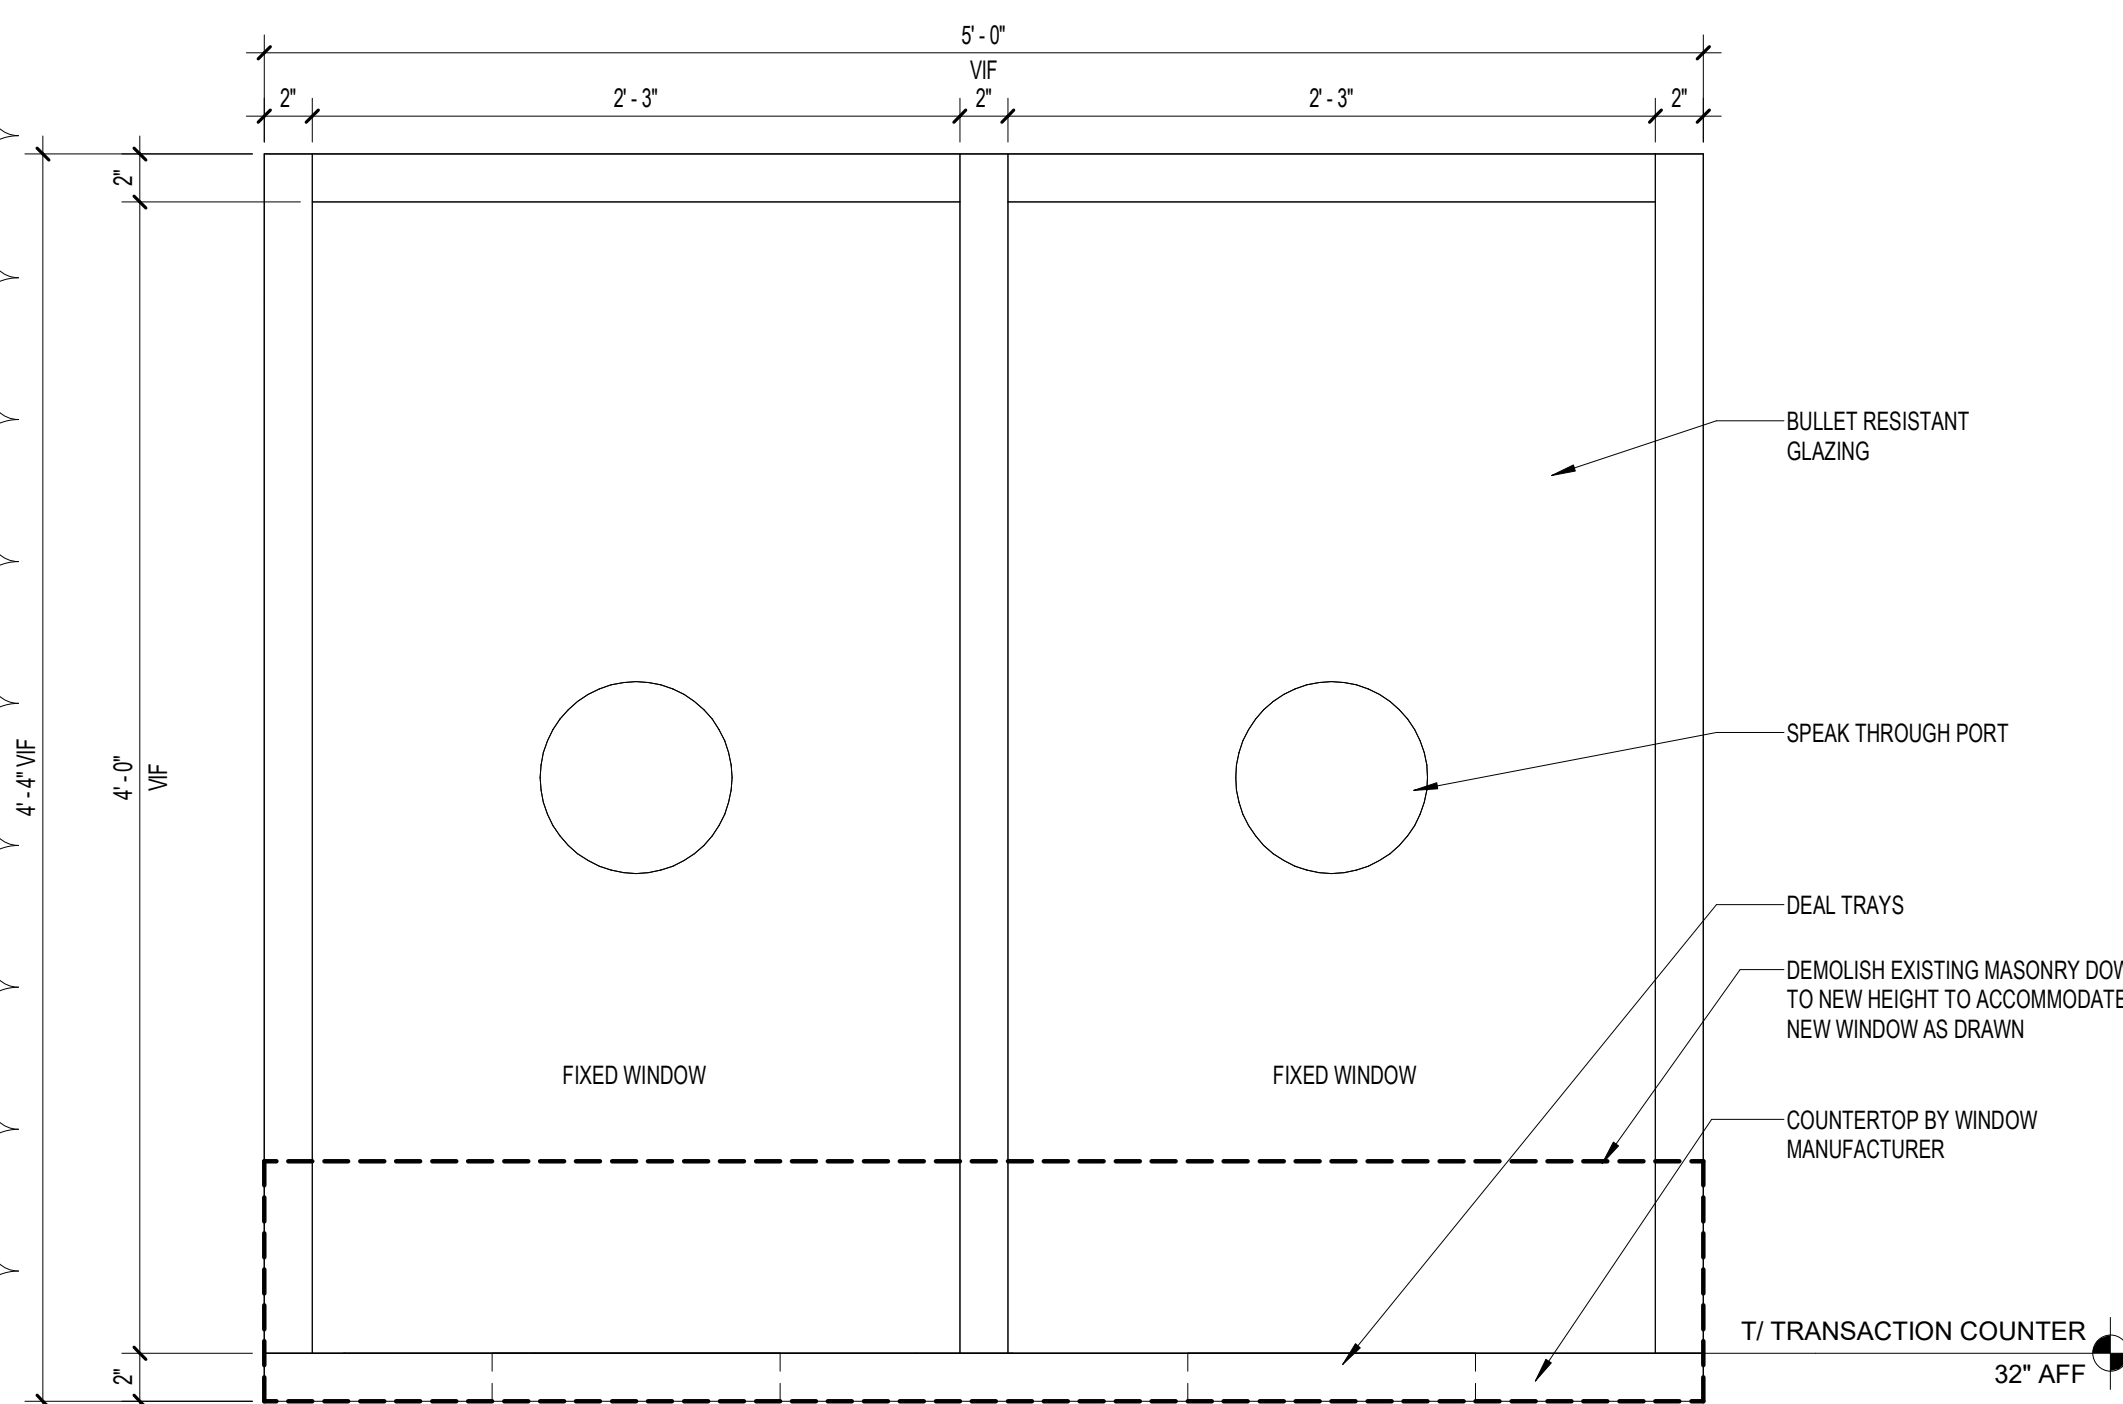


3 FIXED TRANSACTION WINDOW - ELEVATION
1 1/2" = 1'-0"

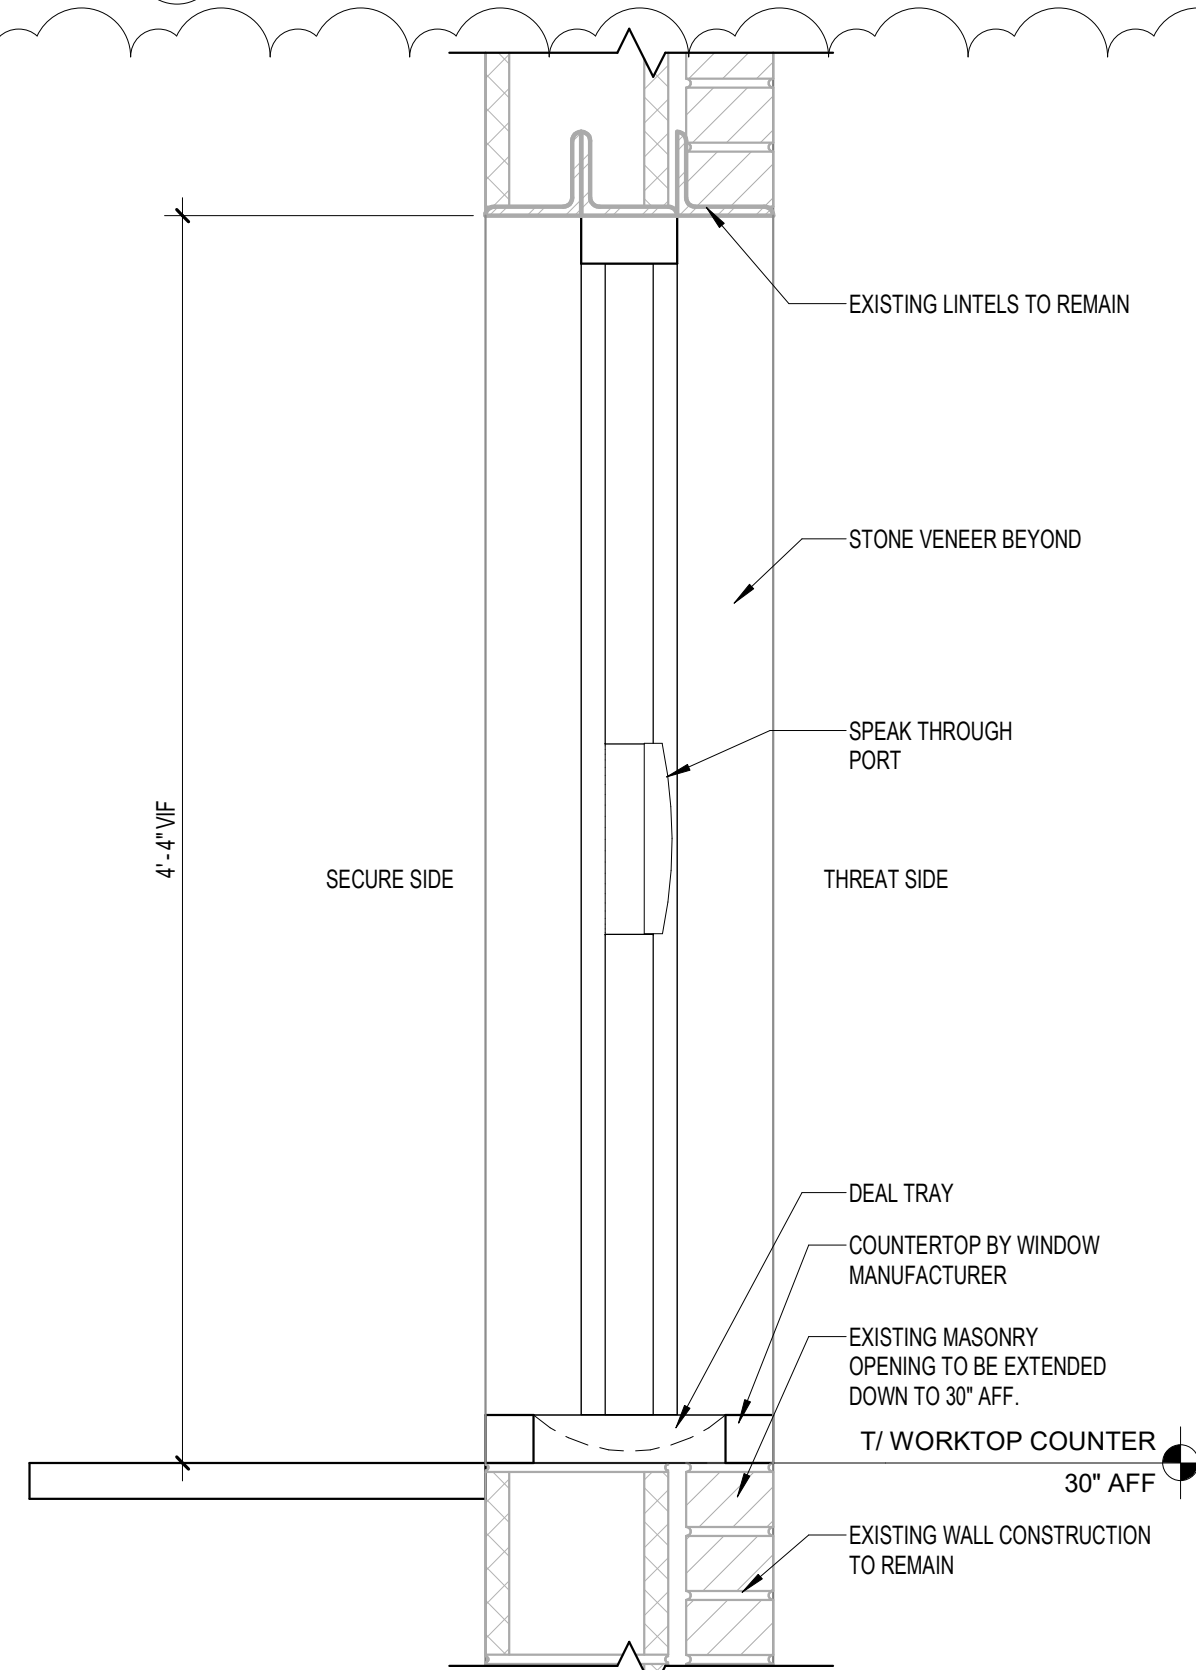


2 FIXED TRANSACTION WINDOW - SECTION 1 1/2" = 1'-0"

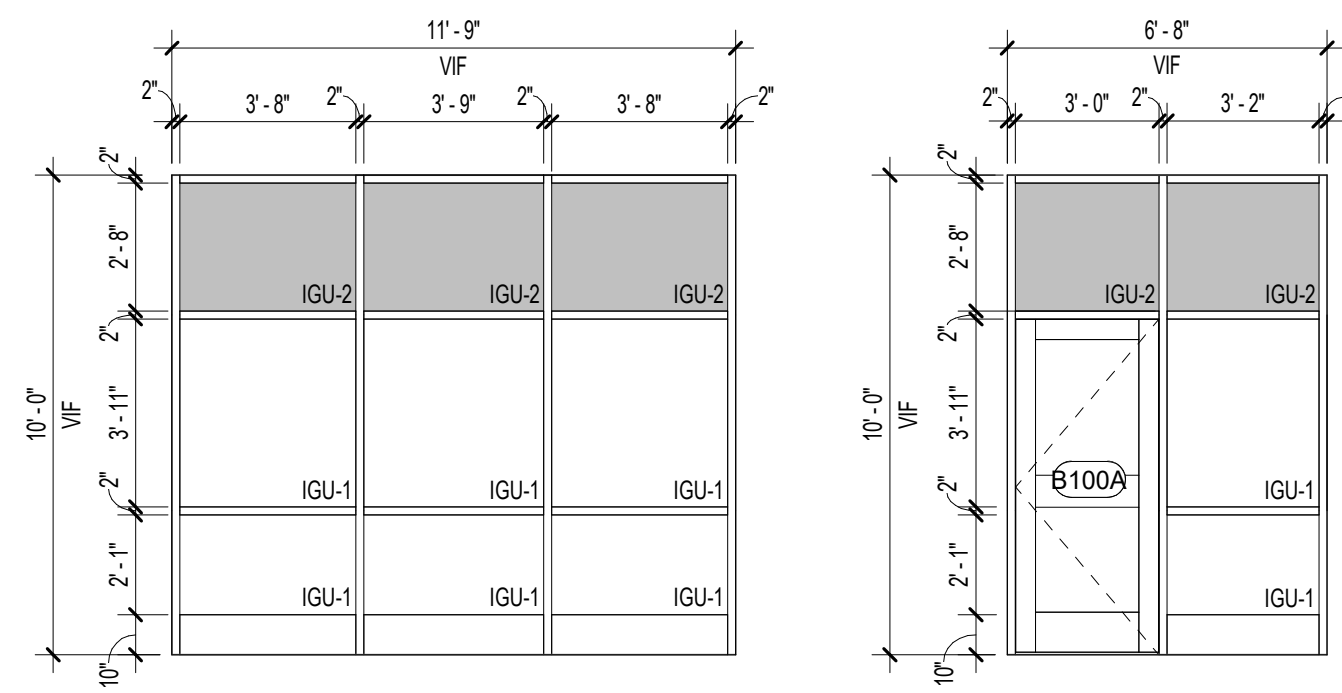


SF-2

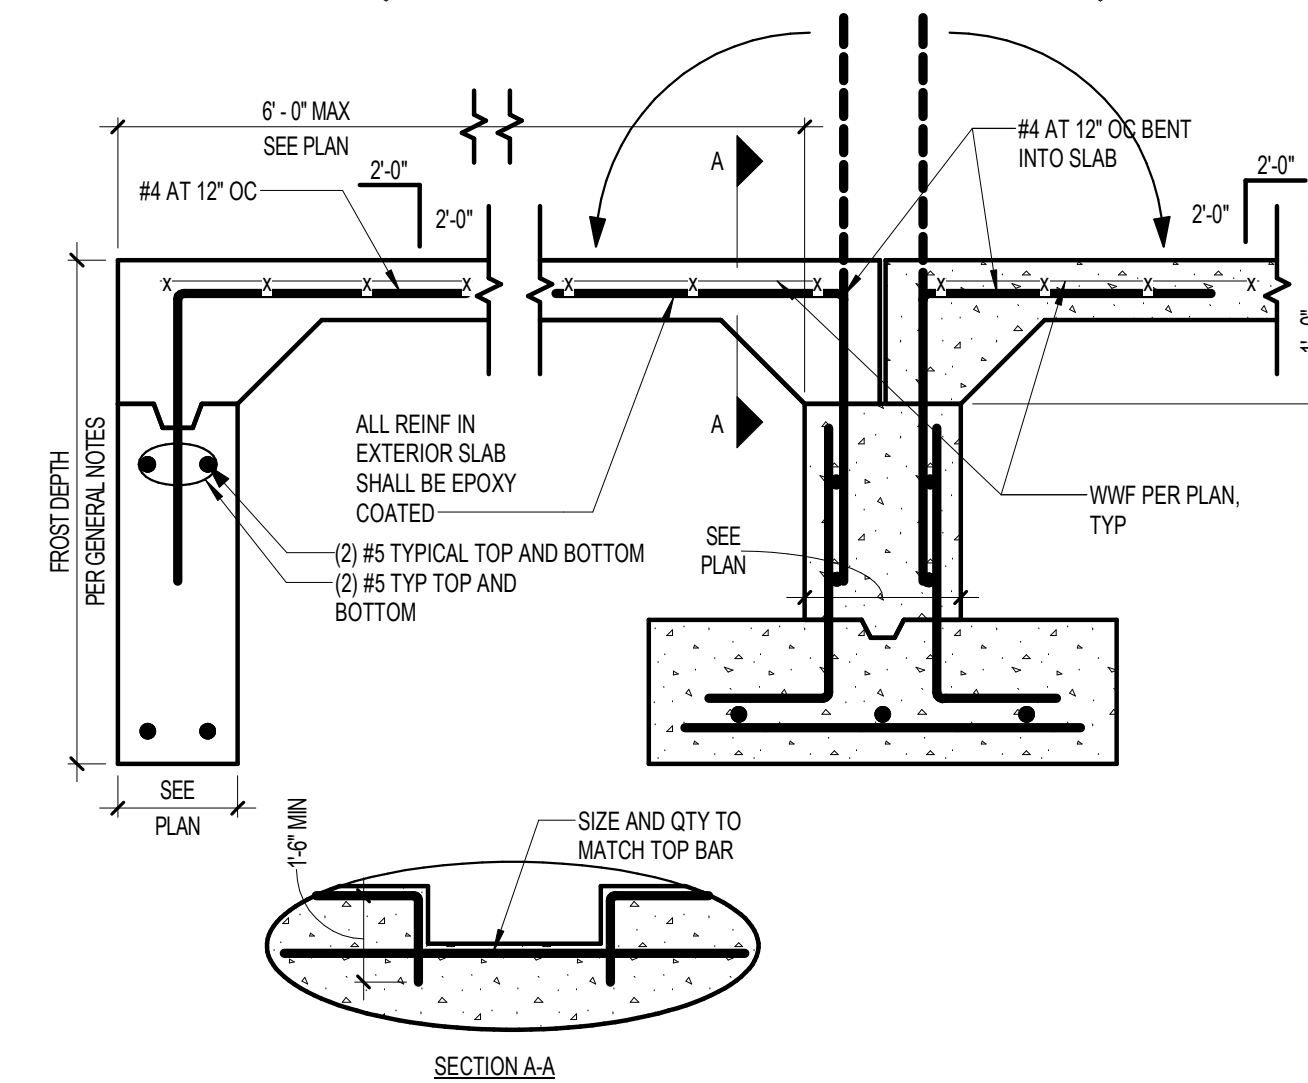

8 TYPICAL SECTION AT EXTERIOR DOOR
3/4" = 1'-0"

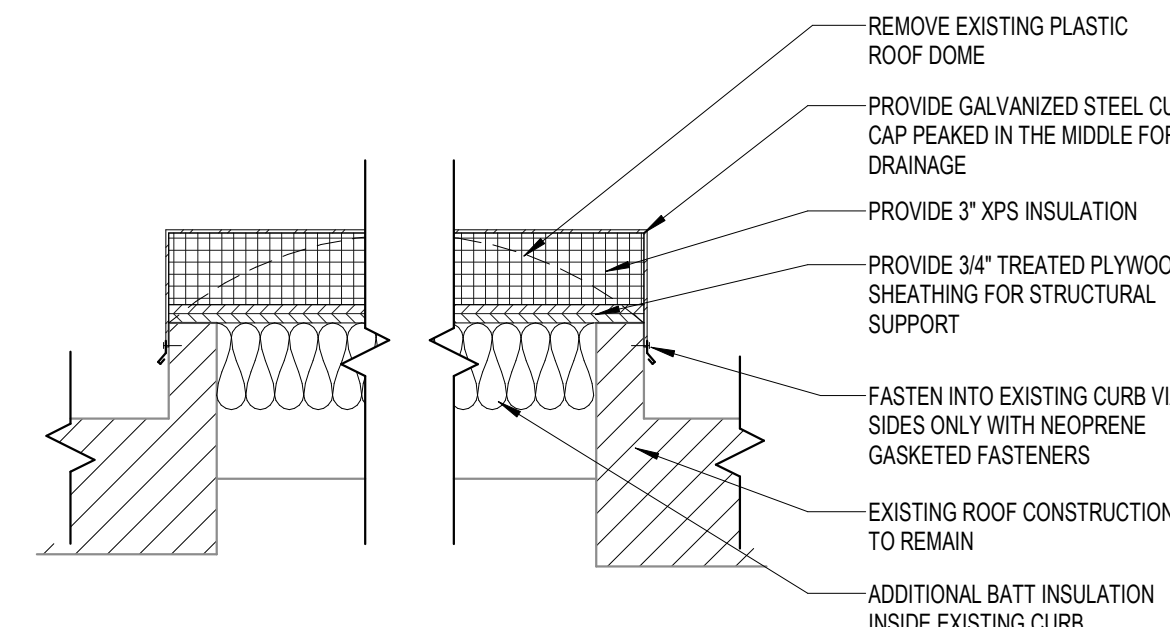

4 ROOF CANOPY INFILL DETAIL

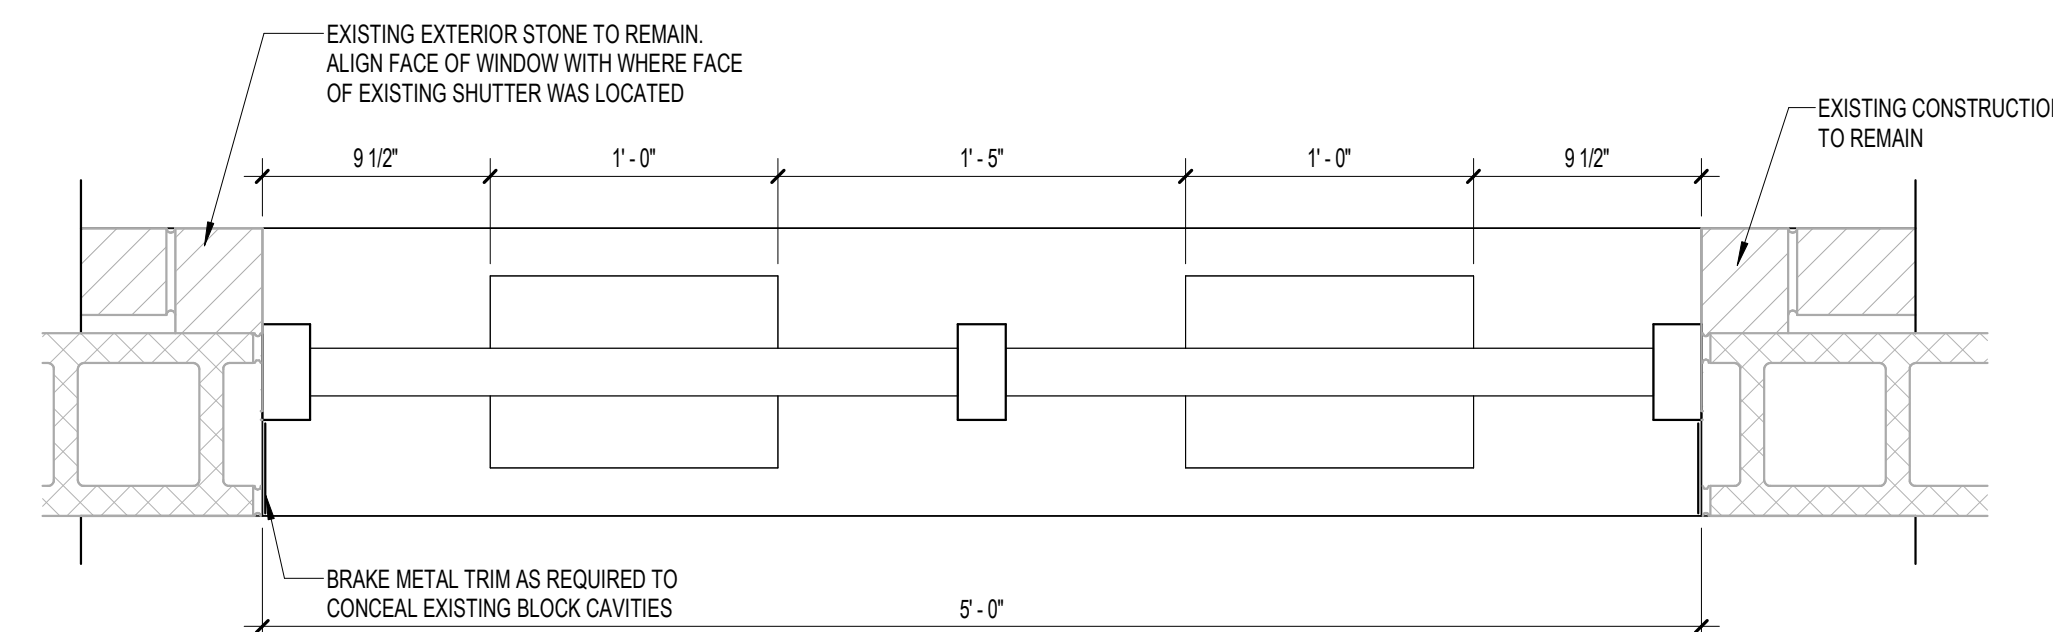


1 FIXED TRANSACTION WINDOW - PLAN
1 1/2" = 1'-0"

- ### GENERAL NOTES

1. CONTRACTOR TO VERIFY EXISTING ROUGH OPENING DIMENSIONS PRIOR TO SHOP DRAWING SUBMITTAL.
2. CONTRACTOR TO VERIFY ALL EXISTING HEAD, JAMB, AND SILL DETAILS PRIOR TO SHOP DRAWING SUBMITTAL.
3. CONTRACTOR TO SUBMIT SHOP DRAWINGS OF PROPOSED TYPICAL TRIM DETAILS.
4. CONTRACTOR TO INSTALL ALUMINUM FRAMED STOREFRONT SYSTEM AND ALL ASSOCIATED TRIM. REFER TO SPECIFICATIONS FOR MORE DETAILS.
5. ALL GLAZING TO BE INSULATED DOUBLE PANE GLAZING, 1" CLEAR, LOW "E" U.N.O.
6. CUT, PREP, PATCH, AND REPAIR EXISTING CONDITIONS AS REQUIRED FOR INSTALLATION OF NEW STOREFRONT AT ALL SILLS, JAMBS, AND HEADS. REFER TO DETAILS FOR ADDITIONAL INFORMATION.
7. PROVIDE CONSISTENT FINISH AROUND ENTIRE WINDOW ASSEMBLY.

GLAZING NOTES AND LEGEND




1. PURSUANT TO 2015 IBC 2406 SAFETY GLAZING PROVIDE FULLY TEMPERED GLAZING IN THE FOLLOWING SITUATIONS ON THIS PROJECT:
- A. ALL GLAZING IN DOORS.
 - B. ALL GLAZING IN RAILINGS.
 - C. ALL GLAZING PANELS LARGER THAN 9 SQ FT IN AREA.



ALTERNATES

ALTERNATE #01 - ADD INTRUDER RESISTANT FILM. BASIS OF DESIGN 3M SAFETY SECURITY WINDOW FILMS ULTRA SERIES COMBINED WITH THE 3M IMPACT PROTECTION ATTACHMENT (IPA) SEALANT OR APPROVED EQUAL. APPLY TO ALL NEW STOREFRONTS.

ALTERNATE #02 - ADD FILM TO EXISTING FRONT DOORS BASIS OF DESIGN 3M SAFETY & SECURITY WINDOW FILMS ULTRA SERIES COMBINED WITH THE 3M IMPACT PROTECTION ATTACHMENT (IPA) SEALANT OR APPROVED EQUAL. APPLY TO ALL EXISTING DOOR 1 DOORS AND WINDOWS (ROUGHLY 53' OF HM FRAME, 4 DOUBLE DOORS, AND WINDOWS AT DOOR 1 FROM GRIDLINE 30 EASTWARD.

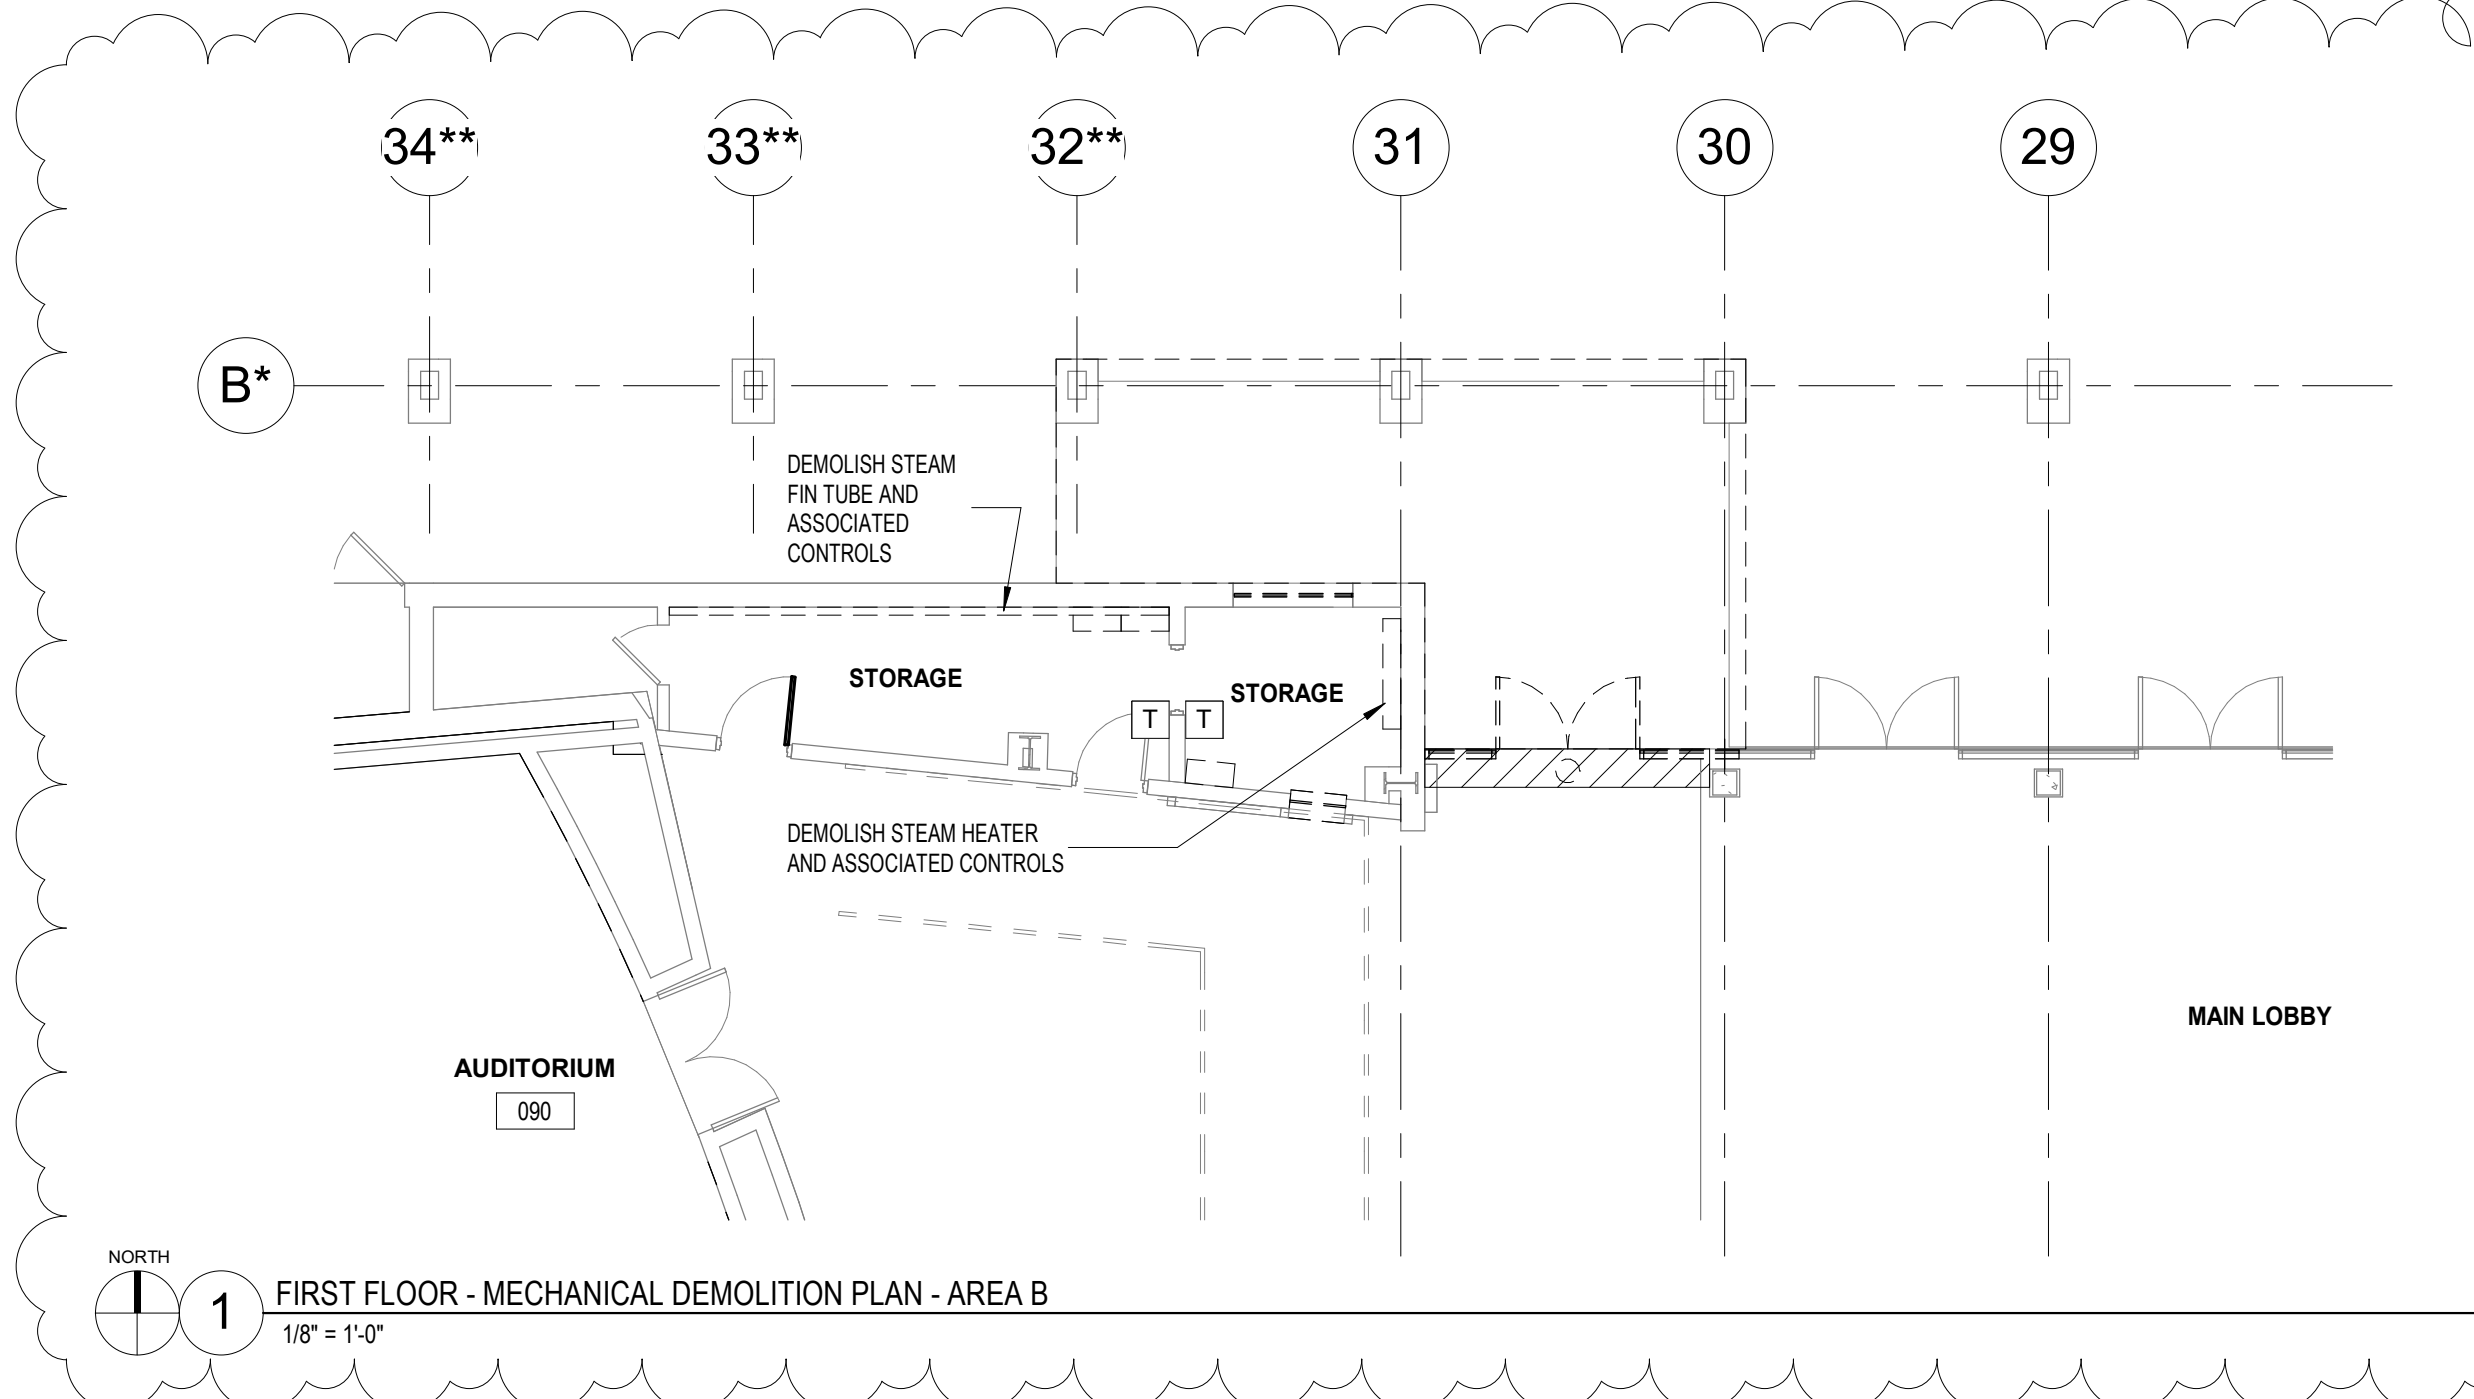

3 AREA B - ROOF PLAN
1/8" = 1'-0"

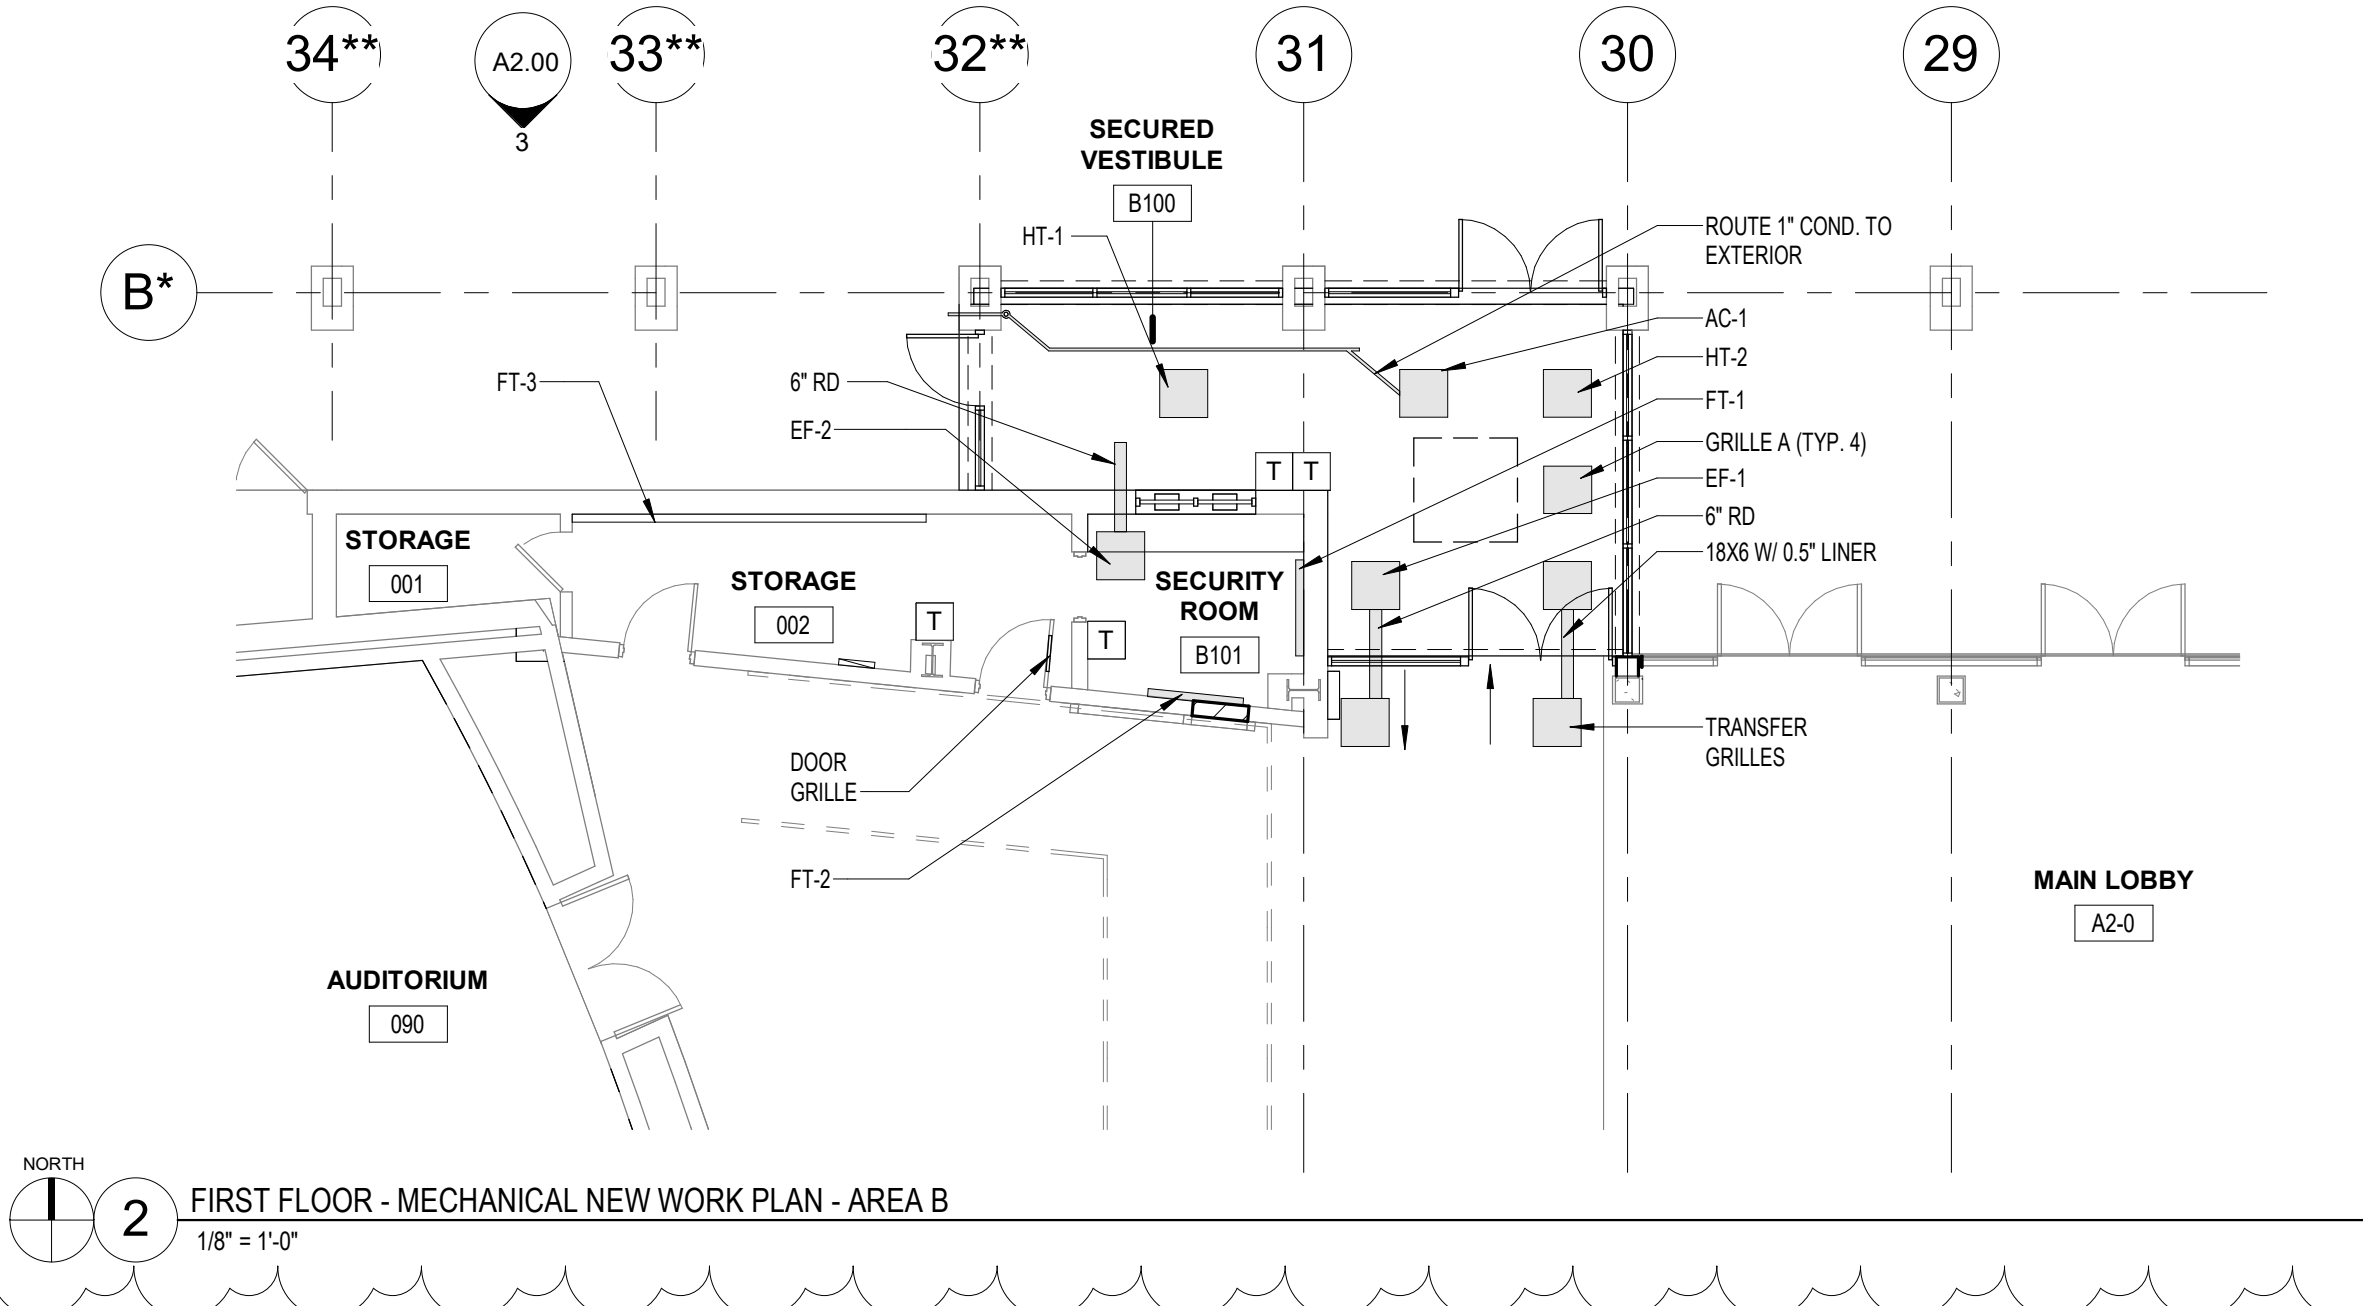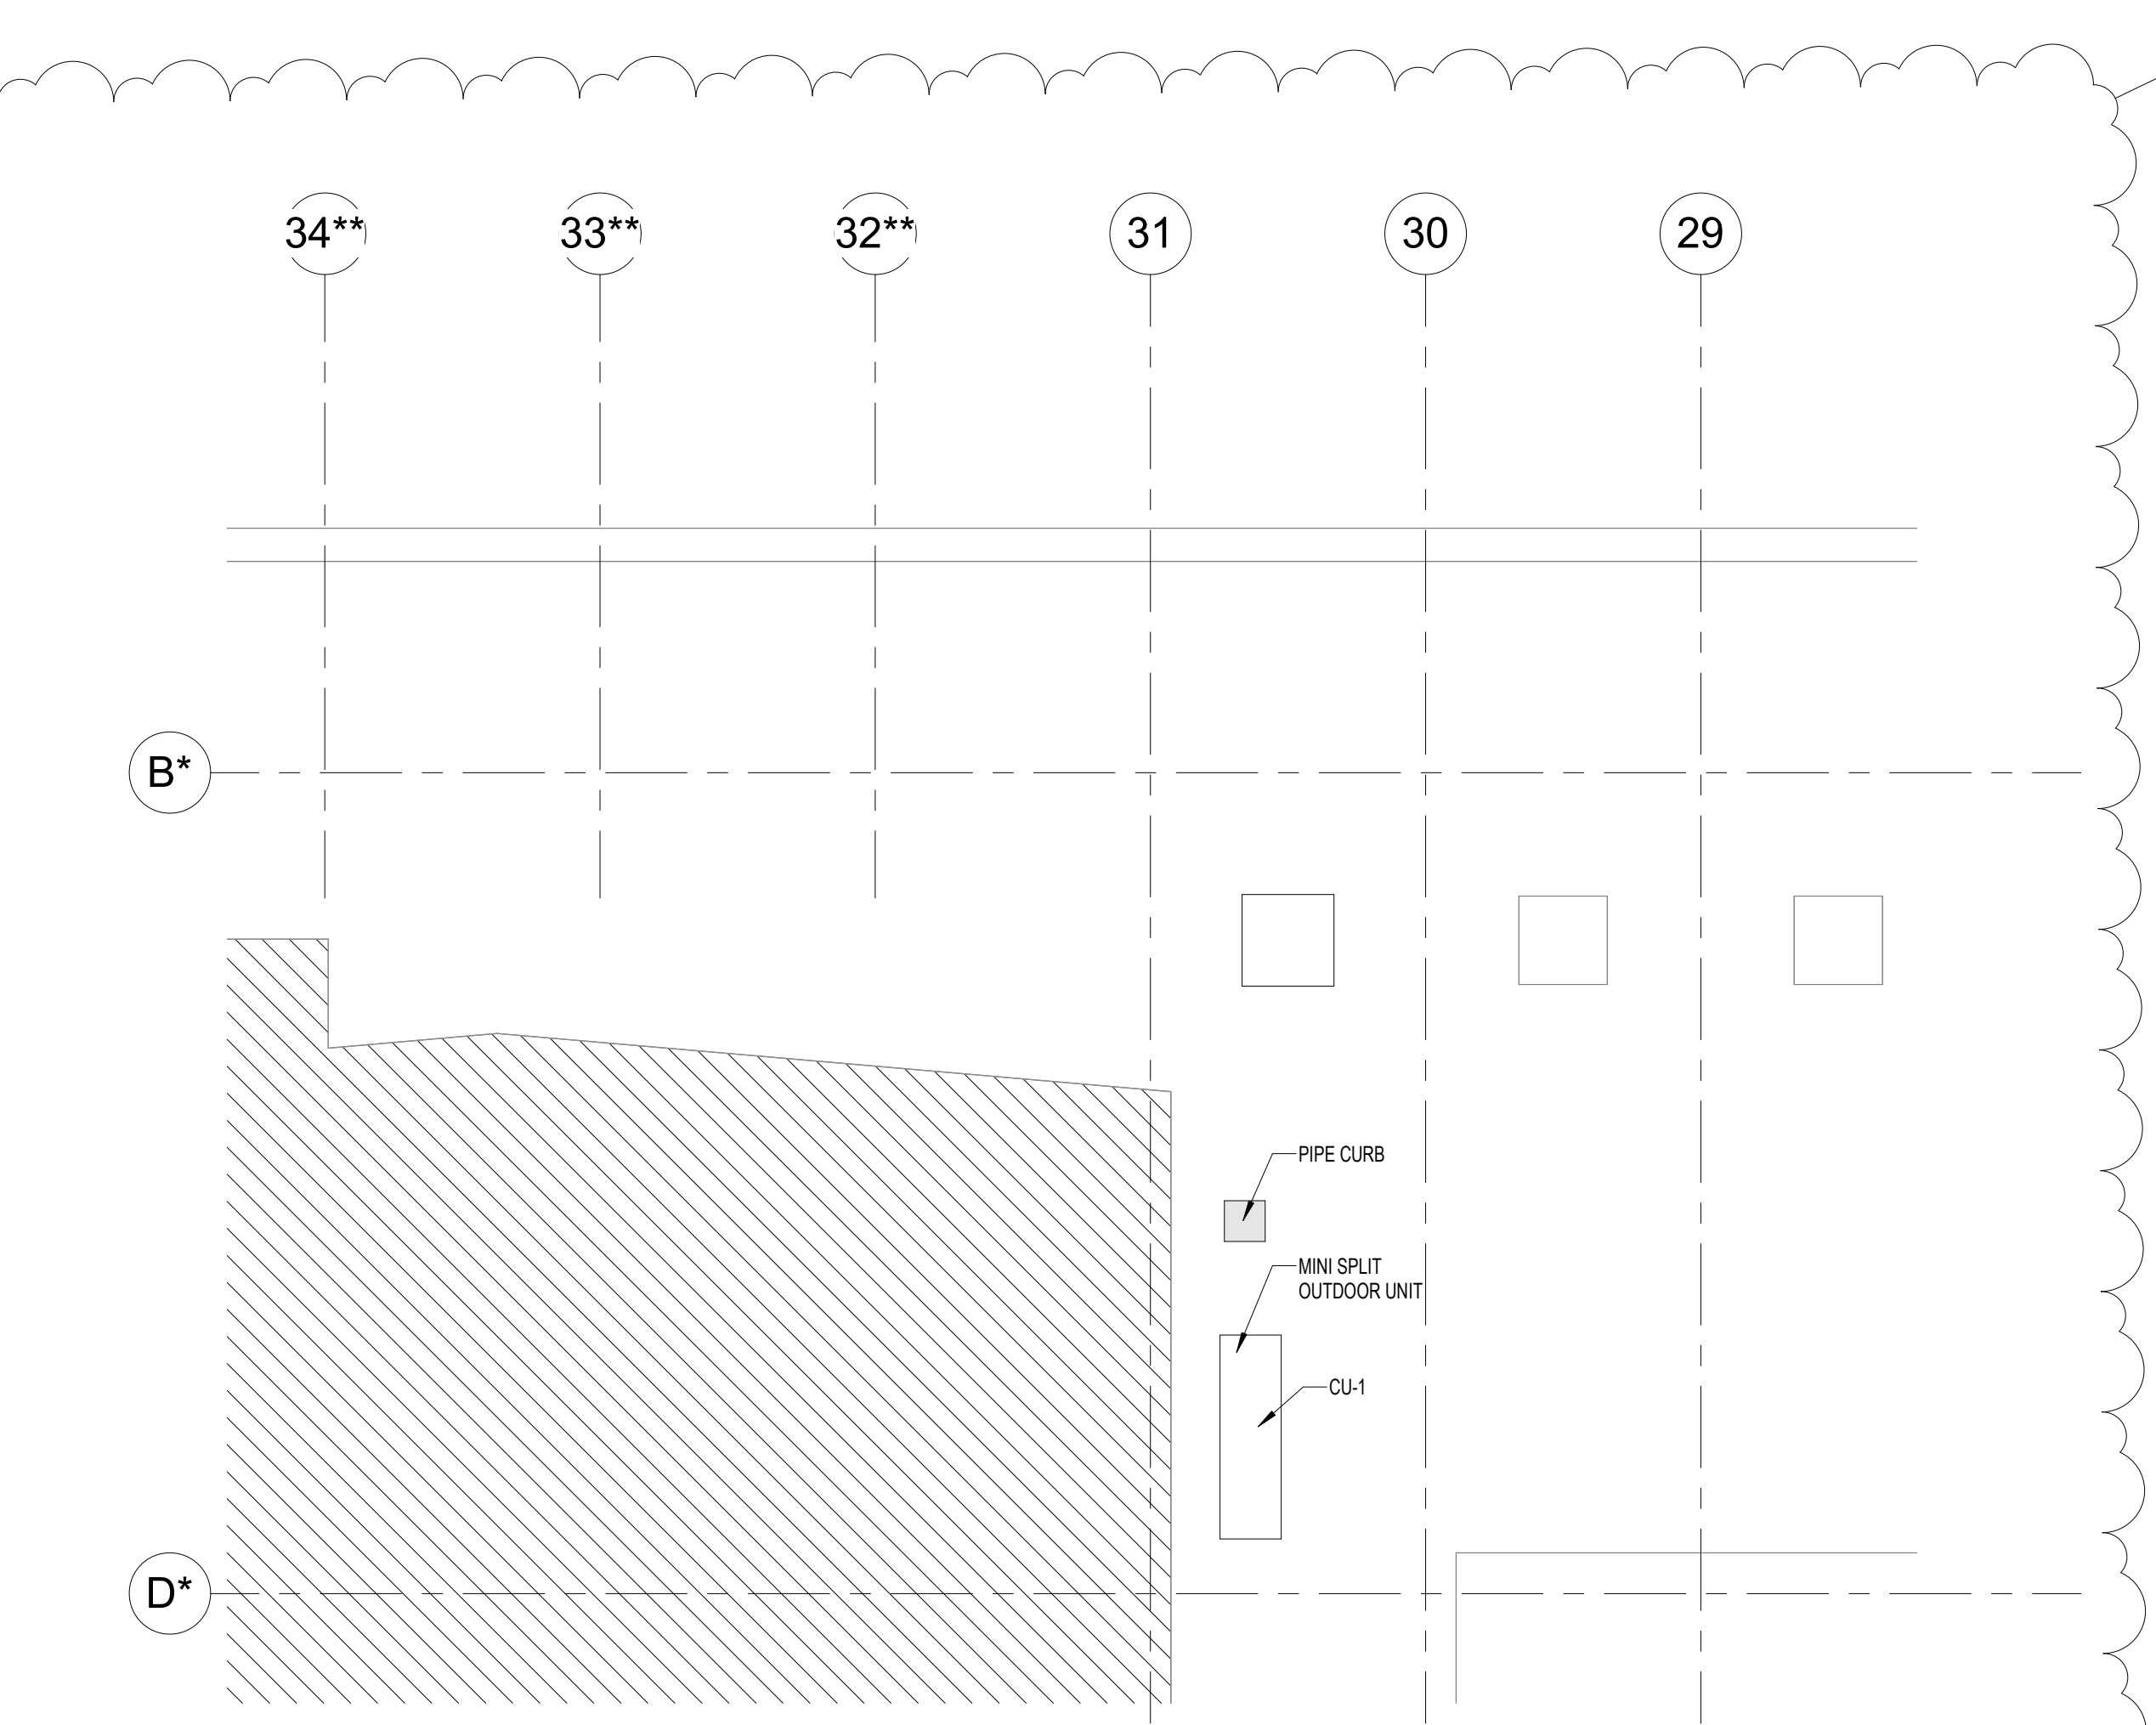

FIRE PROTECTION

- EXTEND THE EXISTING SPRINKLER SYSTEM TO INCLUDE THE VESTIBULE
- MODIFY EXISTING SPRINKLER SYSTEM AS REQUIRED FOR SECURITY ROOM AND STORAGE ROOM RECONFIGURATION
- PIPING: SCH 40 STEEL, THREADED
- HEADS: CONCEALED WITH WHITE COVER PLATE

DUCT AND PIPING

- DUCT: G90 GALVANIZED
- REFRIGERANT PIPE: PREINSULATED ACR COPPER ROLL, PROVIDE PVC JACKET FOR EXTERIOR PIPING & PIPE CURB (NOT PIPE PORTAL) FOR REFRIGERANT PIPING THROUGH ROOF
- CONDENSATE PIPE: TYPE L COPPER, SOLDER OR PRESS, 0.5" ELASTOMERIC INSULATION, TERMINATE WITH RICHARDS GV VENT CAP

TEMPERATURE CONTROLS

- TRANE CONTROLS IS EASD'S CONTROLS CONTRACTOR
- ENGAGE TRANE TO EXTEND THE EXISTING BAS TO INCLUDE EQUIPMENT INSTALLED ON THIS PROJECT
- PROVIDE GUARDS FOR THERMOSTATS IN PUBLIC AREAS
- HEATERS: OAT ENABLE, SCHEDULED OPERATION W/ OCCUPIED / UNOCCUPIED SETPOINTS & FAILURE ALARM, CONTROL MULTIPLE HEATERS SERVING THE SAME SPACE AS A GROUP
- FANS: SCHEDULED OPERATION WITH FAILURE ALARM
- MINI SPLIT: OAT ENABLE, SCHEDULED OPERATION W/ OCCUPIED / UNOCCUPIED SETPOINTS & FAILURE ALARM


MECHANICAL EQUIPMENT SCHEDULE

- HT-1&2: OUELLET ODSR ELECTRIC CEILING HEATER, TBAR MOUNT, 24V CONTROL REALSY, DISCONNECT, 5KW @ 208/1
- GRILLE A: TITUS PAR RETURN GRILLE, 12" NECK, PROVIDE LIGHT SHIELD WHEN NOT CONNECTED TO DUCTWORK
- DOOR GRILLE: TITUS T-700, 18x18, BLACK
- EF-1&2: BROAN PTE1115RK CEILING MOUNTED EXHAUST FAN, 80 CFM @ 0.25", 6" DISCHARGE, ENERGY STAR RATED, <1 SONE, 0.5 AMPS @ 120/1
- AC-1CU-1: TRANE TPLA0A0121EAB0A & TRUYA0121KA70NA MINI SPLIT SYSTEM, 12 MBH, 2X2 CASSETTE, 40F-115F OPERATING RANGE, WIND BAFFLE, SIMPLE MA THERMOSTAT
- FT-1&2: VULCAN SB-3250 ELECTRIC FIN TUBE, WALL MOUNT, 3' LENGTH, 750W @ 208/1, 14 GA COVER, CONTROL SECTION, 24V CONTROLS
- FT-3: VULCAN SB-10250 ELECTRIC FIN TUBE, WALL MOUNT, 10' LENGTH, 2500W @ 208/1, 14 GA COVER, CONTROL SECTION, 24V CONTROLS

EQUIPMENT MANUFACTURERS / VENDORS

- ELECTRIC HEATERS: OUELLET, QMARK, BERKO
- FANS: BROAN, NUTONE, PANASONIC
- FIN TUBE: VULCAN, OUELLET, INDEECO
- GRILLES: TITUS, METALAIR, PRICE
- MINI SPLIT: TRANE, MITSUBISHI
- TEST AND BALANCE: AERO, CEPRO, MECHANICAL TEST & BALANCE

KEY PLAN

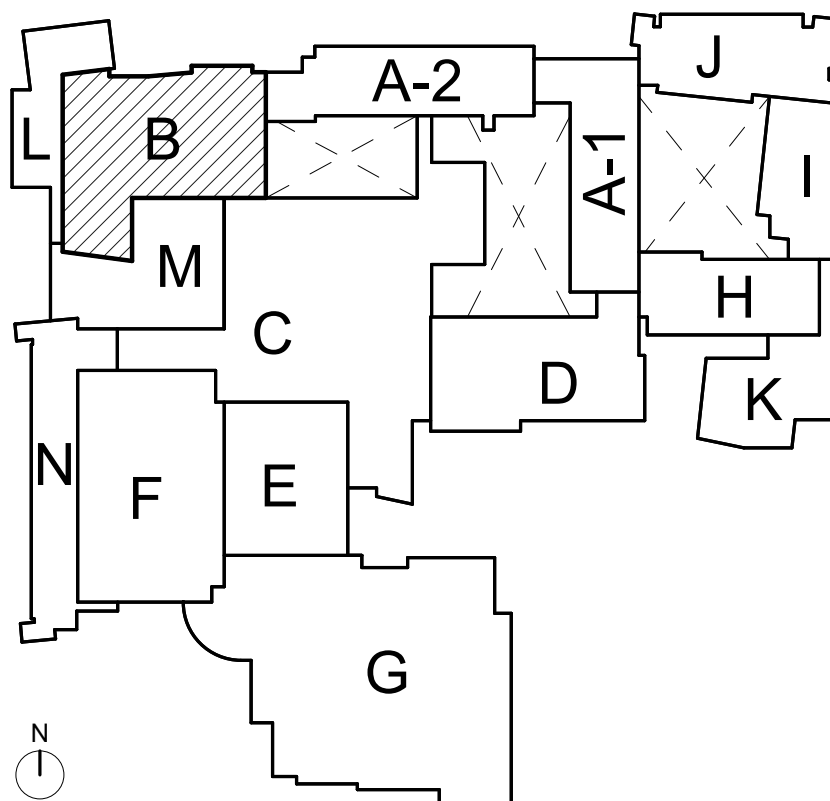

EAST AURORA SCHOOL DISTRICT #131 EAHS SECURED ENTRANCE - DOOR 1

500 TOMCAT LN.
AURORA, IL 60506

COPYRIGHT © CORDOGAN CLARK & ASSOCIATES, INC.

CC JOB NUMBER 25-1008

DATE 04.07.2026

REVISIONS:

#	Description	Date
1	ISSUED FOR BID	04.07.26
1	ADDENDUM 01	04.14.26

DRAWING TITLE:
PARTIAL
MECHANICAL FIRST
FLOOR PLANS -
AREA B


M1.00-B

ADDENDUM 01 - 04.14.2026

4/14/2026 2:29:16 PM

PANEL	RP26		PHASE		3P4W		VOLTAGE		208	
TYPE	SQUARE D NQ		AMPS		100		MAIN:		LUGS:	
LOCATION	SEC B101		MOUNTING		SURFACE				X	
								BREAKER		

AMPS	P	LOCATION		VA	A	B	C	VA		LOCATION	P	AMPS
20	1	RECEP. SECURITY ROOM B101	1	360	2860			2500	2	HT-1	2	35
20	2	ELECTRIC FIN TUBE FT-12.3	3	1625		4125		2500	4		X	X
X	X	(STORAGE AND SECURITY RM)	5	1625			4125	2500	6	HT-2	2	35
25	2	AC-1CU-1 VESTIBULE MINI SPLIT	7	832	3332			2500	8		X	X
X	X		9	832		952		120	10	EF-1 & EF-2	1	20
			11				180	180	12	DOOR POWER SUPPLIES	1	20
			13		0				14			
			15			0			16			
			17				0		18			
				6192	5077	4305	VA					
				51.6	42.31	35.88	AMPS					
TOTAL WATTAGE:				15574								
CONNECTED LOAD:				43								

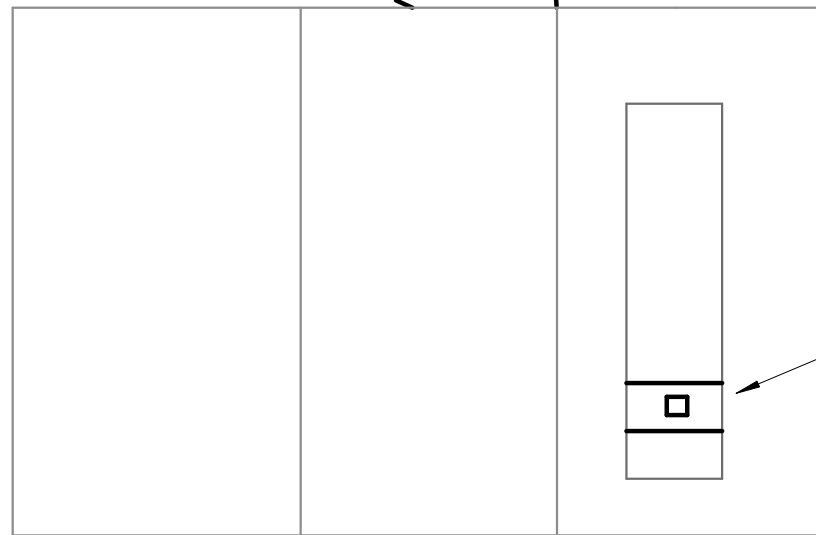

"MSP-2"
EXISTING QED
SERIES 2
SQUARE D
SWITCHBOARD


NEW 3-POLE 100A CIRCUIT
BREAKER, MINIMUM 25 kA
INTERRUPTING RATING

4#2 1#8 1-1/2"C


RP26
100A
3PH 4W
18CT
MLO
22 kAIC

4 NEW PANELBOARD AND EXISTING SWITCHBOARD DETAILS


EQUIPMENT HOOK-UP SCHEDULE:			PROVIDE COMPLIANT HOOKUPS, LOOSE STARTERS AND DISCONNECTS, INTERLOCKS, AND ROOF PENETRATIONS AS REQ'D															
TAG	DESCRIPTION	LOC.	MCA	KW	HP	VOLT	PHASE	SOURCE	DCP	AMPS	PHASE	FUSE	STARTER				NOTES: INCLUDE THE FOLLOWING WORK	
AC-1/1CU-1	SPLIT SYSTEM	ROOF	INDOOR 2; OUTDOOR 11			208	1	RP26-7.9	25/2	30	2	N.F.	PACKAGED			2#10, 1#10G	1/2"	INDOOR UNIT POWERED FROM OUTDOOR UNIT TERMINALS
EF-1	EXHAUST FAN	B100			FRACTIONAL	120	1	RP26-10	20/1	1-P SWITCH			VIA RELAY BY T.C.C.			2#12, 1#12G	1/2"	COMPLIANT HOOK-UP: INSTALL RELAY FURNISHED BY T.C.C.
EF-2	EXHAUST FAN	B101			FRACTIONAL	120	1	RP26-10	20/1	1-P SWITCH			VIA RELAY BY T.C.C.			2#12, 1#12G	1/2"	COMPLIANT HOOK-UP: INSTALL RELAY FURNISHED BY T.C.C.
FT-1	ELECTRIC FIN TUBE	B101		0.75		208	1	RP26-3.5	20/2	INTEGRAL BY MFR			LOW VOLTAGE T-STAT BY TCC			2#12, 1#12G	1/2"	COORDINATE T-STAT LOCATIONS WITH TCC
FT-2	ELECTRIC FIN TUBE	B101		0.75		208	1	RP26-3.5	20/2	INTEGRAL BY MFR			LOW VOLTAGE T-STAT BY TCC			2#12, 1#12G	1/2"	COORDINATE T-STAT LOCATIONS WITH TCC
FT-3	ELECTRIC FIN TUBE	2		2.5		208	1	RP26-3.5	20/2	INTEGRAL BY MFR			LOW VOLTAGE T-STAT BY TCC			2#12, 1#12G	1/2"	COORDINATE T-STAT LOCATIONS WITH TCC
HT-1	ELECTRIC HEATER	B100			5	208	1	RP26-2.4	35/2	INTEGRAL BY MFR			LOW VOLTAGE T-STAT BY TCC			2#12, 1#12G	1/2"	COORDINATE T-STAT LOCATIONS WITH TCC
HT-2	ELECTRIC HEATER	B100			5	208	1	RP26-6.8	35/2	INTEGRAL BY MFR			LOW VOLTAGE T-STAT BY TCC			2#12, 1#12G	1/2"	COORDINATE T-STAT LOCATIONS WITH TCC

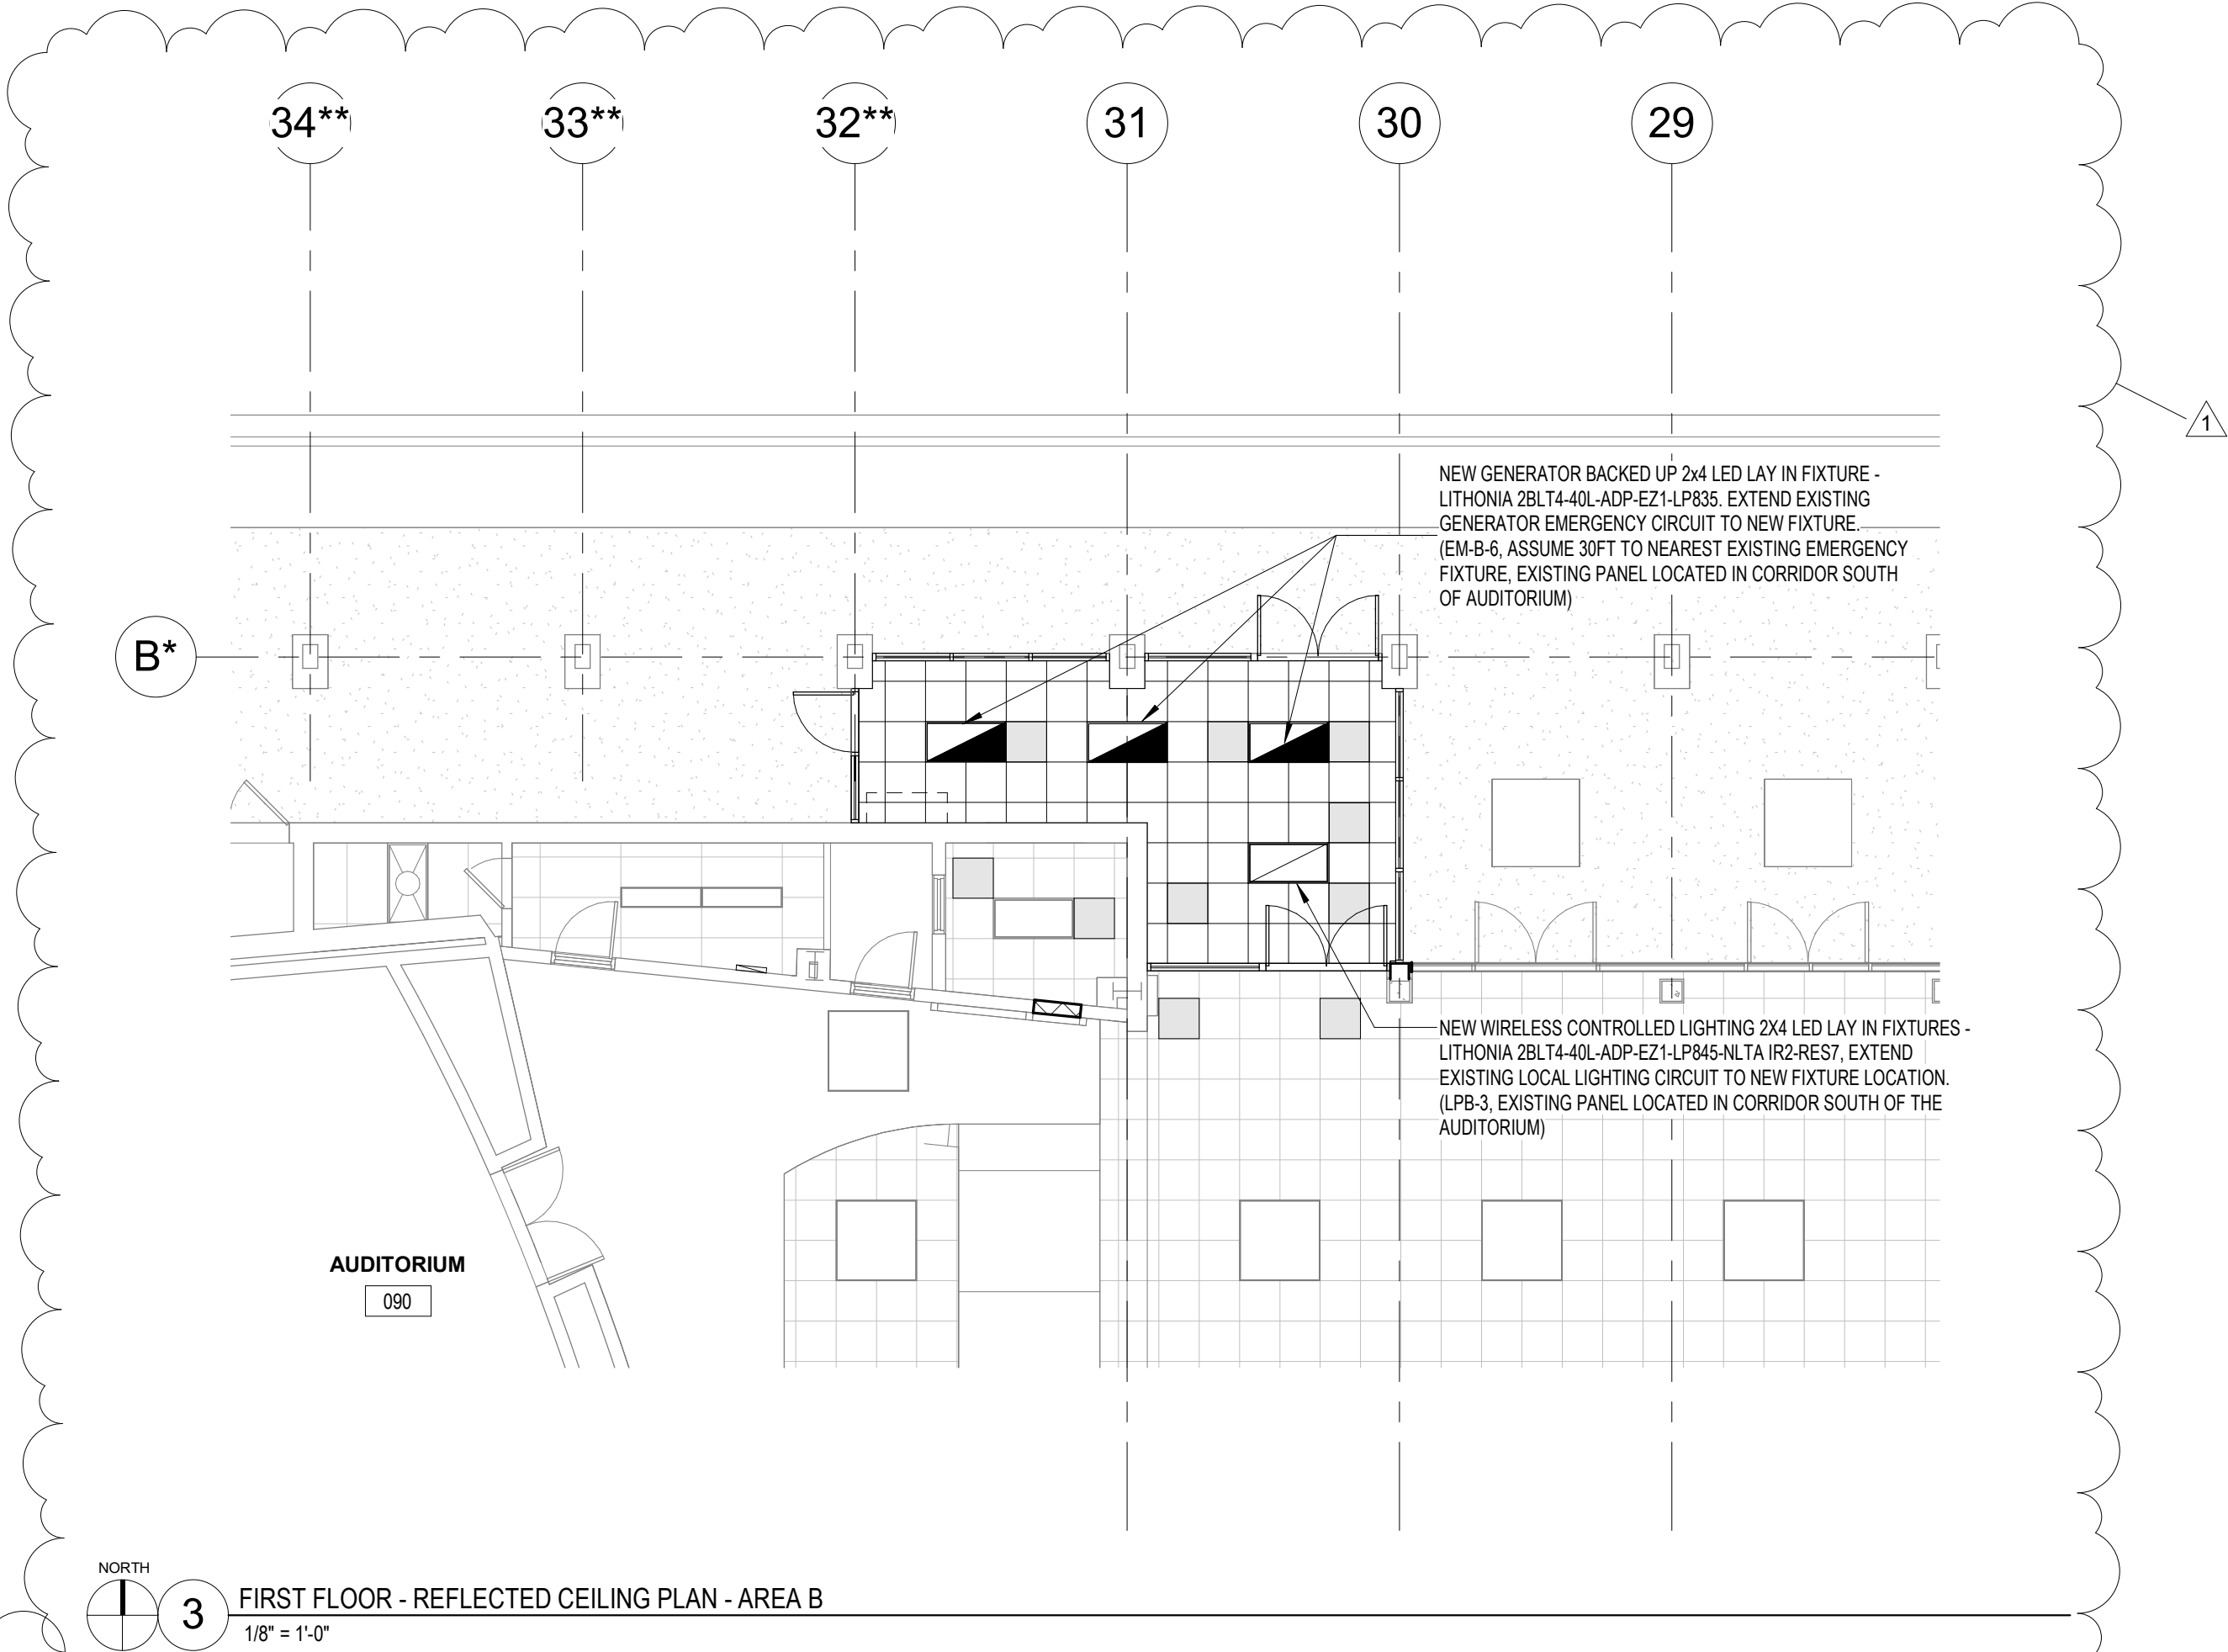

3 FIRST FLOOR - REFLECTED CEILING PLAN - AREA B
1/8" = 1'-0"

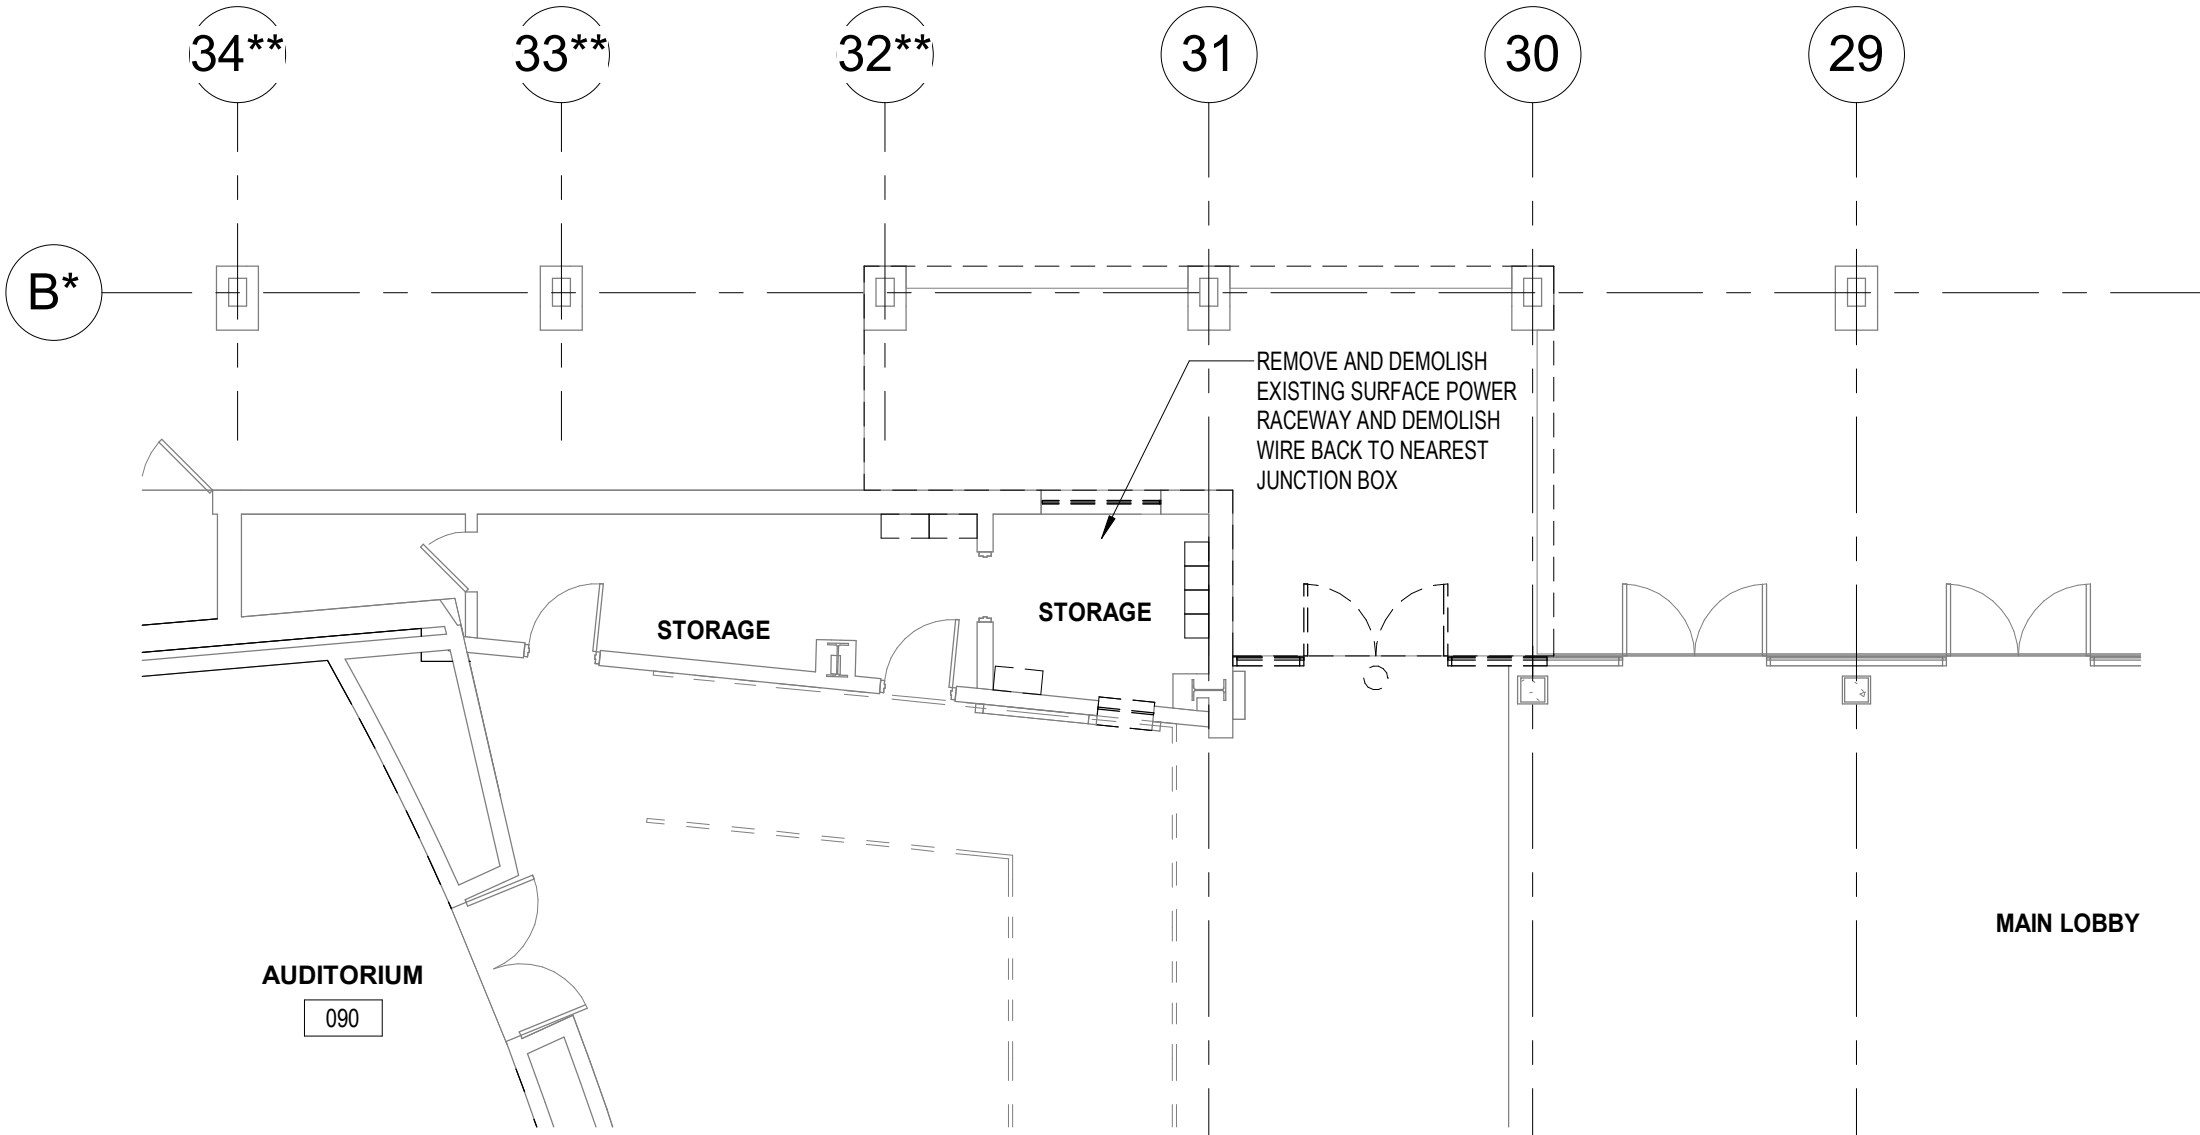


1 FIRST FLOOR - ELECTRICAL DEMOLITION PLAN - AREA B
1/8" = 1'-0"

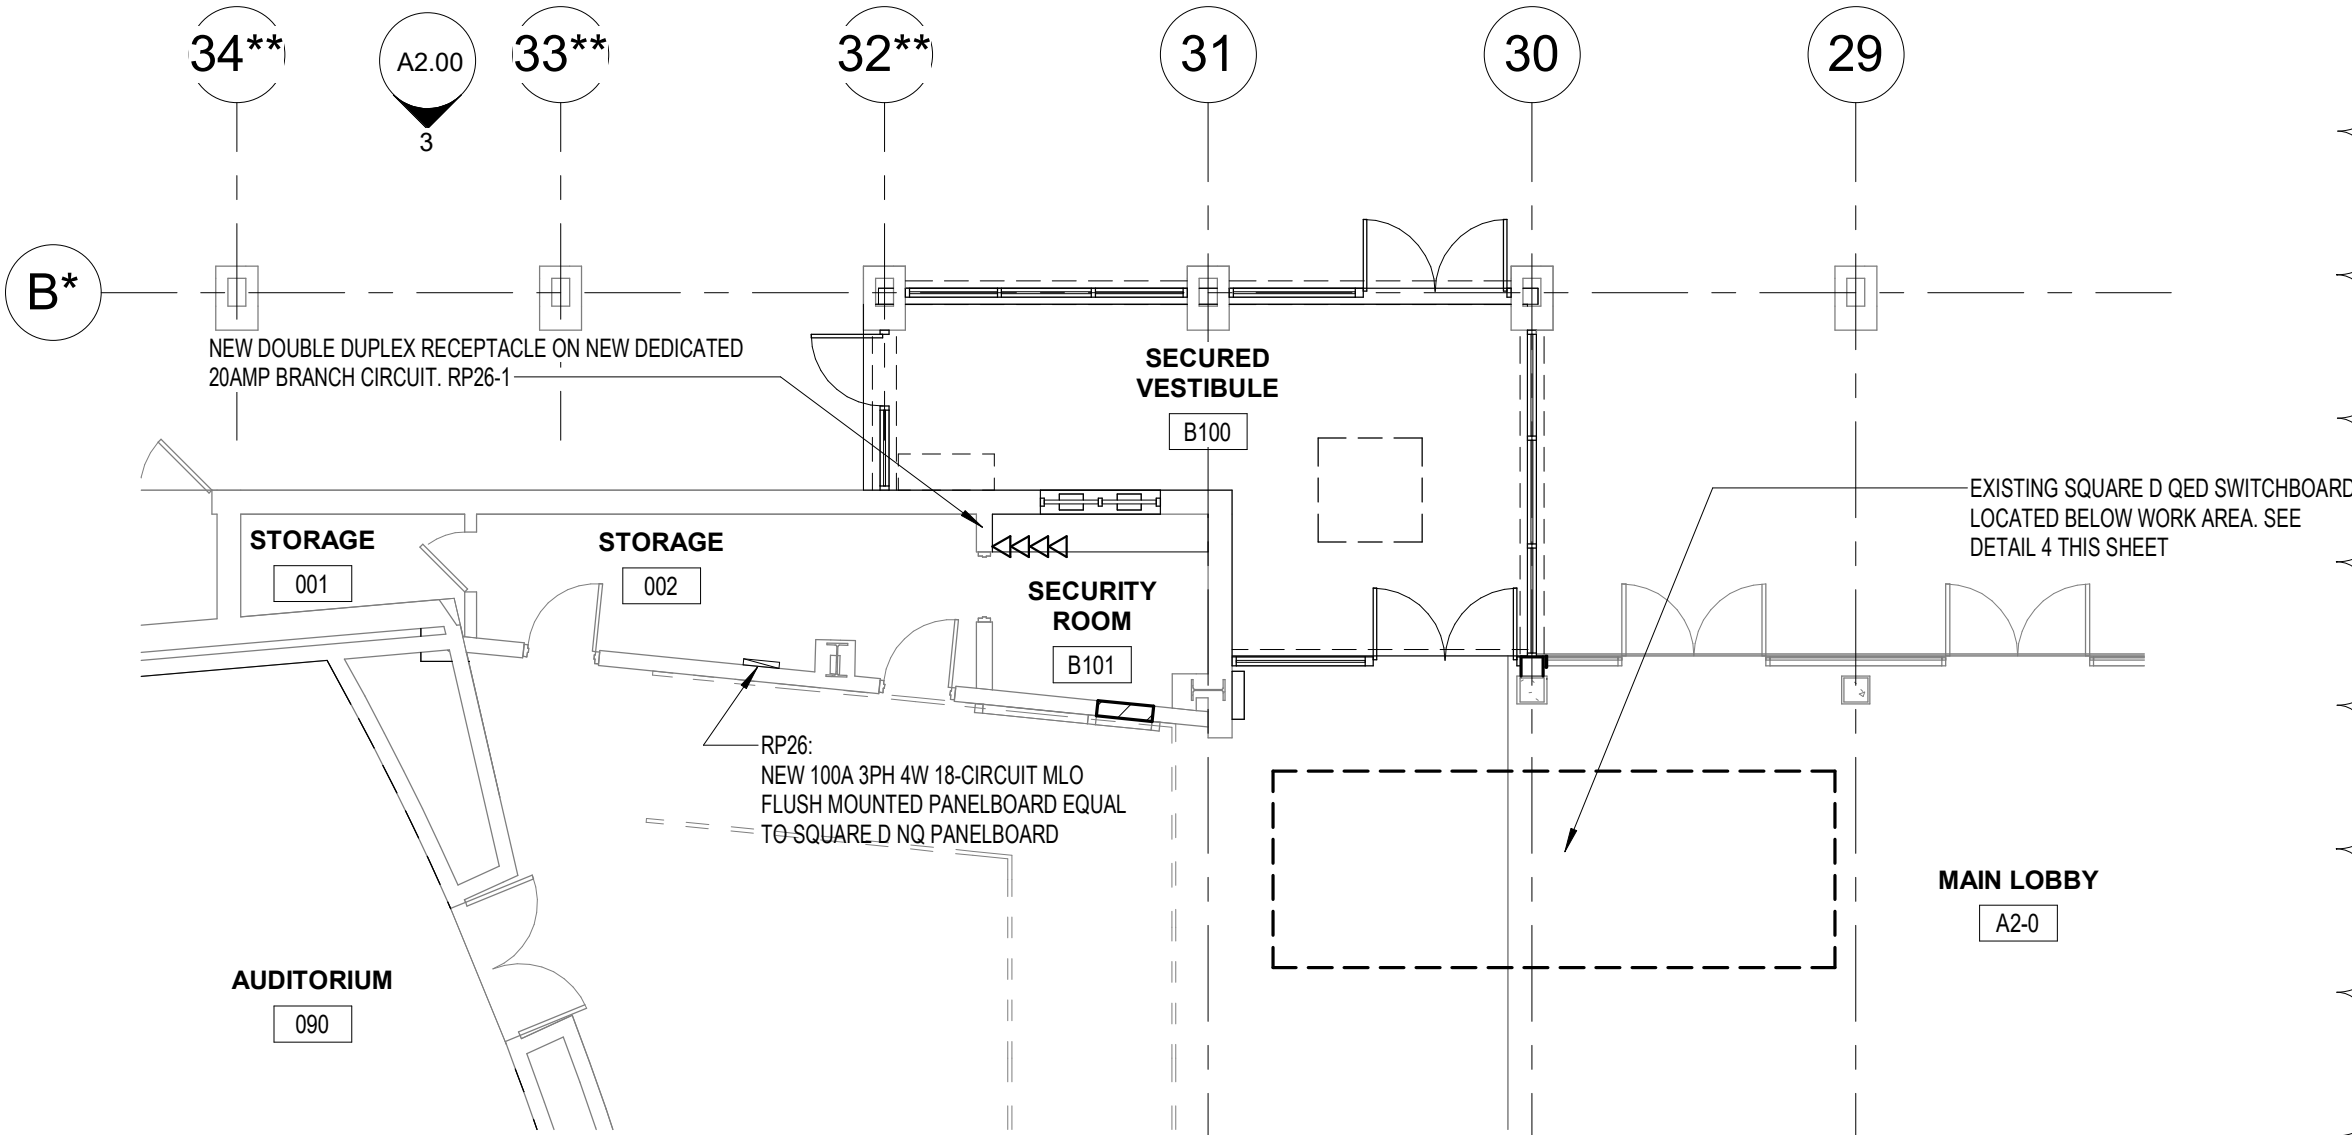

2 FIRST FLOOR - ELECTRICAL NEW WORK PLAN - AREA B
1/8" = 1'-0"

KEY PLAN

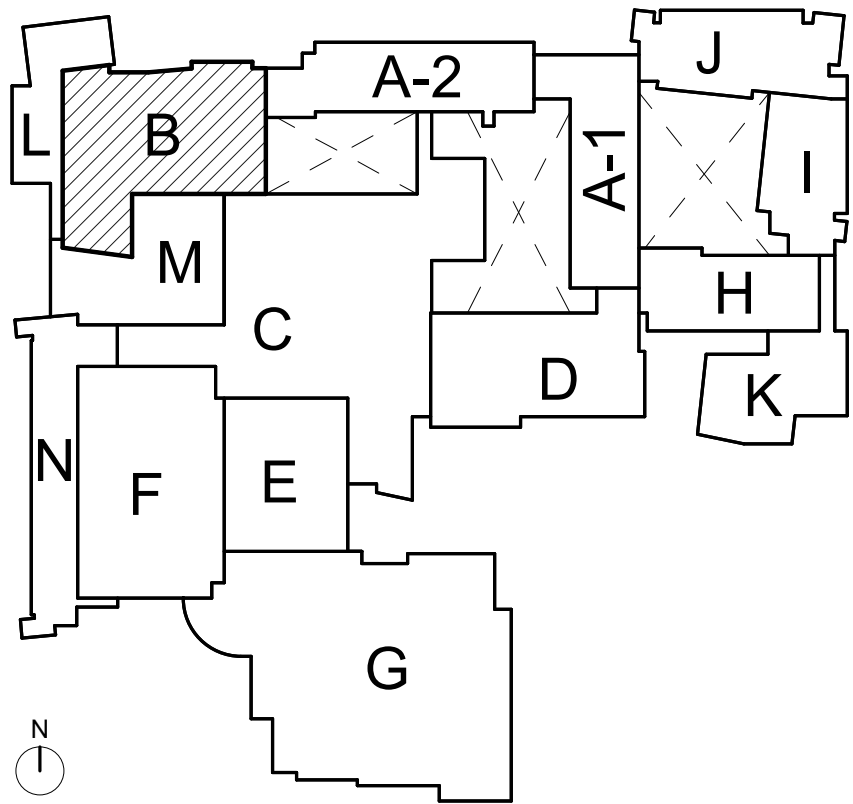

- GENERAL ELECTRICAL NOTES**
- ELECTRICAL CONTRACTOR SHALL VERIFY FINAL EQUIPMENT VOLTAGE AND CIRCUIT REQUIREMENTS WITH THE SELECTED MECHANICAL EQUIPMENT. PROVIDE COMPLIANT CONNECTIONS TO EQUIPMENT AS INDICATED ON THE PLANS ON THE MECHANICAL PLANS.
 - DOORS SCHEDULED TO BE PROVIDED WITH ACCESS CONTROL HARDWARE SHALL BE COORDINATED WITH THE ELECTRICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL PROVIDE AND COORDINATE CONDUIT ROUGH-IN TO DOOR FRAMES FOR ACCESS CONTROL HARDWARE. ELECTRICAL CONTRACTOR SHALL PROVIDE 120 V BRANCH CIRCUIT TO DOOR POWER SUPPLIES PROVIDED WITH THE DOOR HARDWARE. COORDINATE EXACT POWER REQUIREMENTS AND LOCATIONS WITH DOOR HARDWARE SUPPLIER.