
CALL 811
BEFORE DIGGING

ALL FIBER TO BE PLACED
IN SMOOTH SIDED INNERDUCT
UNLESS IN EXISTING CONDUIT

ALL BUILDING INNERDUCT
SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW
INDUSTRY STANDARDS FOR
PLACING FIBERS 36" MINIMUM
DEPTH

USD 261 Boundary Map

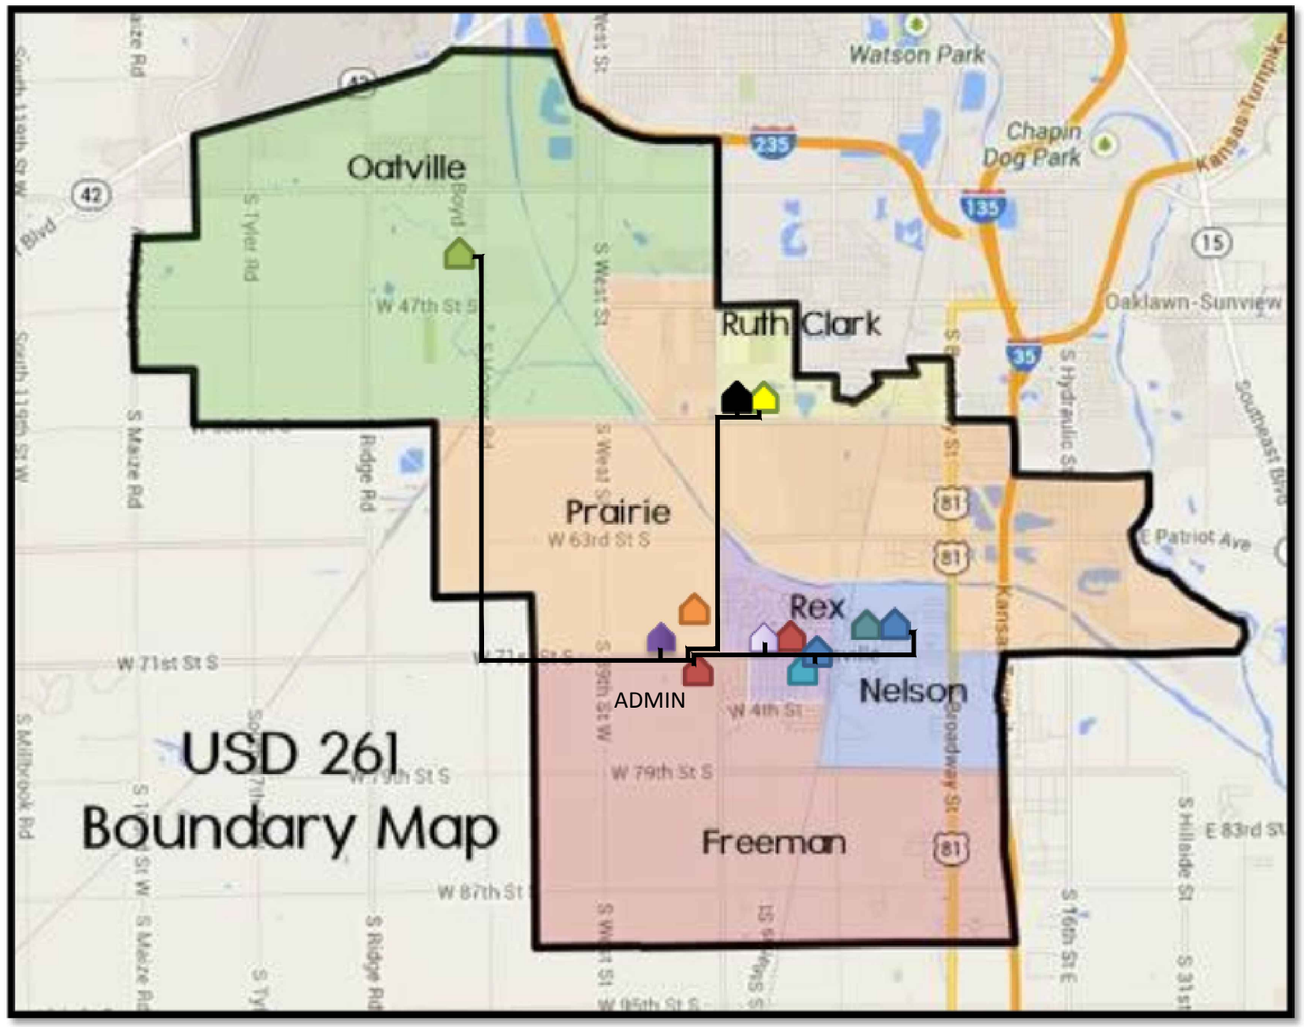

MAP GUIDE

Elementary Schools
- Oatville
- Prairie
- Ruth Clark
- Freeman
- Rex Elementary
- Nelson

Middle Schools
- **Haysville West**
  Feeder Schools
  - Oatville
  - Prairie
- **Haysville Middle**
  Feeder Schools
  - Freeman
  - Rex
  - Nelson
  - Ruth Clark

High Schools
- Campus High
- Haysville High

Other
- Tri-City Day School
- Parents As Teachers

USD 261

N


CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944


NOTES

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	Loc Map
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

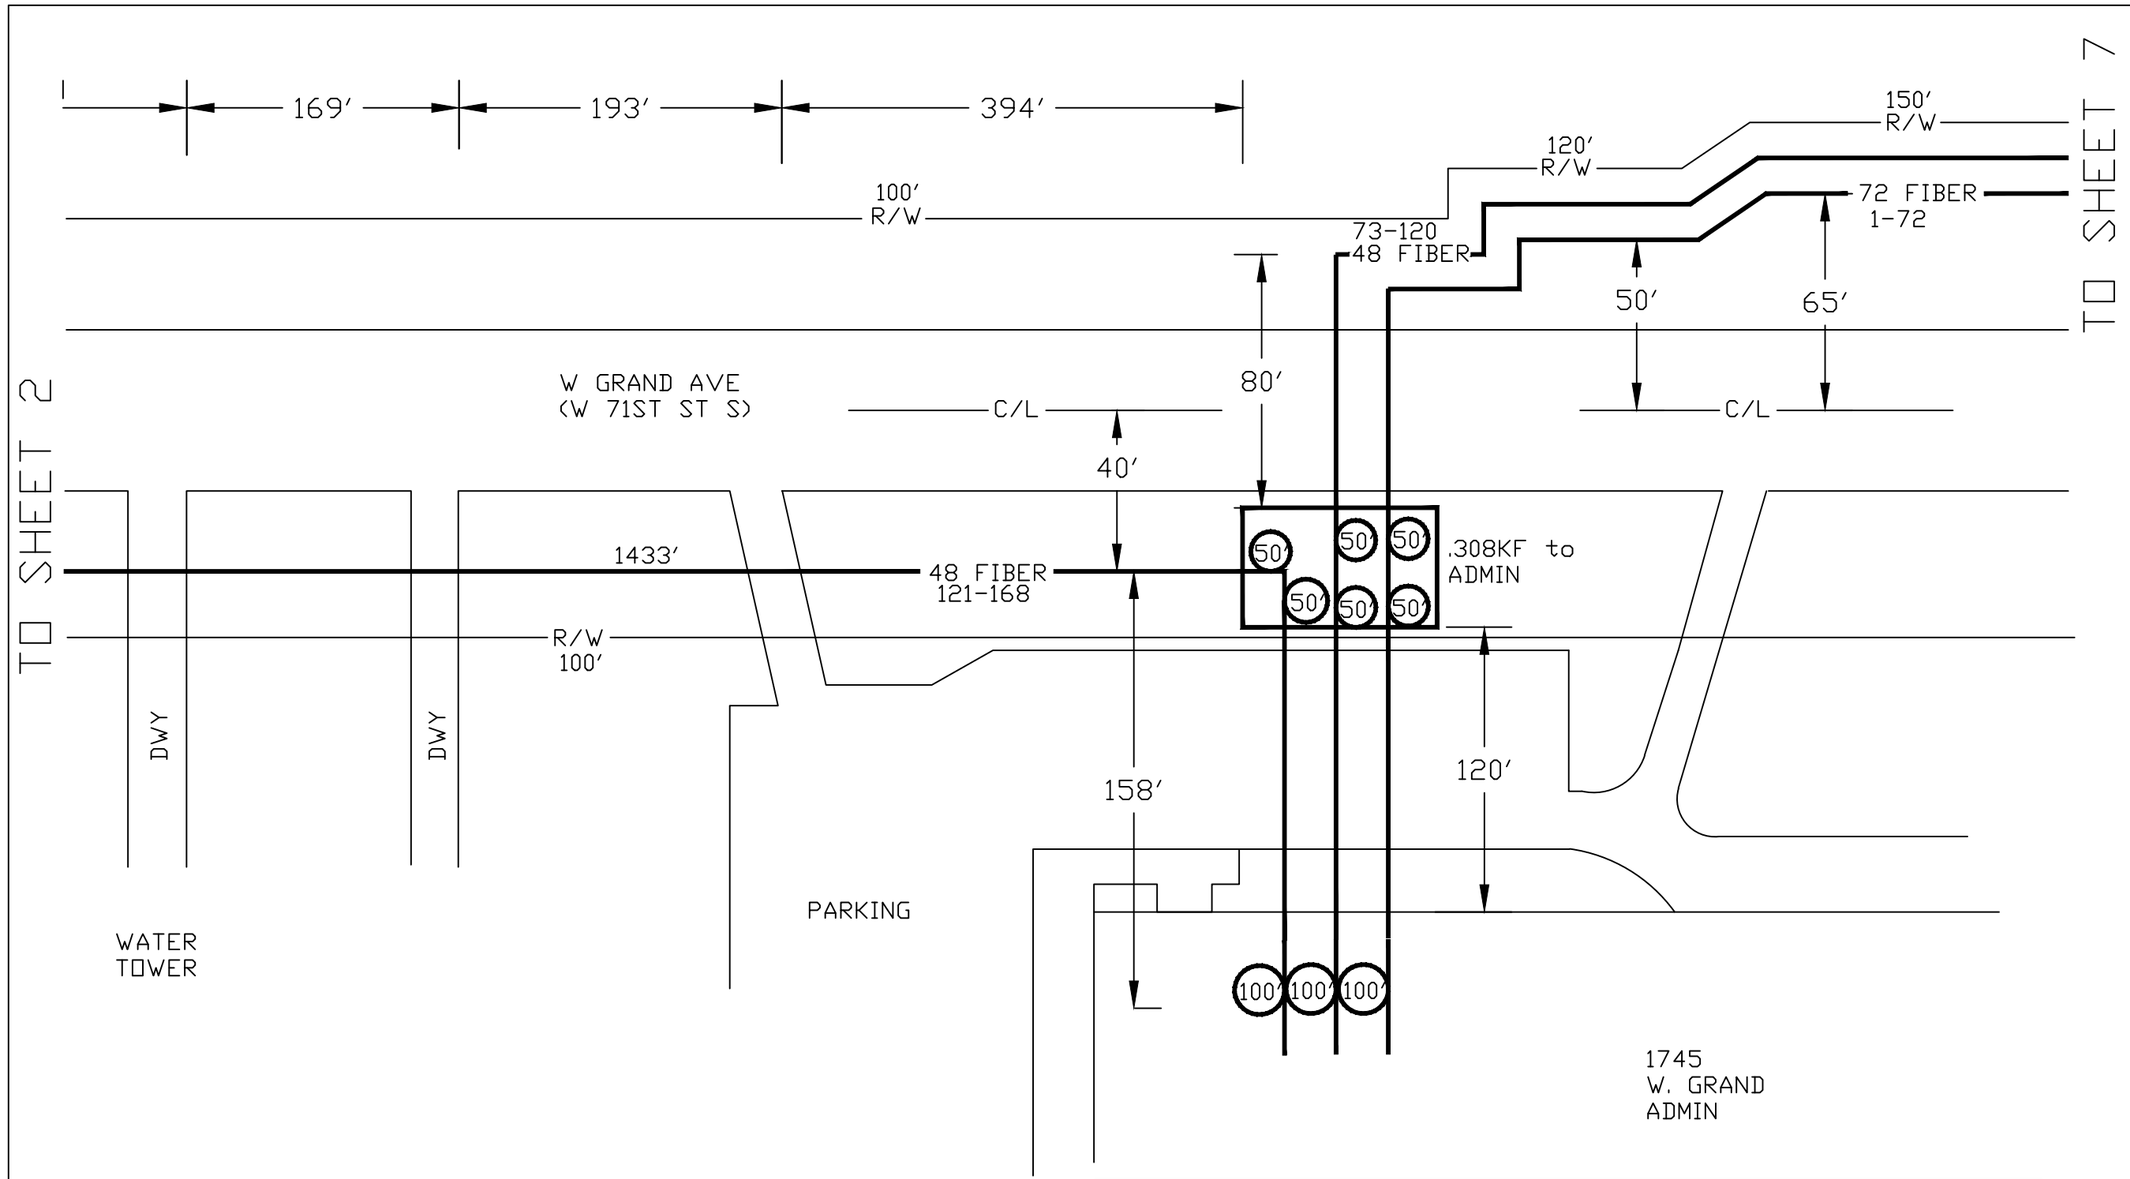

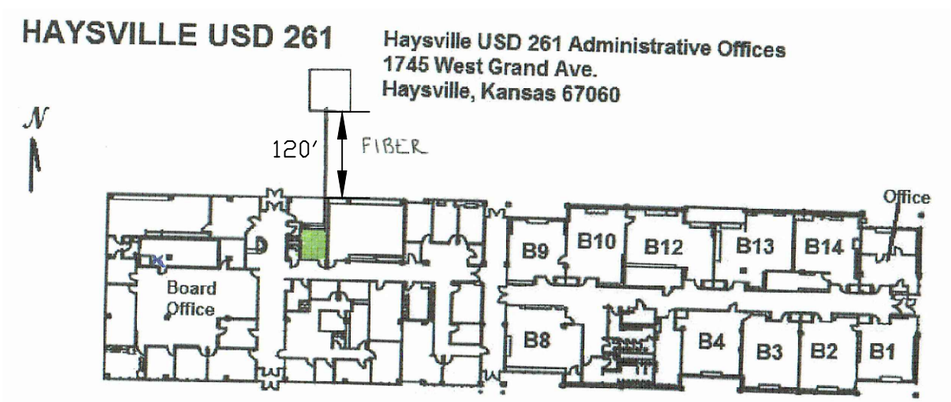

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT


ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36″ MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	1
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

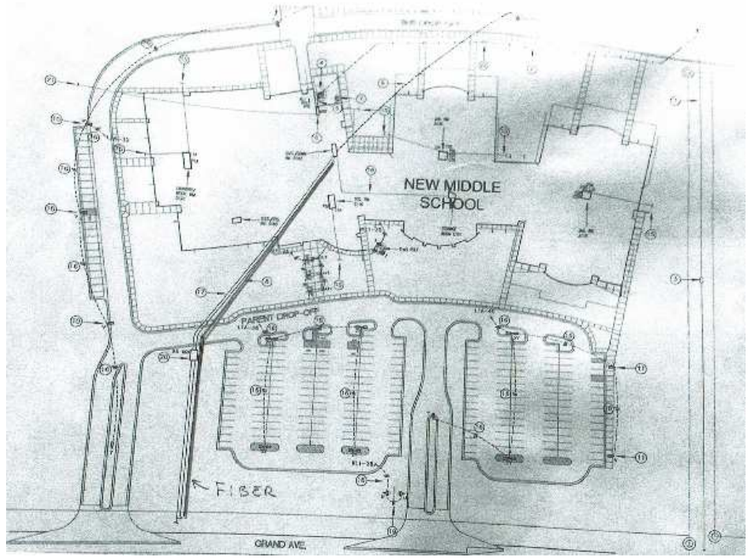

HAYSVILLE WEST MIDDLE SCHOOL

250' EXISTING 2-4" PVC

379'

EXIST HH

175' 515' 1178' 2584' 153' 420'

S WEST ST

100' R/W

50 50

SET HANDHOLE OVER 2 - 4" PVC

W 71ST ST S

C/L

35'

5.703KF to ADMIN

C/L

40'

4.425KF to ADMIN

200' 24 FIBER 145-168

W GRAND AVE (W 71ST ST S)

C/L

40'

TO SHEET 3

2730'

1278'

50' 50'

2684' 24 FIBER 121-144

48 FIBER 121-168

R/W 40' C/L

R/W 45' TO C/L

R/W 50' TO C/L

1.741KF to ADMIN

R/W 100'

TO SHEET 1

FE

DWY

30'

C/L

P/L

4133

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT


ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36" MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	2
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

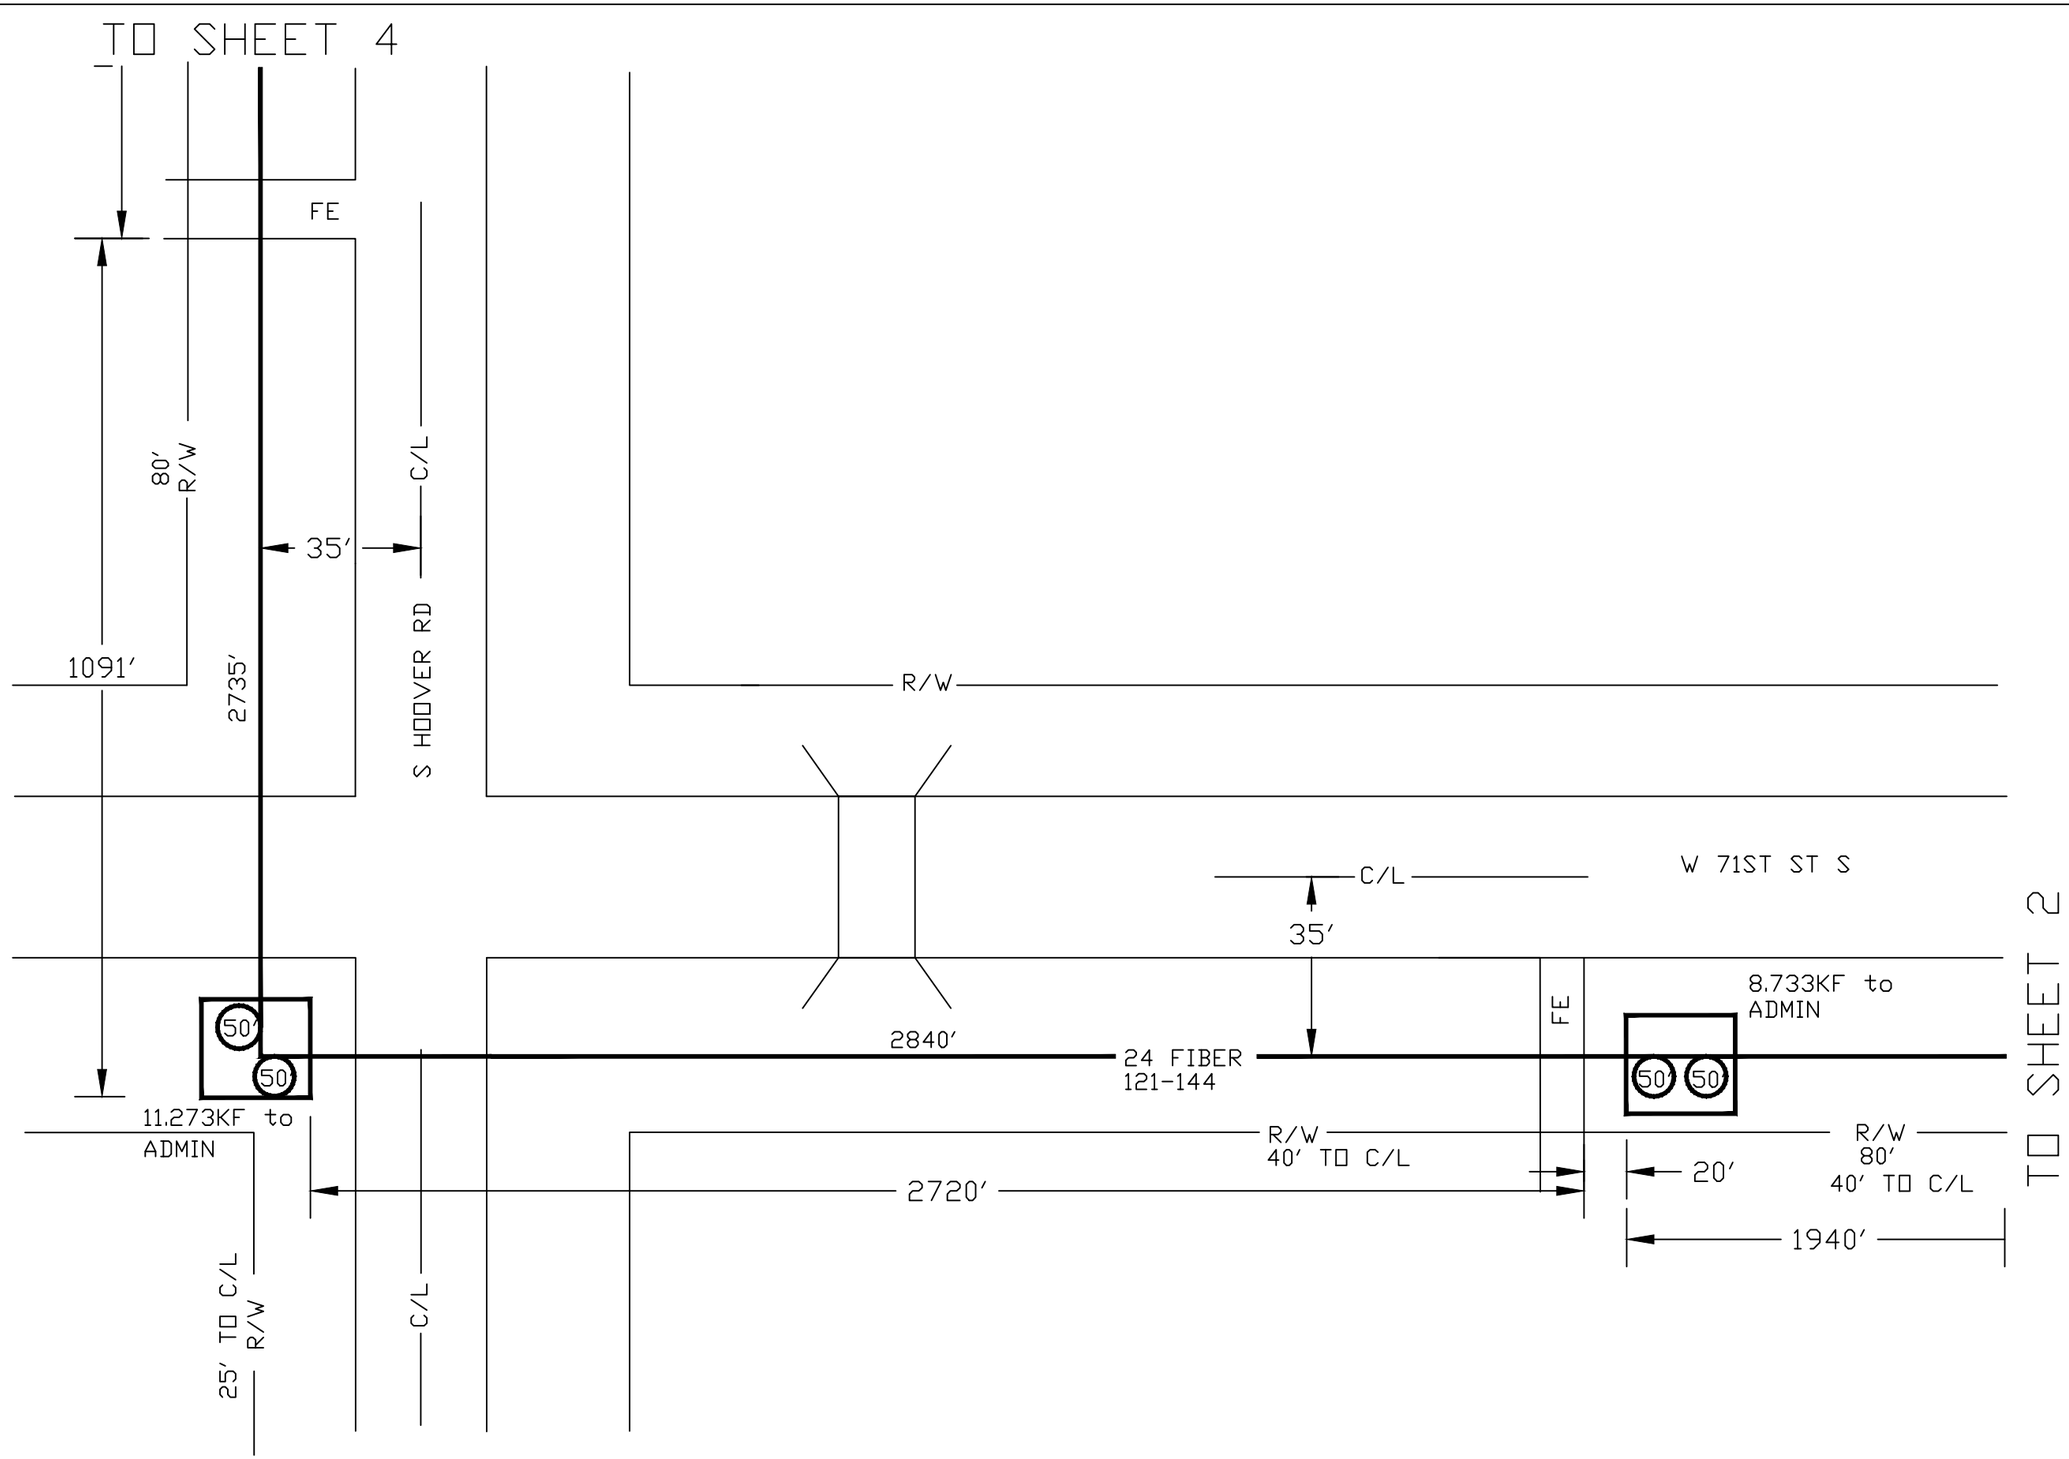

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT

ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36" MINIMUM DEPTH


DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	3
PLOT DATE	
12/16/2015	

FILE NAME

USD 261

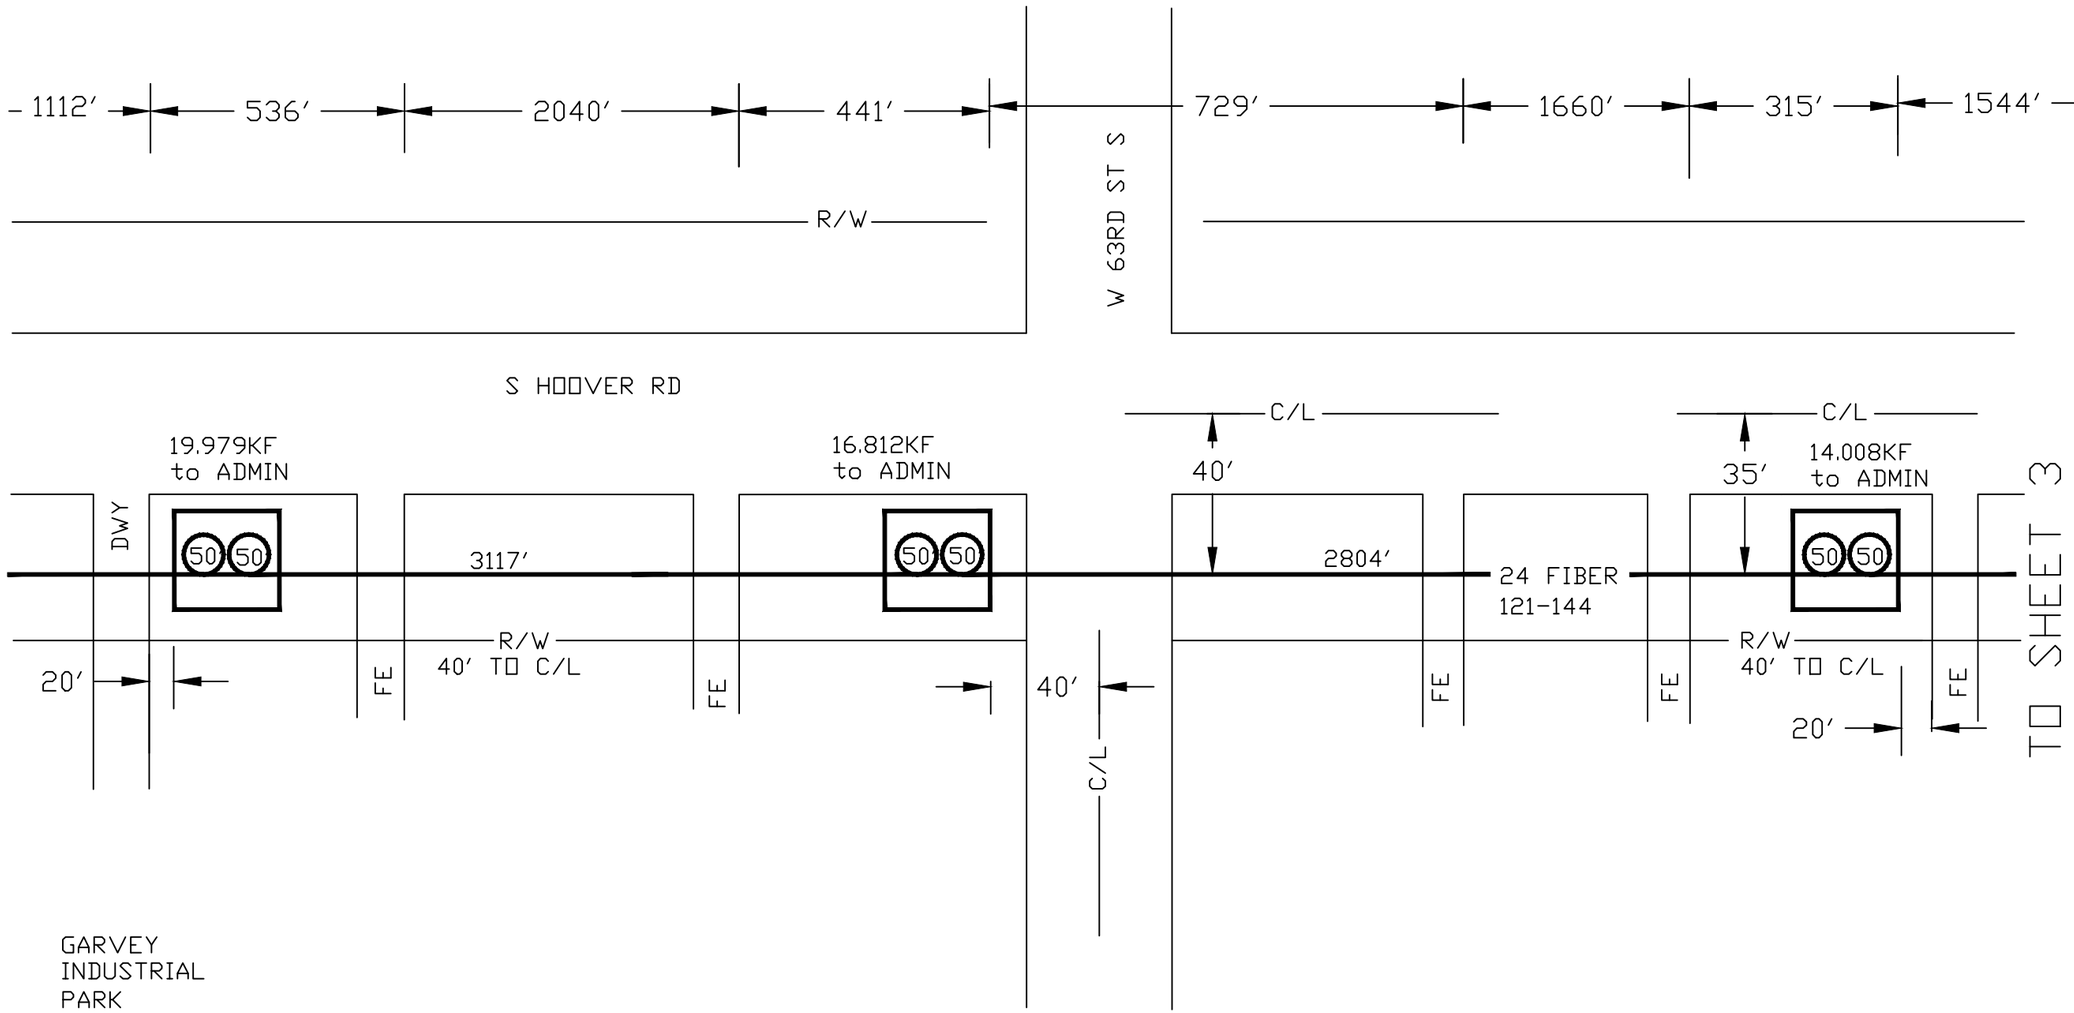

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT


ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36″ MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	4
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

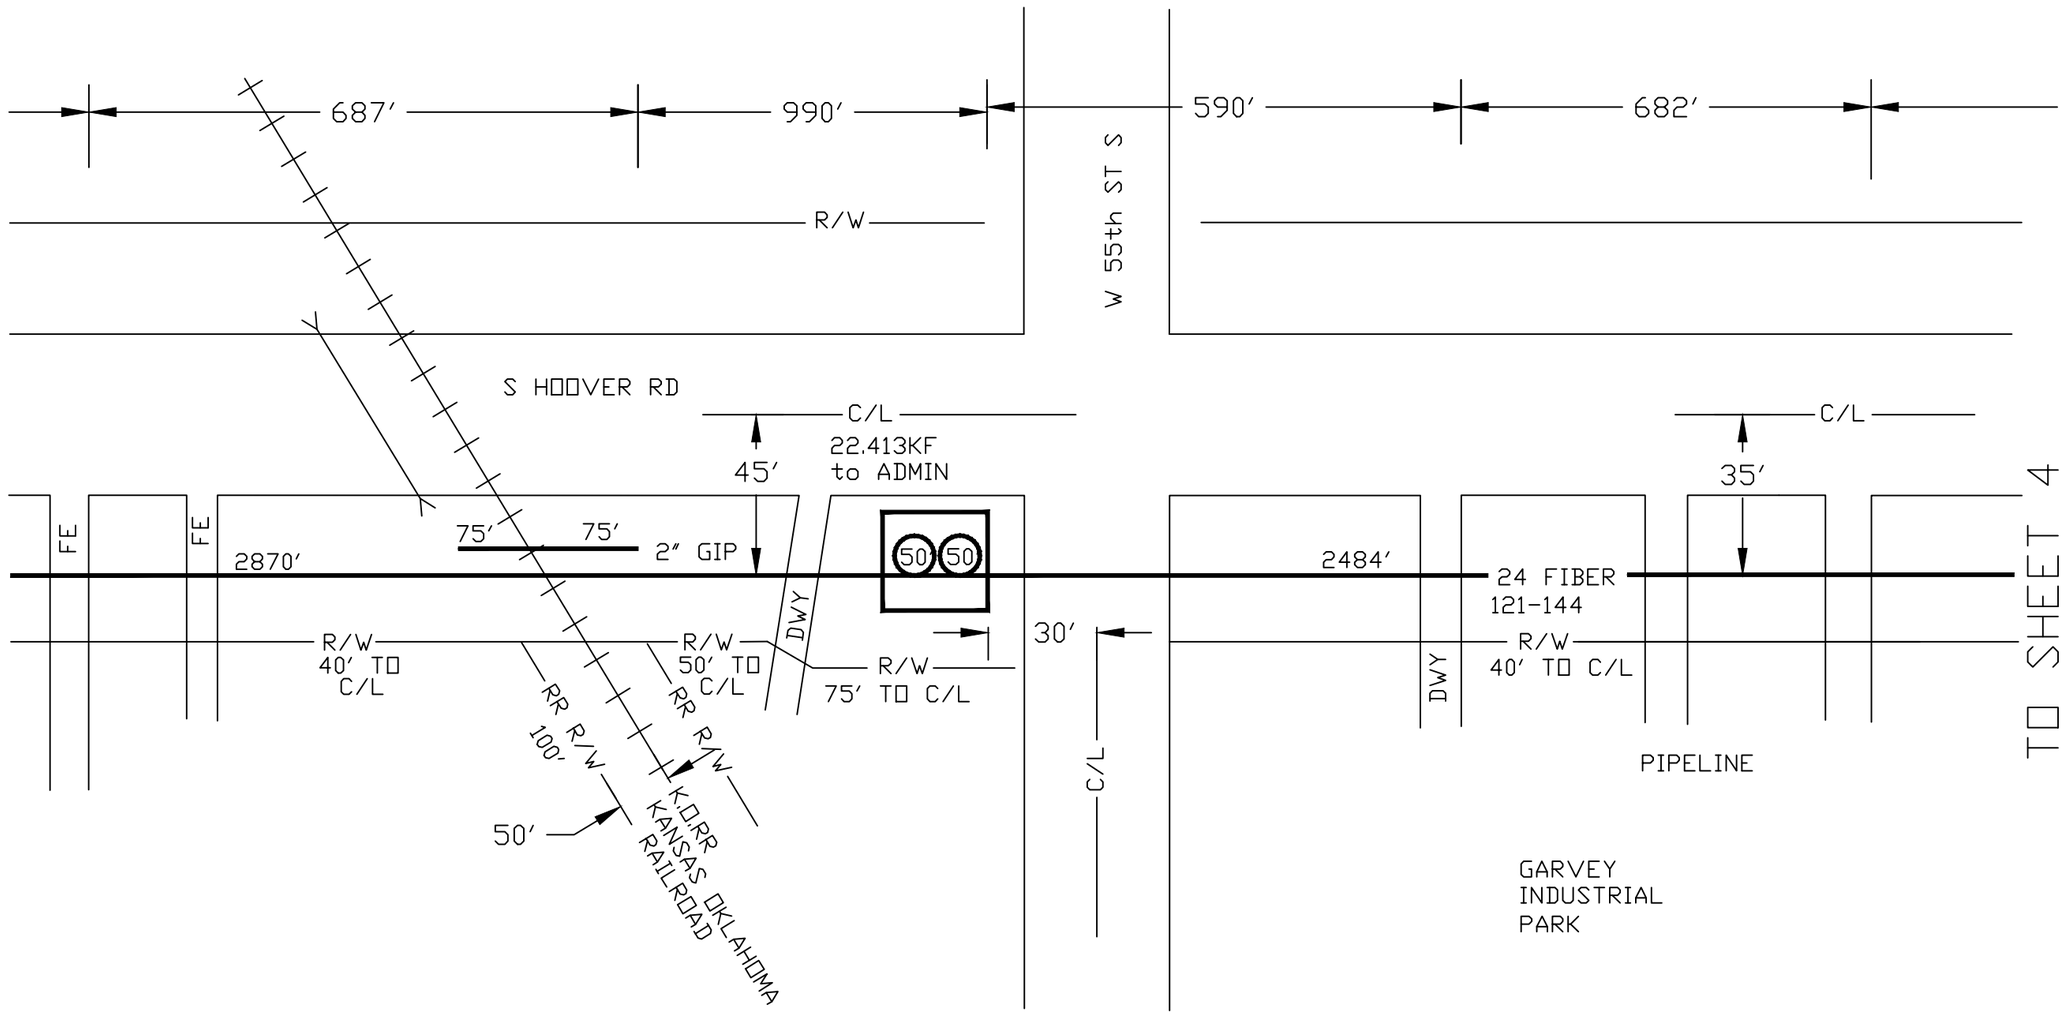

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT

ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36″ MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	5
PLOT DATE	
12/16/2015	

FILE NAME

USD 261

USD 261

BORE 450'
5' BELOW
FLOW LINE

220' 60' 2557' 1387' 1267' 1093'

R/W

S HOOVER RD

C/L C/L C/L

30.974KF
to ADMIN

35' 28.037KF
to ADMIN

35' 20' 25.283KF
to ADMIN 35'

50' 50' DWY FE 2937' 50 50 2754' 24 FIBER 121-144 FE 50 50

TO SHEET 5

R/W 40' TO C/L 30' R/W 40' TO C/L R/W 25' TO C/L R/W 40' TO C/L

5' 129'


SCHOOL SIGN

BORE INTO TUNNEL

C/L W 47th ST S

PIPELINE

OATVILLE
31.103KF
to ADMIN

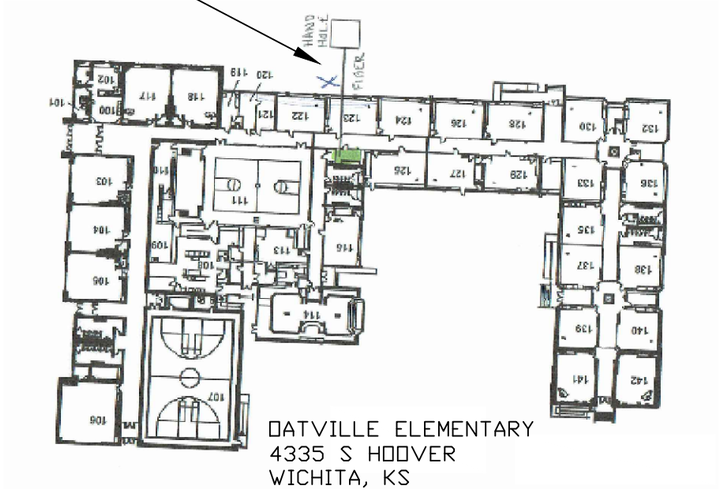

OATVILLE ELEMENTARY
4335 S HOOVER
WICHITA, KS

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT

ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36" MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	6
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

TO SHEET 12

219′ | 70′ | 216′ | 428′ | 102′ | 175′

72 FIBER
1-72

100′
R/W

104′

175′

S MERIDIAN AVE

C/L

45′

55′

70′

150′

W GRAND AVE
(W 71ST ST S)

TO SHEET 8

48 FIBER
73-120

R/W
50′
TO C/L

DWY

DWY

R/W
60′
TO C/L

DWY

R/W
75′
TO C/L

75′ TO C/L
R/W
175′

60′

C/L

7079

RAIN TREE LN

7107

TO SHEET 1

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT


ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36″ MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	7
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

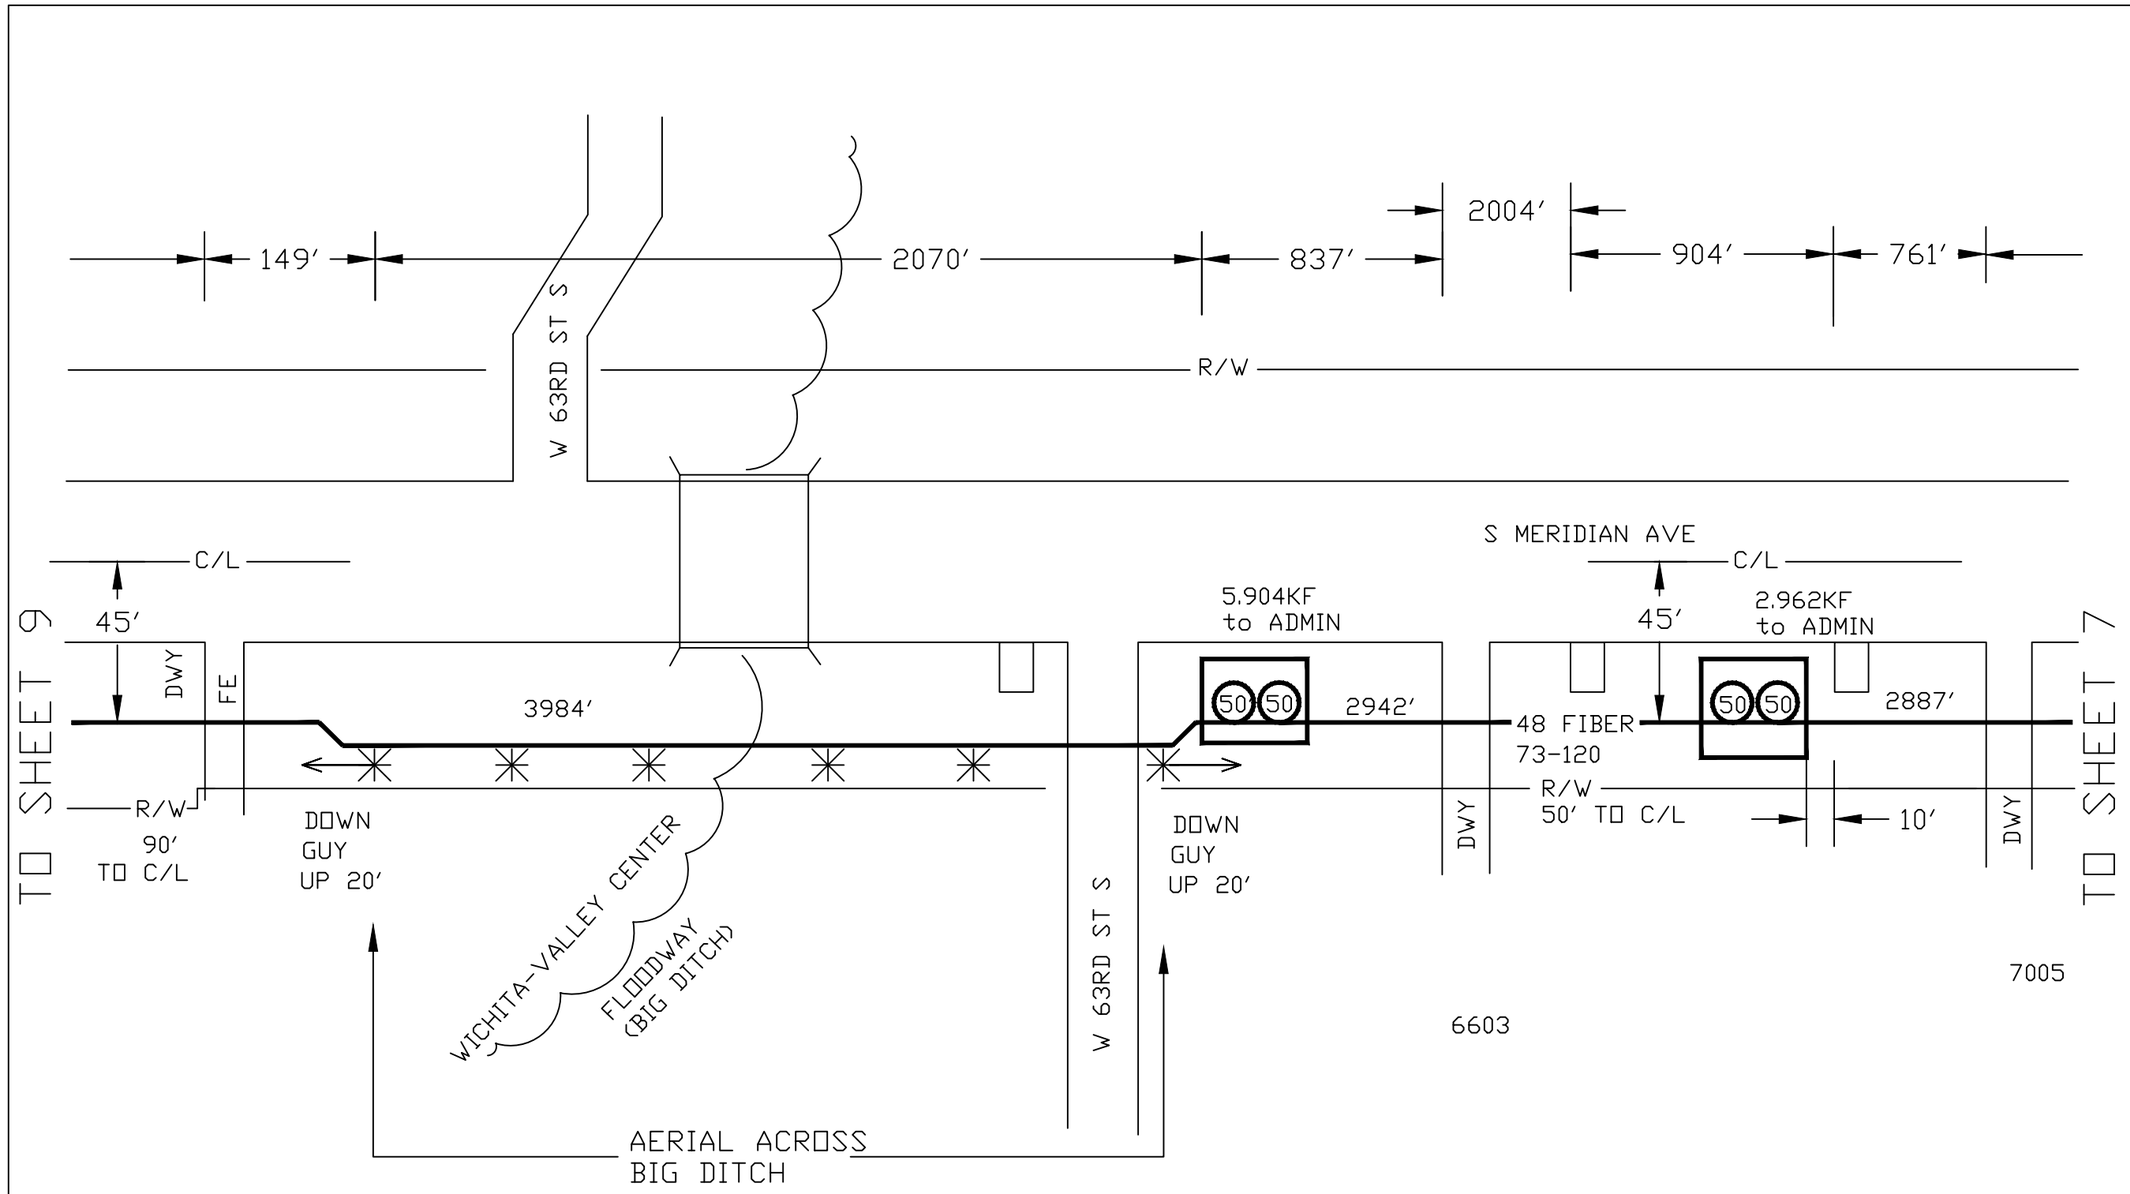

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT


ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36″ MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	8
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

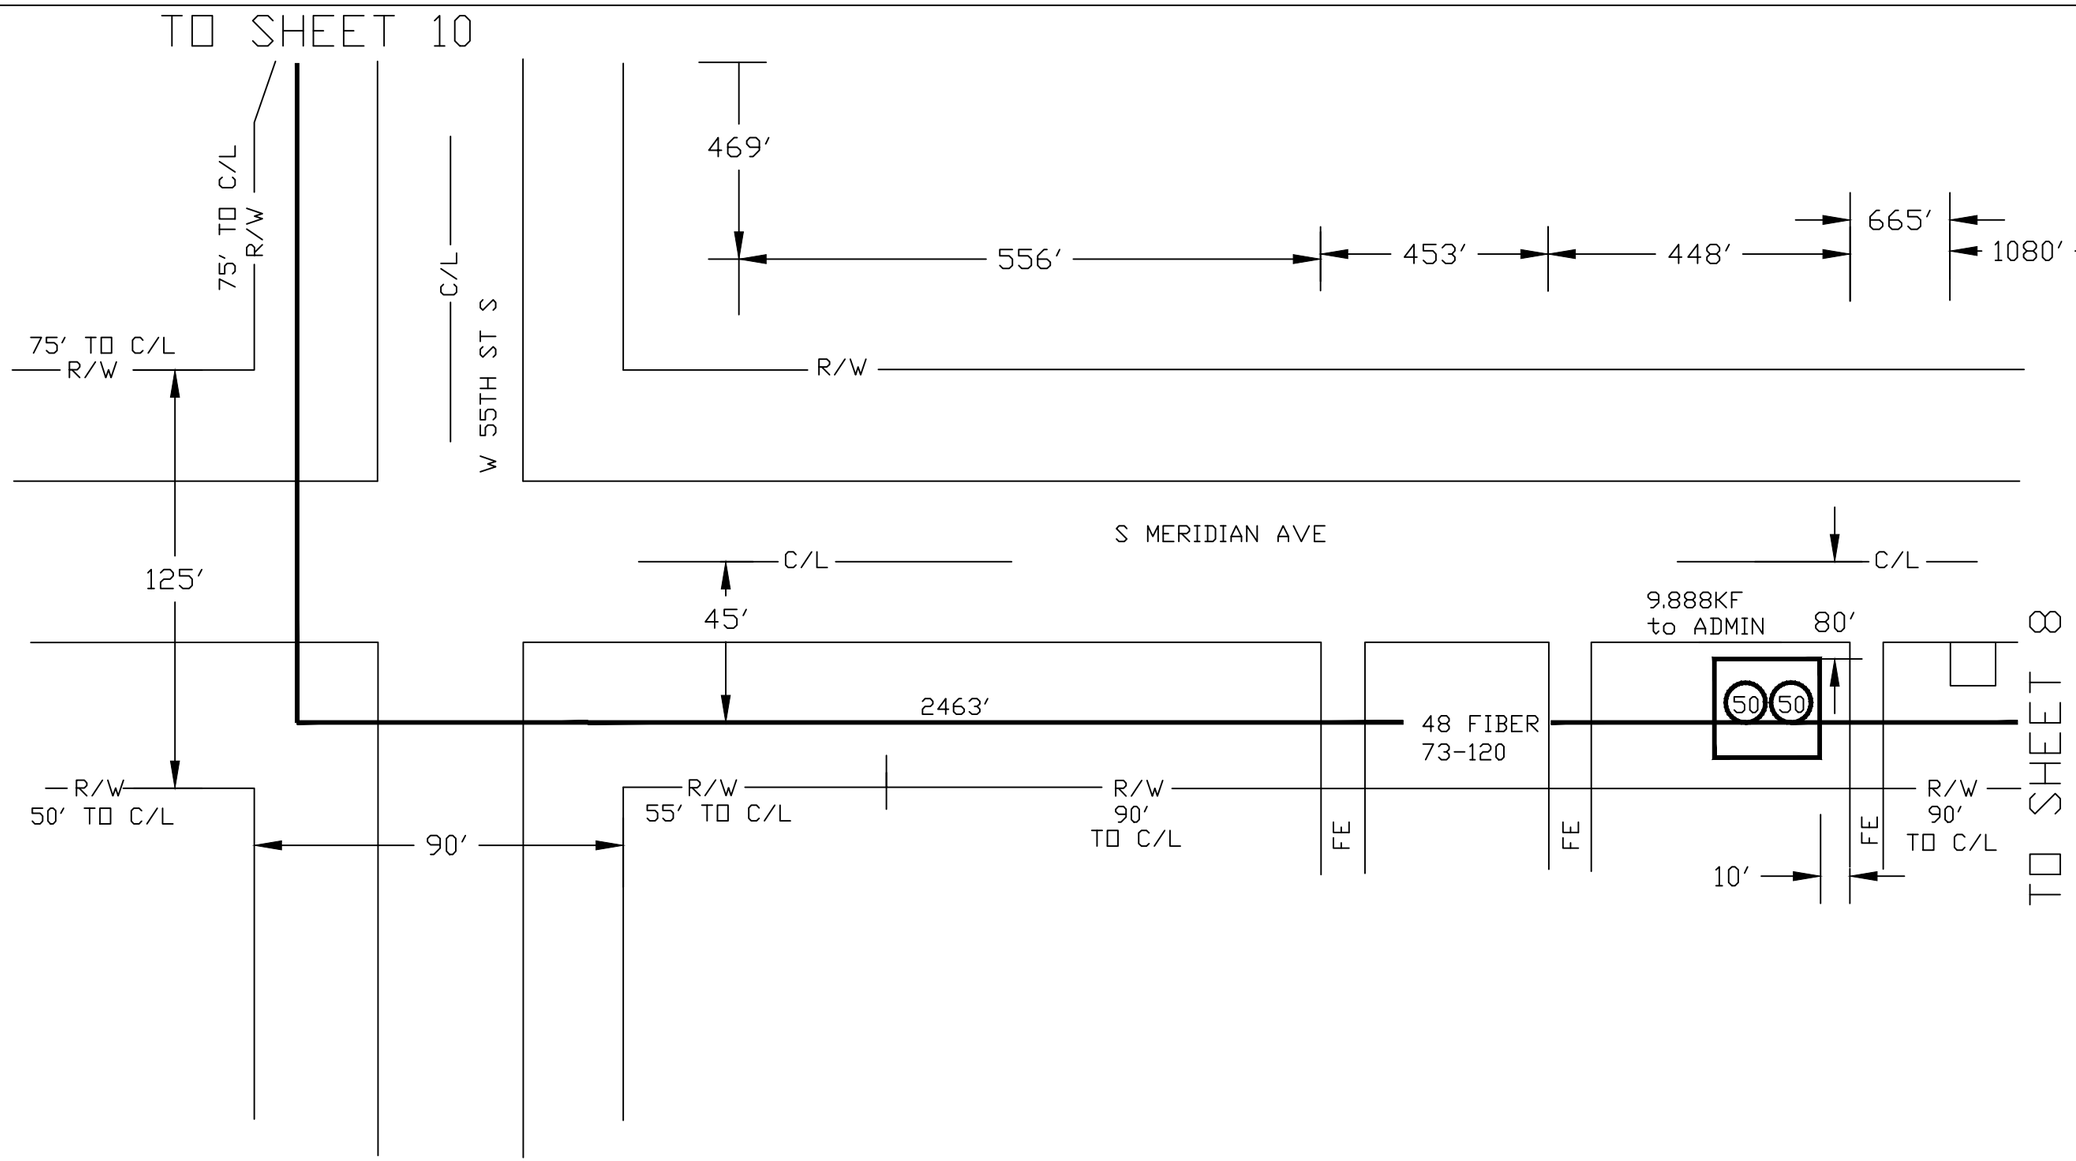

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT


ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36" MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	9
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

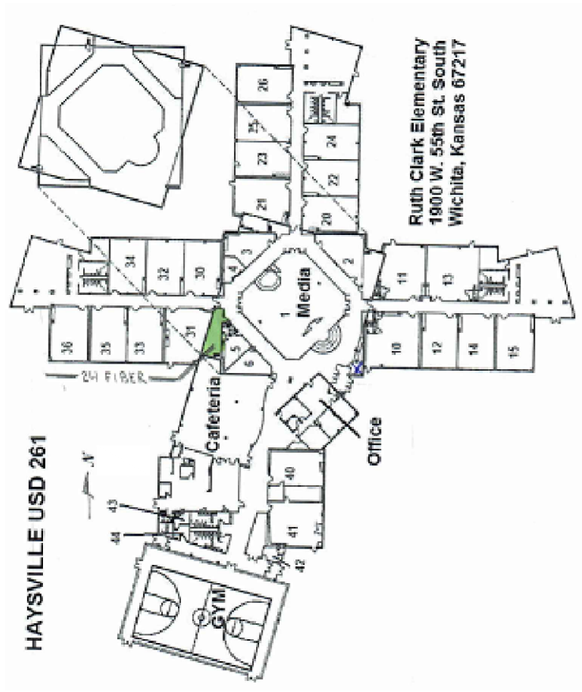

RUTH CLARK
ELEMENTARY SCHOOL
1900 W 55TH ST S
14.209KF to
ADMIN

13.050KF to
ADMIN

CAMPUS HIGH SCHOOL
2100 W 55TH ST S
SEE SHEET 11

TO SHEET 9

681′
24 FIBER
73-96

48 FIBER
73-120

12.351KF to
ADMIN

210′
57′
5′
SDWK
SDWK
5′
PARKING
LOT
270′
100′
R/W
1858′
24 FIBER
97-120
DWY
DWY
DWY
DWY
50′
50′
50′
35′
40′
C/L
W 55TH ST S
222′
20′
266′
225′
365′
210′
R/W

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT

ALL BUILDING INNERDUCT SHALL BE FIRE RATED


CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36″ MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	10
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

HAYSVILLE USD 261

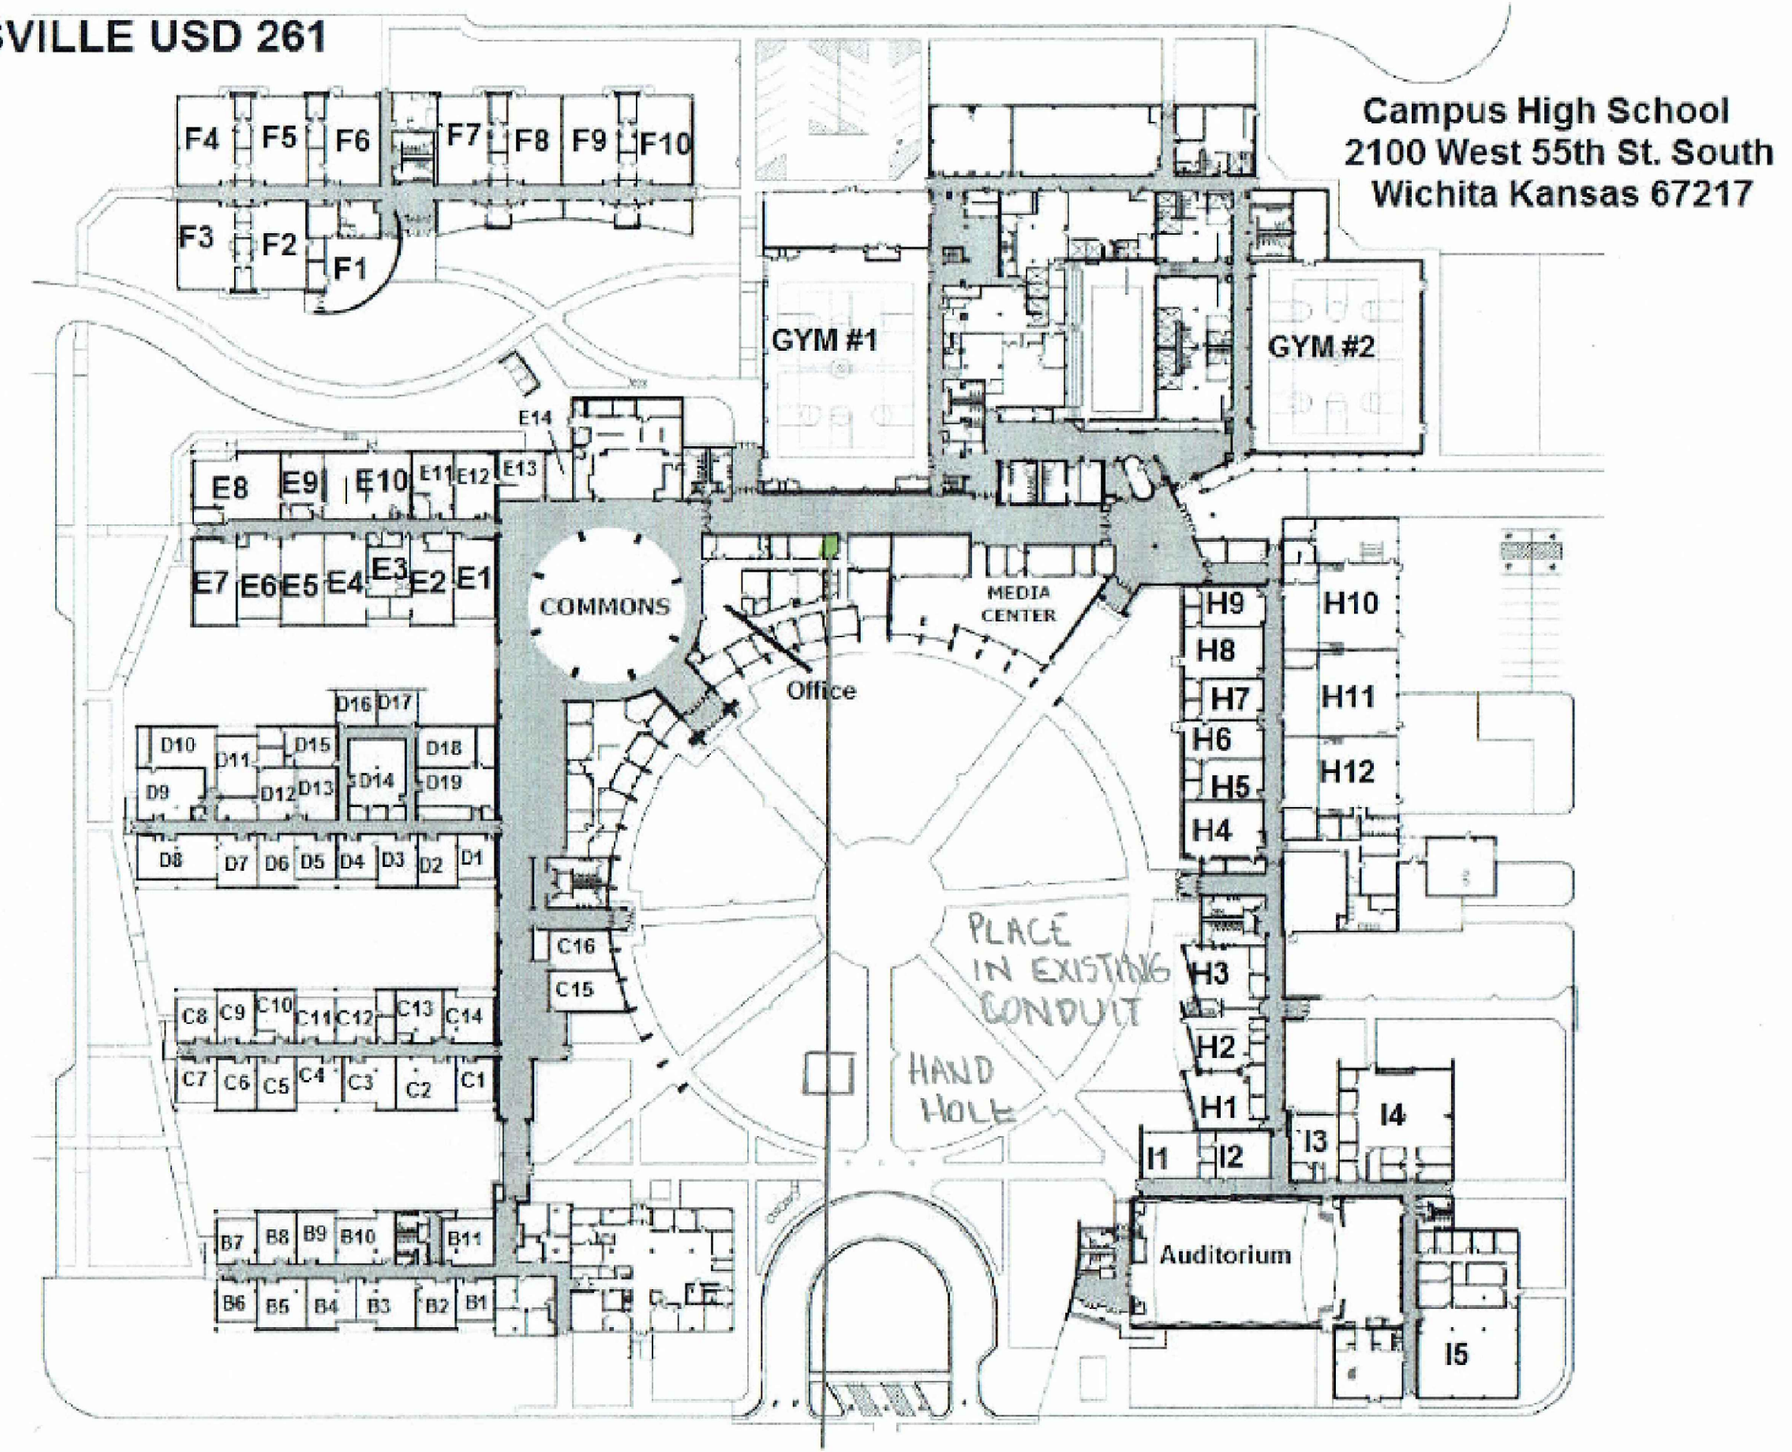

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT

ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36" MINIMUM DEPTH


DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972


HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	11
PLOT DATE	
12/16/2015	

FILE NAME

USD 261

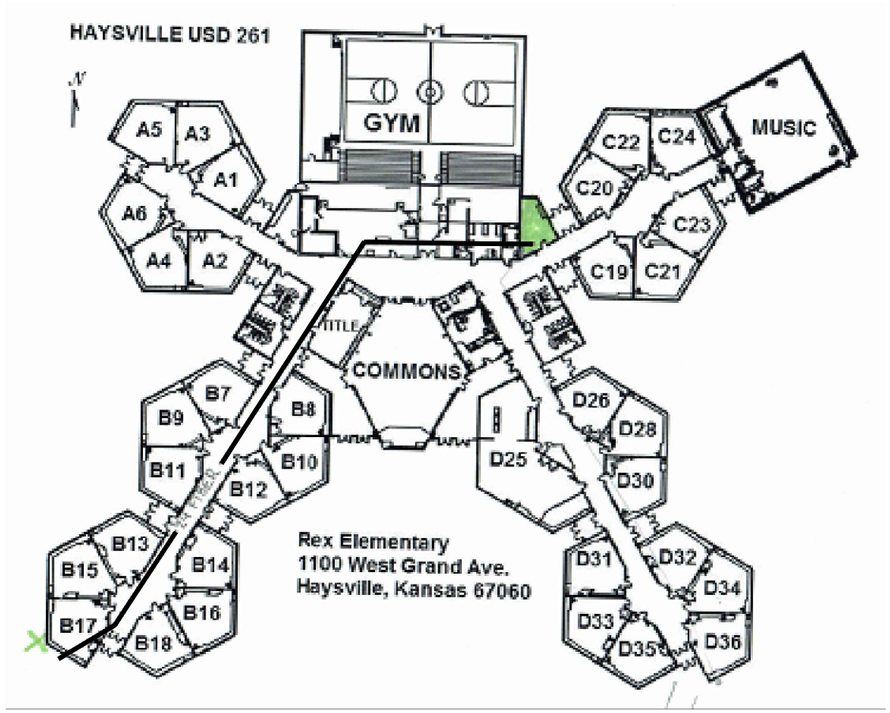

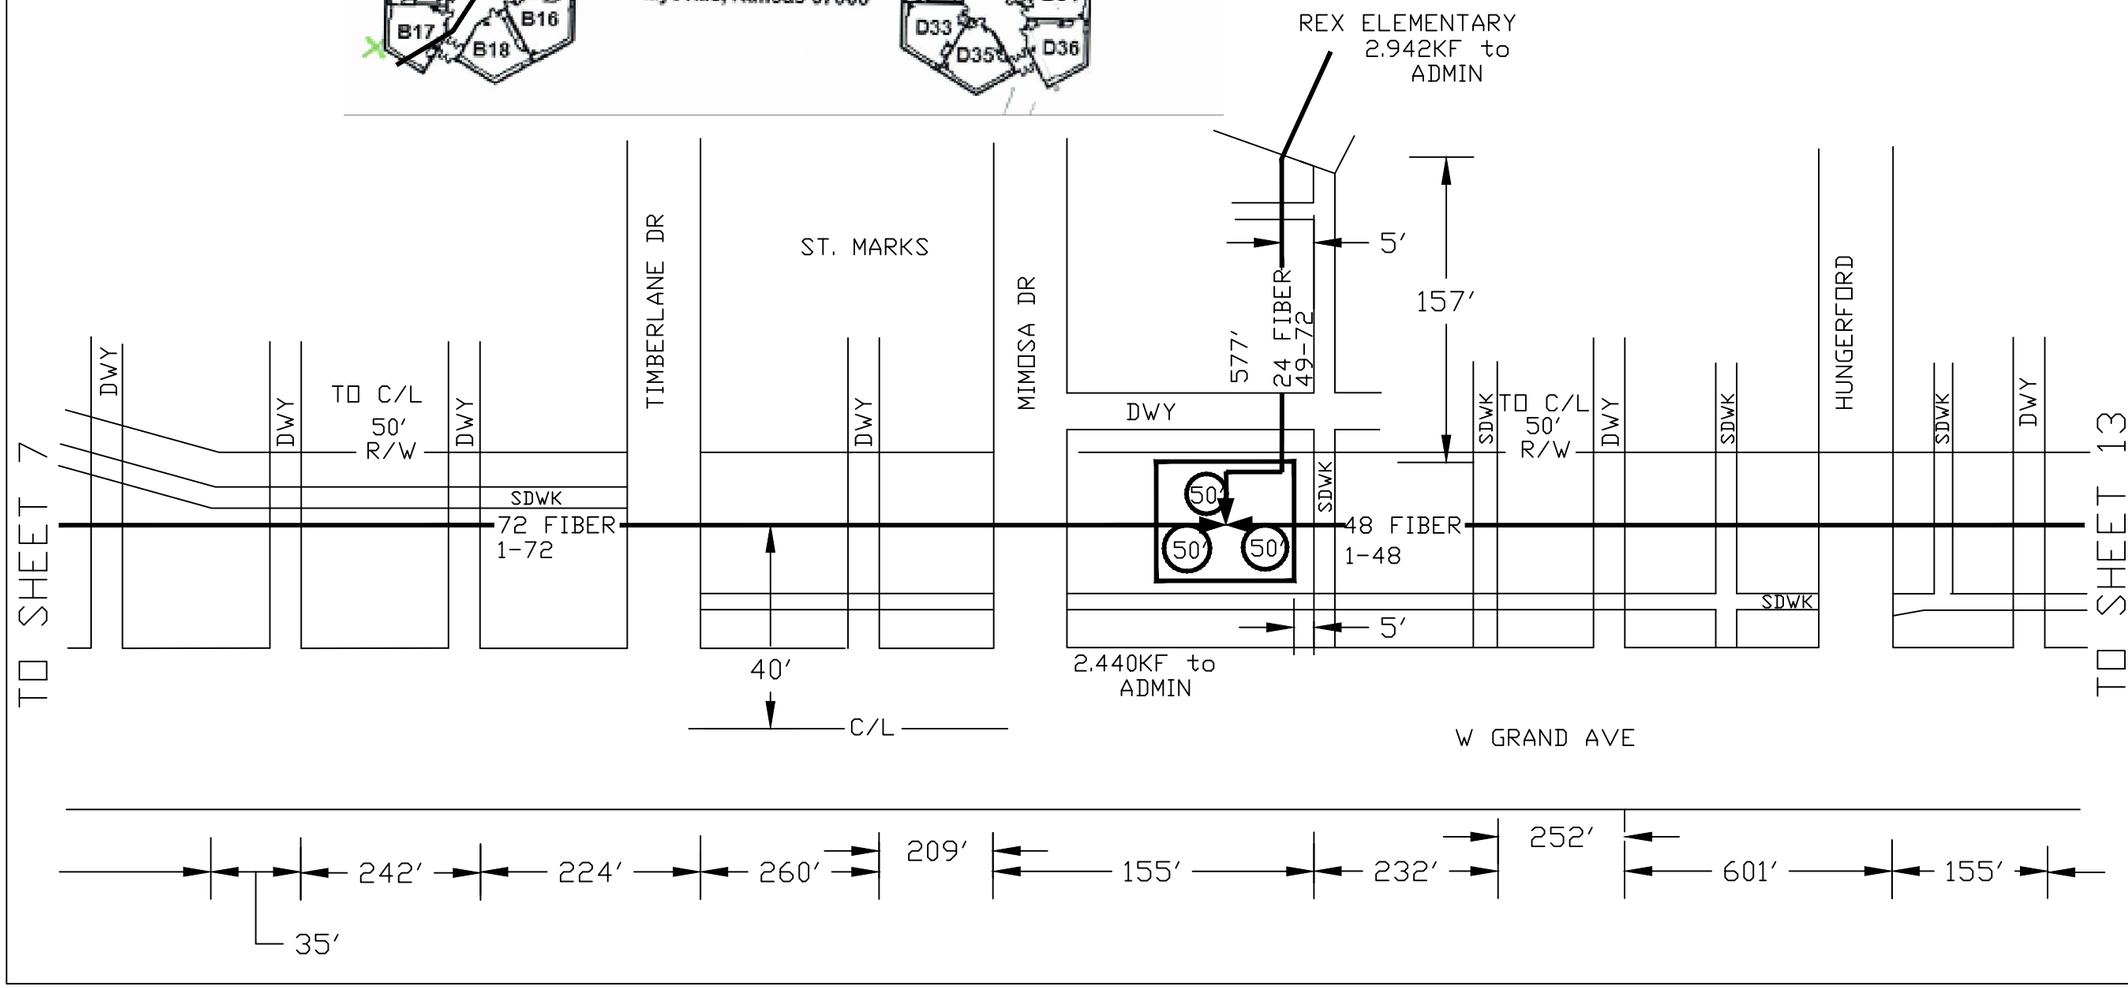

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT


ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36″ MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	12
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

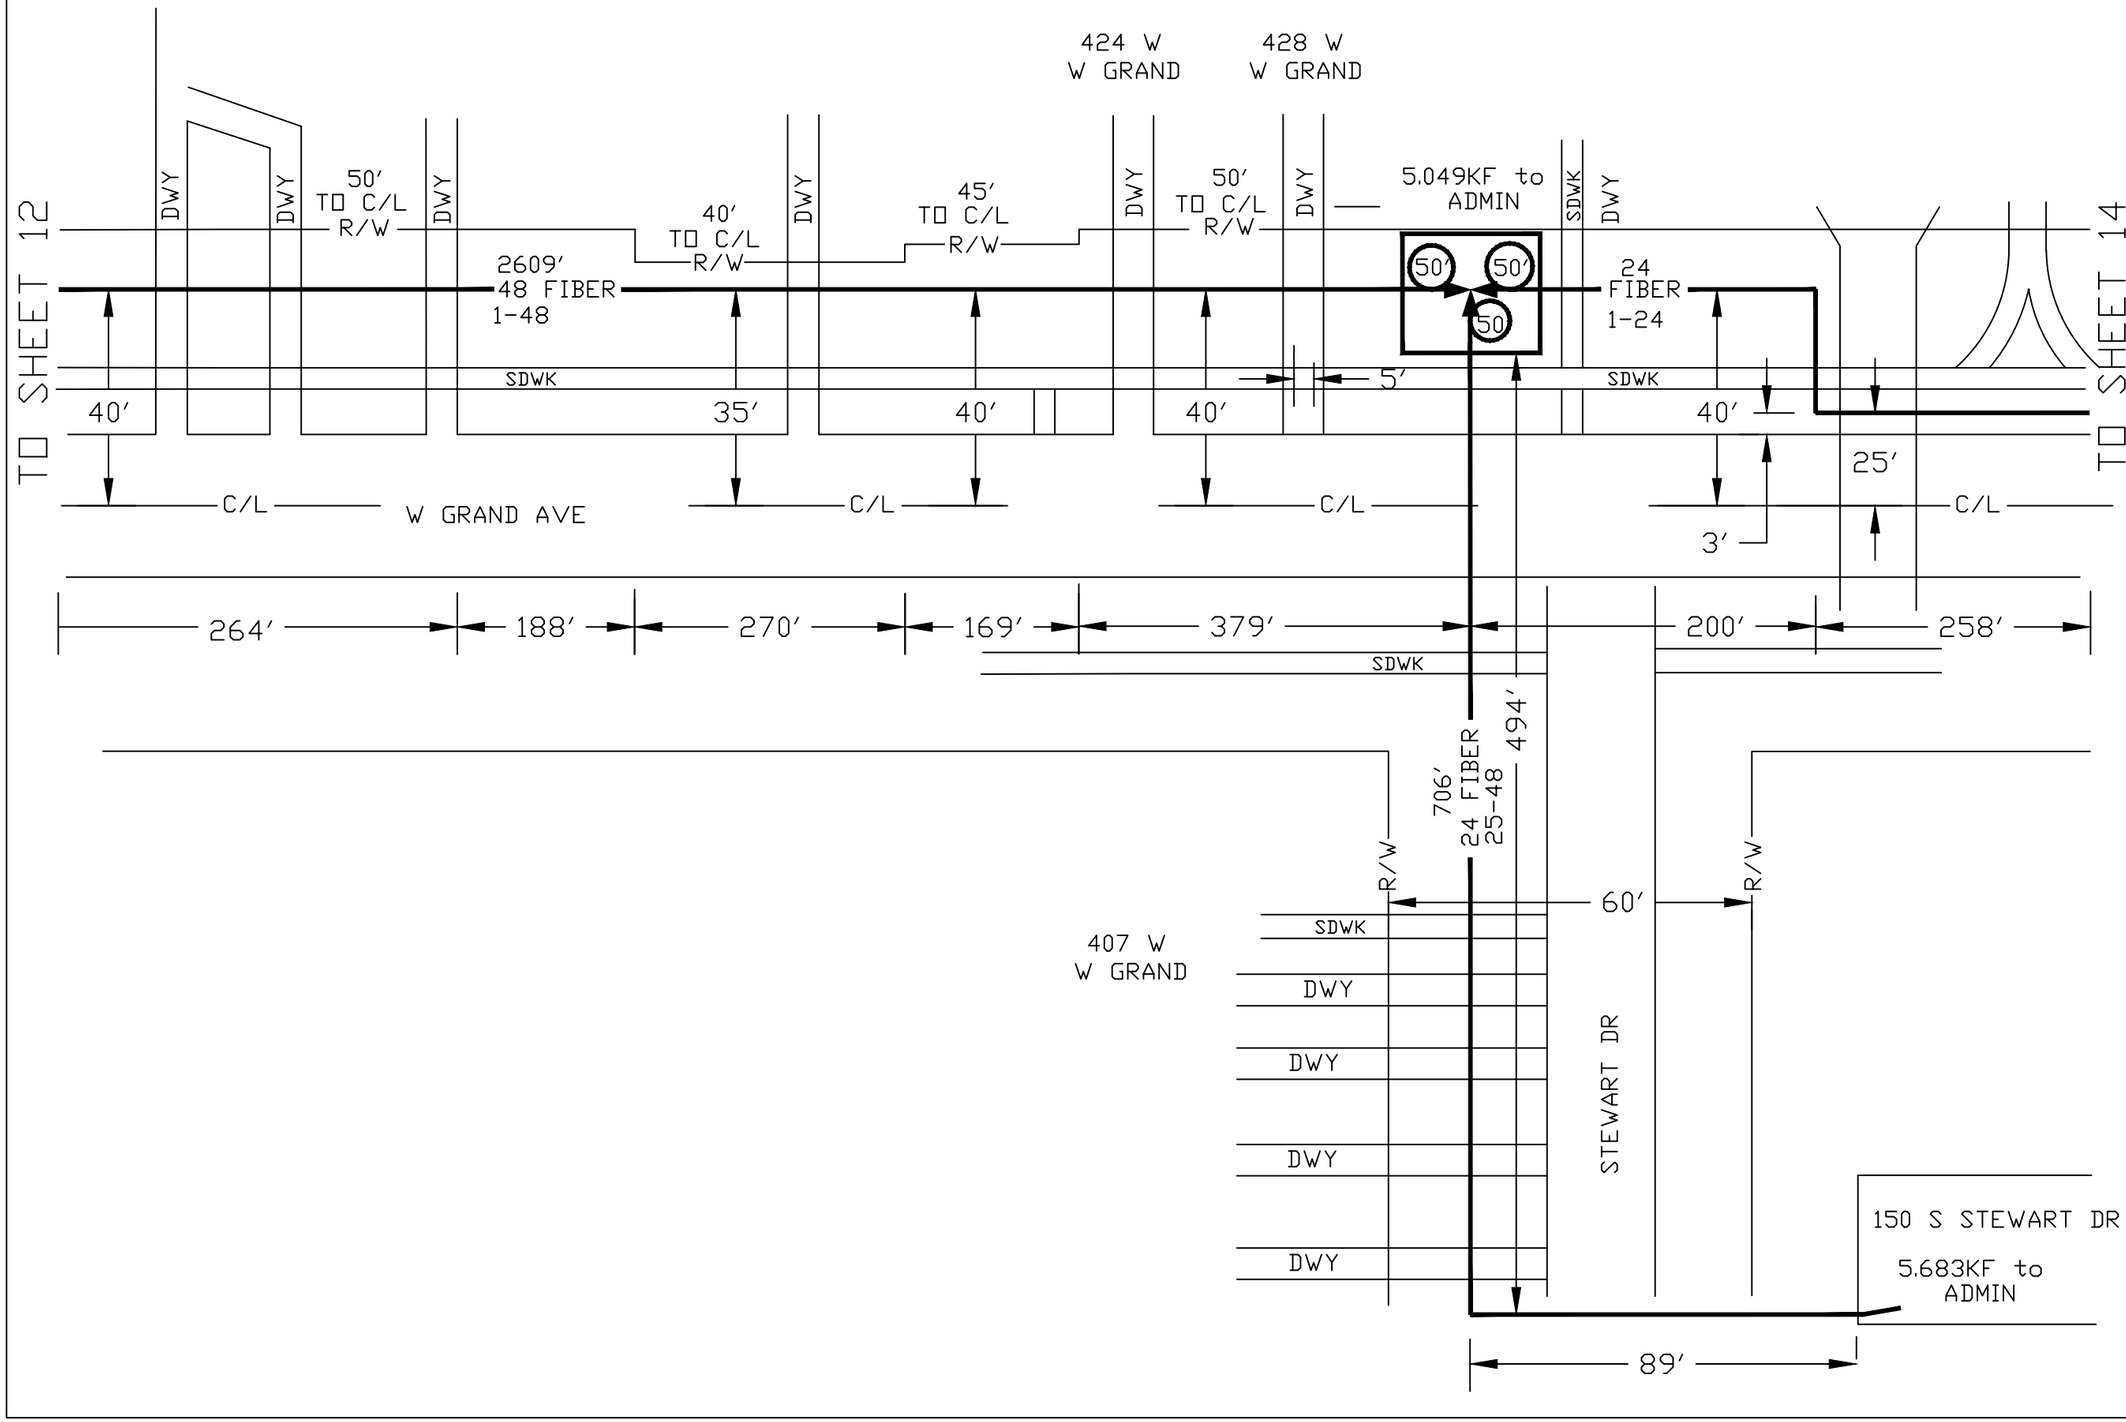

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT

ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36″ MINIMUM DEPTH


DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	13
PLOT DATE	
12/16/2015	

FILE NAME

USD 261

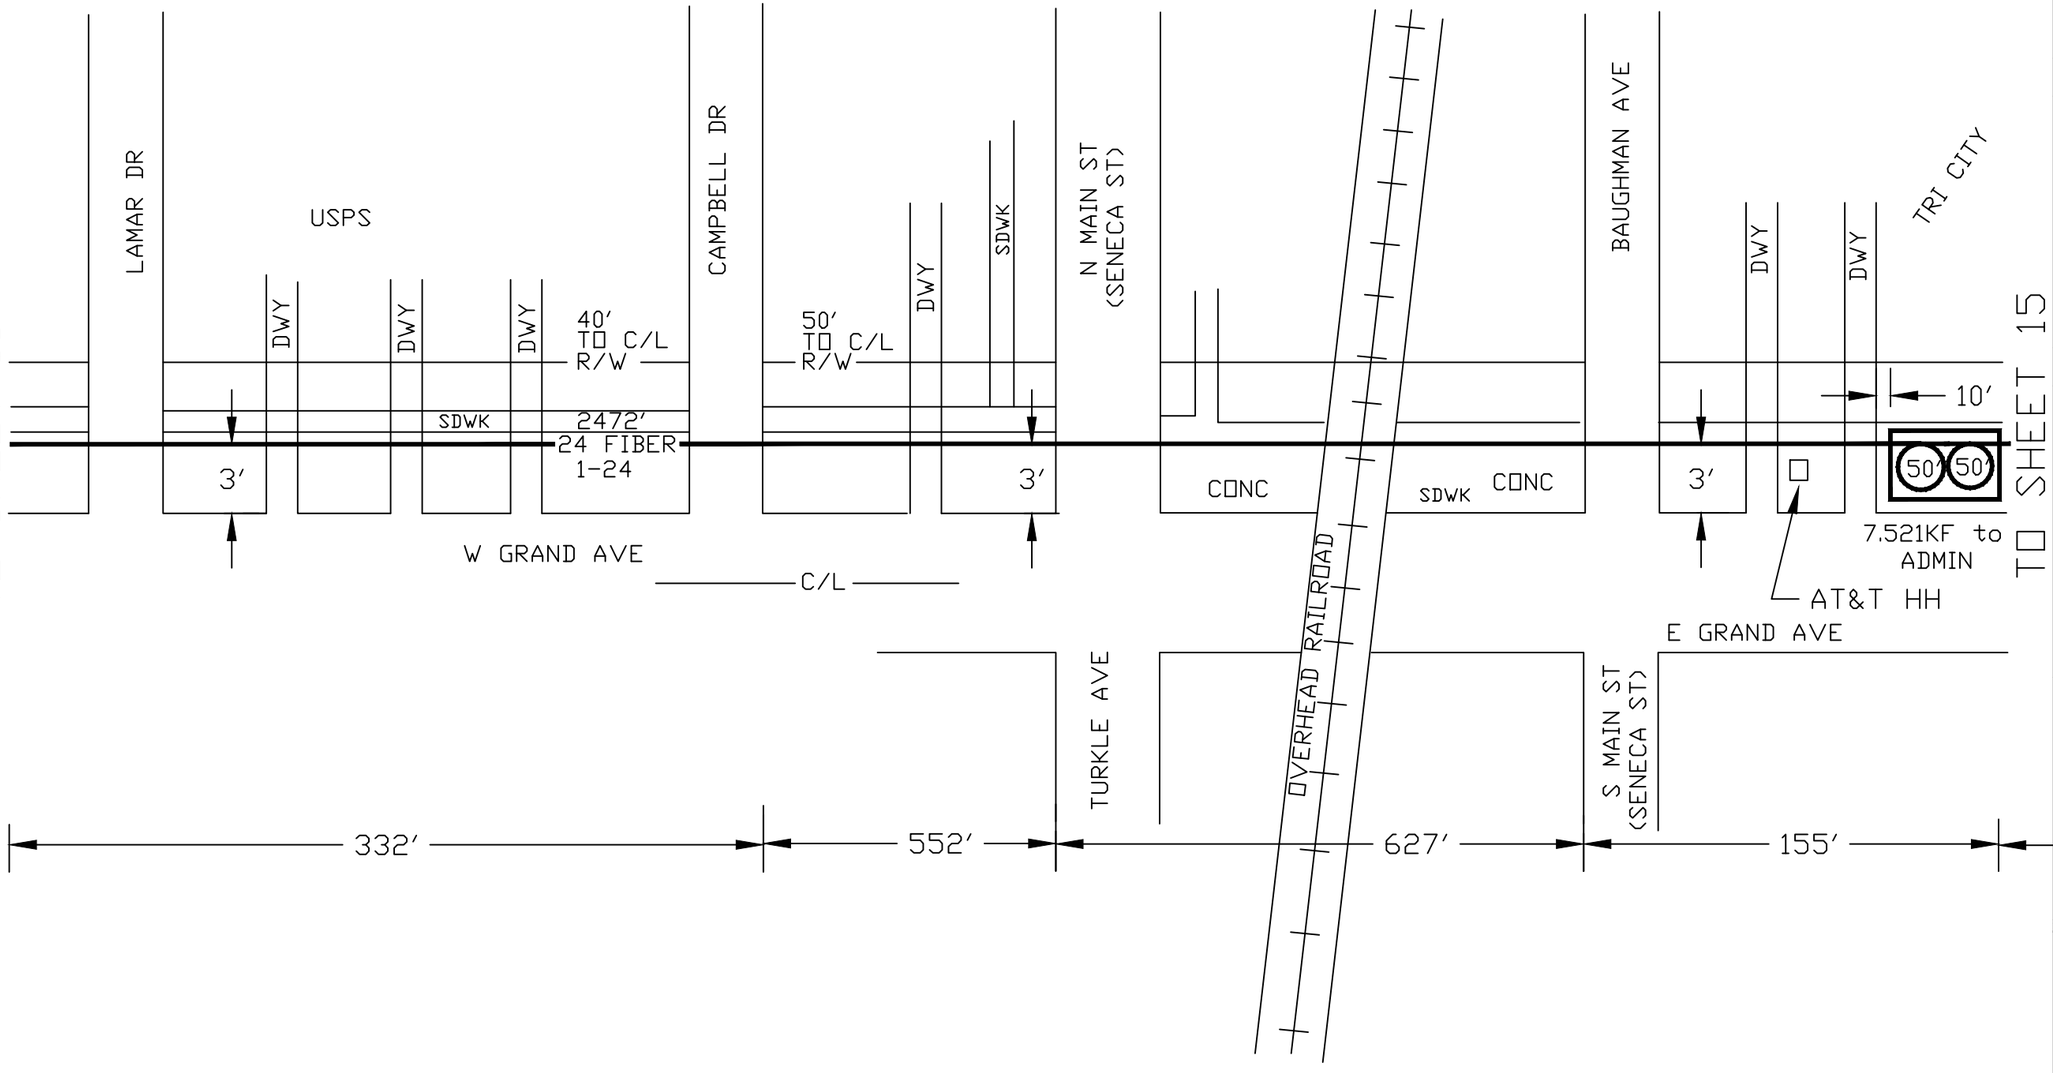

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT


ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36" MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	14
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	

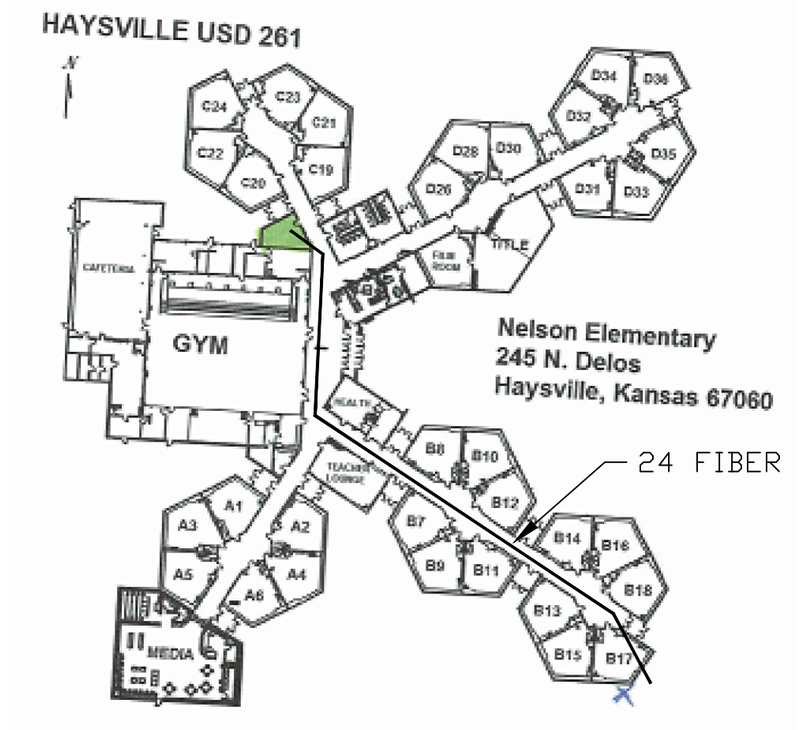

USD 261

N

CAUTION
HIGH VOLTAGE
7.2KV
POWER CO:
WESTAR
(316) 261-6944

NOTES

ALL FIBER TO BE PLACED IN SMOOTH SIDED INNERDUCT UNLESS IN EXISTING CONDUIT

ALL BUILDING INNERDUCT SHALL BE FIRE RATED

CONTRACTOR WILL FOLLOW INDUSTRY STANDARDS FOR PLACING FIBERS 36" MINIMUM DEPTH

DRAWN BY:
BYERS ENG. CO.
BILL WELCH
(316) 796-3972

HAYSVILLE SCHOOLS
HAYSVILLE, KS
JASON SOUPENE
(316) 554-2203

SCALE	SHEET NUMBER
None	15
PLOT DATE	
12/16/2015	
FILE NAME	
USD 261	