

ARCHITECT'S ADDENDUM

Addendum Number: 03

Date: 08/21/2026

RE: EAHS 2026 Secured Entrance

Prepared By: Gabe David
Cordogan, Clark & Associates

CCA Project No.: 251008

To: Prospective Bidders

Subject: Addendum 03 to the Construction Documents for the East Aurora High School 2026 Secured Entrance Project.

This Addendum forms a part of the Construction Documents and modifies the original Construction Documents, dated 08.06.2026. Acknowledge receipt of this Addendum in space provided on the *Bid Form*. *Failure to do so may subject Bidder to disqualification*

THE FOLLOWING ITEMS ARE TO BE INCLUDED IN THE PROPOSAL.

General Clarifications:

- 1) **The Bid Due Date has been extended to Friday August 28, 2026. Post-Bid Interviews will be scheduled for September 1-2, 2026. The revised Milestone Schedule has been attached for reference.**
- 2) The IGU-1 insulated glazing units have been revised to laminated glass (base bid). Refer to specification and drawing revisions below and attached. Alternate #01 is intended to be a deductive alternate to provide security film in lieu of laminated glazing.
- 3) RFI Log has been attached for reference.

Clarifications to the Specifications:

- 1) SECTION 004000 – FORM OF PROPOSAL:
 - **REVISED** Alternate #01 - Furnish and install non-laminated insulated glazing IGU-3 in lieu of laminated glazing IGU-1. Furnish and install 3M Safety Security Window Film or equal.
 - **REVISED** Alternate #02 - Furnish and install new storefront (beyond vestibule, from Gridline 30 Eastward, roughly 53 feet.) as shown on Sheet A1.00.
 - **ADDED** Alternate #02A – Furnish and install non-laminated insulated glazing IGU-3 in lieu of laminated glazing IGU-1. Furnish and install 3M Safety Security Window Film or equal for Alternate #02 Storefront locations.
- 2) SECTION 088000 – GLAZING:
 - **REVISED** Section 2.10 Insulated-Glass Types as follows:
 - A. Glass Type IGU-1: Low-e-coated, insulating glass, laminated.
 2. Overall Unit Thickness: 1-1/8 inch.
 3. Thickness of Outer Lite: (2) 1/8-inch float glass layers with 0.060" PVB interlayer.
 4. Thickness of Inner Lite: (1) 1/4"-inch
 8. On surface #4 (Air gap side of laminate pane)

- B. Glass Type SPANDREL GLASS (IGU-2) **NOT USED**
- C. Glass Type IGU-3: Low-e-coated, insulating glass, non-laminated.
 - 2. Overall Unit Thickness: 1 inch
 - 3. Thickness of Each Glass Lite: 1/4-inch
 - 7. Low-E Coating: on Surface #2

Clarifications to the Architectural Drawings:

- 1) Sheet A1.00 – Partial First Floor Plan – Area B
 - **REVISED** Existing Conditions Photograph, Elevations, and New Work Plan. Refer to clouded regions on the attached drawing sheet.
- 2) Sheet A2.00 – Interior Elevations, Storefront Elevations, Wall Types, & Details
 - **REVISED** Glazing Notes and Legend, Alternate Descriptions, Storefront Elevations, and Detail 5 – Typical Header Detail – Main Entrance. Refer to clouded regions on the attached drawing sheet.

Clarifications to the Mechanical Drawings:

- 1) Sheet M1.00-B – Partial Mechanical First Floor Plans – Area B
 - No changes, sheet issued for reference, refer to ADD03_ASK01 for supporting details.

Attachments:

- 1) Milestone Schedule
- 2) Sheet A1.00 – Partial First Floor Plans – Area B
- 3) Sheet A2.00 – Interior Elevations, Storefront Elevations, Wall Types, & Details
- 4) Sheet M1.00-B – Partial Mechanical First Floor Plans – Area B
- 5) SECTION 004000 – FORM OF PROPOSAL
- 6) RFI Log – 08.21.2026
- 7) ADD03_ASK01
- 8) Thybar TEMS PDF
- 9) Thybar TC-3 Curb PDF

End Of Addendum No. 03

MILESTONE SCHEDULE

East Aurora School District #131 East Aurora High School Secured Entrance Project

Addendum 03


August 4, 2026	QA/QC Sets Due for Review
August 6, 2026	Bid Documents Available
August 11, 2026 11:00 AM CST	Mandatory Pre-Bid Meeting (Meet at EAHS Door 1)
August 12-14, 2026	Facilities Walkthroughs Mandatory (by Appointment)
August 20, 2026	Last Day for Bidder Questions
August 28, 2026 10:00 AM CST	Bids Due to District Office
September 1-2, 2026	Post-Bid Interviews
September 8, 2026*	Presentation of bids to Building and Grounds
September 21, 2026	Presentation of bids to Board of Education for Approval
September 22, 2026	Notice to Proceed
September 28, 2026	Contractor Site Access
October 2, 2026	Construction Barrier In Place
September 29, 2026	Submittal Deadline (Storefront, doors/hardware, concrete, & reinforcing)
October 30, 2026	Demolition and Foundation Substantial Completion
November 16, 2026	Balance of Work Substantial Completion (Including ROE Walkthroughs)



EXISTING CONDITIONS PHOTOGRAPHS - HIGH SCHOOL

DOOR SCHEDULE											
DOOR NO.	DOOR						FRAME			HARDWARE SET	REMARKS
	W	H	T	TYPE	MAT	FIN	TYPE	MAT	FIN		
B100A	3'-0"	7'-0"	1-3/4"	FG	AL	ANOD	SEE ELEV	AL	ANOD	02	
B100B	6'-0"	7'-0"	1-3/4"	FG	AL	ANOD	SEE ELEV	AL	ANOD	04	
B100C	6'-0"	7'-0"	1-3/4"	FG	AL	ANOD	SEE ELEV	AL	ANOD	03	


FINISH MATERIAL LEGEND	
LUXURY VINYL TILE	
WCPT - BASIS OF DESIGN MANUF: MANNINGTON STYLE: RUFFIAN II COLOR: EBONY EARTH 1506 SIZE: 24"x24"	

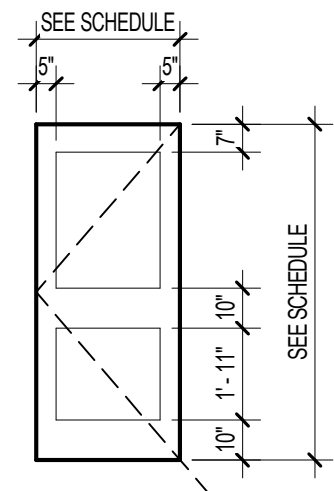


TYPE FG

DOOR TYPE LEGEND
1/4" = 1'-0"


DOOR & FRAME LEGEND	
AL	ALUMINUM
ANOD	ANODIZED
MANU	MANUFACTURER'S STANDARD DETAILING
HM	HOLLOW METAL
PR	PAIR
PT	PAINT
ST	STAIN - PREFINISHED
WD	SOLID WOOD CORE

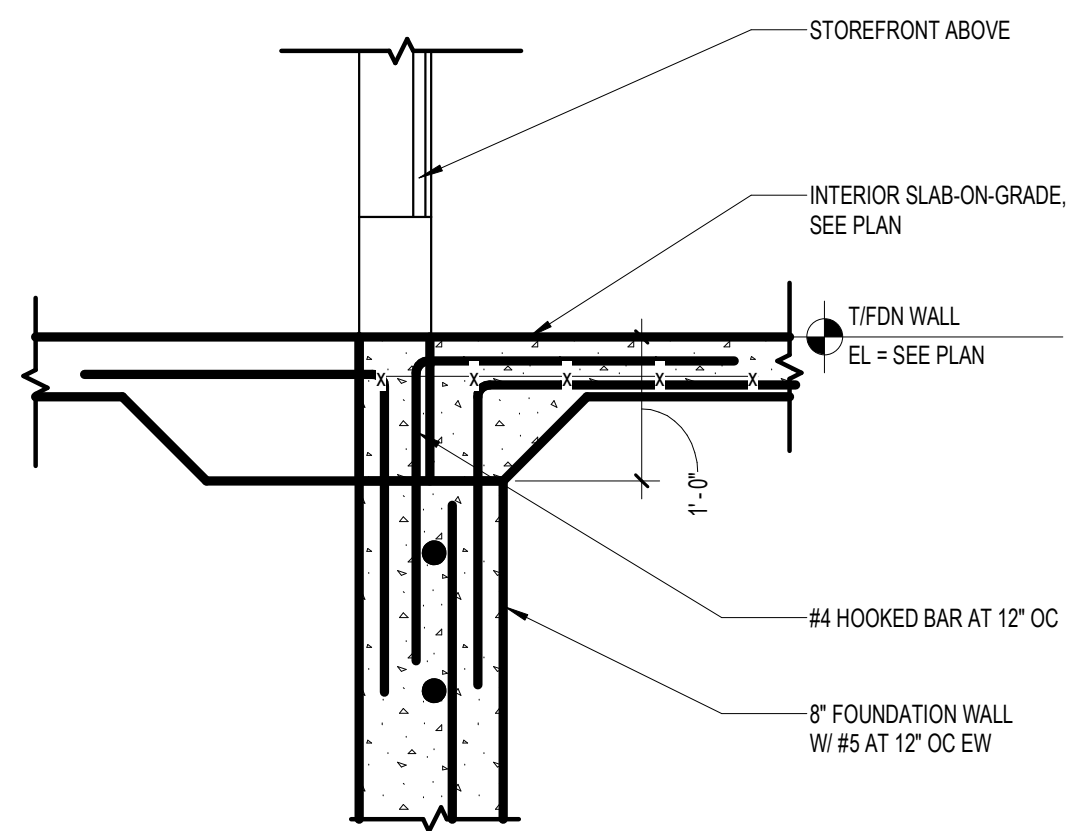


8 TYPICAL CURTAIN WALL THICKENED SLAB AT FOUNDATION WALL
3/4" = 1'-0"

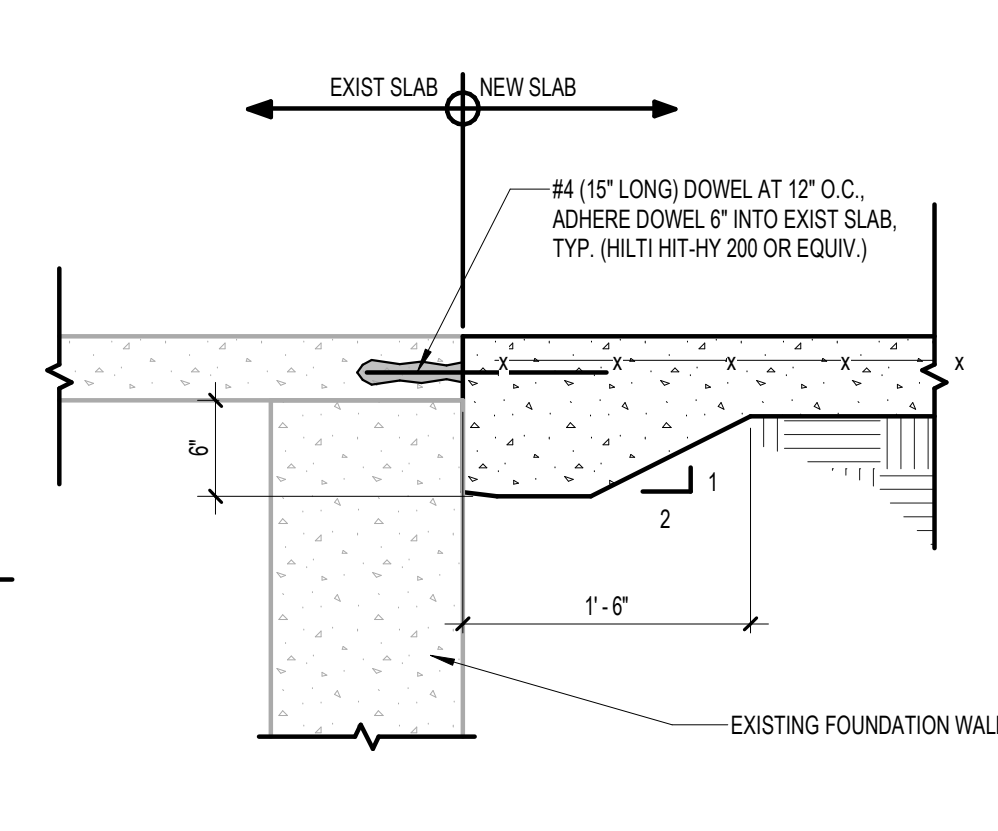


7 TYPICAL NEW/EXISTING SLAB CONNECTION
1" = 1'-0"

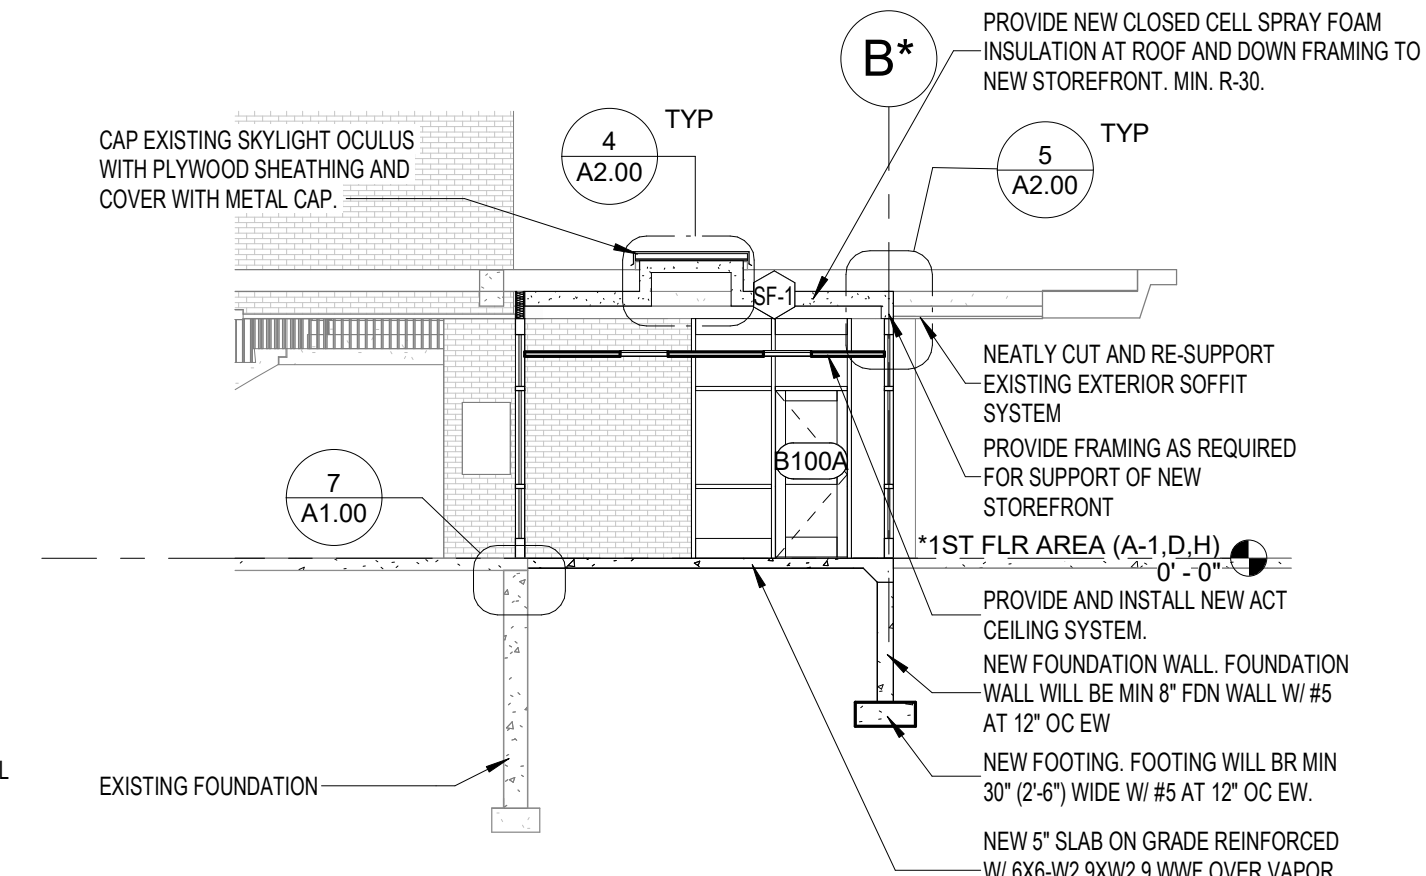


6 FIRST FLOOR - MAIN ENTRANCE - NEW WORK SECTION - AREA B
1/8" = 1'-0"

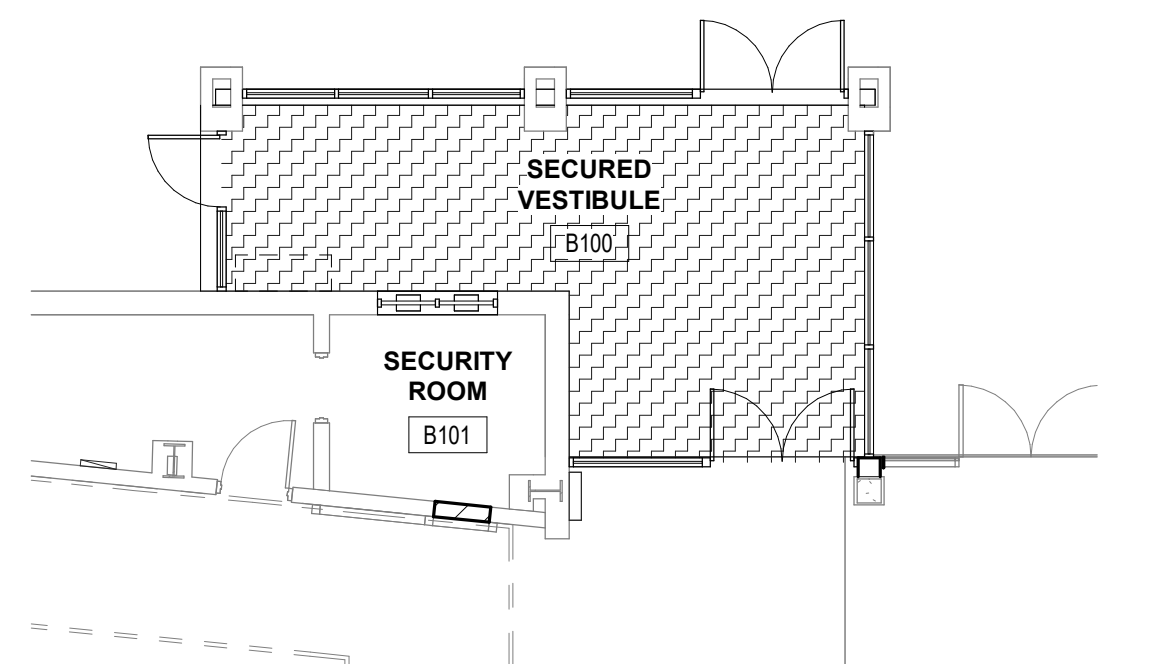


9 AREA B - FIRST FLOOR - MAIN ENTRANCE - FLOOR FINISH PLAN
1/8" = 1'-0"

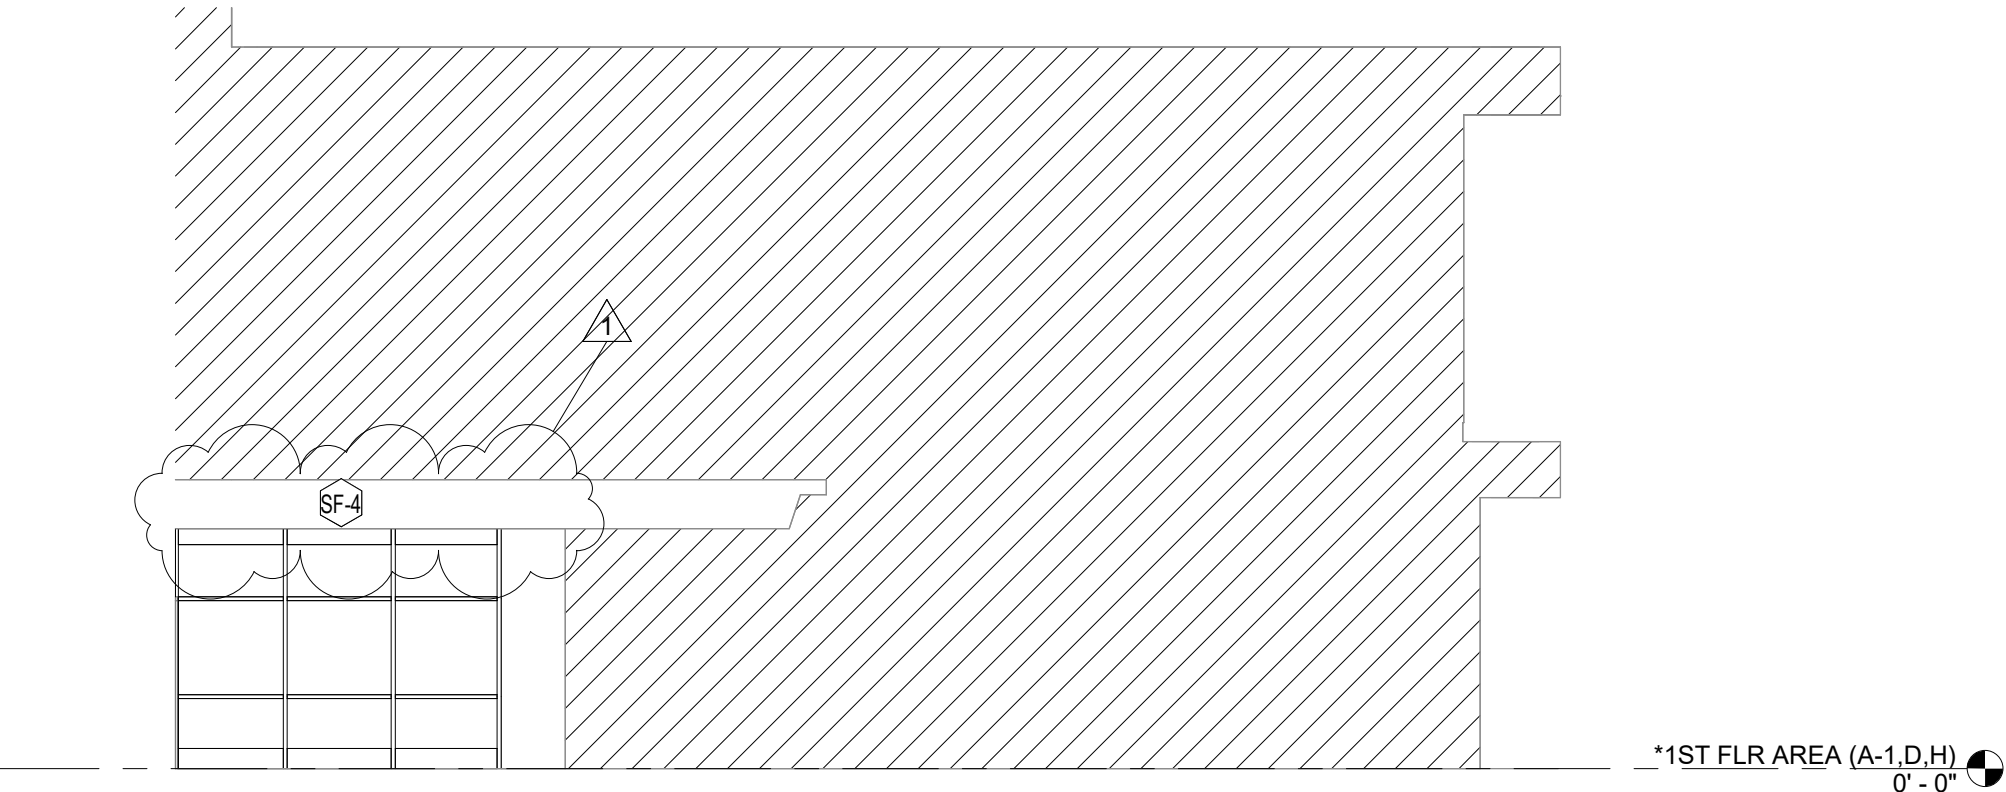


5 EAST ELEVATION - MAIN ENTRANCE NEW WORK
1/8" = 1'-0"

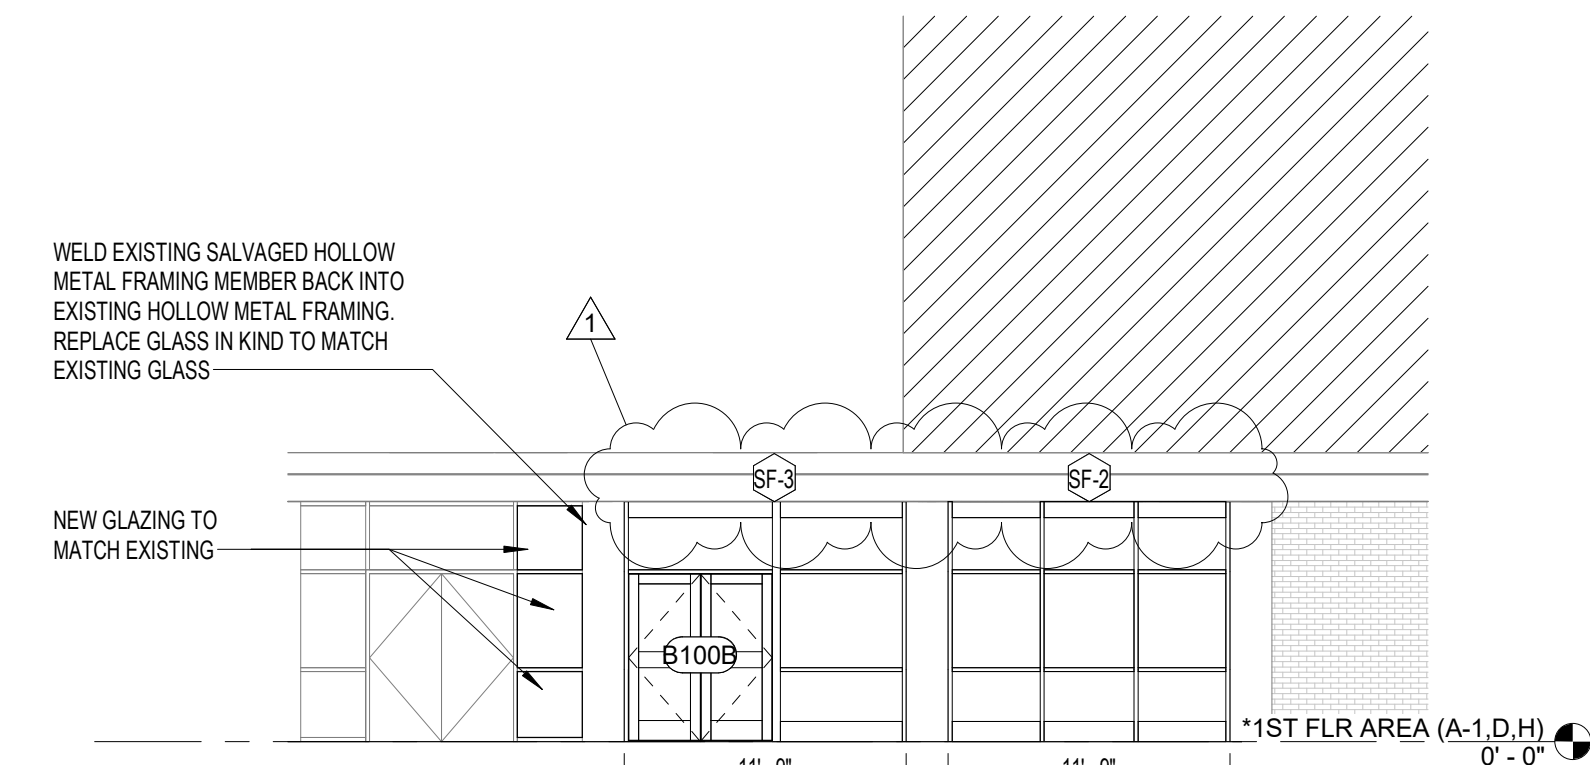


4 NORTH ELEVATION - MAIN ENTRANCE NEW WORK
1/8" = 1'-0"

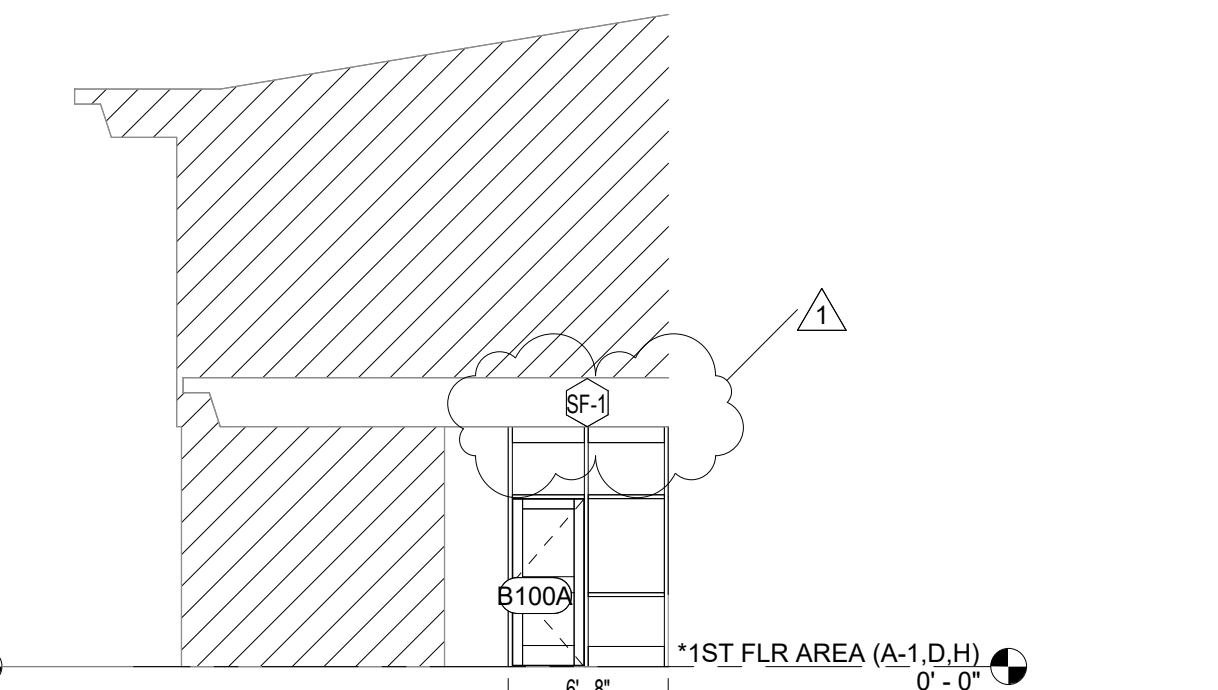

3 WEST ELEVATION - MAIN ENTRANCE NEW WORK
1/8" = 1'-0"

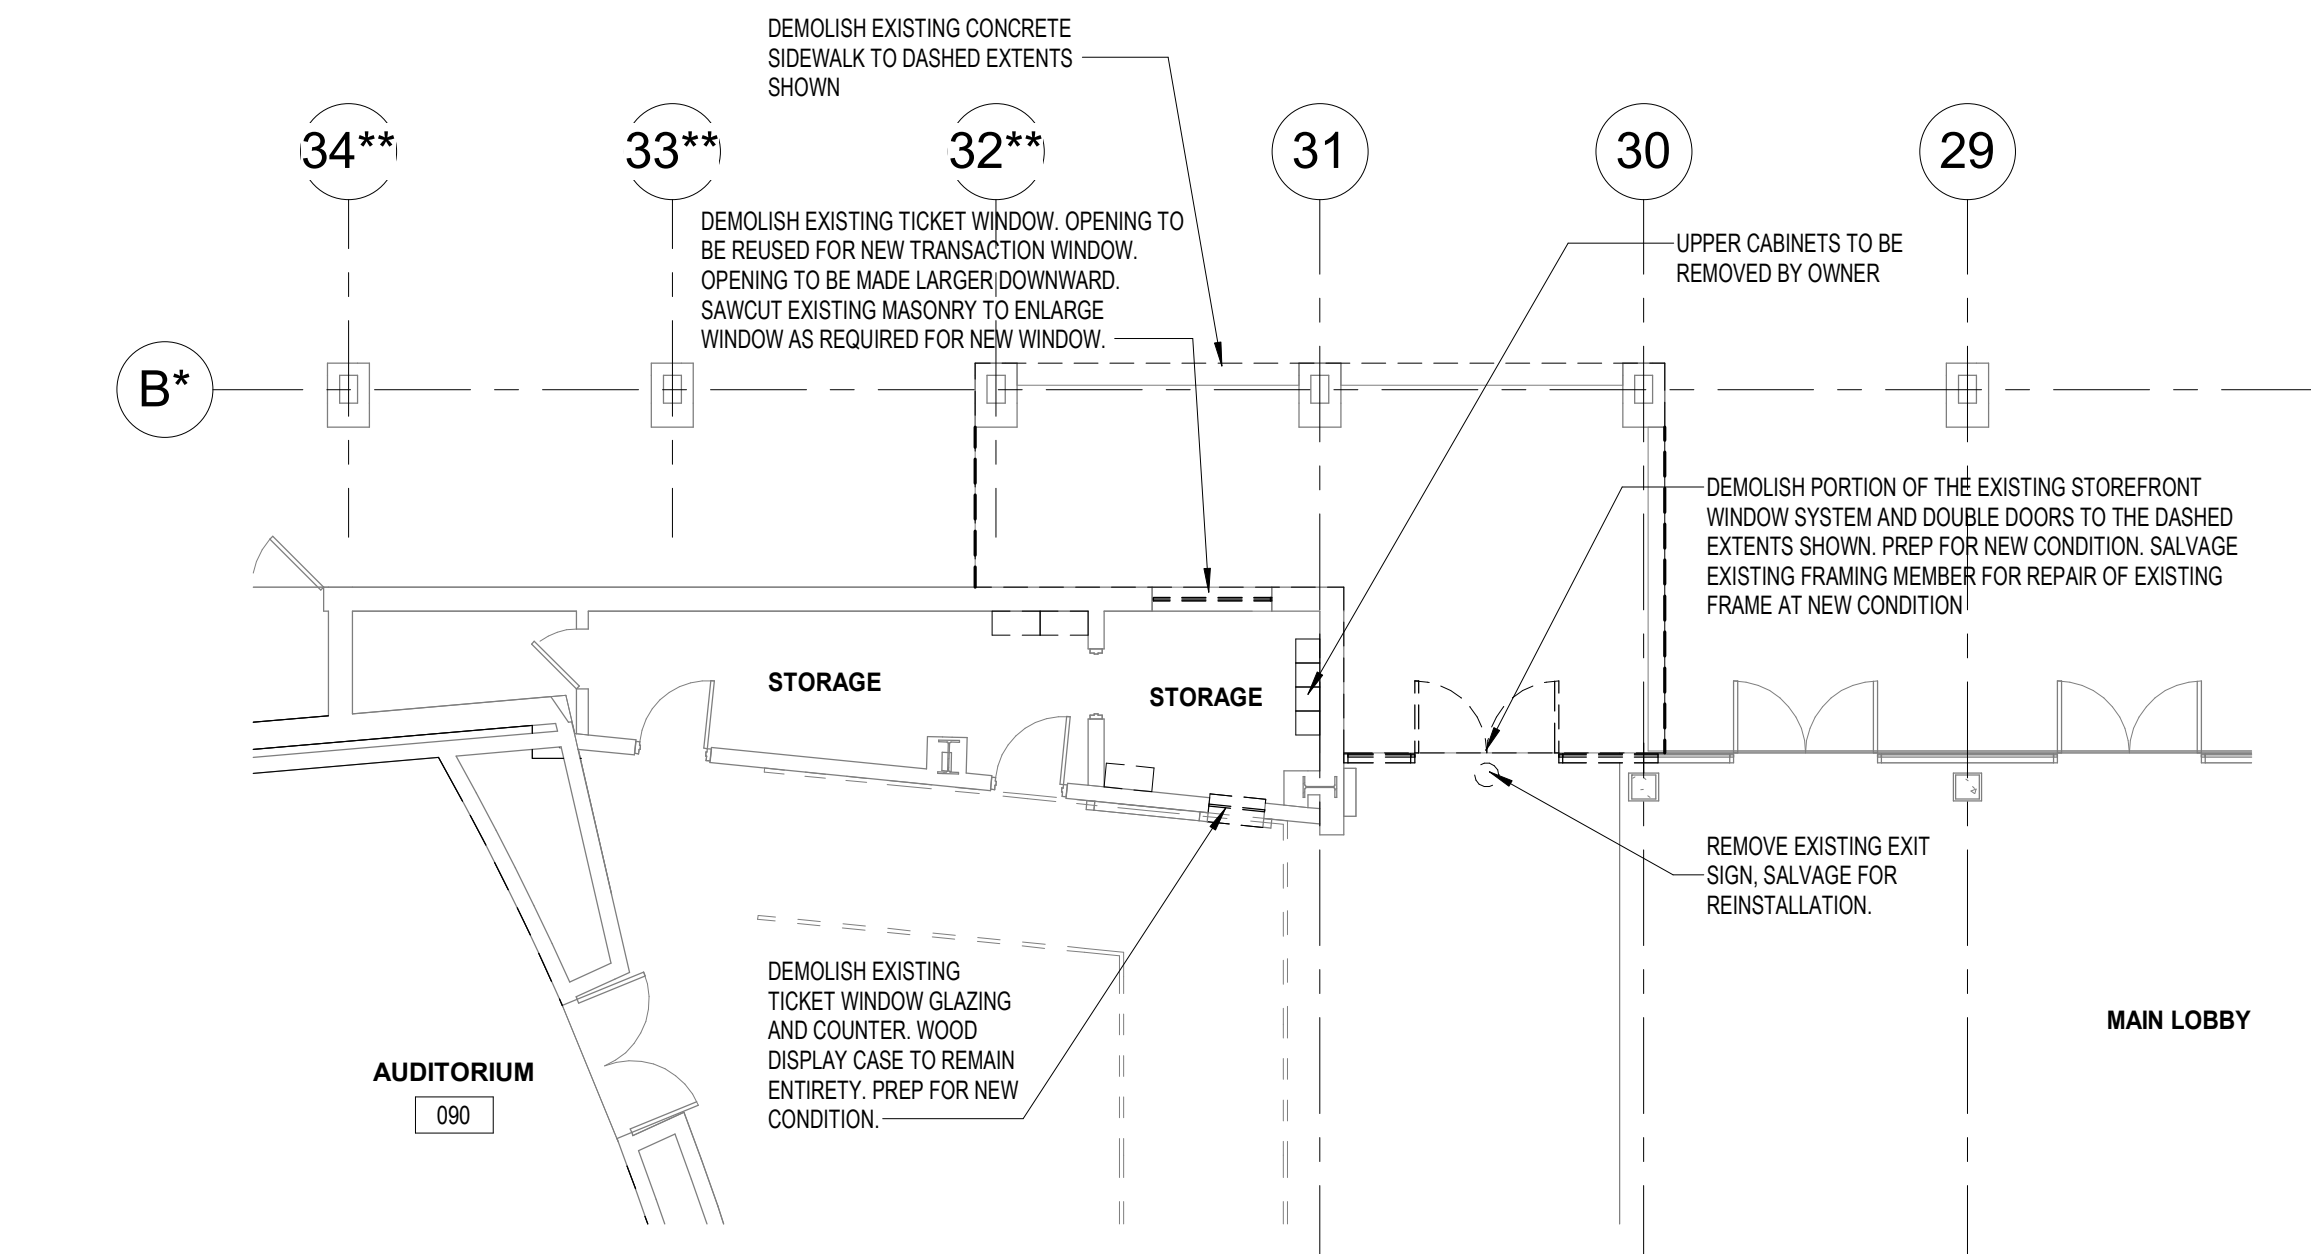

2 FIRST FLOOR - MAIN ENTRANCE DEMOLITION PLAN - AREA B
1/8" = 1'-0"

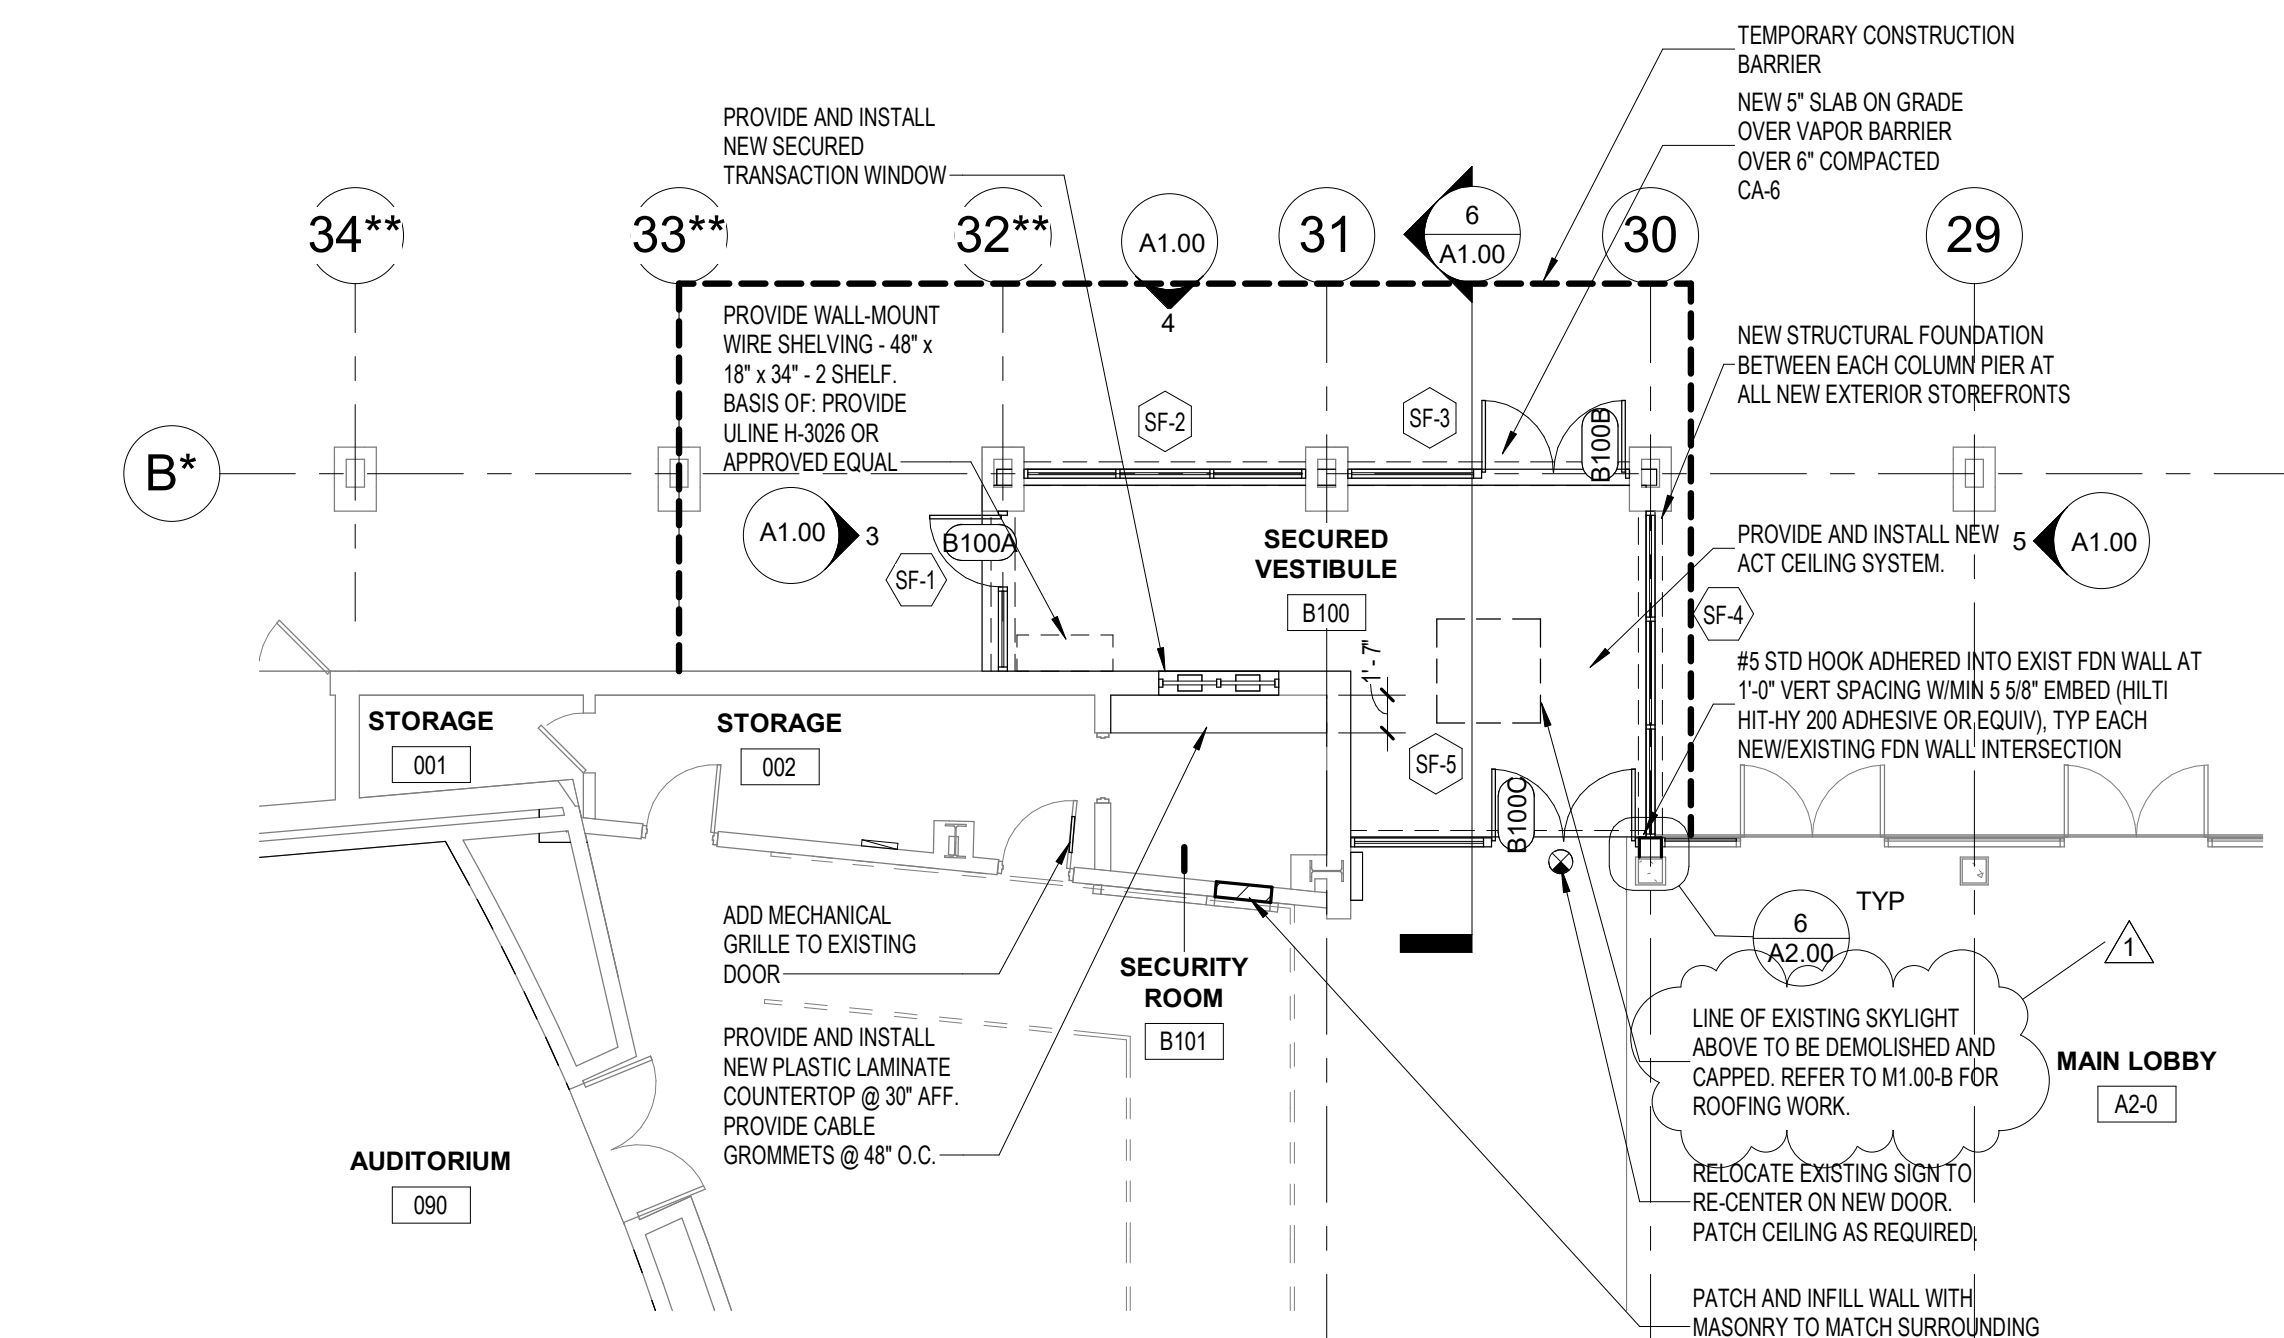



1 FIRST FLOOR - MAIN ENTRANCE NEW WORK PLAN - AREA B
1/8" = 1'-0"

GENERAL NOTES


- REFER TO DRAWING G1.00 FOR FULL GENERAL DEMOLITION NOTES.
- REFER TO MECHANICAL, PLUMBING, AND ELECTRICAL DRAWINGS FOR FULL MECHANICAL, PLUMBING, AND ELECTRICAL DEMOLITION SCOPE OF WORK.
- IN AREAS WHERE EXISTING WALLS, PARTITIONS, ETC. ARE TO BE REMOVED, IT SHALL BE NECESSARY TO REPAIR EXISTING CEILINGS, ADJUST AND RELOCATE OR REWIRE LIGHTING FIXTURES, AND REMOVE OR RELOCATE ELECTRICAL AND MECHANICAL COMPONENTS AS REQUIRED OR DIRECTED. DEMOLITION AREAS SHOWN ON PLAN ARE REPRESENTATIONAL ONLY AND SHOULD NOT BE CONSIDERED ALL ENCOMPASSING. CONTRACTOR WILL BE RESPONSIBLE FOR ALL REMOVAL AND REPLACEMENT OF ADJACENT CONSTRUCTION NECESSARY TO COMPLETE THE WORK.
- WASH AND CLEAN ALL EXISTING INTERIOR HVAC GRILLES AND DIFFUSERS WHICH ARE TO REMAIN (CEILING AND WALL MOUNTED, AND FREESTANDING AT EXPOSED CONSTRUCTION).
- EXISTING WALLS, FLOORS, AND CEILINGS WHICH ARE DAMAGED AND ARE TO REMAIN SHALL BE PATCHED AND REBUILT AS REQUIRED TO MATCH SURROUNDING CONSTRUCTION, AT NO ADDITIONAL COST TO THE OWNER.
- ACTIVE PIPES, CONDUITS, AND OTHER UTILITIES OF ALL TYPES, WHETHER SHOWN IN THE CONSTRUCTION DOCUMENTS OR NOT, MUST BE PROTECTED AT ALL TIMES DURING THE CONSTRUCTION OF THE WORK. EXTREME CARE SHALL BE EXERCISED AT ALL TIMES NOT TO DAMAGE ANY SUCH PIPES AND CONDUITS. WHERE DAMAGE OCCURS, CONTRACTOR CAUSING THE DAMAGE SHALL REPAIR SUCH DAMAGE IN A MANNER APPROVED BY THE ARCHITECT AND OWNER, AND AT NO CHANGE IN THE CONTRACT PRICES OF CONTRACTOR.
- IN AREAS WHERE EXISTING DOORS, WINDOWS, ETC. ARE REQUIRED TO BE REMOVED TO DISPOSE OF EXISTING MECHANICAL SYSTEM, CONTRACTORS MUST REINSTALL, REPAIR, OR REBUILD CONDITION TO MATCH SURROUNDING CONSTRUCTION OR BETTER, AT NO ADDITIONAL COST TO THE OWNER.
- ALL SUPPLY AND RETURN DIFFUSERS NOT ORIGINAL TO BUILDING AND ARE BEING ABANDONED SHALL BE REMOVED.
- ALL CORING REQUIRED FOR NEW WORK IS TO BE INCLUDED IN THE BASE BID. ALL PENETRATIONS TO BE COORDINATED WITH ADJACENT STRUCTURE. REFER TO ROOM FINISH SCHEDULE FOR EXISTING WALL/FLOOR/CEILING MATERIALS. NO EXTRAS WILL BE CONSIDERED FOR MULTIPLE PASSES REQUIRED TO CORE THROUGH MULTIPLE MATERIALS. CLEANING OF ALL DEBRIS AND WET DRILL RUNOFF WILL BE REQUIRED TO RESTORE ADJACENT CONSTRUCTION TO ITS FORMER CONDITION.
- PROTECT ALL FLOORS THROUGHOUT THE PROJECT PER THE GENERAL NOTES ON G1.00. ANY DAMAGE TO EXISTING FLOORS MUST BE REPLACED, IN KIND, AT THE EXPENSE OF THE CONTRACTOR CAUSING THE DAMAGE.

KEY PLAN

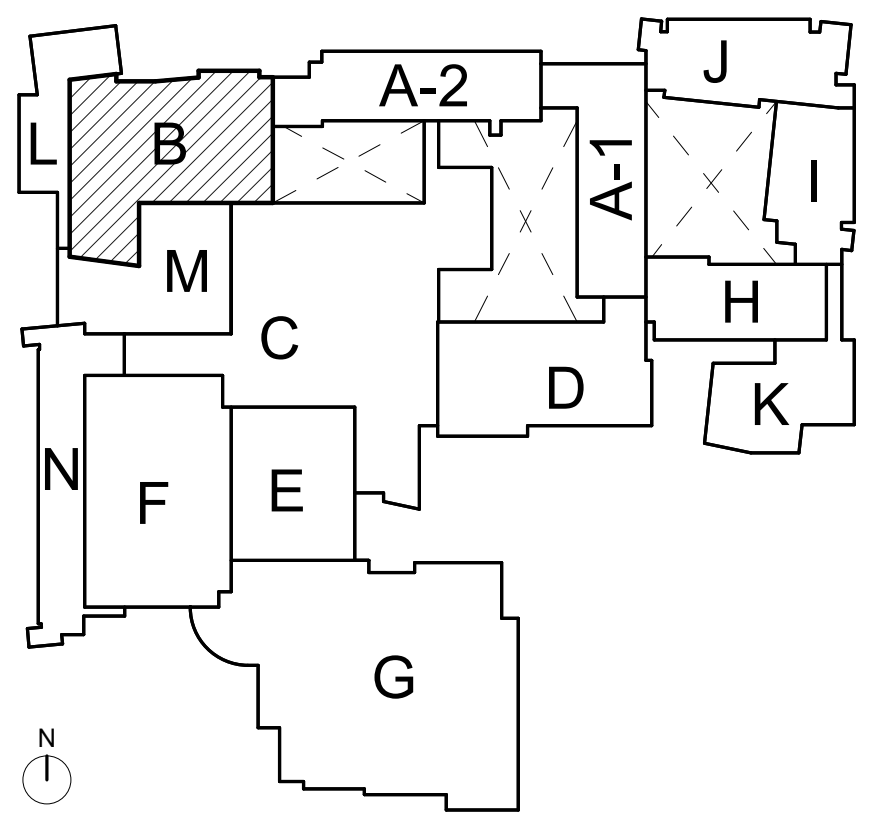


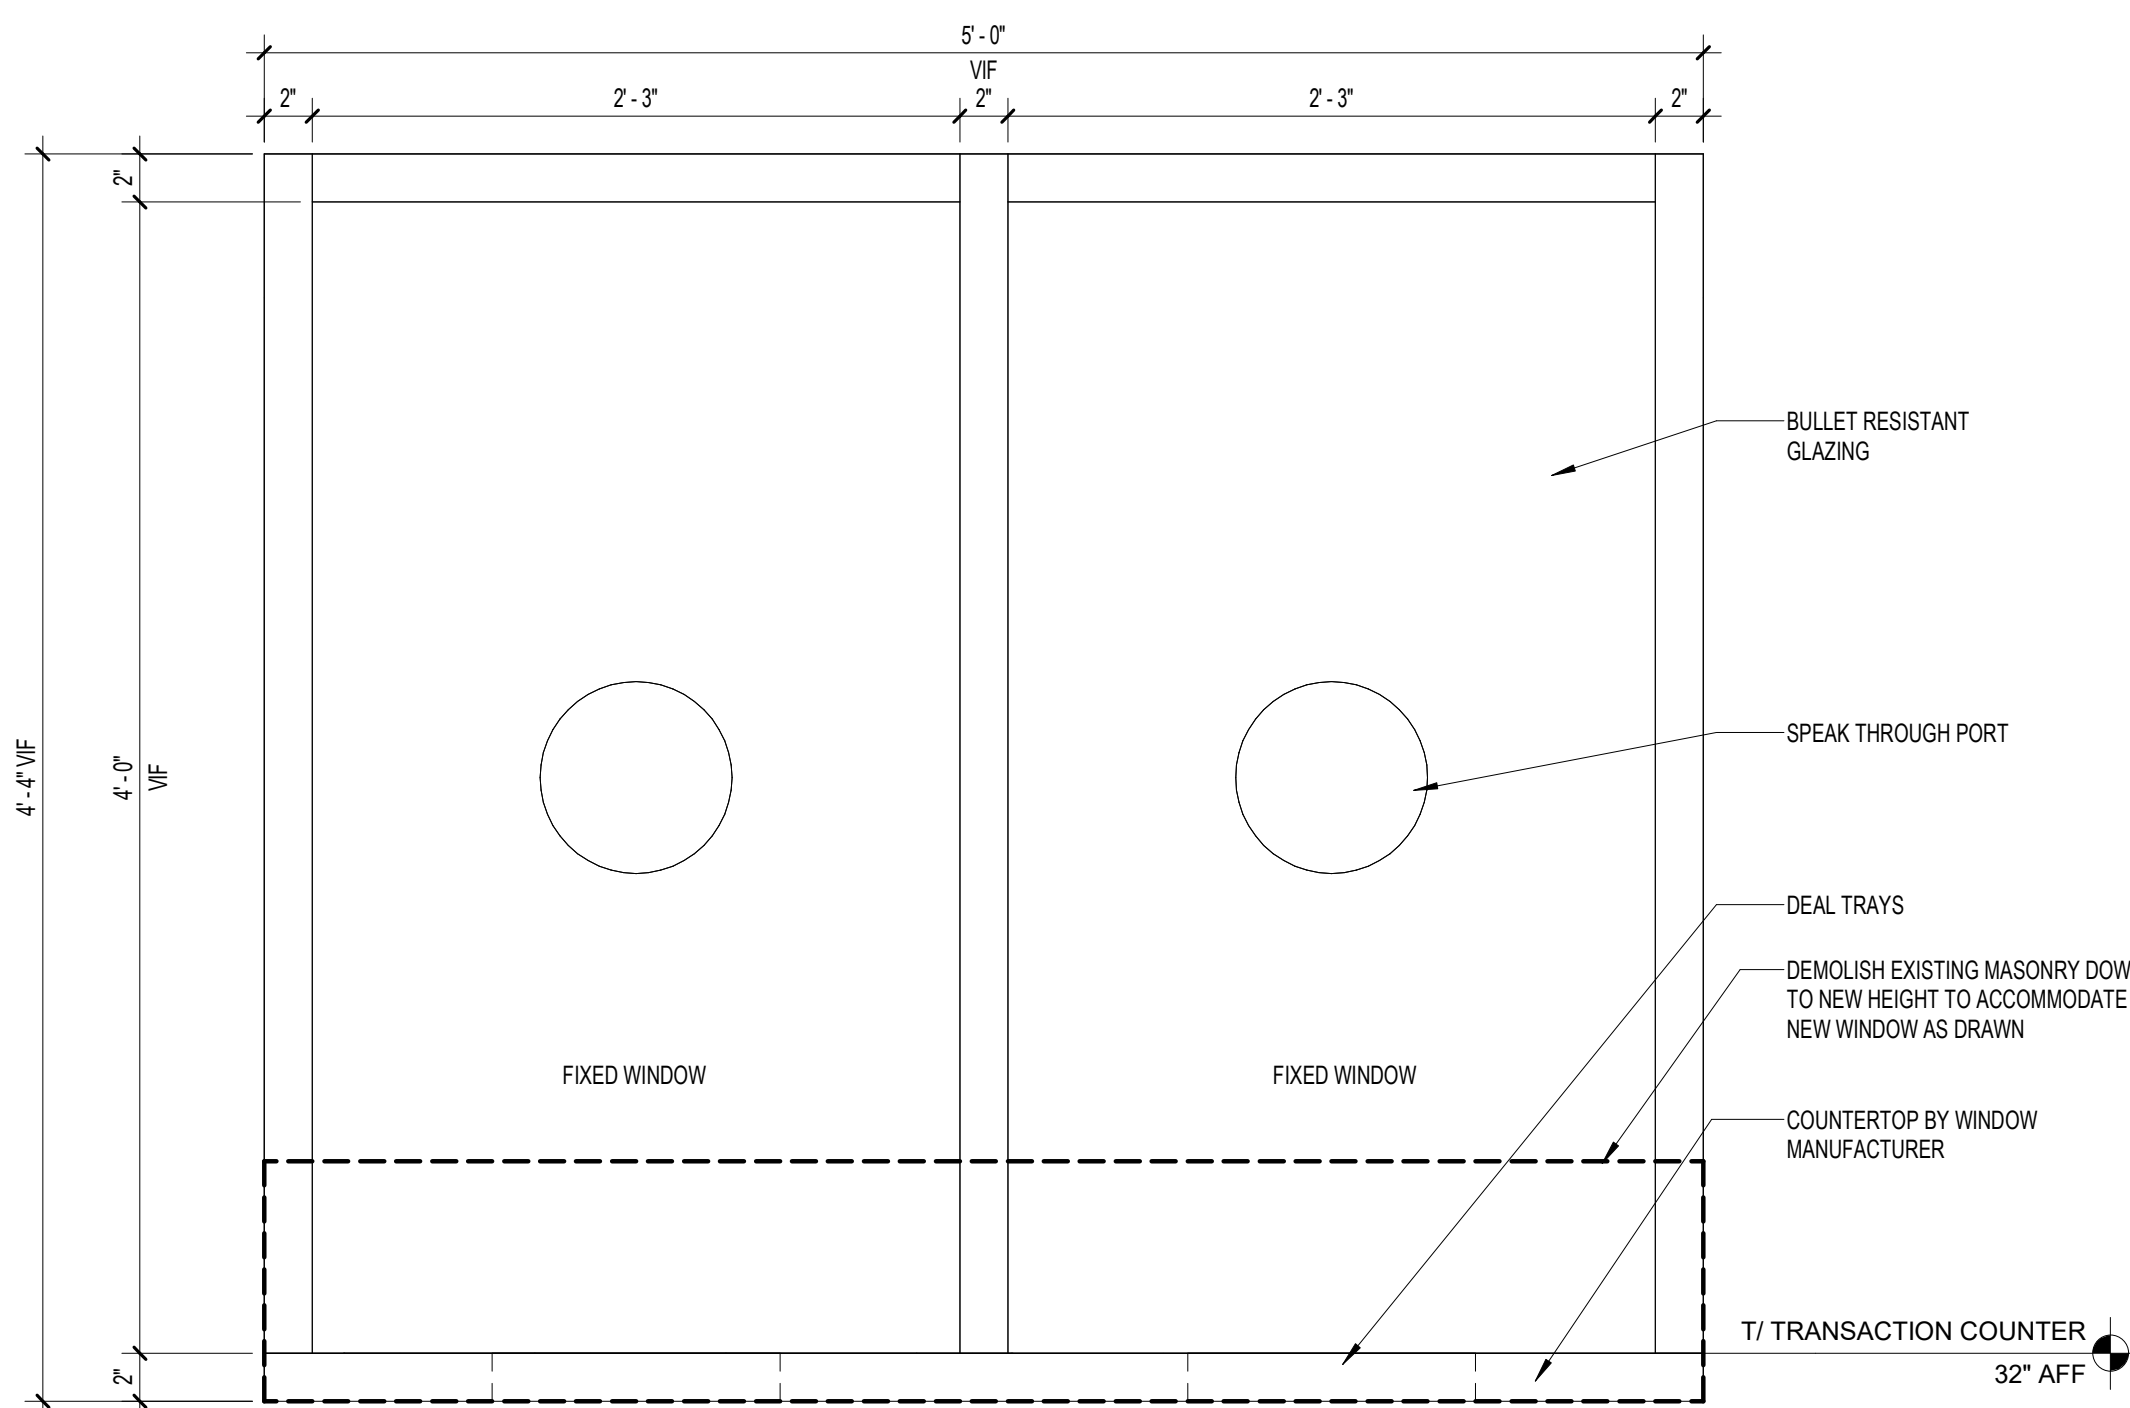


3 FIXED TRANSACTION WINDOW - ELEVATION
1 1/2" = 1'-0"

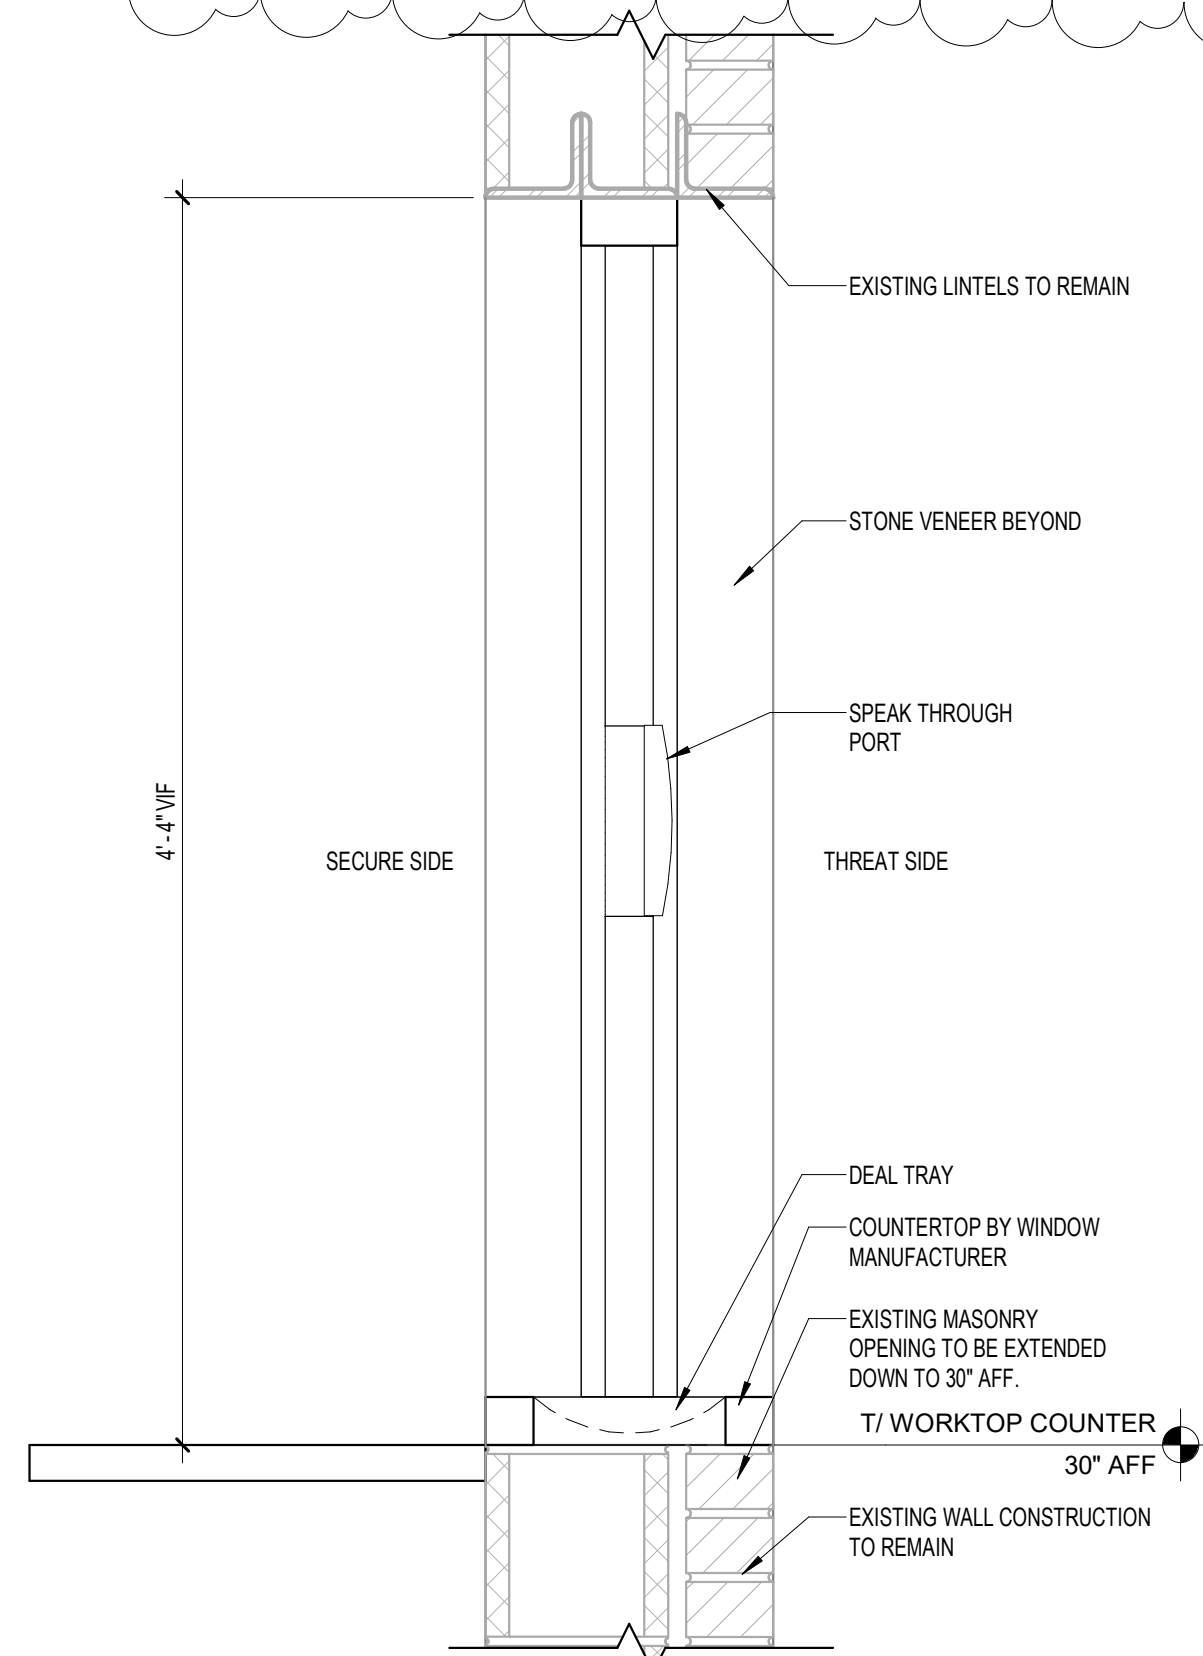


2 FIXED TRANSACTION WINDOW - SECTION
1 1/2" = 1'-0"

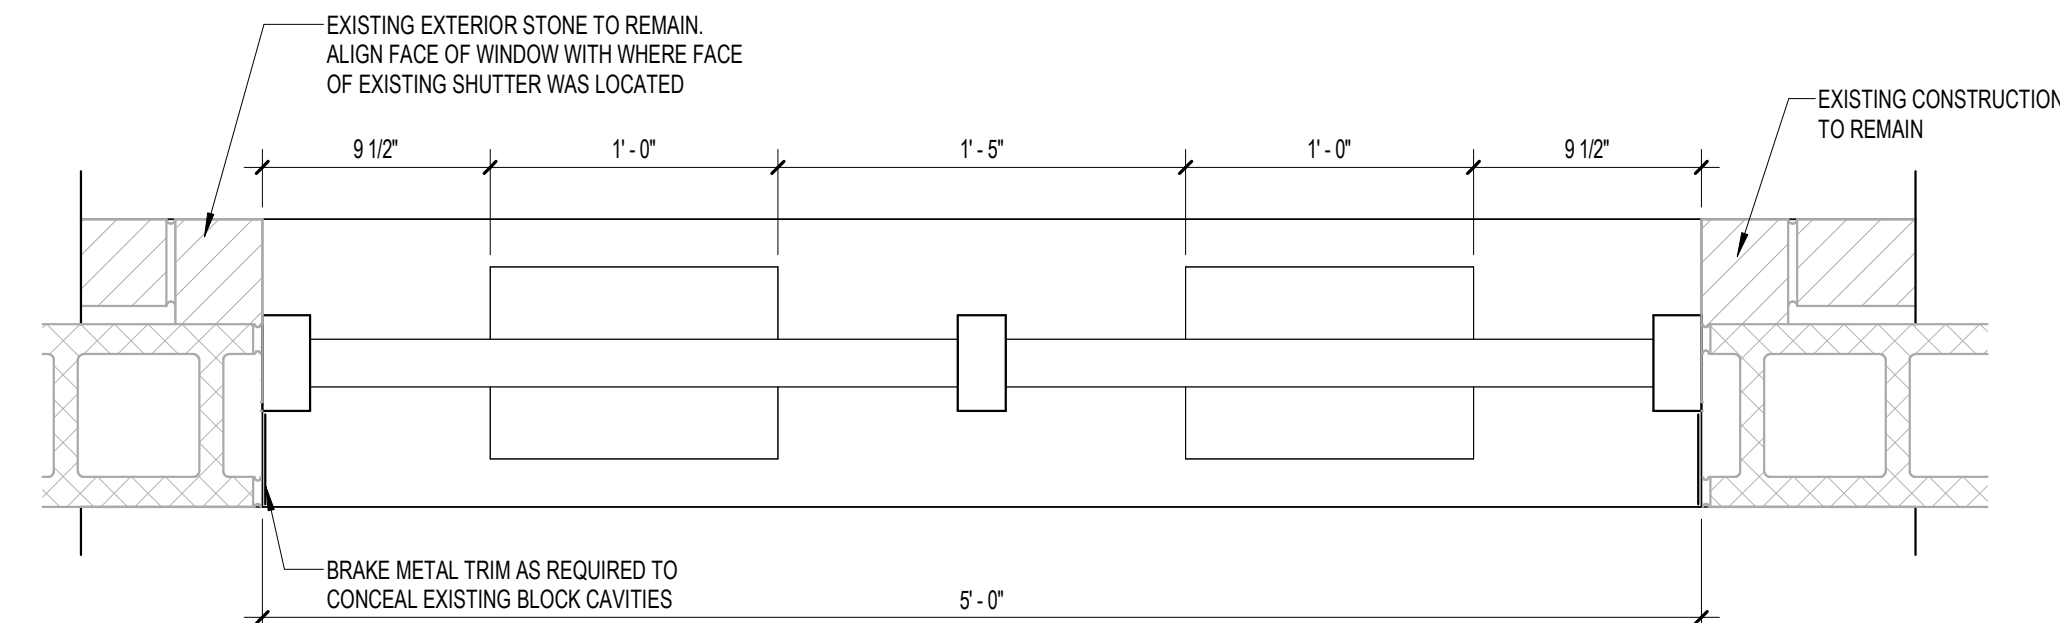


1 FIXED TRANSACTION WINDOW - PLAN
1 1/2" = 1'-0"

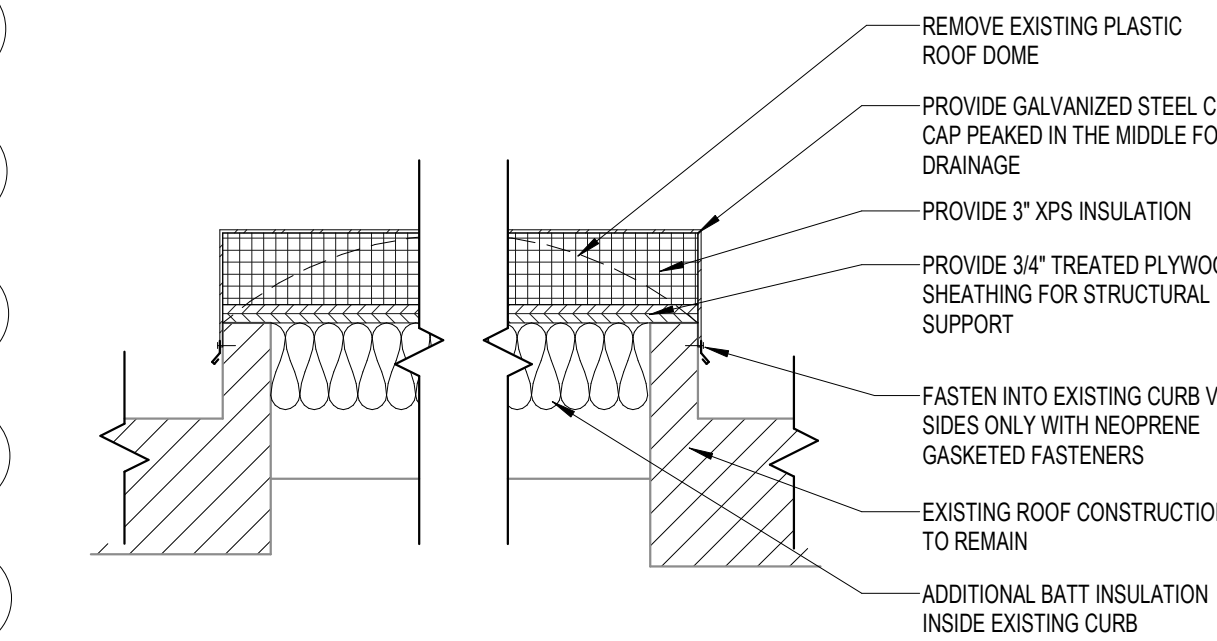


4 ROOF CANOPY INFILL DETAIL
1 1/2" = 1'-0"

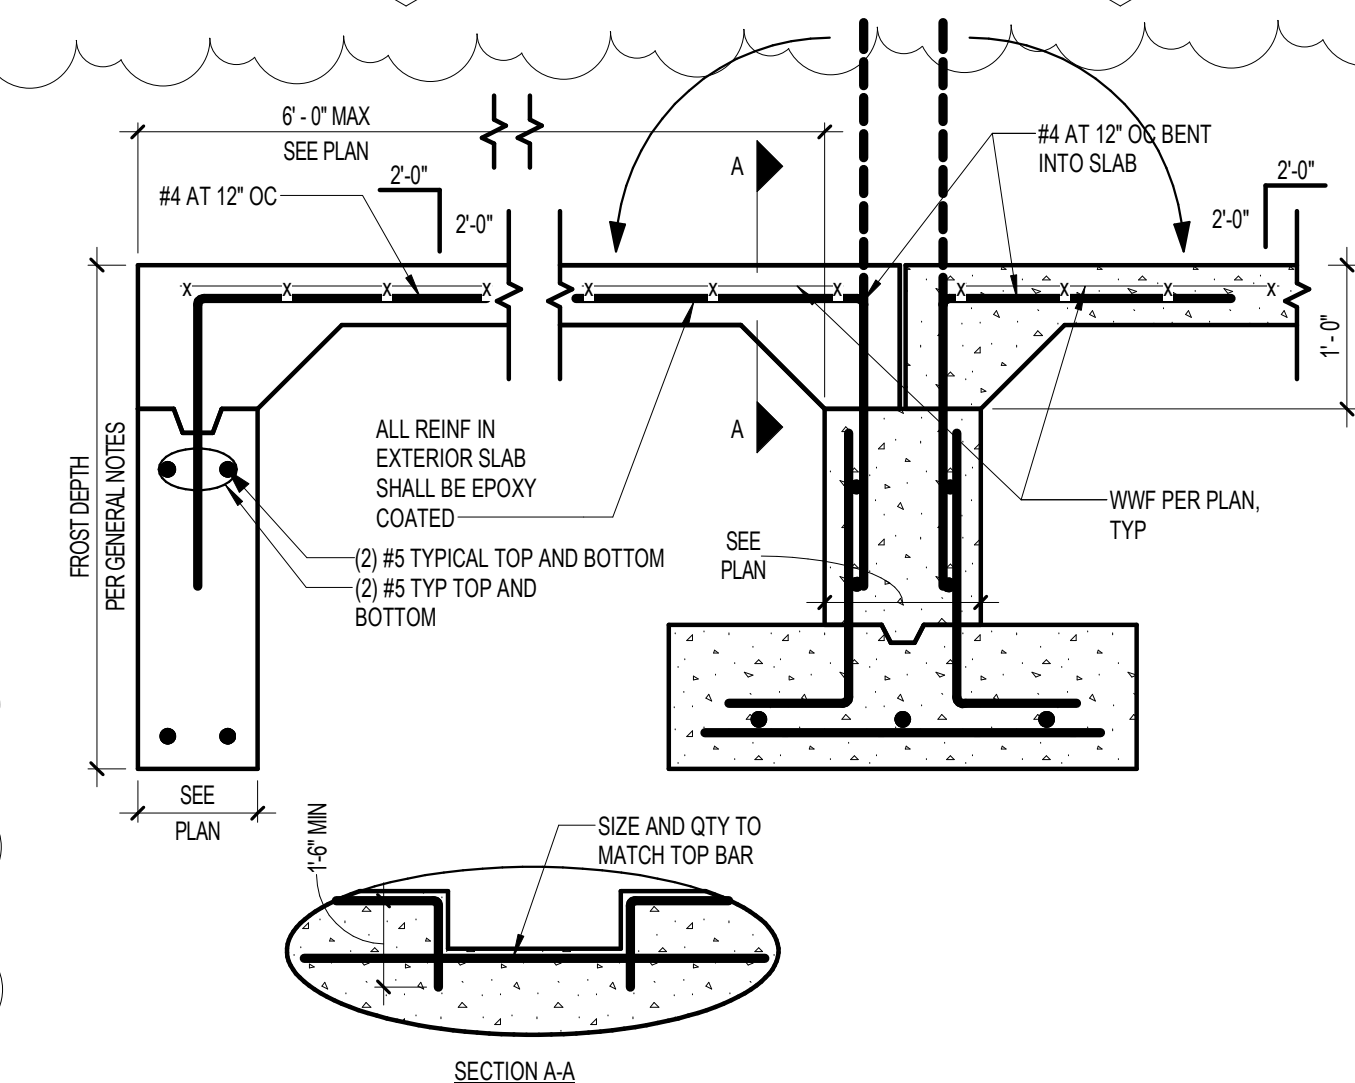


8 TYPICAL SECTION AT EXTERIOR DOOR
3/4" = 1'-0"

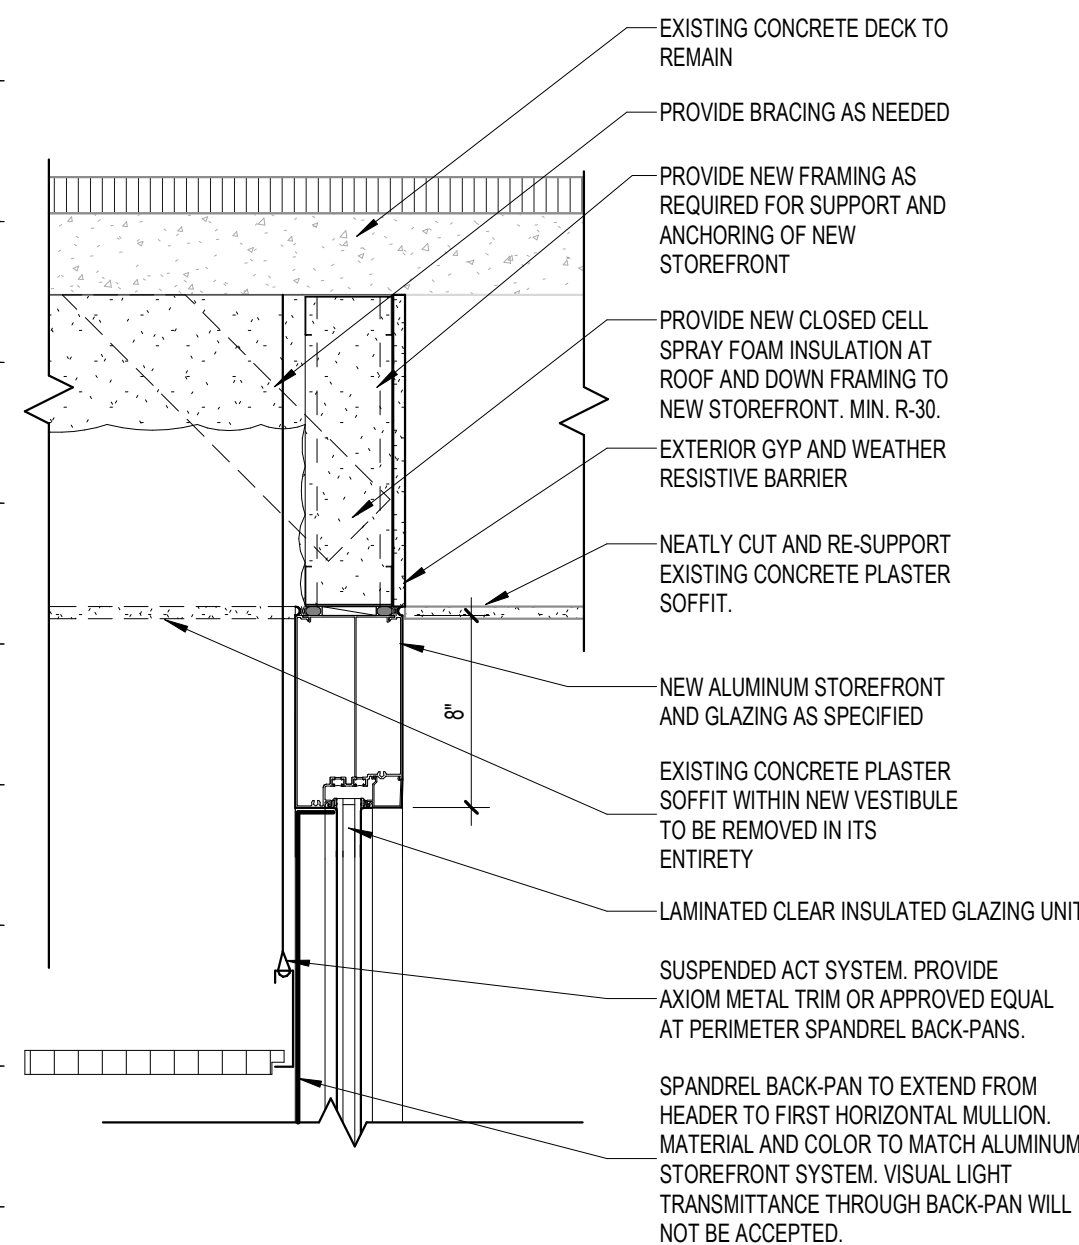


5 TYPICAL HEADER DETAIL - MAIN ENTRANCE
1 1/2" = 1'-0"

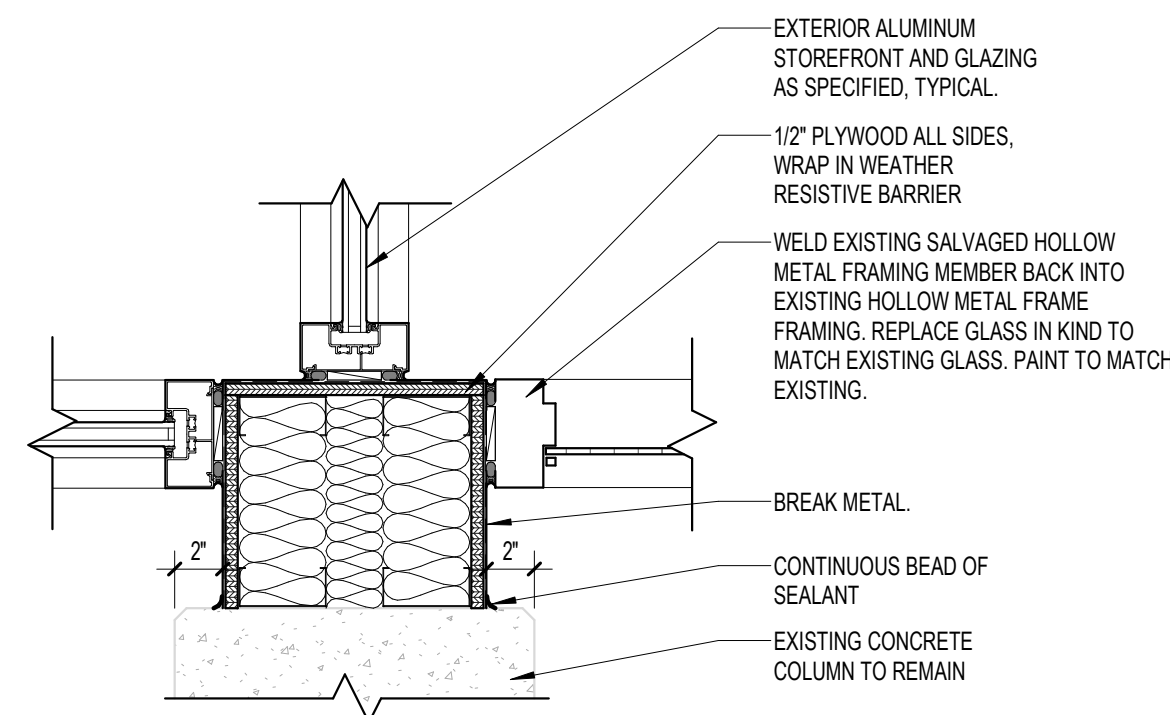


6 PLAN DETAIL - STOREFRONT JAMB TO COLUMN CONNECTION
1 1/2" = 1'-0"

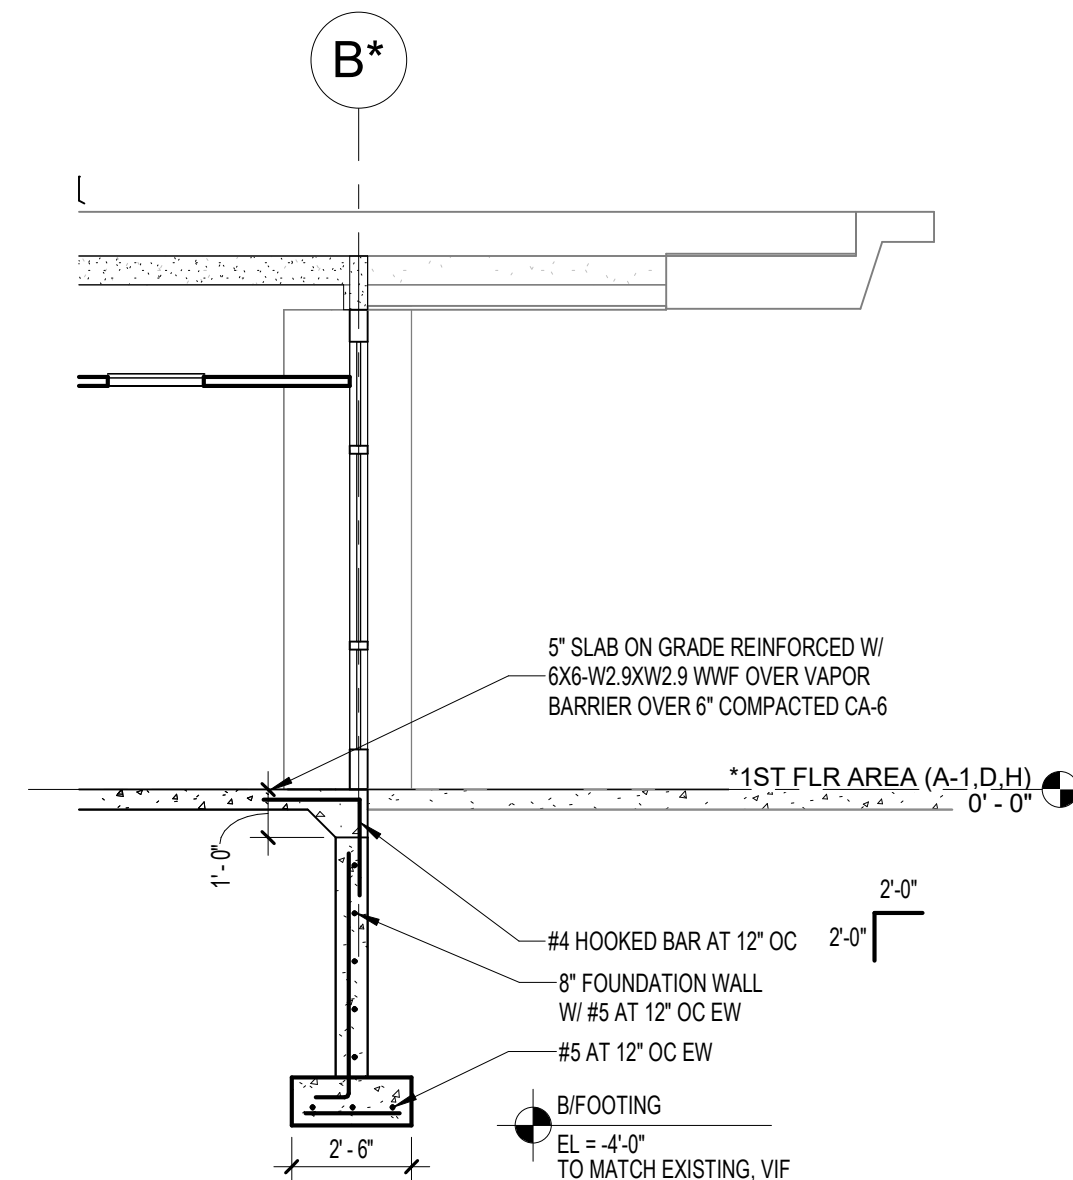


7 FIRST FLOOR - MAIN ENTRANCE - ENLARGED WALL SECTION - AREA B
1/4" = 1'-0"

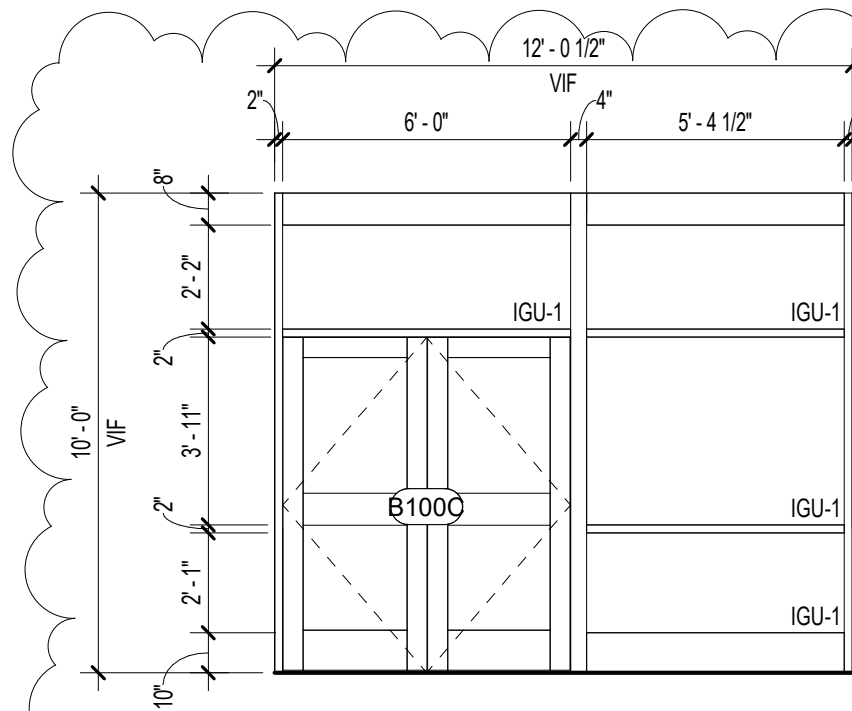


SF-5

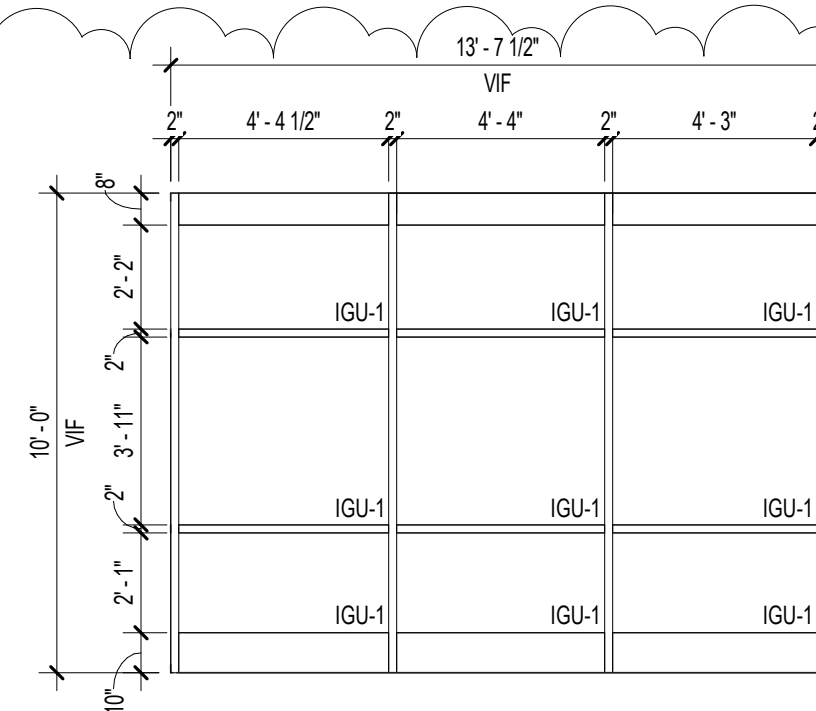


SF-4

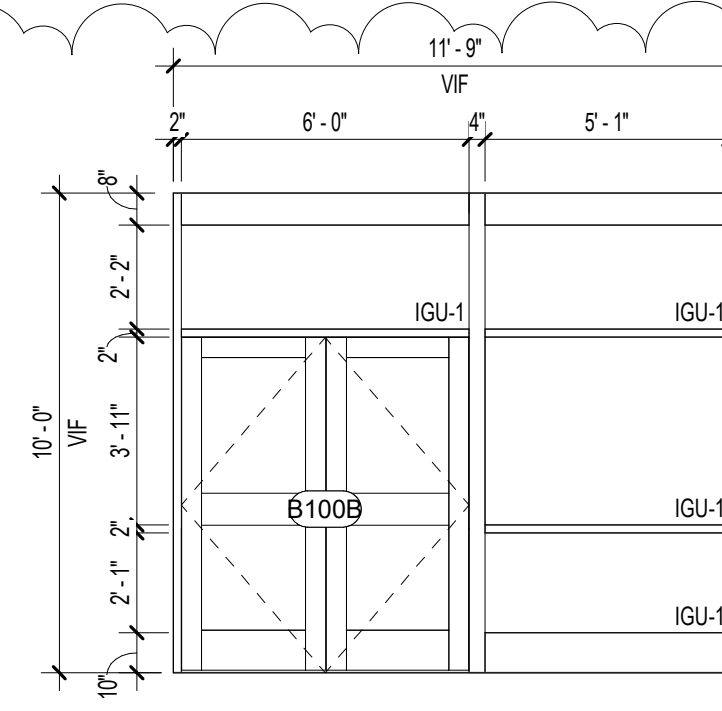

SF-3

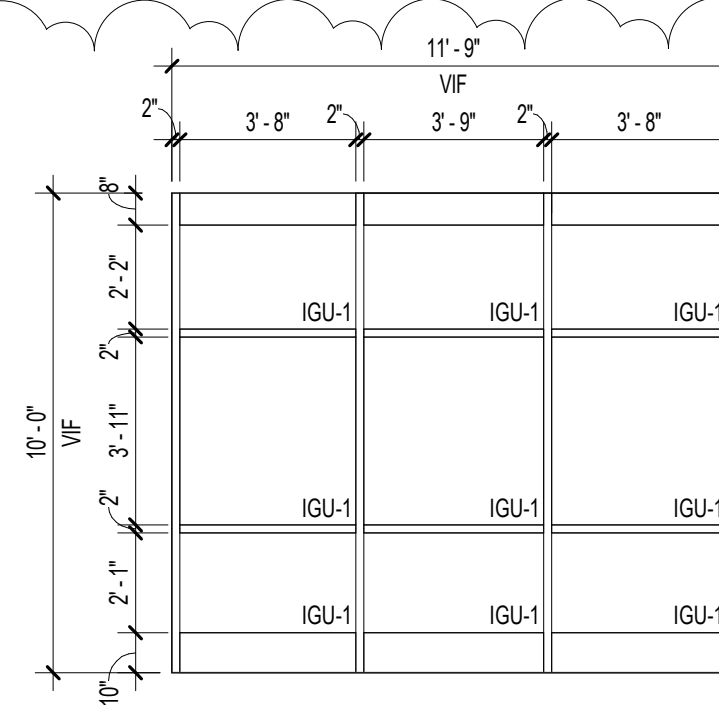

SF-2

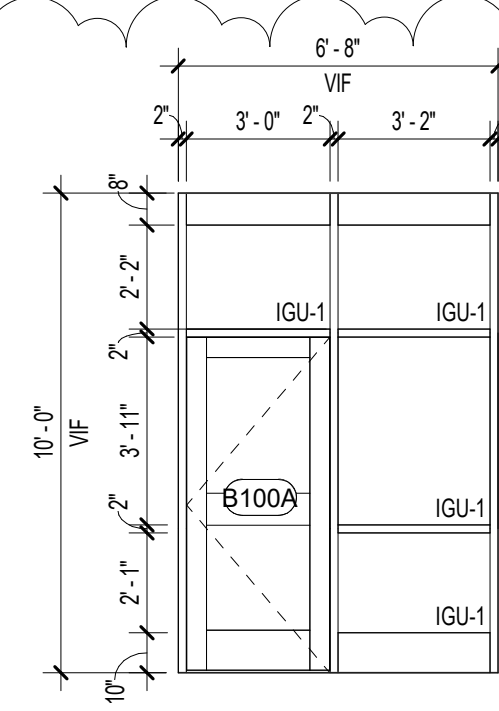


SF-1


GENERAL NOTES

1. CONTRACTOR TO VERIFY EXISTING ROUGH OPENING DIMENSIONS PRIOR TO SHOP DRAWING SUBMITTAL.
2. CONTRACTOR TO VERIFY ALL EXISTING HEAD, JAMB, AND SILL DETAILS PRIOR TO SHOP DRAWING SUBMITTAL.
3. CONTRACTOR TO SUBMIT SHOP DRAWINGS OF PROPOSED TYPICAL TRIM DETAILS.
4. CONTRACTOR TO INSTALL ALUMINUM FRAMED STOREFRONT SYSTEM AND ALL ASSOCIATED TRIM. REFER TO SPECIFICATIONS FOR MORE DETAILS.
5. ALL GLAZING TO BE INSULATED DOUBLE PANE GLAZING, 1" CLEAR, LOW "E" U.N.O.
6. CUT, PREP, PATCH, AND REPAIR EXISTING CONDITIONS AS REQUIRED FOR INSTALLATION OF NEW STOREFRONT AT ALL SILLS, JAMBS, AND HEADS. REFER TO DETAILS FOR ADDITIONAL INFORMATION.
7. PROVIDE CONSISTENT FINISH AROUND ENTIRE WINDOW ASSEMBLY.


GLAZING NOTES AND LEGEND



LAMINATED CLEAR INSULATED GLAZING UNIT. REFER TO SPECIFICATIONS. LAMINATED GLAZING TO BE BASE BID.



NOT USED



NON-LAMINATED INSULATED CLEAR GLAZING UNIT.
REFER TO SPECIFICATIONS. REFER TO ALTERNATES.

1. PURSUANT TO 2015 IBC 2406 SAFETY GLAZING PROVIDE FULLY TEMPERED GLAZING IN THE FOLLOWING SITUATIONS ON THIS PROJECT.
 - A. ALL GLAZING IN DOORS.
 - B. ALL GLAZING IN RAILINGS.
 - C. ALL GLAZING PANELS LARGER THAN 9 SQ FT IN AREA.

ALTERNATES

ALTERNATE #01 - FURNISH AND INSTALL NON-LAMINATED INSULATED GLAZING IGU-3 IN LIEU OF LAMINATED GLAZING IGU-1. FURNISH AND INSTALL 3M SAFETY SECURITY WINDOW FILM OR EQUAL.

ALTERNATE #02 - FURNISH AND INSTALL NEW STOREFRONT (BEYOND VESTIBULE, FROM GRIDLINE 30 EASTWARD, ROUGHLY 53 FEET) AS SHOWN ON SHEET A1.00.

ALTERNATE #02A - FURNISH AND INSTALL NON-LAMINATED INSULATED GLAZING IGU-3 IN LIEU OF LAMINATED GLAZING IGU-1. FURNISH AND INSTALL 3M SAFETY SECURITY WINDOW FILM OR EQUAL FOR ALTERNATE 2 STOREFRONT LOCATIONS.

[illegible]

DRAWING TITLE:

INTERIOR
ELEVATIONS,
STOREFRONT
ELEVATIONS, WALL
TYPES, & DETAILS

2026 SECURED ENTRANCE
EAST AURORA HIGH SCHOOL
500 TOMCAT LANE, AURORA, IL 60505
EAST AURORA SCHOOL DISTRICT #131
PROJECT NUMBER: 251008

CORDOGAN CLARK & ASSOCIATES, INC.
515 REDWOOD DRIVE
AURORA, ILLINOIS 60506
630-896-4678
AUGUST 2026

ADDENDUM 03

SECTION 004000 – FORM OF PROPOSAL

A. GENERAL

FORM OF PROPOSAL FOR: EAST AURORA HIGH SCHOOL 2026 SECURED ENTRANCE PROJECT

SUBMITTED BY: _____ DATE: _____

TO: Ashraf Kawash, Director of Buildings & Grounds, EASD #131

The undersigned having carefully examined the Contract Documents consisting of the following: Specifications (Inclusive of all Sections and Exhibits); Drawings; and Addenda, if any. As prepared by Cordogan, Clark & Associates, which Contract Documents form a component part of this Proposal, and having examined the premises and conditions affecting the work, proposes to furnish all labor and materials required for the Contractor as follows:

B. BASE BID

In accordance with Drawings and Specifications for general contract including all divisions of work as indicated in Work Included in the Specifications for General Construction and as shown in the drawings.

EAST AURORA HIGH SCHOOL 2026 SECURED ENTRANCE PROJECT

I have walked the building with my construction team, and we have a thorough understanding of the existing conditions for the building.

I understand that I need to provide a site project superintendent (an employee of the prime contractor) for the project. This person will be on site daily to supervise the site activity for the duration of the project and coordinate all project schedules, change orders, RFI's, change directives and trades. Field foreman does not qualify for this role.

Signature: _____

Printed Name: _____

BASE BID**EAST AURORA HIGH SCHOOL**

Base Bid (Schedule of Values) \$ _____

+ Contingency Allowance \$ 50,000.00

Total Base Bid Amount: \$ _____

As Written: _____

The undersigned understands that this proposal is for the work fully described in the specifications and individual Bid Package scope of work thereafter for which the proposal is intended.

C. ADDENDA

I acknowledge receipt of the following Addenda:

No. _____ Date _____

No. _____ Date _____

No. _____ Date _____

No. _____ Date _____

D. SCHEDULE OF ALTERNATES

The selected alternates will be used to determine the lowest qualified Bid for this Bid Package. The undersigned Bidder proposes the amount below be added to or deducted from the Base Bid if alternates are accepted by Owner. Amounts listed for each alternate include costs of related coordination, modification, or adjustment and all alternates shall be inclusive of Contractor overhead and profit regardless of whether additive or deductive. Owner reserves the right to accept or reject any alternate, in any order, and to award or amend the Contract accordingly within 90 days of the Notice of Award unless otherwise indicated in the Contract Documents.

Bidder is required to note if alternate is additive, deductive, or no change from base bid amount. If the alternate does not affect the Contract Sum, the Bidder shall indicate "NO CHANGE." If the alternate does not affect the Work of this Contract, the Bidder shall indicate "NOT APPLICABLE." The Bidder shall be responsible for determining from the Contract Documents the effects of each alternate on the Contract Time and the Contract Sum. Acceptance or non-acceptance of any alternates by the Owner shall have no effect on the Contract Time unless the "Schedule of Alternates" Article below provides a formatted space for the adjustment of the Contract Time. Refer to specification 012300 ALTERNATES for additional information.

East Aurora High School Alternates [ADDENDUM 03]

Alternate #01	Furnish and install non-laminated insulated glazing unit IGU-3 in lieu of laminated glazing IGU-1. Furnish and install 3M Safety Security Window Film or equal.	\$ _____ Add/Deduct/No Change
Alternate #02	Furnish and install new storefront (beyond vestibule, from Gridline 30 Eastward, roughly 53 feet) as shown on Sheet A1.00.	\$ _____ Add/Deduct/No Change
Alternate #02A	Furnish and install non-laminated insulated glazing unit IGU-3 in lieu of laminated glazing IGU-1. Furnish and install 3M Safety Security Window Film or equal for Alternate #02 Storefront locations.	\$ _____ Add/Deduct/No Change

E. SCHEDULE OF VALUES

The following Schedule of Values shall be furnished for verification of scope of work, establish unit prices, and determine base bid. All work as identified in drawings to be included in Bid. Items identified in drawings but not as a specific unit price, to be included in miscellaneous item line. All unit costs are to include equipment, material, and labor costs, including overhead and profit. See Specification Section 012100 for description and assignment of allowances. Bidder must quote on all items called for in the Bid Proposal relative to their scope of work and / or Bid Package. Bidder is also required to email the Schedule of Values and Unit Pricing in Microsoft Excel (.XLS) electronic format one to 24 hours after Bid Due Date but no earlier or later to constructionadminaurora@cordoganclark.com. Bidders may attach a printed copy of the Schedule of Values in lieu of handwriting each entry.

BASE BID EAST AURORA HIGH SCHOOL 2026 SECURED ENTRANCE		COST
	General Requirements	\$
	Demolition (equipment and building related)	\$
	Architectural Improvements (all non-electrical or mechanical work)	
	Concrete	\$
	Masonry	\$
	Miscellaneous Metals	\$
	Rough and Finish Carpentry	\$
	Millwork- Furnished and Installed	\$
	Roofing Architectural Sheet Metal	\$
	Doors, Frames, Windows, Glazing, & Hardware	\$
	Metal Stud Framing and Drywall	\$
	Ceilings	\$
	Flooring	\$
	Paint	\$
	Miscellaneous Architectural items	\$
	Mechanical System Material and Equipment	
	Equipment- By Mechanical Contractor	\$
	Materials- By Mechanical Contractor	\$
	Mechanical System Installation	\$
	Plumbing Materials	\$
	Plumbing Installation	\$
	Electrical Materials	\$
	Electrical Installation	\$
	Electrical- Lighting Materials	\$
	Electrical- Lighting Installation	\$
	Fire Alarms	\$
	Miscellaneous items not addressed above	\$
	General Conditions	\$
	Cleaning and Existing Equipment & Finish Protection	\$
	Insurance & Bonding	\$
	Overhead and Profit	\$
	SUB-TOTAL BASE BID:	\$

F. UNIT PRICES

All unit costs are to include equipment, material and labor costs, including bonding, overhead and profit. Bidder must quote on all items called for in their Bid Package. This Form is required to be attached to the Bid Form. The undersigned Bidder proposes the amounts below be added to or deducted from the Contract Sum on performance and measurement of the individual items of Work and for adjustment of the quantity given in the Unit-Price Allowance for the actual measurement of individual items of the Work. If the unit price does not affect the Work of this Contract, the Bidder shall indicate "NOT APPLICABLE." Refer to specification 012200 UNIT PRICES for additional information.

SCHEDULE OF UNIT PRICES

Unit Price #	Description	Unit/Quantity
Unit Price #01	Price to sawcut, remove, and replace 10 Square Feet (S.F.) of existing concrete walk.	\$_____ S.F.
Unit Price #02	Furnish and Install new WCPT flooring as specified	\$_____ S.F.
Unit Price #03	Furnish and Install new LVT flooring as specified	\$_____ S.F.
Unit Price #04	Furnish and install 5" slab on grade – including 6" compacted aggregate base	\$_____ S.F.
Unit Price #05	Furnish and install new acoustical ceiling system and grid, per specifications	\$_____ S.F.
Unit Price #06	Price to furnish and install 1" insulated condensate piping for typical terminal unit	\$_____ L.F.
Unit Price #07	Price to furnish and install Trane Mini-Split System	\$_____ EA.

G. BID SECURITY

Accompanying the proposal is a Bid Bond or (Certified Check) as surety in the amount of not less than 10% of the Base Bid payable to the Owner, which it is agreed will be forfeited if the undersigned fails to execute the Contract in conformity with Specifications and Furnish Performance and Labor and Material Payment Bonds as specified within ten (10) days after notification of the award of the Contract to the undersigned

H. PERFORMANCE / PAYMENT BOND

The undersigned agrees to provide an acceptable Performance and Labor and Material Payment Bonds, in accordance with AIA Document A312, in the amount of 100% of the Base Bid of which the cost of the Bonds are included in the Bid.

I. ATTACHMENT

The undersigned acknowledges that he has read and understands the CERTIFICATE OF ELIGIBILITY TO BID attached to this Bid Form and signed and attested thereto. The undersigned further acknowledges that said CERTIFICATE OF ELIGIBILITY is a part of the Contract Documents and will be attached to the

Agreement.

J. REJECTION AND WITHDRAWAL OF BID

The Owner reserves the right to accept or reject any or all the above proposals.

K. TIME OF COMPLETION

The undersigned agrees, if awarded the Contract, to begin work immediately upon notification by the Architect. The undersigned agrees, if awarded the Contract, to complete the work within the time frame specified in Specification Section 003000.

L. SIGNATURES FORM

IF AN INDIVIDUAL:

Longhand Signature of Bidder: _____

Doing Business as: _____

Business Address: _____

City: _____ State: _____ Zip: _____

IF A CO-PARTNERSHIP:

Name of Firm: _____

By: _____

Business Address: _____

City: _____ State: _____ Zip: _____

Names and Addresses of All Members of the Firm:

IF A CORPORATION:

Corporate Name: _____

A Corporation in State of: _____

By (President): _____

Name of Officers:

President: _____

Secretary: _____

Treasurer: _____

Corporate Seal:

ATTEST: _____

M. CERTIFICATE OF ELIGIBILITY TO BID

The Bidder/Contractor certifies that the Contractor is not barred from Bidding on the Contract as a result of a conviction for either Bid-Rigging or Bid Rotating under Article 33E of the Criminal Code of 1961. The Bidder/Contractor acknowledges that this certificate is a part of the Contract Documents and will be attached to the Owner/SP/Contractor Agreement.

Date: _____ Firm Name: _____

Official Address: _____

_____ By: _____

_____ Position: _____

Where Bidder is a Corporation, add:

Attest: _____
(Secretary) (Seal)

Subscribed and Sworn to Before Me this _____ day of _____, 20__

My Commission Expires: _____
Notary Public

_____, 20__ _____
Address

DRUG FREE WORKPLACE

The Bidder or Contractor, having 25 employees or more, does hereby certify pursuant to Section 3 of the Illinois Drug-Free Workplace Act (III. Rev. Stat. Ch. 127 132.313) that [he, she, it] shall provide a drug-free workplace for all employees engaged in the performance of work under the Contract by complying with the requirements of the Illinois Drug-Free Workplace Act, further certified that [he, she, it] is not ineligible for award of this Contract by reason of debarment for a violation of the Illinois Drug-Free Workplace Act.

Firm Name: _____

By: _____
(Authorized Agent of Contractor)

Title: _____

Subscribed and sworn to before me _____

This day of _____

CERTIFICATE OF COMPLIANCE WITH ILLINOIS HUMAN RIGHTS ACT

_____(Contractor), does hereby certify pursuant to P.A. 87-1257, the Illinois Human Rights Act, that (he, she, it) has adopted a written sexual harassment policy that includes at the minimum the following information: (I) the illegality of sexual harassment; (II) the definition of sexual harassment under Illinois law, (III) a description of sexual harassment, utilizing examples; (IV) internal complaint process including penalty; (V) the legal recourse, investigative and complaint process available through the Illinois Department of Human Rights and the Illinois Human Rights Commission; (VI) directions on how to contact the Department and Commission; and (VII) protection against retaliation as provided by Section 6-101 of the Illinois Human Rights Act.

By: _____

Its: _____

Date: _____

Notary Public

CERTIFICATION REGARDING CRIMINAL BACKGROUND INVESTIGATIONS

Contractor hereby represents, warrants, and certifies that no officer or director thereof has any knowledge that any employee thereof has been convicted of committing or attempting to commit “Criminal Code of 1961,” 720 ILCS, Sections 5/11-6 (Indecent Solicitation of a Child), 5/11-9 (Public Indecency), 5/11-14 (Prostitution), 5/11-15 (Soliciting for a Prostitute), 5/11-15.1 (Soliciting for a Juvenile Prostitute), 5/11-9 (Pimping), 5/11-19.1 (Juvenile Pimping), 5/11-19.2 (Exploitation of a Child), 5/11-20 (Obscenity), 5/11-20.1 (Sexual Assault), 5/12-14 (Aggravated Criminal Sexual Abuse), and/or those offenses defined in the “Cannabis Control Act,” 720 ILCS 570/100 et. seq. And/or any offense committed or attempted in any state or against the laws of the United States, which if committed or attempted in this State, would have been punishable as on or more of the foregoing offenses.

Contractor further agrees that it shall not employ any person who have or may have direct, daily contact with the pupils of any school in the district, and for whom a criminal background investigation has not been conducted pursuant hereto, and further represents and agrees that all applicants for any such employment shall furnish with their applications the attached written “Authorization for Criminal Background Information” form authorizing the Board of Education to request a criminal background investigation of said applicant pursuant to Section 5/10-21.9 of the School Code of Illinois and to receive criminal history record information pursuant thereto to determine if the applicant has been convicted of committing or attempting to commit any of the criminal or drug offenses enumerated above. Contractor further agrees to submit with said authorization payment for any costs and expenses associated with the criminal background investigation.

Contractor further represents, warrants, and certifies that no applicant for employment with respect to whom the criminal investigation reveals any conviction for committing and/or attempting to commit any of the above enumerated offenses, shall be employed thereby in any position that involves or may involve contact with the students of the school district.

This certification is executed on the date hereinafter indicated by the designated contractor by its duly authorized officer.

By:

Its:

Date:


END OF SECTION 004000

East Aurora High School - 2026 Secured Entrance Project #251008

Request For Information (RFI) Log




RFI #	CONTRACTOR	CONTRACTOR'S QUESTION	DRAWING REF.	SPEC REF.	DATE REC'D.	DATE RETURNED	RESPONSE
1	Lite Construction	1. Expected depth of the Foundation is 50". 2. Expected thickness of the footing is 12". 3. For demo of existing concrete sidewalks and prep for new foundation walls/footings, would restoration of the landscape be required? 4. Would the middle set of doors be able to be blocked off for sawcutting, digging, and concrete framing/pour? a. Once the new foundation, footing, and slab is poured this could be moved back in closer to drawings.			8/18/2026	8/21/2026	1. Yes, the expected depth of the foundation is assumed to be 50". 2. Yes, the expected thickness of the footing is expected to be 12". 3. Yes, partial restoration of the landscape would be required as impacted by new work, contractor should factor in pricing for new seed, mulch, etc. 4. Yes, however Owner approval is required as to not impact scheduled district events. Coordination will be required, weekends could be the most ideal for this work.
2	Lite Construction	Whether or not we need to incorporate any additional steel support for CU-1 or whether a Thybar system like the attached would be sufficient? PDFs have been attached for reference.			8/18/2026	8/21/2026	TEMS rails will work for the CU. Piping and Consuit should be routed through pipe curb as shown on attached drawing reference, see ADD03_ASK01.

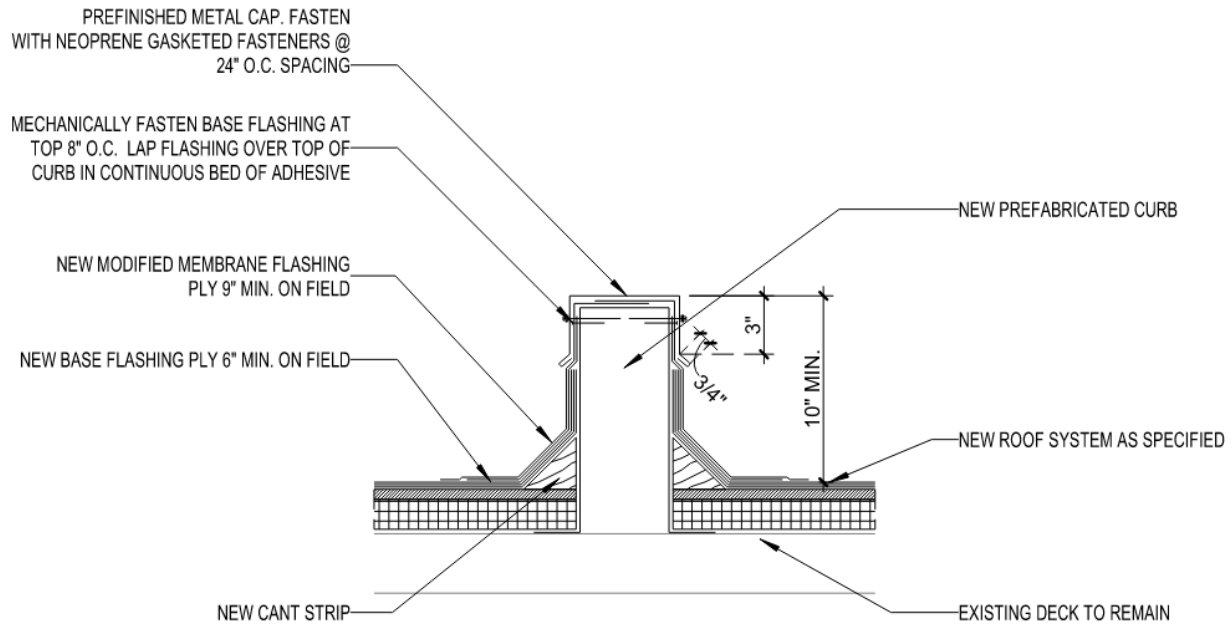

○ TYP. ROOF DETAIL AT EQUIPMENT SUPPORT
NOT TO SCALE

NOTE:

1. ROOF CURB PROVIDED BY MECHANICAL CONTRACTOR. COORDINATE INSTALLATION AND FLASHING WITH THE GENERAL CONTRACTOR.
2. MECHANICAL CONTRACTOR SHALL COORDINATE ROOF OPENING, CURB SIZE AND HEIGHT REQUIRED FOR PIPING PENETRATION.

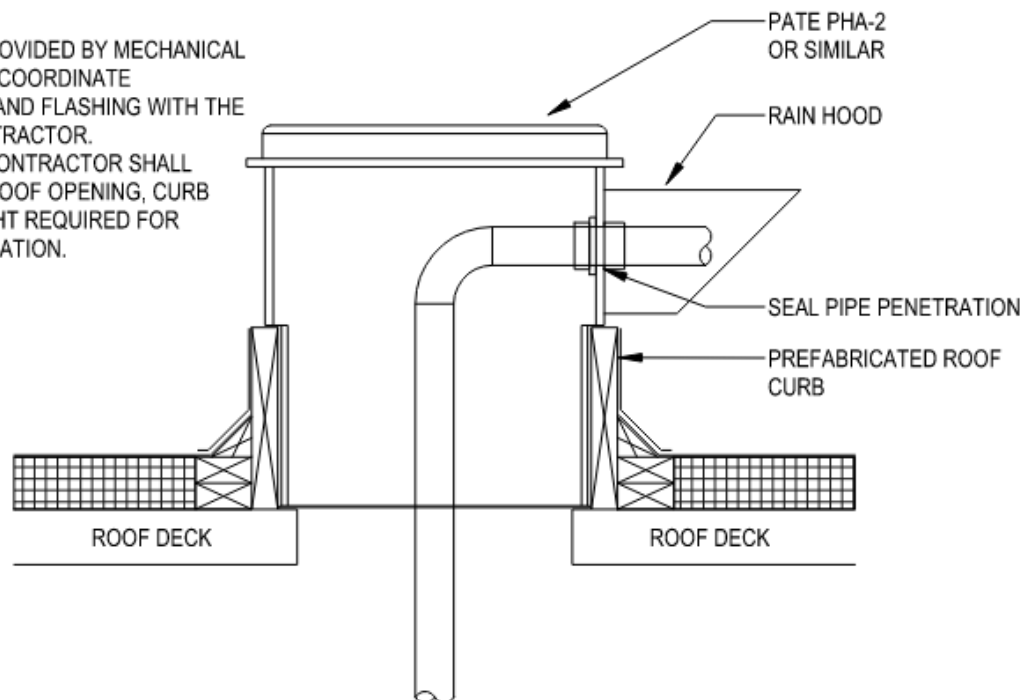


○ TYPICAL ROOF PIPE CURB DETAIL
NOT TO SCALE

thybar
CORPORATION
*Thybar makes it right the first time,
every time*

Project:


Submittal Date:

Equipment Supports are fabricated in three basic styles designated for the following applications:

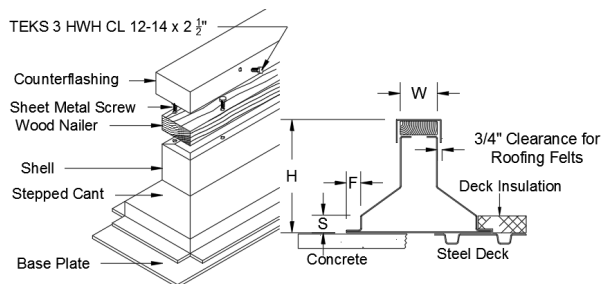


TEMS-1

For Insulated roof decks with 3" cant and variable step to match deck insulation thickness.

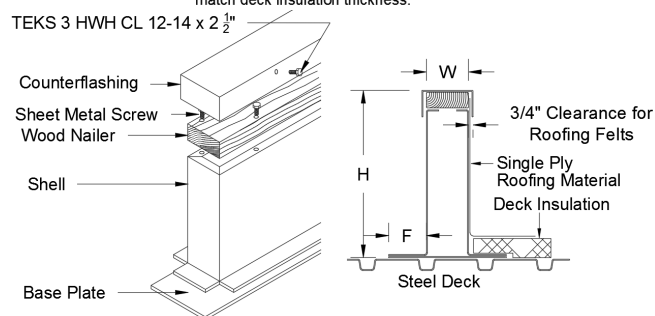

TEMS-3

For all types of roofing decks

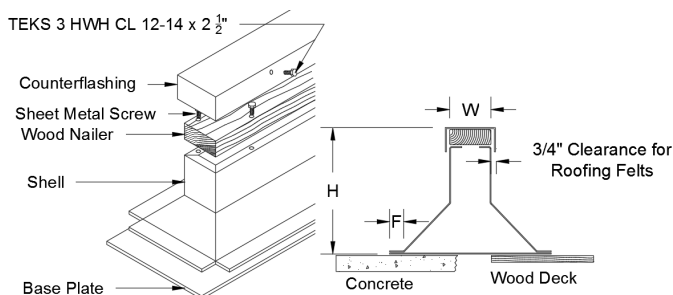

TEMS-2

For Non-insulated roof decks with 3" cant

All welded construction

Added Options

- 1
- 2
- 3
- 4

[illegible]

Thybar Corporation has a policy of continuous product improvement and reserves the right to change the product design without notice



thybar
CORPORATION
*Thybar makes it right the first time,
every time*

Project:

Submittal Date:

Specifications

Prefabricated roof curb to be manufactured of prime galvanized steel construction, 20, 18, 16 or 14 gauge as required, meeting ASTM A653/653M, with welded corners and with seams joined by continuous welds. Roof curb shall be internally reinforced with angles 48" on center, factory insulated with 1 1/2" thick 3# density fiberglass insulation, and factory installed wood nailers. Height to be 8" above roof deck or as detailed. Top of all roof curbs shall be level, with pitch built into curb when deck slopes.

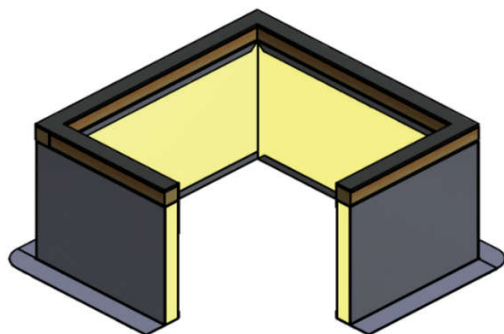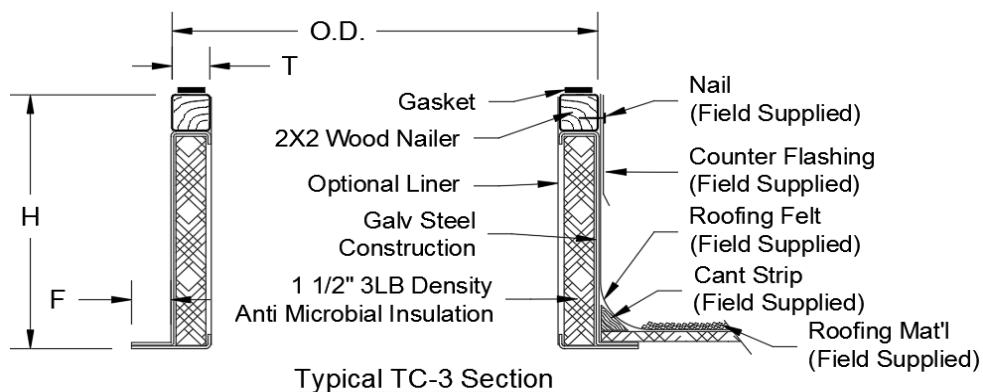

Galvanized steel shell, base plate and counterflashing

Factory installed wood nailer

Internal bulkhead re-inforcement

All welded construction

Added Options

- 1
- 2
- 3
- 4

[illegible]

Thybar Corporation has a policy of continuous product improvement and reserves the right to change the product design without notice