



October 12, 2026

Will Wenzloff
Hillsboro School District
4901 SE Witch Hazel Road
Hillsboro, Oregon 97123

Via email: wenzloffw@hsd.k12.or.us

Regarding: Drinking Water Sampling Report
Oak Street Campus / Hillsboro Online Academy
440 SE Oak Street
Hillsboro, Oregon
Apex Project No. 26010605 / 0008

Dear Mr. Wenzloff:

On September 12 and October 3, 2026, Apex Companies LLC (Apex) collected drinking water samples from the main building and gymnasium at Oak Street Campus / Hillsboro Online Academy, located at 440 SE Oak Street in Hillsboro, Oregon. The testing was requested by Hillsboro School District as part of their efforts to ensure that concentrations of lead in drinking water in the buildings remain below the Oregon Department of Education (ODE) action level of 10 parts per billion (ppb).

Forty-five samples were collected and delivered under chain of custody to Apex Laboratories in Tigard, Oregon, for lead analysis.

Results from the first round of sampling showed that the sample from the faucet in Room 122 (fixture number 002) had a lead concentration of 10.1 ppb, slightly above the ODE action level of 10 ppb. The sample from the faucet in Room 126 (fixture number 001) had a lead concentration slightly under the ODE action level at 9.25 ppb. Both of these fixtures appear to be used infrequently which may have resulted in the relatively high lead concentrations in the samples. Both fixtures were flushed and re-sampled approximately 18 hours later. Lead concentrations from that round of sampling were well below the ODE action level.

The results of the sampling are shown in the following tables. Results above 10.0 ppb are shown in bold.

Round 1 – September 12, 2026

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22390014-001CF26A	Room 126 Classroom Faucet	9.25
002	22390014-002CF26A	Room 122 Classroom Faucet	10.1
003	22390014-003CF26A	Room 120 Classroom Faucet	1.87
004	22390014-004CF26A	Room 116 Classroom Faucet	2.94
005	22390014-005CF26A	Room 114 Classroom Faucet	2.80

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
006	22390014-006CF26A	Room 110 Classroom Faucet	1.50
007	22390014-007SF26A	Main Office Staff Faucet	2.32
008	22390014-008CF26A	Room 108 Classroom Faucet – South Wall (left of door)	1.70
009	22390014-009CF26A	Room 108 Classroom Faucet – North Wall	2.14
010	22390014-010CF26A	Room 107 Classroom Faucet	3.05
011	22390014-011CF26A	Room 115 Classroom Faucet	5.65
012	22390014-012SF26A	Room 123 Staff room kitchen - South Wall, (left of door)	4.76
013	22390014-013SF26A	Room 123 Staff room kitchen - North Wall	3.07
014	22390014-014CF26A	Room 125 Classroom Faucet	0.221
015	22390014-015DW26A	Hall at Room 124 drinking fountain - left	1.11
016	22390014-016DW26A	Hall at Room 124 drinking fountain - right	0.280
017	22390014-017WB26A	Hall at Room 115 water bottle filler	0.502
018	22390014-018DW26A	Hall at Room 115 drinking fountain	0.438
019	22390014-019DW26A	Hall at restrooms across from Room 104, drinking fountain - left	2.75
020	22390014-020DW26A	Hall at restrooms, across from Room 104 drinking fountain - right	1.76
021	22390014-021SF26A	Staff room kitchen, hot water tap at sink	0.299
022	22390014-022BF26A	South hall staff restroom - left	1.01
023	22390014-023BF26A	South hall staff restroom - right	1.16
024	22390014-024BF26A	Girls restroom sink – left	1.03
025	22390014-025BF26A	Girls restroom sink - center	1.37
026	22390014-026BF26A	Girls restroom sink - right	0.909
027	22390014-027WB26A	Gym – Water bottle filler on south wall	0.449
028	22390014-028DW26A	Gym – Drinking fountain on south wall	0.523
029	22390014-029KF26A	Cafeteria, food prep island, east sink (left side sink when kitchen is on your right) - faucet	2.27
030	22390014-030KF26A	Cafeteria, food prep island, west sink (right side sink when kitchen is on your right) - faucet	0.864
031	22390014-031KF26A	Cafeteria, food prep island, west sink (right side sink when kitchen is on your right) - sprayer	0.855
032	22390014-032BF26A	Boys restroom sink – left	3.39
033	22390014-033BF26A	Boys restroom sink - center	4.45
034	22390014-034BF26A	Boys restroom sink - right	2.75
035	22390014-035BF26A	Room 107 staff restroom	1.01
036	22390014-036BF26A	Room 107 children's toilet area, low porcelain sink	1.43
037	22390014-037BF26A	Room 107 children's toilet area, metal counter sink	1.48
038	22390014-038BF26A	Cafeteria, north womens restroom	1.16

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
039	22390014-039BF26A	Cafeteria, north mens restroom	0.434
040	22390014-040BF26A	Gym, south restroom sink	0.278
041	22390014-041KF26A	Kitchen, double sink faucet	1.75
042	22390014-042KF26A	Kitchen, double sink sprayer	1.95
043	22390014-043KF26A	Kitchen, single sink faucet	1.20

Round 2 – October 3, 2026

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22390014-001CF26B	Room 126 Classroom Faucet	2.49
002	22390014-002CF26B	Room 122 Classroom Faucet	2.55

Please refer to the attached fixture location drawings and laboratory analytical reports for additional details. The laboratory analytical results are reported in micrograms per liter ($\mu\text{g/L}$), a unit of measure that is equivalent to ppb.

Sampling methodology and the interpretation of laboratory results were based on the Environmental Protection Agency guidance document titled *3Ts for Reducing Lead in Drinking Water in Schools*. Following this guideline, Apex collected first draw samples from each test location. First draw samples consist of the first 250 milliliters (mL) of water drawn from a fixture after the water has been sitting stagnant for at least 8 hours. The 3Ts' sampling protocol specifying 250-mL samples is designed to maximize the likelihood that the highest concentrations of lead in water used for consumption are identified.

Please feel free to contact me at 503.515.4726 or dale.voeller@apexc.com with any questions or comments.


Sincerely,



Dale Voeller, CSP
Senior Project Manager

Attachment: Fixture Location Drawing
Laboratory Analytical Report

Oak Street Campus / HOA
Fixture Location Drawing
October 2026

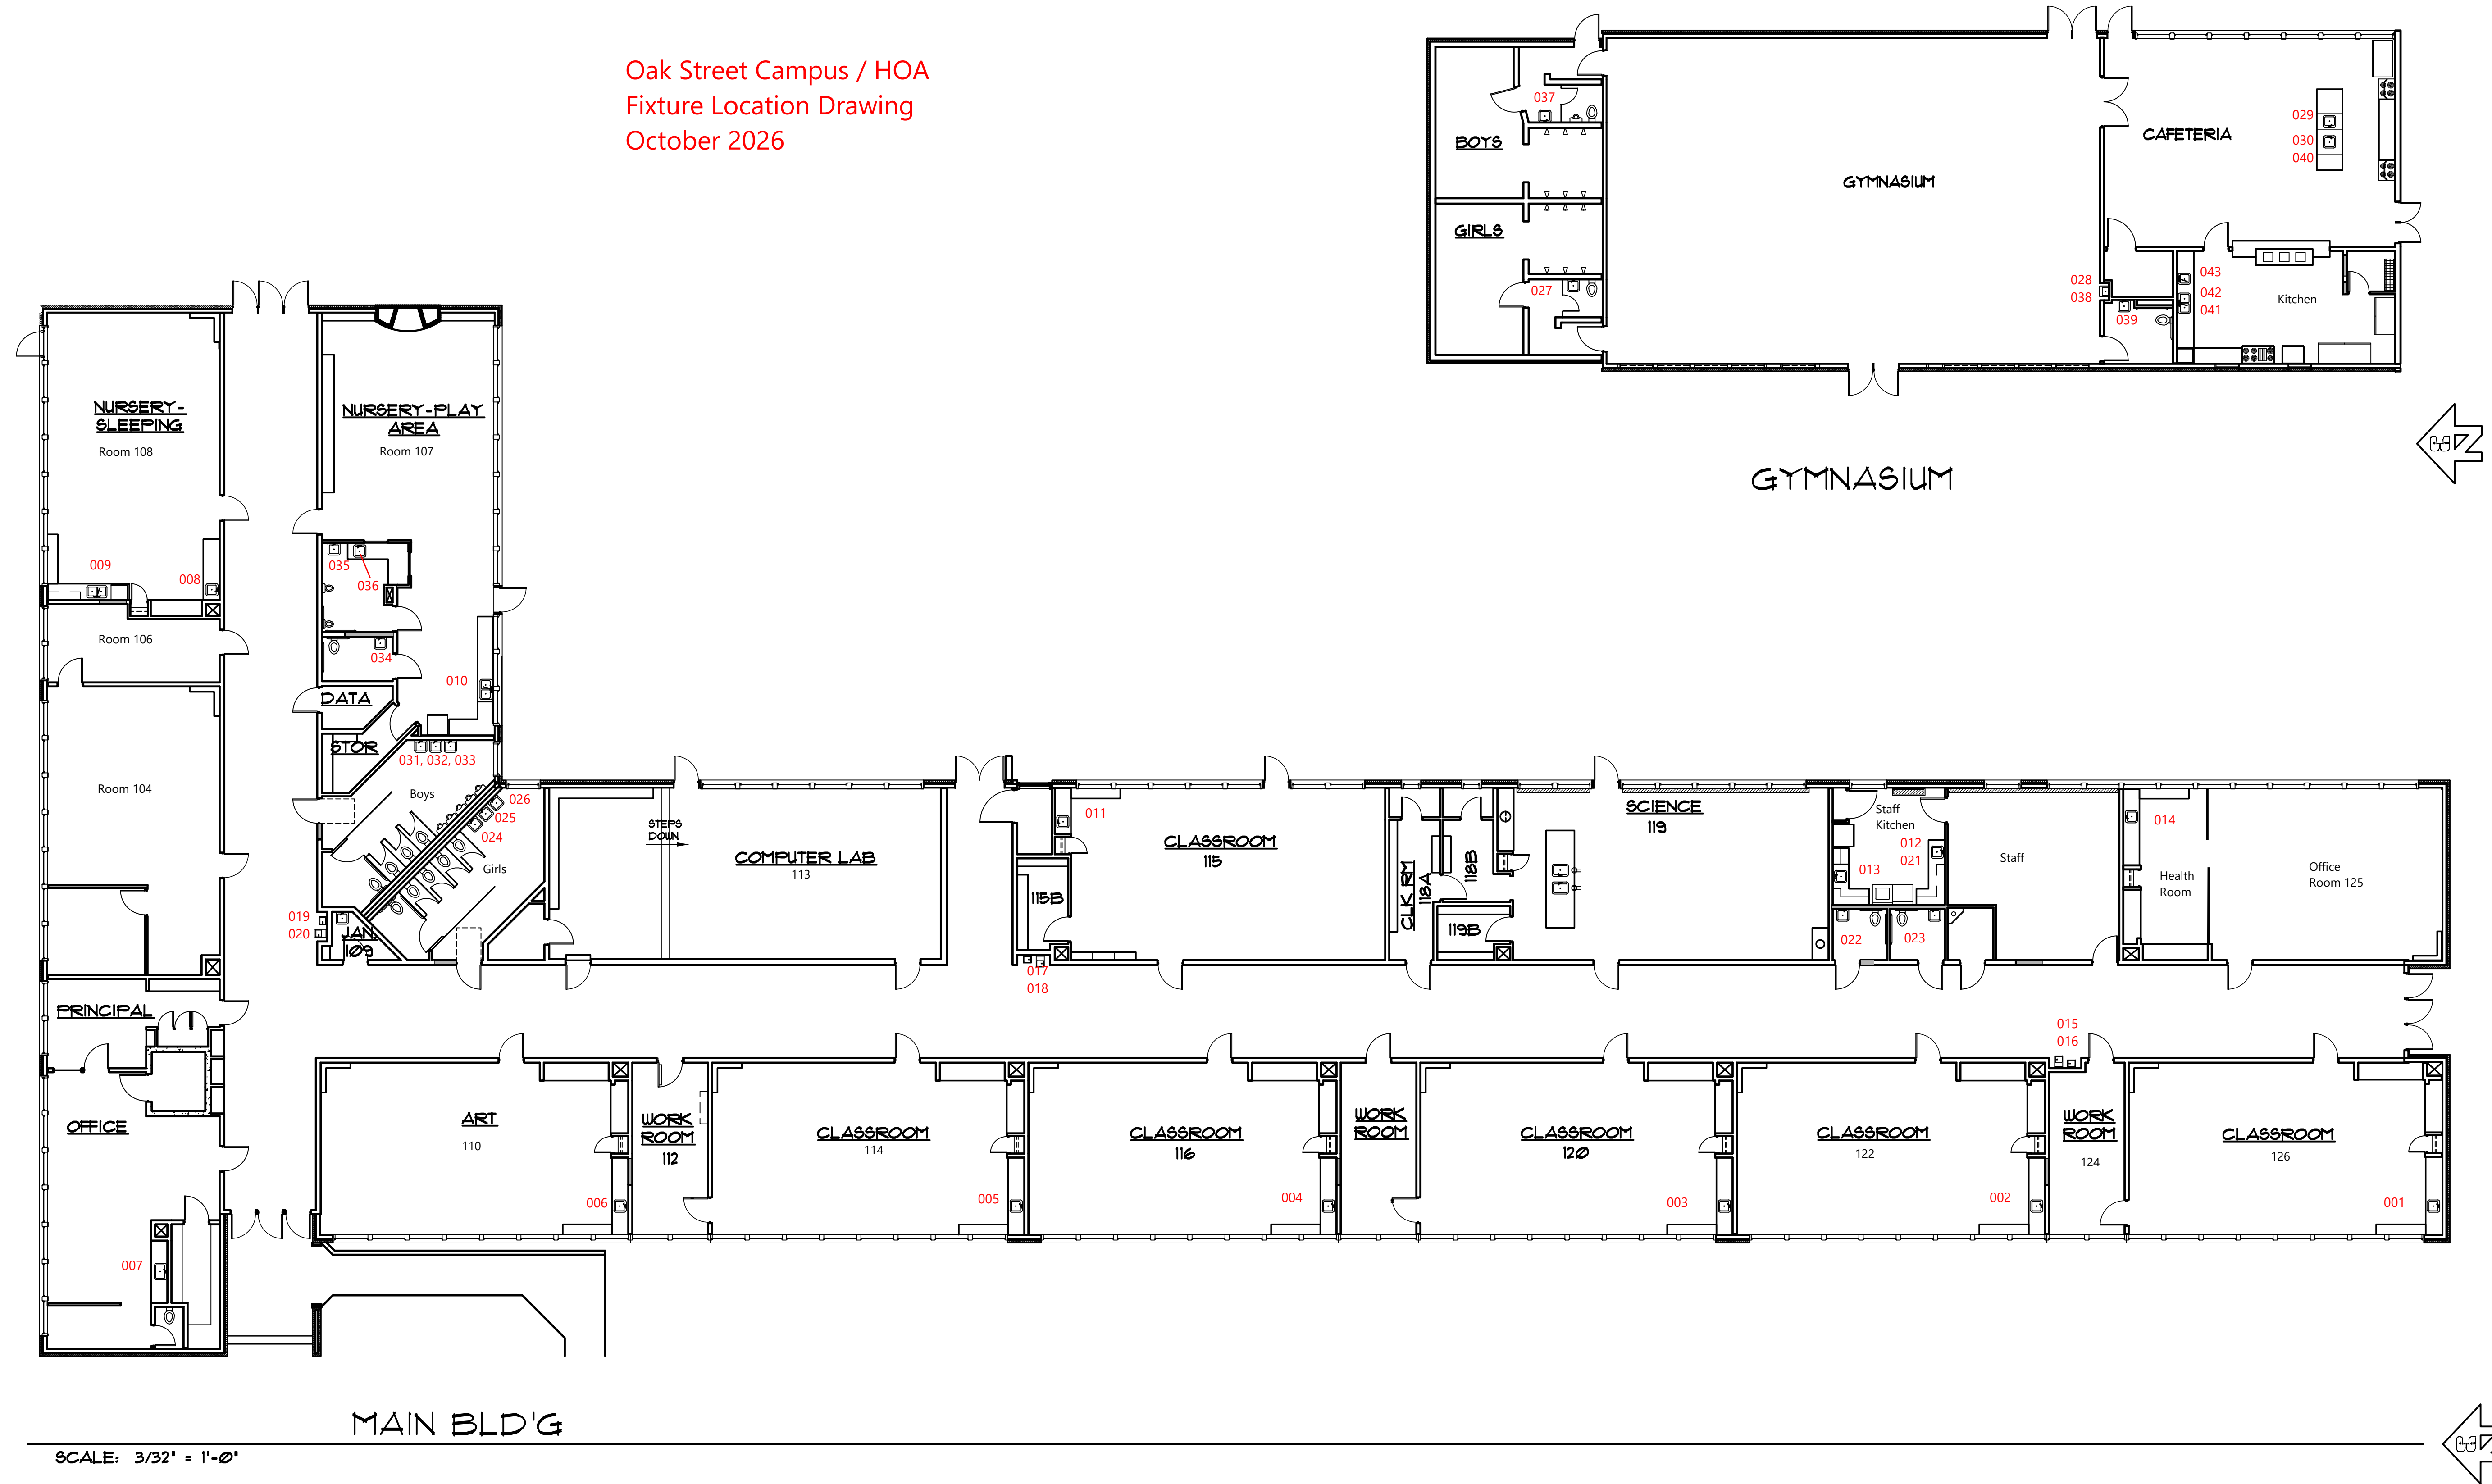



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Monday, September 28, 2026

Dale Voeller

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

RE: A6I1384 - Hillsboro School District - Oak St. Campus HOA / 26010605/0008

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6I1384, which was received by the laboratory on 9/14/2026 at 11:49:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information

Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.

(See Cooler Receipt Form for details)

Default Cooler 21.8 degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Oak St. Campus HOA / 260**Project Manager: **Dale Voeller****Report ID:****A6I1384 - 09 28 26 0952****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390014-001CF26A	A6I1384-01	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-002CF26A	A6I1384-02	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-003CF26A	A6I1384-03	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-004CF26A	A6I1384-04	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-005CF26A	A6I1384-05	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-006CF26A	A6I1384-06	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-007SF26A	A6I1384-07	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-008CF26A	A6I1384-08	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-009CF26A	A6I1384-09	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-010CF26A	A6I1384-10	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-011CF26A	A6I1384-11	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-012SF26A	A6I1384-12	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-013SF26A	A6I1384-13	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-014CF26A	A6I1384-14	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-015DW26A	A6I1384-15	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-016DW26A	A6I1384-16	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-017WB26A	A6I1384-17	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-018DW26A	A6I1384-18	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-019DW26A	A6I1384-19	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-020DW26A	A6I1384-20	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-021SF26A	A6I1384-21	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-022BF26A	A6I1384-22	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-023BF26A	A6I1384-23	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-024BF26A	A6I1384-24	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-025BF26A	A6I1384-25	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-026BF26A	A6I1384-26	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-027WB26A	A6I1384-27	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-028DW26A	A6I1384-28	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-029KF26A	A6I1384-29	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-030KF26A	A6I1384-30	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-031KF26A	A6I1384-31	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-032BF26A	A6I1384-32	Drinking Water	09/12/26 00:00	09/14/26 11:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Oak St. Campus HOA / 260**Project Manager: **Dale Voeller****Report ID:****A6I1384 - 09 28 26 0952****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390014-033BF26A	A6I1384-33	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-034BF26A	A6I1384-34	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-035BF26A	A6I1384-35	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-036BF26A	A6I1384-36	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-037BF26A	A6I1384-37	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-038BF26A	A6I1384-38	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-039BF26A	A6I1384-39	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-040BF26A	A6I1384-40	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-041KF26A	A6I1384-41	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-042KF26A	A6I1384-42	Drinking Water	09/12/26 00:00	09/14/26 11:49
22390014-043KF26A	A6I1384-43	Drinking Water	09/12/26 00:00	09/14/26 11:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Oak St. Campus HOA / 260**Project Manager: **Dale Voeller****Report ID:****A6I1384 - 09 28 26 0952****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390014-001CF26A (A6I1384-01)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	9.25	---	0.200	ug/L	1	09/26/26 15:24	EPA 200.8	
22390014-002CF26A (A6I1384-02)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	10.1	---	0.200	ug/L	1	09/26/26 15:29	EPA 200.8	
22390014-003CF26A (A6I1384-03)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	1.87	---	0.200	ug/L	1	09/26/26 15:31	EPA 200.8	
22390014-004CF26A (A6I1384-04)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	2.94	---	0.200	ug/L	1	09/26/26 15:33	EPA 200.8	
22390014-005CF26A (A6I1384-05)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	2.80	---	0.200	ug/L	1	09/26/26 15:35	EPA 200.8	
22390014-006CF26A (A6I1384-06)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	1.50	---	0.200	ug/L	1	09/26/26 15:37	EPA 200.8	
22390014-007SF26A (A6I1384-07)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	2.32	---	0.200	ug/L	1	09/26/26 15:44	EPA 200.8	
22390014-008CF26A (A6I1384-08)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	1.70	---	0.200	ug/L	1	09/26/26 15:46	EPA 200.8	
22390014-009CF26A (A6I1384-09)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	2.14	---	0.200	ug/L	1	09/26/26 15:48	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Oak St. Campus HOA / 260**Project Manager: **Dale Voeller****Report ID:****A6I1384 - 09 28 26 0952****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390014-010CF26A (A6I1384-10) Matrix: Drinking Water								
Batch: 26I0538								
Lead	3.05	---	0.200	ug/L	1	09/26/26 15:50	EPA 200.8	
22390014-011CF26A (A6I1384-11) Matrix: Drinking Water								
Batch: 26I0538								
Lead	5.65	---	0.200	ug/L	1	09/26/26 15:52	EPA 200.8	
22390014-012SF26A (A6I1384-12) Matrix: Drinking Water								
Batch: 26I0538								
Lead	4.76	---	0.200	ug/L	1	09/26/26 15:54	EPA 200.8	
22390014-013SF26A (A6I1384-13) Matrix: Drinking Water								
Batch: 26I0538								
Lead	3.07	---	0.200	ug/L	1	09/26/26 15:56	EPA 200.8	
22390014-014CF26A (A6I1384-14) Matrix: Drinking Water								
Batch: 26I0538								
Lead	0.221	---	0.200	ug/L	1	09/26/26 15:57	EPA 200.8	
22390014-015DW26A (A6I1384-15) Matrix: Drinking Water								
Batch: 26I0538								
Lead	1.11	---	0.200	ug/L	1	09/26/26 15:59	EPA 200.8	
22390014-016DW26A (A6I1384-16) Matrix: Drinking Water								
Batch: 26I0538								
Lead	0.280	---	0.200	ug/L	1	09/26/26 16:01	EPA 200.8	
22390014-017WB26A (A6I1384-17) Matrix: Drinking Water								
Batch: 26I0538								
Lead	0.502	---	0.200	ug/L	1	09/26/26 16:08	EPA 200.8	
22390014-018DW26A (A6I1384-18) Matrix: Drinking Water								
Batch: 26I0538								
Lead	0.438	---	0.200	ug/L	1	09/26/26 16:10	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**
4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**
Project Number: **Oak St. Campus HOA / 260**
Project Manager: **Dale Voeller****Report ID:**
A6I1384 - 09 28 26 0952**ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390014-019DW26A (A6I1384-19)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	2.75	---	0.200	ug/L	1	09/26/26 16:12	EPA 200.8	
22390014-020DW26A (A6I1384-20)				Matrix: Drinking Water				
Batch: 26I0538								
Lead	1.76	---	0.200	ug/L	1	09/26/26 16:14	EPA 200.8	
22390014-021SF26A (A6I1384-21)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	0.299	---	0.200	ug/L	1	09/26/26 16:22	EPA 200.8	
22390014-022BF26A (A6I1384-22)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	1.01	---	0.200	ug/L	1	09/26/26 16:32	EPA 200.8	
22390014-023BF26A (A6I1384-23)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	1.16	---	0.200	ug/L	1	09/26/26 16:34	EPA 200.8	
22390014-024BF26A (A6I1384-24)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	1.03	---	0.200	ug/L	1	09/26/26 16:36	EPA 200.8	
22390014-025BF26A (A6I1384-25)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	1.37	---	0.200	ug/L	1	09/26/26 16:38	EPA 200.8	
22390014-026BF26A (A6I1384-26)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	0.909	---	0.200	ug/L	1	09/26/26 16:40	EPA 200.8	
22390014-027WB26A (A6I1384-27)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	0.449	---	0.200	ug/L	1	09/26/26 16:42	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260

Project Manager: Dale Voeller

Report ID:

A6I1384 - 09 28 26 0952

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390014-028DW26A (A6I1384-28) Matrix: Drinking Water								
Batch: 26I0541								
Lead	0.523	---	0.200	ug/L	1	09/26/26 16:44	EPA 200.8	
22390014-029KF26A (A6I1384-29) Matrix: Drinking Water								
Batch: 26I0541								
Lead	2.27	---	0.200	ug/L	1	09/26/26 16:46	EPA 200.8	
22390014-030KF26A (A6I1384-30) Matrix: Drinking Water								
Batch: 26I0541								
Lead	0.864	---	0.200	ug/L	1	09/26/26 16:48	EPA 200.8	
22390014-031KF26A (A6I1384-31) Matrix: Drinking Water								
Batch: 26I0541								
Lead	0.855	---	0.200	ug/L	1	09/26/26 16:50	EPA 200.8	
22390014-032BF26A (A6I1384-32) Matrix: Drinking Water								
Batch: 26I0541								
Lead	3.39	---	0.200	ug/L	1	09/26/26 16:56	EPA 200.8	
22390014-033BF26A (A6I1384-33) Matrix: Drinking Water								
Batch: 26I0541								
Lead	4.45	---	0.200	ug/L	1	09/26/26 16:58	EPA 200.8	
22390014-034BF26A (A6I1384-34) Matrix: Drinking Water								
Batch: 26I0541								
Lead	2.75	---	0.200	ug/L	1	09/26/26 17:00	EPA 200.8	
22390014-035BF26A (A6I1384-35) Matrix: Drinking Water								
Batch: 26I0541								
Lead	1.01	---	0.200	ug/L	1	09/26/26 17:02	EPA 200.8	
22390014-036BF26A (A6I1384-36) Matrix: Drinking Water								
Batch: 26I0541								
Lead	1.43	---	0.200	ug/L	1	09/26/26 17:04	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Oak St. Campus HOA / 260**Project Manager: **Dale Voeller****Report ID:****A6I1384 - 09 28 26 0952****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390014-037BF26A (A6I1384-37)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	1.48	---	0.200	ug/L	1	09/26/26 17:06	EPA 200.8	
22390014-038BF26A (A6I1384-38)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	1.16	---	0.200	ug/L	1	09/26/26 17:08	EPA 200.8	
22390014-039BF26A (A6I1384-39)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	0.434	---	0.200	ug/L	1	09/26/26 17:10	EPA 200.8	
22390014-040BF26A (A6I1384-40)				Matrix: Drinking Water				
Batch: 26I0541								
Lead	0.278	---	0.200	ug/L	1	09/26/26 17:12	EPA 200.8	
22390014-041KF26A (A6I1384-41)				Matrix: Drinking Water				
Batch: 26I0646								
Lead	1.75	---	0.200	ug/L	1	09/26/26 17:24	EPA 200.8	
22390014-042KF26A (A6I1384-42)				Matrix: Drinking Water				
Batch: 26I0646								
Lead	1.95	---	0.200	ug/L	1	09/26/26 17:30	EPA 200.8	
22390014-043KF26A (A6I1384-43)				Matrix: Drinking Water				
Batch: 26I0646								
Lead	1.20	---	0.200	ug/L	1	09/26/26 17:32	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260
Project Manager: Dale Voeller

Report ID:

A6I1384 - 09 28 26 0952

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26I0538 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26I0538-BLK1)		Prepared: 09/18/26 08:54		Analyzed: 09/26/26 15:20								
<u>EPA 200.8</u>												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26I0538-BS1)		Prepared: 09/18/26 08:54		Analyzed: 09/26/26 15:22								
<u>EPA 200.8</u>												
Lead	15.1	---	0.201	ug/L	1	15.0	---	101	85 - 115%	---	---	
Duplicate (26I0538-DUP1)		Prepared: 09/18/26 08:54		Analyzed: 09/26/26 15:26								
<u>QC Source Sample: 22390014-001CF26A (A6I1384-01)</u>												
<u>EPA 200.8</u>												
Lead	9.23	---	0.200	ug/L	1	---	9.25	---	---	0.2	20%	
Matrix Spike (26I0538-MS1)		Prepared: 09/18/26 08:54		Analyzed: 09/26/26 15:28								
<u>QC Source Sample: 22390014-001CF26A (A6I1384-01)</u>												
<u>EPA 200.8</u>												
Lead	24.5	---	0.201	ug/L	1	15.0	9.25	102	70 - 130%	---	---	
Matrix Spike (26I0538-MS2)		Prepared: 09/18/26 08:54		Analyzed: 09/26/26 16:16								
<u>QC Source Sample: 22390014-020DW26A (A6I1384-20)</u>												
<u>EPA 200.8</u>												
Lead	16.4	---	0.201	ug/L	1	15.0	1.76	98	70 - 130%	---	---	
Batch 26I0541 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26I0541-BLK1)		Prepared: 09/18/26 10:23		Analyzed: 09/26/26 16:18								
<u>EPA 200.8</u>												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26I0541-BS1)		Prepared: 09/18/26 10:23		Analyzed: 09/26/26 16:20								
<u>EPA 200.8</u>												
Lead	15.3	---	0.201	ug/L	1	15.0	---	102	85 - 115%	---	---	
Duplicate (26I0541-DUP1)		Prepared: 09/18/26 10:23		Analyzed: 09/26/26 16:24								
<u>QC Source Sample: 22390014-021SF26A (A6I1384-21)</u>												

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260
Project Manager: Dale Voeller

Report ID:

A6I1384 - 09 28 26 0952

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26I0541 - EPA 200.8 Direct Analysis							Drinking Water					
Duplicate (26I0541-DUP1)			Prepared: 09/18/26 10:23		Analyzed: 09/26/26 16:24							
<u>QC Source Sample: 22390014-021SF26A (A6I1384-21)</u>												
<u>EPA 200.8</u>												
Lead	0.233	---	0.200	ug/L	1	---	0.299	---	---	25	20%	Q-05
Matrix Spike (26I0541-MS1)			Prepared: 09/18/26 10:23		Analyzed: 09/26/26 16:26							
<u>QC Source Sample: 22390014-021SF26A (A6I1384-21)</u>												
<u>EPA 200.8</u>												
Lead	14.9	---	0.201	ug/L	1	15.0	0.299	98	70 - 130%	---	---	
Matrix Spike (26I0541-MS2)			Prepared: 09/18/26 10:23		Analyzed: 09/26/26 17:14							
<u>QC Source Sample: 22390014-040BF26A (A6I1384-40)</u>												
<u>EPA 200.8</u>												
Lead	15.0	---	0.201	ug/L	1	15.0	0.278	98	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260
Project Manager: Dale Voeller

Report ID:

A6I1384 - 09 28 26 0952

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26I0646 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26I0646-BLK1)		Prepared: 09/22/26 09:59			Analyzed: 09/26/26 17:20							
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26I0646-BS1)		Prepared: 09/22/26 09:59			Analyzed: 09/26/26 17:22							
EPA 200.8												
Lead	15.0	---	0.201	ug/L	1	15.0	---	100	85 - 115%	---	---	
Duplicate (26I0646-DUP1)		Prepared: 09/22/26 09:59			Analyzed: 09/26/26 17:26							
QC Source Sample: 22390014-041KF26A (A6I1384-41)												
EPA 200.8												
Lead	1.70	---	0.200	ug/L	1	---	1.75	---	---	3	20%	
Matrix Spike (26I0646-MS1)		Prepared: 09/22/26 09:59			Analyzed: 09/26/26 17:28							
QC Source Sample: 22390014-041KF26A (A6I1384-41)												
EPA 200.8												
Lead	16.6	---	0.201	ug/L	1	15.0	1.75	99	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Oak St. Campus HOA / 260**Project Manager: **Dale Voeller****Report ID:****A6I1384 - 09 28 26 0952****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26I0538							
A6I1384-01	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-02	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-03	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-04	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-05	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-06	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-07	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-08	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-09	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-10	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-11	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-12	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-13	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-14	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-15	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-16	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-17	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-18	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-19	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
A6I1384-20	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 08:54	10mL/10mL	10mL/10mL	1.00
Batch: 26I0541							
A6I1384-21	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-22	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-23	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-24	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-25	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-26	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-27	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-28	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-29	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-30	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-31	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-32	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-33	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-34	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-35	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Oak St. Campus HOA / 260**Project Manager: **Dale Voeller****Report ID:****A6I1384 - 09 28 26 0952****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
A6I1384-36	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-37	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-38	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-39	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
A6I1384-40	Drinking Water	EPA 200.8	09/12/26 00:00	09/18/26 10:23	10mL/10mL	10mL/10mL	1.00
Batch: 26I0646							
A6I1384-41	Drinking Water	EPA 200.8	09/12/26 00:00	09/22/26 09:59	10mL/10mL	10mL/10mL	1.00
A6I1384-42	Drinking Water	EPA 200.8	09/12/26 00:00	09/22/26 09:59	10mL/10mL	10mL/10mL	1.00
A6I1384-43	Drinking Water	EPA 200.8	09/12/26 00:00	09/22/26 09:59	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260

Project Manager: Dale Voeller

Report ID:

A6I1384 - 09 28 26 0952

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

Apex Laboratories

Q-05 Analyses are not controlled on RPD values from sample and duplicate concentrations that are below 5 times the reporting level.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Oak St. Campus HOA / 260**

Project Manager: **Dale Voeller**

Report ID:

A6I1384 - 09 28 26 0952

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.

Results where dry weight correction has not been applied do not have the "dry" designation appended to the units, and results are reported on an "as received" basis.

Results for Volatiles analyses on soils and sediments that are reported on a "dry weight" basis include the water miscible solvent (WMS) correction referenced in the EPA 8000 Method guidance documents. Solid and Liquid samples reported on an "As Received" basis do not have the WMS correction applied, as dry weight was not performed.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260

Project Manager: Dale Voeller

Report ID:

A611384 - 09 28 26 0952

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Oak St. Campus HOA / 260**

Project Manager: **Dale Voeller**

Report ID:

A6I1384 - 09 28 26 0952

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Oak St. Campus HOA / 260**

Project Manager: **Dale Voeller**

Report ID:

A611384 - 09 28 26 0952

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	Analyte	TNI_ID	Accreditation
--------	----------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260

Project Manager: Dale Voeller

Report ID:

A6I1384 - 09 28 26 0952

Lead in Drinking Water Testing Program

A6I1384

Date Collected: 09/12/2026

PBS Project: 26010605 / 0008

School Name: Oak St. Campus / HOA

Building: Main Building - Round 1

Building Number: 22390014

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	001	22390014-001CF26A	Room 126 Classroom Faucet
2	002	22390014-002CF26A	Room 122 Classroom Faucet
3	003	22390014-003CF26A	Room 120 Classroom Faucet
4	004	22390014-004CF26A	Room 116 Classroom Faucet
5	005	22390014-005CF26A	Room 114 Classroom Faucet
6	006	22390014-006CF26A	Room 110 Classroom Faucet
7	007	22390014-007SF26A	Main Office Staff Faucet
8	008	22390014-008CF26A	Room 108 Classroom Faucet - South Wall (left of door)
9	009	22390014-009CF26A	Room 108 Classroom Faucet - North Wall
10	010	22390014-010CF26A	Room 107 Classroom Faucet
11	011	22390014-011CF26A	Room 115 Classroom Faucet
12	012	22390014-012SF26A	Room 123 Staff room kitchen - South Wall, (left of door)
13	013	22390014-013SF26A	Room 123 Staff room kitchen - North Wall
14	014	22390014-014CF26A	Room 125 Classroom Faucet
15	015	22390014-015DW26A	Hall at Room 124 drinking fountain - left
16	016	22390014-016DW26A	Hall at Room 124 drinking fountain - right
17	017	22390014-017WB26A	Hall at Room 115 water bottle filler
18	018	22390014-018DW26A	Hall at Room 115 drinking fountain
19	019	22390014-019DW26A	Hall at restrooms across from Room 104, drinking fountain - left
20	020	22390014-020DW26A	Hall at restrooms, across from Room 104 drinking fountain - right
21	021	22390014-021SF26A	Staff room kitchen, hot water tap at sink
22	022	22390014-022BF26A	South hall staff restroom - left
23	023	22390014-023BF26A	South hall staff restroom - right
24	024	22390014-024BF26A	Girls restroom sink - left
25	025	22390014-025BF26A	Girls restroom sink - center

1 of 2

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260
Project Manager: Dale Voeller

Report ID:

A611384 - 09 28 26 0952

Lead in Drinking Water Testing Program

A611384

Hillsboro School District

Date Collected: 09/12/2026

School Name: Oak St. Campus / HOA

	Fixture Number	Sample Number	Location / Description
26	026	22390014-026BF26A	Girls restroom sink - right
27	027	22390014-027WB26A	Gym - Water bottle filler on south wall
28	028	22390014-028DW26A	Gym - Drinking fountain on south wall
29	029	22390014-029KF26A	Cafeteria, food prep island, east sink (left side sink when kitchen is on your right) - faucet
30	030	22390014-030KF26A	Cafeteria, food prep island, west sink (right side sink when kitchen is on your right) - faucet
31	031	22390014-031KF26A	Cafeteria, food prep island, west sink (right side sink when kitchen is on your right) - sprayer
32	032	22390014-032BF26A	Boys restroom sink - left
33	033	22390014-033BF26A	Boys restroom sink - center
34	034	22390014-034BF26A	Boys restroom sink - right
35	035	22390014-035BF26A	Room 107 staff restroom
36	036	22390014-036BF26A	Room 107 children's toilet area, low porcelain sink
37	037	22390014-037BF26A	Room 107 children's toilet area, metal counter sink
38	038	22390014-038BF26A	Cafeteria, north womens restroom
39	039	22390014-039BF26A	Cafeteria, north mens restroom
40	040	22390014-040BF26A	Gym, south restroom sink
41	041	22390014-041KF26A	Kitchen, double sink faucet
42	042	22390014-042KF26A	Kitchen, double sink sprayer
43	043	22390014-043KF26A	Kitchen, single sink faucet
44	044		
45	045		
46	046		
47	047		
48	048		
49	049		
50	050		

Relinquished By/Signature

Date/Time: 9/12/26 2:00 PM

Received By/Signature

Date/Time: 9/14/26 1149



2 of 2

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus HOA / 260

Project Manager: Dale Voeller

Report ID:

A6I1384 - 09 28 26 0952

APEX LABS COOLER RECEIPT FORM

Client: Apex Companies Element WO#: A6 I 1384Project/Project #: Lead Drinking Water Testing Program / 26010605/2018Delivery Info: Oak St. Campus / HOA #442 9/15/26Date/time received: 9-14-26 @ 1149 By: SPEDelivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒Cooler Inspection Date/time inspected: 9-14-26 @ 1215 By: SPEChain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>21.8</u>						
Custody seals? (Y/N)	<u>N</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>N</u>						
Ice type: (Gel/Real/Other)	<u>None</u>						
Condition (In/Out):	<u>Out</u>						

Cooler out of temp? (Y/N) Possible reason why: Drinking WatersGreen dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐Sample Inspection: Date/time inspected: 9/14/26 @ 1324 By: KSAll samples intact? Yes ☒ No ☐ Comments: _____Bottle labels/COCs agree? Yes ☒ No ☐ Comments: _____COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: _____Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments: _____

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A25G271

Comments: _____

Labeled by:

MLH

Witness:

MS

Cooler Inspected by:

KS

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Wednesday, October 7, 2026

Dale Voeller

Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

RE: A6J1189 - Hillsboro School District - Oak St. Campus/HOA/26010605/008

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6J1189, which was received by the laboratory on 10/5/2026 at 10:50:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information			
<u>Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.</u>			
(See Cooler Receipt Form for details)			
Default Cooler	22.8	degC	

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus/HOA/2601

Project Manager: Dale Voeller

Report ID:

A6J1189 - 10 07 26 1649

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390014-001CF26B	A6J1189-01	Drinking Water	10/03/26 00:00	10/05/26 10:50
22390014-002CF26B	A6J1189-02	Drinking Water	10/03/26 00:00	10/05/26 10:50

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: **Oak St. Campus/HOA/2601**

Project Manager: **Dale Voeller**

Report ID:

A6J1189 - 10 07 26 1649

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390014-001CF26B (A6J1189-01)				Matrix: Drinking Water				
Batch: 26J0129								
Lead	2.49	---	0.200	ug/L	1	10/06/26 14:43	EPA 200.8	
22390014-002CF26B (A6J1189-02)				Matrix: Drinking Water				
Batch: 26J0129								
Lead	2.55	---	0.200	ug/L	1	10/06/26 14:45	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Oak St. Campus/HOA/2601**

Project Manager: **Dale Voeller**

Report ID:

A6J1189 - 10 07 26 1649

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26J0129 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26J0129-BLK1)		Prepared: 10/05/26 14:19 Analyzed: 10/06/26 13:56										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26J0129-BS1)		Prepared: 10/05/26 14:19 Analyzed: 10/06/26 13:58										
EPA 200.8												
Lead	15.6	---	0.201	ug/L	1	15.0	---	104	85 - 115%	---	---	

No Client related Batch QC samples analyzed for this batch. See notes page for more information.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Oak St. Campus/HOA/2601**

Project Manager: **Dale Voeller**

Report ID:

A6J1189 - 10 07 26 1649

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26J0129							
A6J1189-01	Drinking Water	EPA 200.8	10/03/26 00:00	10/05/26 14:19	10mL/10mL	10mL/10mL	1.00
A6J1189-02	Drinking Water	EPA 200.8	10/03/26 00:00	10/05/26 14:19	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus/HOA/2601

Project Manager: Dale Voeller

Report ID:

A6J1189 - 10 07 26 1649

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Oak St. Campus/HOA/2601**

Project Manager: **Dale Voeller**

Report ID:

A6J1189 - 10 07 26 1649

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.

Results where dry weight correction has not been applied do not have the "dry" designation appended to the units, and results are reported on an "as received" basis.

Results for Volatiles analyses on soils and sediments that are reported on a "dry weight" basis include the water miscible solvent (WMS) correction referenced in the EPA 8000 Method guidance documents. Solid and Liquid samples reported on an "As Received" basis do not have the WMS correction applied, as dry weight was not performed.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Oak St. Campus/HOA/2601**

Project Manager: **Dale Voeller**

Report ID:

A6J1189 - 10 07 26 1649

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Oak St. Campus/HOA/2601**

Project Manager: **Dale Voeller**

Report ID:

A6J1189 - 10 07 26 1649

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus/HOA/2601

Project Manager: Dale Voeller

Report ID:

A6J1189 - 10 07 26 1649

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	Analyte	TNI_ID	Accreditation
--------	----------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus/HOA/2601

Project Manager: Dale Voeller

Report ID:

A6J1189 - 10 07 26 1649

Lead in Drinking Water Testing Program

Date Collected: 10/03/2026

PBS Project: 26010605 / 0008

School Name: Oak St. Campus / HOA

Building: Main Building - Round 2

Building Number: 22390014

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: RUSH 10 day

	Fixture Number	Sample Number	Location / Description
1	001	22390014-001CF26B	Room 126 Classroom Faucet
2	002	22390014-002CF26B	Room 122 Classroom Faucet
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

Relinquished By/Signature: Dale Voeller

Date/Time: 10/3/26 11:18 AM

Received By/Signature: [Signature]

Date/Time: 10/5/26 10:50

1 of 1

Apex Laboratories

[Signature]

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Oak St. Campus/HOA/2601

Project Manager: Dale Voeller

Report ID:

A6J1189 - 10 07 26 1649

APEX LABS COOLER RECEIPT FORM

Client: Apex Co Element WO#: A6 J1189Project/Project #: Oak St. Campus / HOA / 26010605/0008

Delivery Info:

Date/time received: 10/5/26 @ 10:50 By: AJMDelivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒Cooler Inspection Date/time inspected: 10/5/26 @ 12:20 By: AJMChain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>22.8</u>						
Custody seals? (Y/N)	<u>N</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>N</u>						
Ice type: (Gel/Real/Other)	<u>None</u>						
Condition (In/Out):	<u>Out</u>						

Cooler out of temp? (Y/N) Possible reason why: Lead Testing / Metals TestingGreen dots applied to out of temperature samples? Yes ☐ No ☒Out of temperature samples form initiated? Yes ☐ No ☒Sample Inspection: Date/time inspected: 10/5/26 @ 1230 By: AAWAll samples intact? Yes ☒ No ☐ Comments: _____Bottle labels/COCs agree? Yes ☒ No ☐ Comments: _____COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: _____Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments: _____

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A256271

Comments: _____

Labeled by: AAWWitness: AAWCooler Inspected by: AAW

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.