October 26, 2026

Will Wenzloff
Hillsboro School District
4901 SE Witch Hazel Road
Hillsboro, Oregon 97123

Via email: wenzlofw@hsd.k12.or.us

Regarding: Drinking Water Sampling Report
Jacobson Street Transportation & Support Services
7705 NE Jacobson Street
Hillsboro, Oregon
Apex Project No. 26010605 / 0013

Dear Mr. Wenzloff:

On October 10, 2026, Apex Companies LLC (Apex) collected drinking water samples at the Jacobson Street Transportation and Support Services facility in Hillsboro, Oregon. The testing was requested by Hillsboro School District as part of their efforts to ensure that concentrations of lead in drinking water in the building remain below the Oregon Department of Education (ODE) action level of 10 parts per billion (ppb).

Water from all fixtures in the building used for drinking or food preparation have lead concentrations below 10 ppb.

Thirty samples were collected and delivered under chain of custody to Apex Laboratories in Tigard, Oregon, for lead analysis. The results of the sampling is shown in the table below.

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22390013-001SF26A	113 Maintenance Conference Room	1.27
002	22390013-002OT26A	119 Carpenter Shop, Shop Sink	ND
003	22390013-003OT26A	125 Maintenance Shop, Shop Sink	ND
004	22390013-004OT26A	Bay 5, West Wall, Shop Sink	ND
005	22390013-005OT26A	Bay 6, East Wall, Shop Sink	0.339
006	22390013-006WB26A	Bay 6, East Wall, Water Bottle Filler	ND
007	22390013-007DW26A	Bay 6, East Wall, Drinking r Fountain	ND
008	22390013-008OT26A	Bay 1, East Wall, Shop Sink	0.409
009	22390013-009SF26A	127 Break Room Sink	ND
010	22390013-010DW26A	Hall at Restrooms, Drinking Fountain – Left	ND
011	22390013-011WB26A	Hall at Restrooms, Water Bottle Filler	ND
012	22390013-012DW26A	Hall at Restrooms, Drinking Fountain - Right	ND
013	22390013-013SF26A	144 Driver Break Room Sink	ND

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
014	22390013-014DW26A	2nd Floor East Hall, Drinking Fountain - Left	ND
015	22390013-015WB26A	2nd Floor East Hall, Water Bottle Filler	ND
016	22390013-016DW26A	2nd Floor East Hall, Drinking Fountain - Right	ND
017	22390013-017BF26A	Women's Restroom, Left Sink	ND
018	22390013-018BF26A	Women's Restroom, Center Sink	0.364
019	22390013-019BF26A	Women's Restroom, Right Sink	0.352
020	22390013-020BF26A	Unisex Restroom, South	ND
021	22390013-021BF26A	Unisex Restroom, North	ND
022	22390013-022BF26A	Men's Restroom, Left Sink	0.451
023	22390013-023BF26A	Men's Restroom, Center Sink	0.246
024	22390013-024BF26A	Men's Restroom, Right Sink	ND
025	22390013-025BF26A	Unisex Restroom , Room 131	0.221
026	22390013-026BF26A	Unisex Restroom, 2nd Floor	0.374
027	22390013-027IM26A	Break Room Ice Machine	ND
028	22390013-028IM26A	Driver Break Room Ice Machine	ND
029	22390013-029WB26A	Driver Break Room Water Bottle Filler	ND
030	22390013-030OT26A	Driver Break Room Hot Water Spout	0.419

ND = no lead detected

Please refer to the attached fixture location drawings and laboratory analytical report for additional details.

The laboratory analytical results are reported in micrograms per liter (µg/L), a unit of measure that is equivalent to ppb.

Sampling methodology and the interpretation of laboratory results were based on the Environmental Protection Agency guidance document titled *3Ts for Reducing Lead in Drinking Water in Schools*. Following this guideline, Apex collected first draw samples from each test location. First draw samples consist of the first 250 milliliters (mL) of water drawn from a fixture after the water has been sitting stagnant for at least 8 hours. The 3Ts' sampling protocol specifying 250-mL samples is designed to maximize the likelihood that the highest concentrations of lead in water used for consumption are identified.

Please feel free to contact me at 503.515.4726 or dale.voeller@apexcos.com with any questions or comments.

Sincerely,

Dale Voeller, CSP
Senior Project Manager


Attachment: Fixture Location Drawings
Laboratory Analytical Reports

Jacobson Street T&SS
Fixture Location Drawing
October 2026



1 FIRST FLOOR PLAN
A1.1 1/8" = 1'-0"

Jacobson Street T&SS
Fixture Location Drawing
October 2026
2 of 2

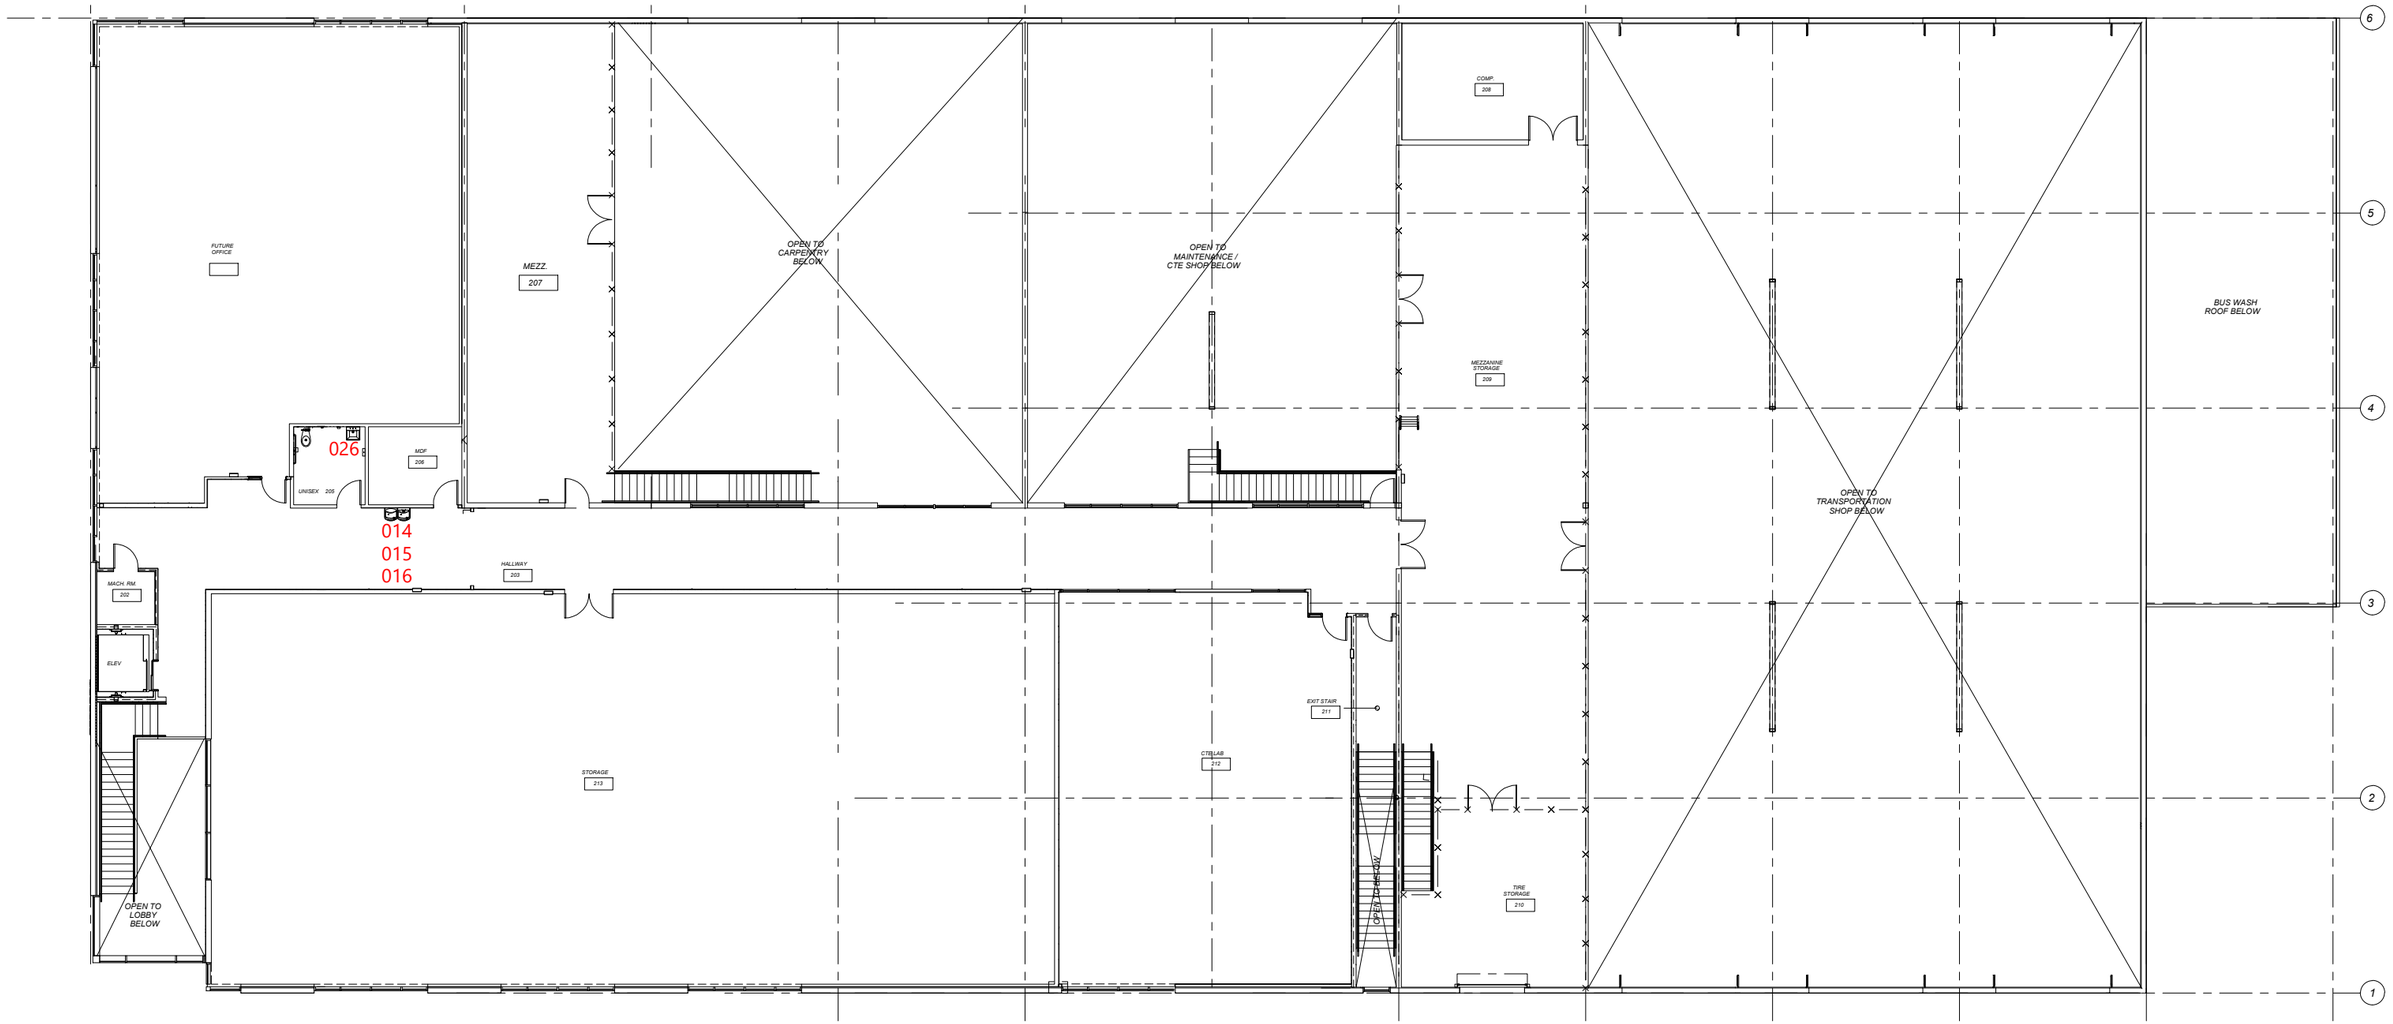

NOTE: ALL DRAWINGS DIMENSIONS TO FACE OF STUD U.O.N. - SEE G2.0 FOR WALL TYPES

1 A1.2 **SECOND FLOOR PLAN**
1/8" = 1'-0"

5/21/2020 12:03:33 PM

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT

Monday, October 26, 2026

Dale Voeller
Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

RE: A6J1463 - Hillsboro School District - Transportation & Support Services/26010605

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6J1463, which was received by the laboratory on 10/12/2026 at 10:37:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information
Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.
(See Cooler Receipt Form for details)
Default Cooler 15.1 degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.
All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

ANALYTICAL REPORT


Apex Companies, LLC - Portland	Project: Hillsboro School District	
4412 S Corbett Ave	Project Number: Transportation & Support S	Report ID:
Portland, OR 97239	Project Manager: Dale Voeller	A6J1463 - 10 26 26 1119

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390013-001SF26A	A6J1463-01	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-002OT26A	A6J1463-02	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-003OT26A	A6J1463-03	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-004OT26A	A6J1463-04	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-005OT26A	A6J1463-05	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-006WB26A	A6J1463-06	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-007DW26A	A6J1463-07	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-008OT26A	A6J1463-08	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-009SF26A	A6J1463-09	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-010DW26A	A6J1463-10	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-011WB26A	A6J1463-11	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-012DW26A	A6J1463-12	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-013SF26A	A6J1463-13	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-014DW26A	A6J1463-14	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-015WB26A	A6J1463-15	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-016DW26A	A6J1463-16	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-017BF26A	A6J1463-17	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-018BF26A	A6J1463-18	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-019BF26A	A6J1463-19	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-020BF26A	A6J1463-20	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-021BF26A	A6J1463-21	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-022BF26A	A6J1463-22	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-023BF26A	A6J1463-23	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-024BF26A	A6J1463-24	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-025BF26A	A6J1463-25	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-026BF26A	A6J1463-26	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-027IM26A	A6J1463-27	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-028IM26A	A6J1463-28	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-029WB26A	A6J1463-29	Drinking Water	10/10/26 00:00	10/12/26 10:37
22390013-030OT26A	A6J1463-30	Drinking Water	10/10/26 00:00	10/12/26 10:37

Apex Laboratories

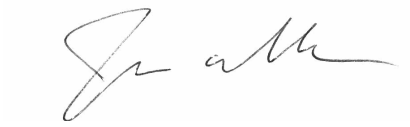

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

APEX LABORATORIES

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT


Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390013-001SF26A (A6J1463-01)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	**1.27**	---	0.200	ug/L	1	10/23/26 14:57	EPA 200.8	
22390013-002OT26A (A6J1463-02)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:04	EPA 200.8	
22390013-003OT26A (A6J1463-03)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:07	EPA 200.8	
22390013-004OT26A (A6J1463-04)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:10	EPA 200.8	
22390013-005OT26A (A6J1463-05)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	**0.339**	---	0.200	ug/L	1	10/23/26 15:12	EPA 200.8	
22390013-006WB26A (A6J1463-06)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:15	EPA 200.8	
22390013-007DW26A (A6J1463-07)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:23	EPA 200.8	
22390013-008OT26A (A6J1463-08)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	**0.409**	---	0.200	ug/L	1	10/23/26 15:25	EPA 200.8	
22390013-009SF26A (A6J1463-09)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:28	EPA 200.8	

Apex Laboratories

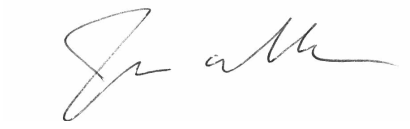

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

ANALYTICAL REPORT


Apex Companies, LLC - Portland	Project: Hillsboro School District	
4412 S Corbett Ave	Project Number: Transportation & Support S	Report ID:
Portland, OR 97239	Project Manager: Dale Voeller	A6J1463 - 10 26 26 1119

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390013-010DW26A (A6J1463-10)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:31	EPA 200.8	
22390013-011WB26A (A6J1463-11)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:33	EPA 200.8	
22390013-012DW26A (A6J1463-12)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:36	EPA 200.8	
22390013-013SF26A (A6J1463-13)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:38	EPA 200.8	
22390013-014DW26A (A6J1463-14)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:41	EPA 200.8	
22390013-015WB26A (A6J1463-15)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:44	EPA 200.8	
22390013-016DW26A (A6J1463-16)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:46	EPA 200.8	
22390013-017BF26A (A6J1463-17)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 15:54	EPA 200.8	
22390013-018BF26A (A6J1463-18)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	**0.364**	---	0.200	ug/L	1	10/23/26 15:57	EPA 200.8	

Apex Laboratories

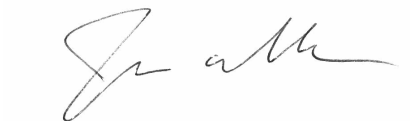

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

ANALYTICAL REPORT


Apex Companies, LLC - Portland	Project: Hillsboro School District	
4412 S Corbett Ave	Project Number: Transportation & Support S	Report ID:
Portland, OR 97239	Project Manager: Dale Voeller	A6J1463 - 10 26 26 1119

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390013-019BF26A (A6J1463-19)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	**0.352**	---	0.200	ug/L	1	10/23/26 15:59	EPA 200.8	
22390013-020BF26A (A6J1463-20)				**Matrix: Drinking Water**				
Batch: 26J0546								
Lead	ND	---	0.200	ug/L	1	10/23/26 16:02	EPA 200.8	
22390013-021BF26A (A6J1463-21)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	ND	---	0.200	ug/L	1	10/20/26 21:55	EPA 200.8	
22390013-022BF26A (A6J1463-22)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	**0.451**	---	0.200	ug/L	1	10/20/26 22:03	EPA 200.8	
22390013-023BF26A (A6J1463-23)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	**0.246**	---	0.200	ug/L	1	10/20/26 22:05	EPA 200.8	
22390013-024BF26A (A6J1463-24)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	ND	---	0.200	ug/L	1	10/20/26 22:08	EPA 200.8	
22390013-025BF26A (A6J1463-25)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	**0.221**	---	0.200	ug/L	1	10/20/26 22:10	EPA 200.8	
22390013-026BF26A (A6J1463-26)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	**0.374**	---	0.200	ug/L	1	10/20/26 22:13	EPA 200.8	
22390013-027IM26A (A6J1463-27)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	ND	---	0.200	ug/L	1	10/20/26 22:21	EPA 200.8	

Apex Laboratories

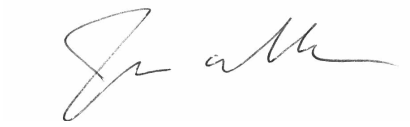

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT


Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390013-028IM26A (A6J1463-28)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	ND	---	0.200	ug/L	1	10/20/26 22:23	EPA 200.8	
22390013-029WB26A (A6J1463-29)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	ND	---	0.200	ug/L	1	10/20/26 22:26	EPA 200.8	
22390013-030OT26A (A6J1463-30)				**Matrix: Drinking Water**				
Batch: 26J0547								
Lead	**0.419**	---	0.200	ug/L	1	10/20/26 22:29	EPA 200.8	

Apex Laboratories

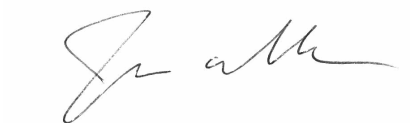

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**


Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26J0546 - EPA 200.8 Direct Analysis											**Drinking Water**	
Blank (26J0546-BLK1)		Prepared: 10/16/26 07:28		Analyzed: 10/23/26 14:51								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26J0546-BS1)		Prepared: 10/16/26 07:28		Analyzed: 10/23/26 14:54								
EPA 200.8												
Lead	15.8	---	0.201	ug/L	1	15.0	---	105	85 - 115%	---	---	
Duplicate (26J0546-DUP1)		Prepared: 10/16/26 07:28		Analyzed: 10/23/26 14:59								
QC Source Sample: 22390013-001SF26A (A6J1463-01)												
EPA 200.8												
Lead	**1.26**	---	0.200	ug/L	1	---	1.27	---	---	0.7	20%	
Matrix Spike (26J0546-MS1)		Prepared: 10/16/26 07:28		Analyzed: 10/23/26 15:02								
QC Source Sample: 22390013-001SF26A (A6J1463-01)												
EPA 200.8												
Lead	16.8	---	0.201	ug/L	1	15.0	1.27	103	70 - 130%	---	---	
Matrix Spike (26J0546-MS2)		Prepared: 10/16/26 07:28		Analyzed: 10/23/26 16:04								
QC Source Sample: 22390013-020BF26A (A6J1463-20)												
EPA 200.8												
Lead	15.9	---	0.201	ug/L	1	15.0	0.183	105	70 - 130%	---	---	
Batch 26J0547 - EPA 200.8 Direct Analysis											**Drinking Water**	
Blank (26J0547-BLK1)		Prepared: 10/16/26 08:04		Analyzed: 10/20/26 21:50								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26J0547-BS1)		Prepared: 10/16/26 08:04		Analyzed: 10/20/26 21:52								
EPA 200.8												
Lead	15.6	---	0.201	ug/L	1	15.0	---	104	85 - 115%	---	---	
Duplicate (26J0547-DUP1)		Prepared: 10/16/26 08:04		Analyzed: 10/20/26 21:57								
QC Source Sample: 22390013-021BF26A (A6J1463-21)												

Apex Laboratories

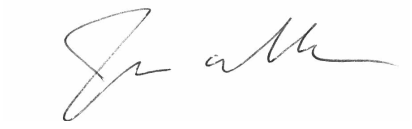

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

ANALYTICAL REPORT

Apex Companies, LLC - Portland	Project:	Hillsboro School District
4412 S Corbett Ave	Project Number:	Transportation & Support S
Portland, OR 97239	Project Manager:	Dale Voeller


Report ID:
A6J1463 - 10 26 26 1119

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26J0547 - EPA 200.8 Direct Analysis											Drinking Water	
Duplicate (26J0547-DUP1)		Prepared: 10/16/26 08:04		Analyzed: 10/20/26 21:57								
QC Source Sample: 22390013-021BF26A (A6J1463-21)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	0.155	---	---	***	20%	
Matrix Spike (26J0547-MS1)		Prepared: 10/16/26 08:04		Analyzed: 10/20/26 22:00								
QC Source Sample: 22390013-021BF26A (A6J1463-21)												
EPA 200.8												
Lead	15.6	---	0.201	ug/L	1	15.0	0.155	103	70 - 130%	---	---	

Apex Laboratories

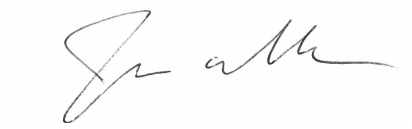

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT

Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26J0546							
A6J1463-01	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-02	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-03	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-04	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-05	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-06	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-07	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-08	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-09	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-10	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-11	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-12	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-13	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-14	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-15	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-16	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-17	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-18	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-19	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
A6J1463-20	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 07:28	10mL/10mL	10mL/10mL	1.00
Batch: 26J0547							
A6J1463-21	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-22	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-23	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-24	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-25	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-26	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-27	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-28	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-29	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00
A6J1463-30	Drinking Water	EPA 200.8	10/10/26 00:00	10/16/26 08:04	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT


Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

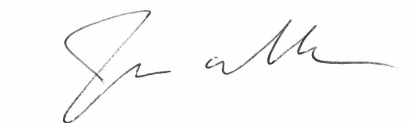

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT

Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.

ND Analyte NOT DETECTED at or above the detection or reporting limit.

NR Result Not Reported.

RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ). If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.

Results where dry weight correction has not been applied do not have the "dry" designation appended to the units, and results are reported on an "as received" basis.

Results for Volatiles analyses on soils and sediments that are reported on a “dry weight” basis include the water miscible solvent (WMS) correction referenced in the EPA 8000 Method guidance documents. Solid and Liquid samples reported on an “As Received” basis do not have the WMS correction applied, as dry weight was not performed.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.


Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

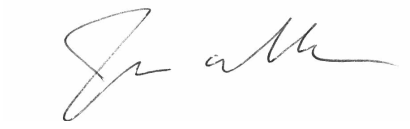

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).
Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.
-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.
-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.
For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.
'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentraton of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

Apex Companies, LLC - Portland	Project:	**Hillsboro School District**	
4412 S Corbett Ave	Project Number:	**Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager:	**Dale Voeller**	**A6J1463 - 10 26 26 1119**

Decanted Samples:

Soils/Sediments:
Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:
Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)
Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight corretion as for normal analyses. In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT

Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)
EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	Analyte	TNI_ID	Accreditation
All reported analytes are included in Apex Laboratories' current ORELAP scope.				

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.


Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.
Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provded by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

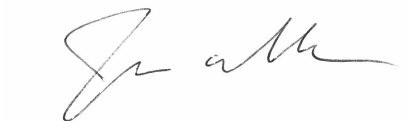

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

A6J1463

APEX.

Lead in Drinking Water COC

Date Collected: 10/10/2026

PBS Project: 26010605 / 0013

School Name: Transportation & Support Services

Building: Main Building - Round 1

Building Number: 22390013

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	001	22390013-001SF26A	113 Maintenance Conference Room
2	002	22390013-002OT26A	119 Carpenter Shop, Shop Sink
3	003	22390013-003OT26A	125 Maintenance Shop, Shop Sink
4	004	22390013-004OT26A	Bay 5, West Wall, Shop Sink
5	005	22390013-005OT26A	Bay 6, East Wall, Shop Sink
6	006	22390013-006WB26A	Bay 6, East Wall, Water Bottle Filler
7	007	22390013-007DW26A	Bay 6, East Wall, Drinking r Fountain
8	008	22390013-008OT26A	Bay 1, East Wall, Shop Sink
9	009	22390013-009SF26A	127 Break Room Sink
10	010	22390013-010DW26A	Hall at Restrooms, Drinking Fountain – Left
11	011	22390013-011WB26A	Hall at Restrooms, Water Bottle Filler
12	012	22390013-012DW26A	Hall at Restrooms, Drinking Fountain - Right
13	013	22390013-013SF26A	144 Driver Break Room Sink
14	014	22390013-014DW26A	2nd Floor East Hall, Drinking Fountain - Left
15	015	22390013-015WB26A	2nd Floor East Hall, Water Bottle Filler
16	016	22390013-016DW26A	2nd Floor East Hall, Drinking Fountain - Right
17	017	22390013-017BF26A	Women's Restroom, Left Sink
18	018	22390013-018BF26A	Women's Restroom, Center Sink
19	019	22390013-019BF26A	Women's Restroom, Right Sink
20	020	22390013-020BF26A	Unisex Restroom, South
21	021	22390013-021BF26A	Unisex Restroom, North
22	022	22390013-022BF26A	Men's Restroom, Left Sink

APEX.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT

Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

Lead in Drinking Water Testing Program — A6J1463 Hillsboro School District

Date Collected: 10/10/2026 — School Name: Jacobson Street T & SS

	Fixture Number	Sample Number	Location / Description
23	023	22390013-023BF26A	Men's Restroom, Center Sink
24	024	22390013-024BF26A	Men's Restroom, Right Sink
25	025	22390013-025BF26A	Unisex Restroom , Room 131
26	026	22390013-026BF26A	Unisex Restroom, 2nd Floor
27	027	22390013-027IM26A	127 Break Room, Ice Machine
28	028	22390013-028IM26A	144 Driver Break Room, Ice Machine
29	029	22390013-029WB26A	144 Driver Break Room, Water Bottle Filler
30	030	22390013-030OT26A	144 Driver Break Room, Hot Water Spout
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			

Relinquished By/Signature: Kelsey Day — Date/Time: 10/12/26, 07:41

Received By/Signature: — Date/Time: 10/12/26 10:37

APEX.

2 of 2

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

Apex Laboratories, LLC
6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: **OR100062**

ANALYTICAL REPORT

Apex Companies, LLC - Portland	Project: **Hillsboro School District**	
4412 S Corbett Ave	Project Number: **Transportation & Support S**	**Report ID:**
Portland, OR 97239	Project Manager: **Dale Voeller**	**A6J1463 - 10 26 26 1119**

APEX LABS COOLER RECEIPT FORM

Client: Apex Co Element WO#: A6J1463

Project/Project #: Transportation & Support Services / 26010605/0013

Delivery Info:

Date/time received: 10/12/26@ 10:37 By: AJM

Delivered by: Apex ✓ Client ESS FedEx UPS Radio Morgan SDS Evergreen Other

From USDA Regulated Origin? Yes ____ No ✓

Cooler Inspection Date/time inspected: 10/12/26@ 11:36 By: AJM

Chain of Custody included? Yes ✓ No ____

Signed/dated by client? Yes ✓ No ____

Contains USDA Reg. Soils? Yes ____ No ✓ Unsure (email RegSoils) ____

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	15.1						
Custody seals? (Y/N)	N						
Received on ice? (Y/N)	N						
Temp. blanks? (Y/N)	N						
Ice type: (Gel/Real/Other)	None						
Condition (In/Out)	Out						

Cooler out of temp? (Y/N) Possible reason why: Metals Testing

Green dots applied to out of temperature samples? Yes/No

Out of temperature samples form initiated? Yes/No

Sample Inspection: Date/time inspected: 10/13/26 @ 1552 By: AMW

All samples intact? Yes X No ___ Comments: ____

Bottle labels/COCs agree? Yes X No ___ Comments: ____

COC/container discrepancies form initiated? Yes ___ No X

Containers/volumes received appropriate for analysis? Yes X No ___ Comments: ____

Do VOA vials have visible headspace? Yes ___ No ___ NA X

Comments ____

Water samples: pH checked: Yes X No ___ NA ___ pH appropriate? Yes X No ___ NA ___ pH ID: MSG71

Comments: ____

Labeled by: AMW Witness: JAM Cooler Inspected by: AMW

Form Y-003 R-02

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager